

**TOWN OF WALPOLE
SECONDARY METER INSTALLATION
SPECIFICATIONS**

Secondary Water meters for outside water usage shall be installed by a licensed plumber only after the appropriate permits and applications have been processed.


This meter shall be installed horizontally before the main water meter and shall be protected by an isolation valve and appropriate backflow prevention device.

DEDUCT METERS INSTALLED AFTER THE PRIMARY METERS WILL NOT BE ALLOWED.

Upon completion of the above work, a remote register will be installed and an inspection will be performed by a Water Department employee.

Appointments for water shut offs and inspections can be made by contacting the Sewer and Water Department office at 660-7306.

Typical Detail
of
Secondary Meter Installation

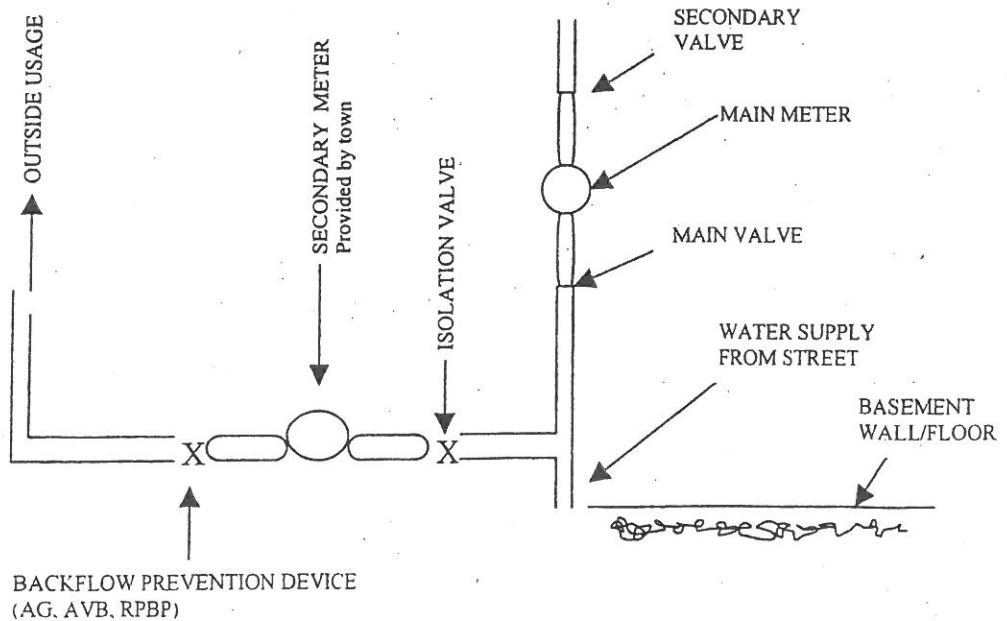

NOTE: IN THE EVENT A RBPB IS REQUIRED A DESIGN DATA SHEET SHALL BE SUBMITTED TO THE WATER DEPT. FOR APPROVAL