

## **STORMWATER MANAGEMENT REPORT**

**PROJECT SITE:  
NEPONSET VILLAGE  
5 PLEASANT STREET  
WALPOLE, MASSACHUSETTS 02081**

**PREPARED FOR:  
McSHARRY BROTHERS, INC.  
P.O. Box 206  
ABINGTON, MASSACHUSETTS 02351**

**PREPARED BY:**



*4 First Street • Bridgewater, Massachusetts 02324*

Phone: (508) 697-3191 • Fax: (508) 697-5996  
E-mail: [ddmitruk@coneco.com](mailto:ddmitruk@coneco.com)

**SEPTEMBER 14, 2023**

# TABLE OF CONTENTS

MASSACHUSETTS DEP CHECKLIST FOR STORMWATER REPORT

INTRODUCTION

STORMWATER MANAGEMENT SYSTEM OVERVIEW

METHODOLOGY

EXISTING CONDITIONS

Table 1 Existing Soil Classifications

PROPOSED CONDITIONS

STORMWATER MANAGEMENT STANDARDS REVIEW

Table 2 Total Suspended Solids Removal

CONCLUSION/SUMMARY

LIST OF FIGURES

Figure 1 Aerial Map

Figure 2 USGS Topographic Map

Figure 3 Flood Insurance Rate Map

Figure 4 Natural Heritage Map

Figure 5 Critical Areas

Figure 6 Soil Survey Map

Figure 7 Existing Drainage Areas/ Drainage Areas & Flowpaths Plan

Figure 8 Proposed Drainage Areas/ Drainage Areas & Flowpaths Plan

APPENDIX A – EXISTING HYDROLOGICAL CONDITIONS

HydroCAD Analysis Printouts for 2-yr, 10-yr, 25-yr & 100-yr Storm Events

APPENDIX B – PROPOSED HYDROLOGICAL CONDITIONS

HydroCAD Analysis Printouts for 2-yr, 10-yr, 25-yr & 100-yr Storm Events

APPENDIX C – DRAINAGE SYSTEM CALCULATIONS

APPENDIX D – LONG TERM POLLUTION PREVENTION PLAN

APPENDIX E - OPERATION AND MAINTENANCE PLAN, CHECKLIST AND LOG

APPENDIX F – ILLICIT DISCHARGE COMPLIANCE STATEMENT


APPENDIX G – SOIL LOGS



# Checklist for Stormwater Report

## A. Introduction

**Important:** When filling out forms on the computer, use only the tab key to move your cursor - do not use the return key.



A Stormwater Report must be submitted with the Notice of Intent permit application to document compliance with the Stormwater Management Standards. The following checklist is NOT a substitute for the Stormwater Report (which should provide more substantive and detailed information) but is offered here as a tool to help the applicant organize their Stormwater Management documentation for their Report and for the reviewer to assess this information in a consistent format. As noted in the Checklist, the Stormwater Report must contain the engineering computations and supporting information set forth in Volume 3 of the [Massachusetts Stormwater Handbook](#). The Stormwater Report must be prepared and certified by a Registered Professional Engineer (RPE) licensed in the Commonwealth.

The Stormwater Report must include:

- The Stormwater Checklist completed and stamped by a Registered Professional Engineer (see page 2) that certifies that the Stormwater Report contains all required submittals.<sup>1</sup> This Checklist is to be used as the cover for the completed Stormwater Report.
- Applicant/Project Name
- Project Address
- Name of Firm and Registered Professional Engineer that prepared the Report
- Long-Term Pollution Prevention Plan required by Standards 4-6
- Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan required by Standard 8<sup>2</sup>
- Operation and Maintenance Plan required by Standard 9

In addition to all plans and supporting information, the Stormwater Report must include a brief narrative describing stormwater management practices, including environmentally sensitive site design and LID techniques, along with a diagram depicting runoff through the proposed BMP treatment train. Plans are required to show existing and proposed conditions, identify all wetland resource areas, NRCS soil types, critical areas, Land Uses with Higher Potential Pollutant Loads (LUHPPL), and any areas on the site where infiltration rate is greater than 2.4 inches per hour. The Plans shall identify the drainage areas for both existing and proposed conditions at a scale that enables verification of supporting calculations.

As noted in the Checklist, the Stormwater Management Report shall document compliance with each of the Stormwater Management Standards as provided in the Massachusetts Stormwater Handbook. The soils evaluation and calculations shall be done using the methodologies set forth in Volume 3 of the Massachusetts Stormwater Handbook.

To ensure that the Stormwater Report is complete, applicants are required to fill in the Stormwater Report Checklist by checking the box to indicate that the specified information has been included in the Stormwater Report. If any of the information specified in the checklist has not been submitted, the applicant must provide an explanation. The completed Stormwater Report Checklist and Certification must be submitted with the Stormwater Report.

<sup>1</sup> The Stormwater Report may also include the Illicit Discharge Compliance Statement required by Standard 10. If not included in the Stormwater Report, the Illicit Discharge Compliance Statement must be submitted prior to the discharge of stormwater runoff to the post-construction best management practices.

<sup>2</sup> For some complex projects, it may not be possible to include the Construction Period Erosion and Sedimentation Control Plan in the Stormwater Report. In that event, the issuing authority has the discretion to issue an Order of Conditions that approves the project and includes a condition requiring the proponent to submit the Construction Period Erosion and Sedimentation Control Plan before commencing any land disturbance activity on the site.



# Checklist for Stormwater Report

---

## B. Stormwater Checklist and Certification

The following checklist is intended to serve as a guide for applicants as to the elements that ordinarily need to be addressed in a complete Stormwater Report. The checklist is also intended to provide conservation commissions and other reviewing authorities with a summary of the components necessary for a comprehensive Stormwater Report that addresses the ten Stormwater Standards.

*Note:* Because stormwater requirements vary from project to project, it is possible that a complete Stormwater Report may not include information on some of the subjects specified in the Checklist. If it is determined that a specific item does not apply to the project under review, please note that the item is not applicable (N.A.) and provide the reasons for that determination.


A complete checklist must include the Certification set forth below signed by the Registered Professional Engineer who prepared the Stormwater Report.

---

### Registered Professional Engineer's Certification

I have reviewed the Stormwater Report, including the soil evaluation, computations, Long-term Pollution Prevention Plan, the Construction Period Erosion and Sedimentation Control Plan (if included), the Long-term Post-Construction Operation and Maintenance Plan, the Illicit Discharge Compliance Statement (if included) and the plans showing the stormwater management system, and have determined that they have been prepared in accordance with the requirements of the Stormwater Management Standards as further elaborated by the Massachusetts Stormwater Handbook. I have also determined that the information presented in the Stormwater Checklist is accurate and that the information presented in the Stormwater Report accurately reflects conditions at the site as of the date of this permit application.

Registered Professional Engineer Block and Signature

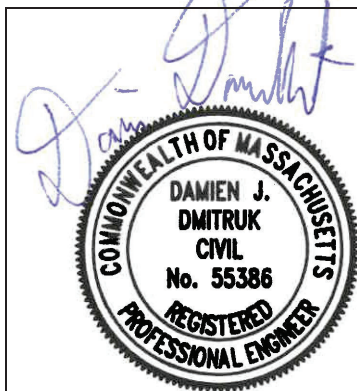

9/14/2023

Signature and Date

---

## Checklist

**Project Type:** Is the application for new development, redevelopment, or a mix of new and redevelopment?

- New development
- Redevelopment
- Mix of New Development and Redevelopment



# Checklist for Stormwater Report

---

## Checklist (continued)

**LID Measures:** Stormwater Standards require LID measures to be considered. Document what environmentally sensitive design and LID Techniques were considered during the planning and design of the project:

- No disturbance to any Wetland Resource Areas
- Site Design Practices (e.g. clustered development, reduced frontage setbacks)
- Reduced Impervious Area (Redevelopment Only)
- Minimizing disturbance to existing trees and shrubs
- LID Site Design Credit Requested:
  - Credit 1
  - Credit 2
  - Credit 3
- Use of "country drainage" versus curb and gutter conveyance and pipe
- Bioretention Cells (includes Rain Gardens)
- Constructed Stormwater Wetlands (includes Gravel Wetlands designs)
- Treebox Filter
- Water Quality Swale
- Grass Channel
- Green Roof
- Other (describe): \_\_\_\_\_

### Standard 1: No New Untreated Discharges

- No new untreated discharges
- Outlets have been designed so there is no erosion or scour to wetlands and waters of the Commonwealth
- Supporting calculations specified in Volume 3 of the Massachusetts Stormwater Handbook included.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 2: Peak Rate Attenuation

- Standard 2 waiver requested because the project is located in land subject to coastal storm flowage and stormwater discharge is to a wetland subject to coastal flooding.
- Evaluation provided to determine whether off-site flooding increases during the 100-year 24-hour storm.
- Calculations provided to show that post-development peak discharge rates do not exceed pre-development rates for the 2-year and 10-year 24-hour storms. If evaluation shows that off-site flooding increases during the 100-year 24-hour storm, calculations are also provided to show that post-development peak discharge rates do not exceed pre-development rates for the 100-year 24-hour storm.

### Standard 3: Recharge

- Soil Analysis provided.
- Required Recharge Volume calculation provided.
- Required Recharge volume reduced through use of the LID site Design Credits.
- Sizing the infiltration, BMPs is based on the following method: Check the method used.
  - Static
  - Simple Dynamic
  - Dynamic Field<sup>1</sup>
- Runoff from all impervious areas at the site discharging to the infiltration BMP.
- Runoff from all impervious areas at the site is *not* discharging to the infiltration BMP and calculations are provided showing that the drainage area contributing runoff to the infiltration BMPs is sufficient to generate the required recharge volume.
- Recharge BMPs have been sized to infiltrate the Required Recharge Volume.
- Recharge BMPs have been sized to infiltrate the Required Recharge Volume *only* to the maximum extent practicable for the following reason:
  - Site is comprised solely of C and D soils and/or bedrock at the land surface
  - M.G.L. c. 21E sites pursuant to 310 CMR 40.0000
  - Solid Waste Landfill pursuant to 310 CMR 19.000
  - Project is otherwise subject to Stormwater Management Standards only to the maximum extent practicable.
- Calculations showing that the infiltration BMPs will drain in 72 hours are provided.
- Property includes a M.G.L. c. 21E site or a solid waste landfill and a mounding analysis is included.

---

<sup>1</sup> 80% TSS removal is required prior to discharge to infiltration BMP if Dynamic Field method is used.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 3: Recharge (continued)

- The infiltration BMP is used to attenuate peak flows during storms greater than or equal to the 10-year 24-hour storm and separation to seasonal high groundwater is less than 4 feet and a mounding analysis is provided.
- Documentation is provided showing that infiltration BMPs do not adversely impact nearby wetland resource areas.

### Standard 4: Water Quality

The Long-Term Pollution Prevention Plan typically includes the following:

- Good housekeeping practices;
  - Provisions for storing materials and waste products inside or under cover;
  - Vehicle washing controls;
  - Requirements for routine inspections and maintenance of stormwater BMPs;
  - Spill prevention and response plans;
  - Provisions for maintenance of lawns, gardens, and other landscaped areas;
  - Requirements for storage and use of fertilizers, herbicides, and pesticides;
  - Pet waste management provisions;
  - Provisions for operation and management of septic systems;
  - Provisions for solid waste management;
  - Snow disposal and plowing plans relative to Wetland Resource Areas;
  - Winter Road Salt and/or Sand Use and Storage restrictions;
  - Street sweeping schedules;
  - Provisions for prevention of illicit discharges to the stormwater management system;
  - Documentation that Stormwater BMPs are designed to provide for shutdown and containment in the event of a spill or discharges to or near critical areas or from LUHPPL;
  - Training for staff or personnel involved with implementing Long-Term Pollution Prevention Plan;
  - List of Emergency contacts for implementing Long-Term Pollution Prevention Plan.
- A Long-Term Pollution Prevention Plan is attached to Stormwater Report and is included as an attachment to the Wetlands Notice of Intent.
  - Treatment BMPs subject to the 44% TSS removal pretreatment requirement and the one inch rule for calculating the water quality volume are included, and discharge:
    - is within the Zone II or Interim Wellhead Protection Area
    - is near or to other critical areas
    - is within soils with a rapid infiltration rate (greater than 2.4 inches per hour)
    - involves runoff from land uses with higher potential pollutant loads.
  - The Required Water Quality Volume is reduced through use of the LID site Design Credits.
  - Calculations documenting that the treatment train meets the 80% TSS removal requirement and, if applicable, the 44% TSS removal pretreatment requirement, are provided.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 4: Water Quality (continued)

- The BMP is sized (and calculations provided) based on:
  - The ½" or 1" Water Quality Volume or
  - The equivalent flow rate associated with the Water Quality Volume and documentation is provided showing that the BMP treats the required water quality volume.
- The applicant proposes to use proprietary BMPs, and documentation supporting use of proprietary BMP and proposed TSS removal rate is provided. This documentation may be in the form of the propriety BMP checklist found in Volume 2, Chapter 4 of the Massachusetts Stormwater Handbook and submitting copies of the TARP Report, STEP Report, and/or other third party studies verifying performance of the proprietary BMPs.
- A TMDL exists that indicates a need to reduce pollutants other than TSS and documentation showing that the BMPs selected are consistent with the TMDL is provided.

### Standard 5: Land Uses With Higher Potential Pollutant Loads (LUHPPLs)

- The NPDES Multi-Sector General Permit covers the land use and the Stormwater Pollution Prevention Plan (SWPPP) has been included with the Stormwater Report.
- The NPDES Multi-Sector General Permit covers the land use and the SWPPP will be submitted **prior to** the discharge of stormwater to the post-construction stormwater BMPs.
- The NPDES Multi-Sector General Permit does **not** cover the land use.
- LUHPPLs are located at the site and industry specific source control and pollution prevention measures have been proposed to reduce or eliminate the exposure of LUHPPLs to rain, snow, snow melt and runoff, and been included in the long term Pollution Prevention Plan.
- All exposure has been eliminated.
- All exposure has **not** been eliminated and all BMPs selected are on MassDEP LUHPPL list.
- The LUHPPL has the potential to generate runoff with moderate to higher concentrations of oil and grease (e.g. all parking lots with >1000 vehicle trips per day) and the treatment train includes an oil grit separator, a filtering bioretention area, a sand filter or equivalent.

### Standard 6: Critical Areas

- The discharge is near or to a critical area and the treatment train includes only BMPs that MassDEP has approved for stormwater discharges to or near that particular class of critical area.
- Critical areas and BMPs are identified in the Stormwater Report.





# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 7: Redevelopments and Other Projects Subject to the Standards only to the maximum extent practicable

- The project is subject to the Stormwater Management Standards only to the maximum Extent Practicable as a:
  - Limited Project
  - Small Residential Projects: 5-9 single family houses or 5-9 units in a multi-family development provided there is no discharge that may potentially affect a critical area.
  - Small Residential Projects: 2-4 single family houses or 2-4 units in a multi-family development with a discharge to a critical area
  - Marina and/or boatyard provided the hull painting, service and maintenance areas are protected from exposure to rain, snow, snow melt and runoff
  - Bike Path and/or Foot Path
  - Redevelopment Project
  - Redevelopment portion of mix of new and redevelopment.
- Certain standards are not fully met (Standard No. 1, 8, 9, and 10 must always be fully met) and an explanation of why these standards are not met is contained in the Stormwater Report.
- The project involves redevelopment and a description of all measures that have been taken to improve existing conditions is provided in the Stormwater Report. The redevelopment checklist found in Volume 2 Chapter 3 of the Massachusetts Stormwater Handbook may be used to document that the proposed stormwater management system (a) complies with Standards 2, 3 and the pretreatment and structural BMP requirements of Standards 4-6 to the maximum extent practicable and (b) improves existing conditions.

### Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control

A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan must include the following information:

- Narrative;
  - Construction Period Operation and Maintenance Plan;
  - Names of Persons or Entity Responsible for Plan Compliance;
  - Construction Period Pollution Prevention Measures;
  - Erosion and Sedimentation Control Plan Drawings;
  - Detail drawings and specifications for erosion control BMPs, including sizing calculations;
  - Vegetation Planning;
  - Site Development Plan;
  - Construction Sequencing Plan;
  - Sequencing of Erosion and Sedimentation Controls;
  - Operation and Maintenance of Erosion and Sedimentation Controls;
  - Inspection Schedule;
  - Maintenance Schedule;
  - Inspection and Maintenance Log Form.
- A Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan containing the information set forth above has been included in the Stormwater Report.



# Checklist for Stormwater Report

---

## Checklist (continued)

### Standard 8: Construction Period Pollution Prevention and Erosion and Sedimentation Control (continued)

- The project is highly complex and information is included in the Stormwater Report that explains why it is not possible to submit the Construction Period Pollution Prevention and Erosion and Sedimentation Control Plan with the application. A Construction Period Pollution Prevention and Erosion and Sedimentation Control has **not** been included in the Stormwater Report but will be submitted **before** land disturbance begins.
- The project is **not** covered by a NPDES Construction General Permit.
- The project is covered by a NPDES Construction General Permit and a copy of the SWPPP is in the Stormwater Report.
- The project is covered by a NPDES Construction General Permit but no SWPPP been submitted. The SWPPP will be submitted BEFORE land disturbance begins.

### Standard 9: Operation and Maintenance Plan

- The Post Construction Operation and Maintenance Plan is included in the Stormwater Report and includes the following information:
  - Name of the stormwater management system owners;
  - Party responsible for operation and maintenance;
  - Schedule for implementation of routine and non-routine maintenance tasks;
  - Plan showing the location of all stormwater BMPs maintenance access areas;
  - Description and delineation of public safety features;
  - Estimated operation and maintenance budget; and
  - Operation and Maintenance Log Form.
- The responsible party is **not** the owner of the parcel where the BMP is located and the Stormwater Report includes the following submissions:
  - A copy of the legal instrument (deed, homeowner's association, utility trust or other legal entity) that establishes the terms of and legal responsibility for the operation and maintenance of the project site stormwater BMPs;
  - A plan and easement deed that allows site access for the legal entity to operate and maintain BMP functions.

### Standard 10: Prohibition of Illicit Discharges

- The Long-Term Pollution Prevention Plan includes measures to prevent illicit discharges;
- An Illicit Discharge Compliance Statement is attached;
- NO Illicit Discharge Compliance Statement is attached but will be submitted **prior to** the discharge of any stormwater to post-construction BMPs.

## INTRODUCTION

Coneco Engineers & Scientists, Incorporated (Coneco) has completed a drainage analysis of the subject site, located at 5 Pleasant Street in Walpole, Massachusetts, the results of which are contained herein. The purpose of this analysis is to quantitatively understand the impacts of the proposed development of the project site on the existing hydrologic conditions and to mitigate said impacts through the implementation of a stormwater management system that utilizes best management practices. This design is supported by an operations and maintenance plan as well as a long-term pollution prevention plan.

## DEVELOPMENT SUMMARY

The existing site is a primarily wooded undeveloped lot. The proposed project is a Chapter 40B development supported by MassHousing to include seven buildings consisting of a total of 24 condominium units. In addition to the residential units, ancillary parking, walkways, landscaping, amenity structures, utilities, and a stormwater management system will be constructed as part of the development. The associated construction period pollution prevention, clearing, grading, and paving will be performed as required for the completion of the project.

## STORMWATER MANAGEMENT SYSTEM OVERVIEW

The proposed stormwater management system consists of a series of deep sump hooded catch basins, roof leaders, underground piping, drain manholes, underground infiltration chambers, and outlet control structures, which will work in combination to collect, control, and treat runoff prior to it being discharging from the site. This project is located on an undeveloped lot and has been designed to meet the Massachusetts Stormwater Management Standards.

The site's stormwater flows will be captured by roof gutter and leader systems or travel overland through drainage channels and site grading features until captured by one of the site's catch basins. Catch basin structures will include four-foot deep sumps and oil/gas separator hoods. The deep sumps are intended to remove sediment, and the hoods are intended to remove oil and gas from the stormwater prior to release. Stormwater will then travel through a system of pipes and drain manholes to infiltration chamber systems. The closed drainage system has been designed to accommodate a 25-year rainfall event.

The site has been equipped with multiple subsurface infiltration chamber systems for the control and treatment of stormwater.

The infiltration chamber systems have been designed to provide water quality treatment, groundwater recharge, and attenuation of the proposed peak flow rates and volumes to that of the existing conditions or less. Multistage spillways and weir manholes have been incorporated to facilitate the discharge of stormwater during a high magnitude storm event.

The plunge pool at the system's outlet has been designed to include a depressed center and a level outer rim. The depressed center promotes the removal of any residual sediment, while the level outer rim dissipates the energy of the stormwater by reducing flow velocities and eliminating point discharges.

From an environmentally sensitive perspective, the aforementioned measures will result in a stormwater design that enhances the introduction of surface water into the ground while preserving the site's natural hydrologic conditions.

The remainder of this report demonstrates in detail how the proposed site conditions follow the design conditions set forth by Massachusetts Stormwater Standards as well as supplying calculations based on these standards.

## METHODOLOGY

Drainage calculations are performed to demonstrate that there is no increase in the rate of runoff from the subject site due to the proposed project. The rate of runoff is compared at a common point, referred to as the design point, for both the pre and post development condition (or the existing and proposed condition in the case of a redevelopment project). The hydrologic and hydraulic model created to analyze the pre and post development condition was developed using the Soil Conservation Service (SCS) Technical Release No. 20 (TR 20, SCS unit hydrograph procedures), SCS Technical Release No. 55 (TR 55, Time of Concentration ( $T_c$ ) and Curve Number (CN)), SCS Technical Paper No. 40 (TP 40, rainfall intensity), and the stormwater detention facilities were modeled using the SCS Storage Indication Method.

Time of Concentration ( $T_c$ ) - is the time required for stormwater runoff to travel from the most hydraulically distant point in a drainage area or subcatchment to the design point. The  $T_c$  is calculated based upon slope, distance, surface cover and type of flow. A longer time of concentration will generally result in a smaller rate of runoff.

Curve Number (CN) - represents the amount of runoff expected from a particular segment of the drainage area. A higher curve number will be less permeable and therefore a larger rate of runoff. The CN is based upon three factors: soil type, soil cover, and cover condition. The soil type is graded A to D; A soil is the most permeable, D is the least. The soil cover (e.g. - vegetated, developed, farmland or impervious) ranges from 30-98, with more permeable soil covers having a lower value. The final factor is the condition of the vegetated soil cover (good, fair or poor), where vegetated cover in good condition is the most permeable and allows the least runoff.

The Hydrologic Soil Group (HSG) for the drainage areas was determined from the Soil Conservation Service Soil Survey of Norfolk County, Massachusetts. The soil survey contains maps which depict the extent of the various soil types. A soil type overlay plan is attached as Figure 6.

Design Software - To assist in the analysis, software entitled HydroCAD, Version 10.0 (developed by HydroCAD Software Solutions, L.L.C.) was utilized. The HydroCAD program calculates the runoff based on rainfall events and watershed characteristics, and produces a runoff hydrograph (a runoff rate versus time curve). If applicable, stage-storage-discharge curves for a specific detention facility are calculated.

Peak Attenuation - The peak rate of runoff at the design points was calculated for the existing and proposed conditions for the 2, 10, 25, and 100-year, 24-hour storm events. The peak rate of runoff was compared for each storm event to determine if there was an increase from the pre to post development condition.

Runoff Volume - The total volume of runoff for the entire site was calculated for the existing and proposed conditions for the 2, 10, 25, and 100-year, 24-hour storm events. The volume of runoff was compared for each storm event to determine if there was an increase from the pre to post development condition.

## EXISTING CONDITIONS

The site is a mostly wooded lot located on the northwest side of Pleasant Street, along the Norwood-Walpole town line. The lot abuts residential homes along its southern and eastern borders, a commercial lot along its northern border, and railroad tracks along its western border. Existing drainage patterns and watershed areas were established from a topographic survey. A site visit was conducted by Coneco to

confirm this analysis. Topography generally slopes from the south and southeast sides of the site to the northwest at grades of approximately 1.5 to 6.5 percent. Runoff from storm events discharges from the site along the northwestern corner of the property.

The Soil Conservation Service map for the area indicates that the site is made of four soil types. Please refer to Table 1 for a summary of these soils.

Table 1  
Existing Soil Classifications

SOIL MAP UNIT	<i>Norfolk County SOIL SURVEY MAP UNIT NAME AND DESCRIPTION</i>	HYDROLOGIC SOIL GROUP
420B	Canton fine sandy loam, 3 to 8 percent slopes	B
602	Urban Land, 0 to 15 percent slopes	Unclassified
628C	Canton-Urban land Complex, 3 to 15 percent slopes	A
654	Udorthents, loamy	A

## PROPOSED CONDITIONS

The proposed development consists of seven new condominium buildings which will provide a total of 24 residential units. To support the new residential buildings, the project will also include an access drive, parking areas, pedestrian walkways, landscaped areas, utilities connections, and stormwater management systems. The main site entrance will be at the property's frontage on Pleasant Street and the proposed emergency access road will provide a secondary ingress to the property through Maguire Park. As part of this work, the existing lot will be cleared and grubbed and all other existing onsite features will be removed from the site.

These changes increase the overall impervious area found at the site. However, the addition of underground infiltration chamber systems will promote recharge on the site and results in a reduction of the peak rate of runoff. Furthermore, with the addition of the stormwater management BMP's, the runoff will be treated prior to being discharged from the site.

## STORMWATER MANAGEMENT STANDARDS REVIEW

As part of this drainage analysis, Coneco has performed an in-depth review of the subject site for conformance with the Massachusetts Department of Environmental Protection's Stormwater Management Standards. The project is a new construction project (as defined in Standard 7) within the Stormwater Management Standards. The following is a summary of our findings relative to our review of each of the standards. Please note that the actual text of each standard is italicized for clarity.

***STANDARD 1: No new stormwater conveyances (e.g. outfalls) may discharge untreated stormwater directly to or cause erosion in wetlands or waters of the Commonwealth.***

Stormwater shall be treated prior to release with deep sump catch basins with hoods and infiltration chambers with inlet isolation row. The deep sumps of the catch basin will capture sediment, and the hood will withhold oil and gas within the catch basin. The outlets of infiltration facilities have been designed to reduce erosion and eliminate scouring. A plunge pool will be installed at each discharge

point. The plunge pool will be lined with rip rap forming a depression which will enhance sediment removal prior to discharging runoff. It will also eliminate erosion by reducing flow velocities.

**STANDARD 2:** *Stormwater management systems shall be designed so that post-development peak discharge rates do not exceed pre-development peak discharge rates. This Standard may be waived for discharges to land subject to coastal storm flowage as defined in 310 CMR 10.04.*

The existing and proposed site conditions were analyzed for the 2, 10, 25 and 100-year 24-hour storm events using the aforementioned methodology (please refer to appendices A and B of this report for HydroCAD output support data). Due to stormwater being captured, controlled, attenuated, and infiltrated, there is no increase in peak discharge rates for all storm events analyzed (please refer to Appendix C of this report for Peak Rate of Runoff tables).

## CLOSED DRAINAGE SYSTEM CALCULATIONS

### *Rational Method – Sizing pipes for the 25-year storm*

The Rational Method was used to calculate the peak flow through the pipes, and the Manning equation was used to determine the minimum pipe size required to pass the required flow. The closed drainage system calculations determine the rate of runoff, the time of concentration and the rainfall intensity for the drainage subcatchment. The calculations were performed for a 25-year storm event. The following standards were used:

1. The Rational Formula ( $Q = CIA$ ) was used to determine the flow to each structure.

Q = Flow cubic feet per second (CFS)  
C = Runoff coefficients  
I = Rainfall Intensity (inches per hour)  
A = Drainage Area (acres)

2. The runoff coefficients used are as follows:

Impervious (pavement and roofs) = 0.85  
Bare Ground and gravel = 0.50  
Landscape = 0.4  
Wooded = 0.2

3. The intensity for each area was determined by the Steel Formula for a 25-year frequency storm. The Steel Formula is:

$I = k/(t+b)$   
I = Intensity  
k = 230 (25 yr)  
t = Time of Concentration  
b = 30 (25 yr)

4. The times of concentration were calculated using a spreadsheet which calculates flow time in the pipe with the Manning equation. A minimum time of concentration of five (5) minutes was utilized.
5. The Manning's formula was utilized to calculate the capacity of the individual pipes in the closed drainage system. The Manning's formula is:

$$Q = (A_p) (1.486/n) (s^{1/2}) (h^{2/3})$$

Q = Flow in CFS  
Ap = Cross-sectional area of the pipe (square feet)  
n = Roughness coefficient  
s = slope of the pipe (ft/ft)  
h = hydraulic radius = area/wetted perimeter (sf/ft)

The closed drainage system is capable of handling the design flow as calculated, as well as maintaining a design velocity of between two feet per second (fps) and ten fps. Two fps is considered “self cleansing velocity”, and will prevent the pipes from accumulating sediment. Ten fps is considered a safe maximum velocity, to reduce scouring of the pipes. Please refer to Appendix C for the closed drainage system pipe sizing calculation spreadsheet.

**STANDARD 3:** *Loss of annual recharge to groundwater shall be eliminated or minimized through the use of infiltration measures including environmentally sensitive site design, low impact development techniques, stormwater best management practices, and good operation and maintenance. At a minimum, the annual recharge from the post-development site shall approximate the annual recharge from pre-development conditions based on soil type. This Standard is met when the stormwater management system is designed to infiltrate the required recharge volume as determined in accordance with the Massachusetts Stormwater Handbook.*

Standard 3 requires that a specific volume of water be recharged to the site depending on existing soil types and the total impervious area over each soil type. Please refer to Appendix C Stormwater Management Standard 3 - Recharge Volume for a summary of the required recharge.

According to the required recharge volume calculation, the on-site infiltration systems must be designed to provide a minimum recharge volume of 2,260 cubic feet. The proposed design directs 99.4% of the impervious area within the project’s subcatchment areas to recharge facilities. This prompts the need for an adjustment factor and increases the required recharge volume to 2,274 cf. Soils in the locations of the proposed infiltration facilities are adequate for infiltration as determined by exploratory test pits. The bottom of the infiltration facilities have been designed to provide four feet of separation to seasonal high groundwater elevations. Please refer to Appendix F for the test pit soil logs. The infiltration facilities as designed will provide a total static recharge volume of 24,027 cubic feet. Please refer to Appendix C for these calculations as well as 72-hour drawdown calculations.

Coneco has used the *Static* method for sizing the infiltration BMPs. See appendix C for the related calculations.

**STANDARD 4:** *Stormwater management systems shall be designed to remove 80% of the average annual post-construction load of Total Suspended Solids (TSS). This Standard is met when:*

- a) *Suitable practices for source control and pollution prevention are identified in a long-term pollution prevention plan, and thereafter are implemented and maintained;*
- b) *Structural stormwater best management practices are sized to capture the required water quality volume determined in accordance with the Massachusetts Stormwater Handbook; and*
- c) *Pretreatment is provided in accordance with the Massachusetts Stormwater Handbook.*

The proposed stormwater management system is primarily utilized to facilitate the recharge of groundwater due to the increase of impervious area on the site. The proposed system will achieve the 80% TSS removal requirement for all surface water captured by the system. Please refer to Table 2 for a TSS removal summary.

Please note that a long term pollution prevention plan has been developed as part of the analysis and can be found in Appendix D.

**TREATMENT OF SUSPENDED SOLIDS:**

Runoff from non-metal roofs does not require pretreatment and will be routed directly to infiltration facilities. All other impervious area, such as pavement, will meet the treatment requirements of the Stormwater Standards. Pretreatment will be provided with deep sump catch basins and isolation rows.

As some of the site’s infiltration rates are greater than 2.4 in/hr, a pretreatment requirement of 44% is necessary to receive the 80% TSS removal rate for the infiltration facilities. This requirement is met by the use of isolation rows.

Catch basins will be equipped with hoods and four-foot sumps to limit sediment, oils, and grease from being discharged to the drainage system. Please refer to Table 2 – Total Suspended Solids Removal worksheet attached herein for this information.

The inlet rows of the infiltration chamber system receiving non-roof stormwater will be designed as isolation rows. Each isolation row of chambers will be wrapped in filter fabric, thus further filtering TSS from the stormwater. The isolation row functions as pretreatment to the infiltration chambers, thus allowing 80% TSS removal for the system.

Table 2  
Total Suspended Solids Removal

<i>BMP</i>	<i>TSS Removal Rate</i>	<i>Starting TSS Load</i>	<i>TSS Removed</i>	<i>Remaining TSS Load</i>
Deep Sump Hooded Catch Basin	0.25	1.00	Pretreatment	1.00
Isolation Row	0.50	1.00	Pretreatment	1.00
Infiltration Chambers	0.80	1.00	0.80	0.20
<b>Total Suspended Solids Removed:</b>				<b>80%</b>

**WATER QUALITY VOLUME**

See Appendix C for required water quality volume calculations based on impervious area and the *Static* method calculations for sizing of the infiltration BMPs.

**STANDARD 5:** *For land uses with higher potential pollutant loads, source control and pollution prevention shall be implemented in accordance with the Massachusetts Stormwater Handbook to eliminate or reduce the discharge of stormwater runoff from such land uses to the maximum extent practicable. If through source control and/or pollution prevention all land uses with higher potential pollutant loads cannot be completely protected from exposure to rain, snow, snow melt, and stormwater runoff, the proponent shall use the specific structural stormwater BMPs determined by the Department to be suitable for such uses as provided in the Massachusetts Stormwater Handbook. Stormwater discharges from land uses with higher potential pollutant loads shall also comply with the requirements of the Massachusetts Clean Waters Act, M.G.L. c. 21, §§ 26-53 and the regulations promulgated thereunder at 314 CMR 3.00, 314 CMR 4.00 and 314 CMR 5.00.*



The project site is not a land use with higher potential pollutant loads, per the regulation.

**STANDARD 6:** *Stormwater discharges within the Zone II or Interim Wellhead Protection Area of a public water supply, and stormwater discharges near or to any other critical area, require the use of the specific source control and pollution prevention measures and the specific structural stormwater best management practices determined by the Department to be suitable for managing discharges to such areas, as provided in the Massachusetts Stormwater Handbook. A discharge is near a critical area if there is a strong likelihood of a significant impact occurring to said area, taking into account site-specific factors. Stormwater discharges to Outstanding Resource Waters and Special Resource Waters shall be removed and set back from the receiving water or wetland and receive the highest and best practical method of treatment. A “storm water discharge” as defined in 314 CMR 3.04(2)(a)1 or (b) to an Outstanding Resource Water or Special Resource Water shall comply with 314 CMR 3.00 and 314 CMR 4.00. Stormwater discharges to a Zone I or Zone A are prohibited unless essential to the operation of a public water supply.*

The project site is not within the Zone II or Interim Wellhead Protection Area of a public water supply and does not discharge near or to any other critical area. See Figure 5, Critical Areas.

**STANDARD 7:** *A redevelopment project is required to meet the following Stormwater Management Standards only to the maximum extent practicable: Standard 2, Standard 3, and the pretreatment and structural best management practice requirements of Standards 4, 5, and 6. Existing stormwater discharges shall comply with Standard 1 only to the maximum extent practicable. A redevelopment project shall also comply with all other requirements of the Stormwater Management Standards and improve existing conditions.*

This project is considered new development and has been designed to meet all the Massachusetts Stormwater Management Standards.

**STANDARD 8:** *A plan to control construction-related impacts including erosion, sedimentation and other pollutant sources during construction and land disturbance activities (construction period erosion, sedimentation, and pollution prevention plan) shall be developed and implemented.*

This project will disturb more than one acre of land and will therefore be required to obtain coverage under the NPDES Construction General Permit. A Stormwater Pollution Prevention Plan (SWPPP) will be required before earth-disturbing activities commence on the project site. The SWPPP will be prepared per EPA NPDES NOI guidelines and submitted under a separate cover.

**STANDARD 9:** *A long-term operation and maintenance plan shall be developed and implemented to ensure that stormwater management systems function as designed.*

Please refer to Appendix F for the Operation and Maintenance Plan for the proposed Stormwater Management System.

**STANDARD 10:** *All illicit discharges to the stormwater management system are prohibited.*

To our knowledge, no illicit discharges are made to the stormwater management system. An Illicit Discharge Compliance Statement is attached in Appendix G.

## CONCLUSION/SUMMARY:

Based on the HydroCAD analysis for the 2, 10, 25, and 100-year storm events, the peak rate of runoff will decrease from the existing to the proposed condition. Furthermore, stormwater will be treated prior to its discharge from the site and controlled infiltration has been introduced to previously uncontrolled areas, thereby promoting/preserving the natural hydrologic conditions. In addition to these improvements, all 10 of the DEP Stormwater Standards have been met.

# LIST OF FIGURES

FIGURE 1 - AERIAL MAP

FIGURE 2 - USGS TOPOGRAPHIC MAP

FIGURE 3 - FLOOD INSURANCE RATE MAP


FIGURE 4 - NATURAL HERITAGE MAP

FIGURE 5 - CRITICAL AREAS

FIGURE 6 - SOIL SURVEY MAP

FIGURE 7 - EXISTING DRAINAGE AREAS

FIGURE 8 - PROPOSED DRAINAGE AREAS

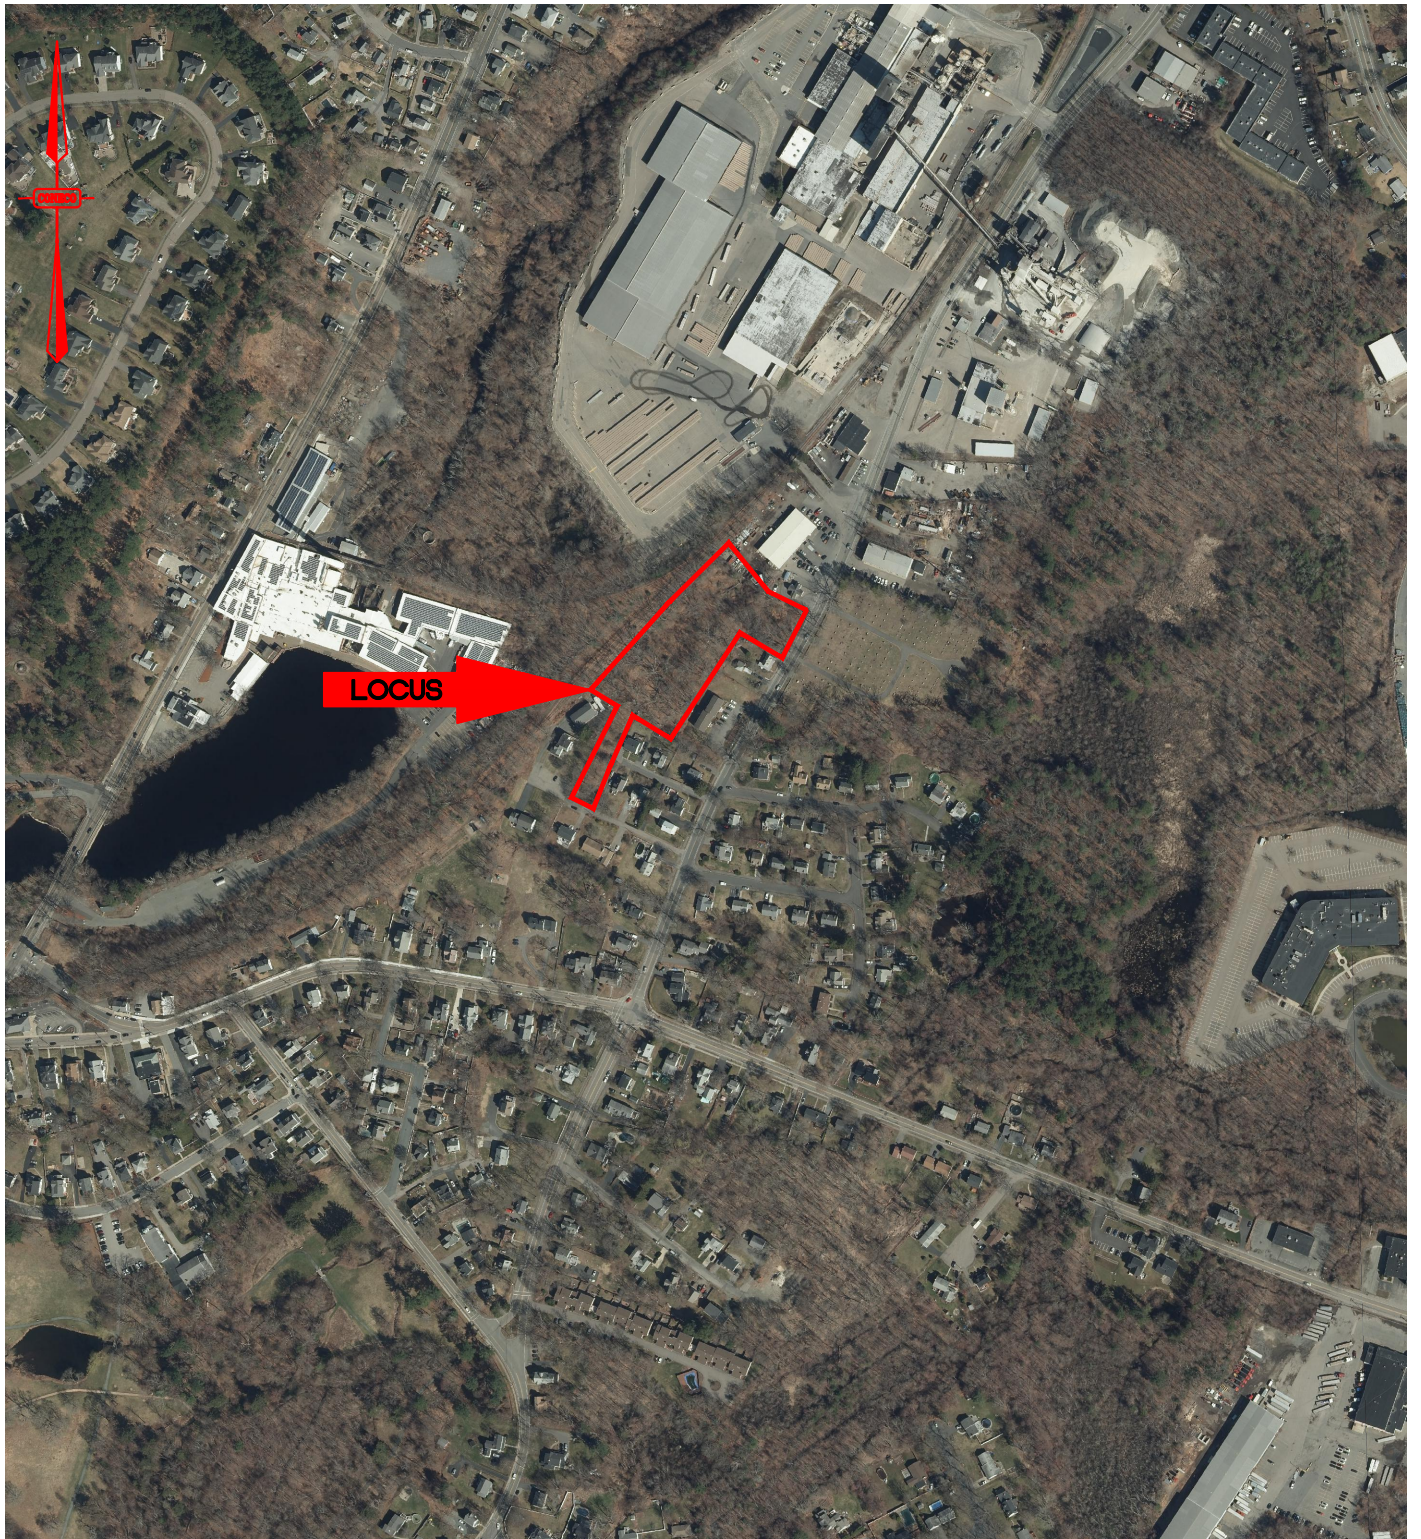

**NOTES:**

1. INFORMATION ON THESE FIGURES WERE OBTAINED FROM BUREAU OF GEOGRAPHIC INFORMATION (MASSGIS), COMMONWEALTH OF MASSACHUSETTS, EXECUTIVE OFFICE OF TECHNOLOGY AND SECURITY SERVICES.
2. 2021 AERIAL IMAGERY, SPRING 2021.

5 PLEASANT STREET, WALPOLE, MA 02032



PREPARED FOR:

NEPONSET VILLAGE, LLC

PLAN SET:

REPORT FIGURES


SCALE  
1" = 500'

DATE  
08/30/2023

PROJECT NO.  
10365.0

TITLE:

FIGURE 1  
AERIAL MAP

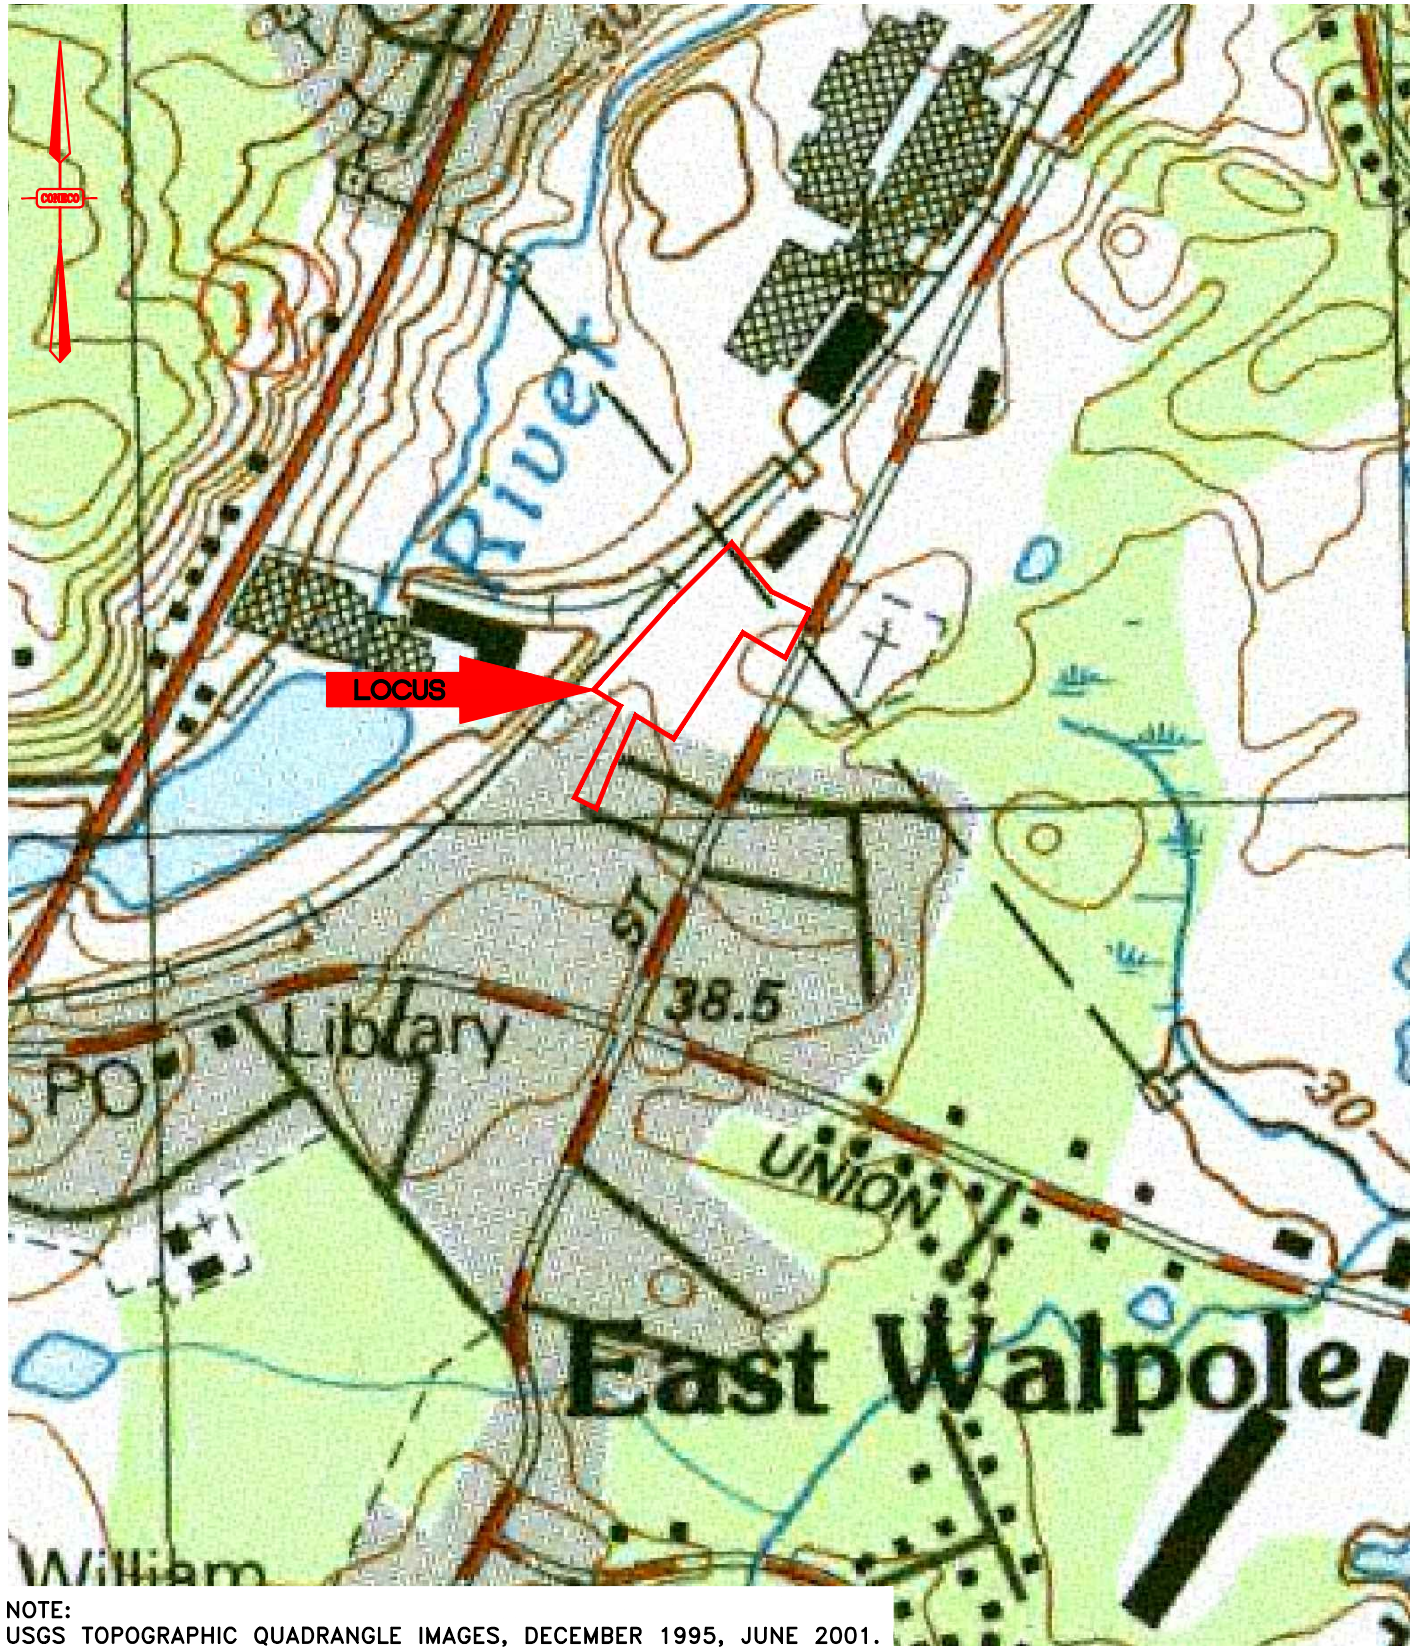

5 PLEASANT STREET, WALPOLE, MA 02032



PREPARED FOR:  
NEPONSET VILLAGE, LLC


PLAN SET:  
REPORT FIGURES





SCALE  
1" = 500'

DATE  
08/30/2023

PROJECT NO.  
10365.0

TITLE:  
FIGURE 2  
USGS TOPOGRAPHIC  
MAP

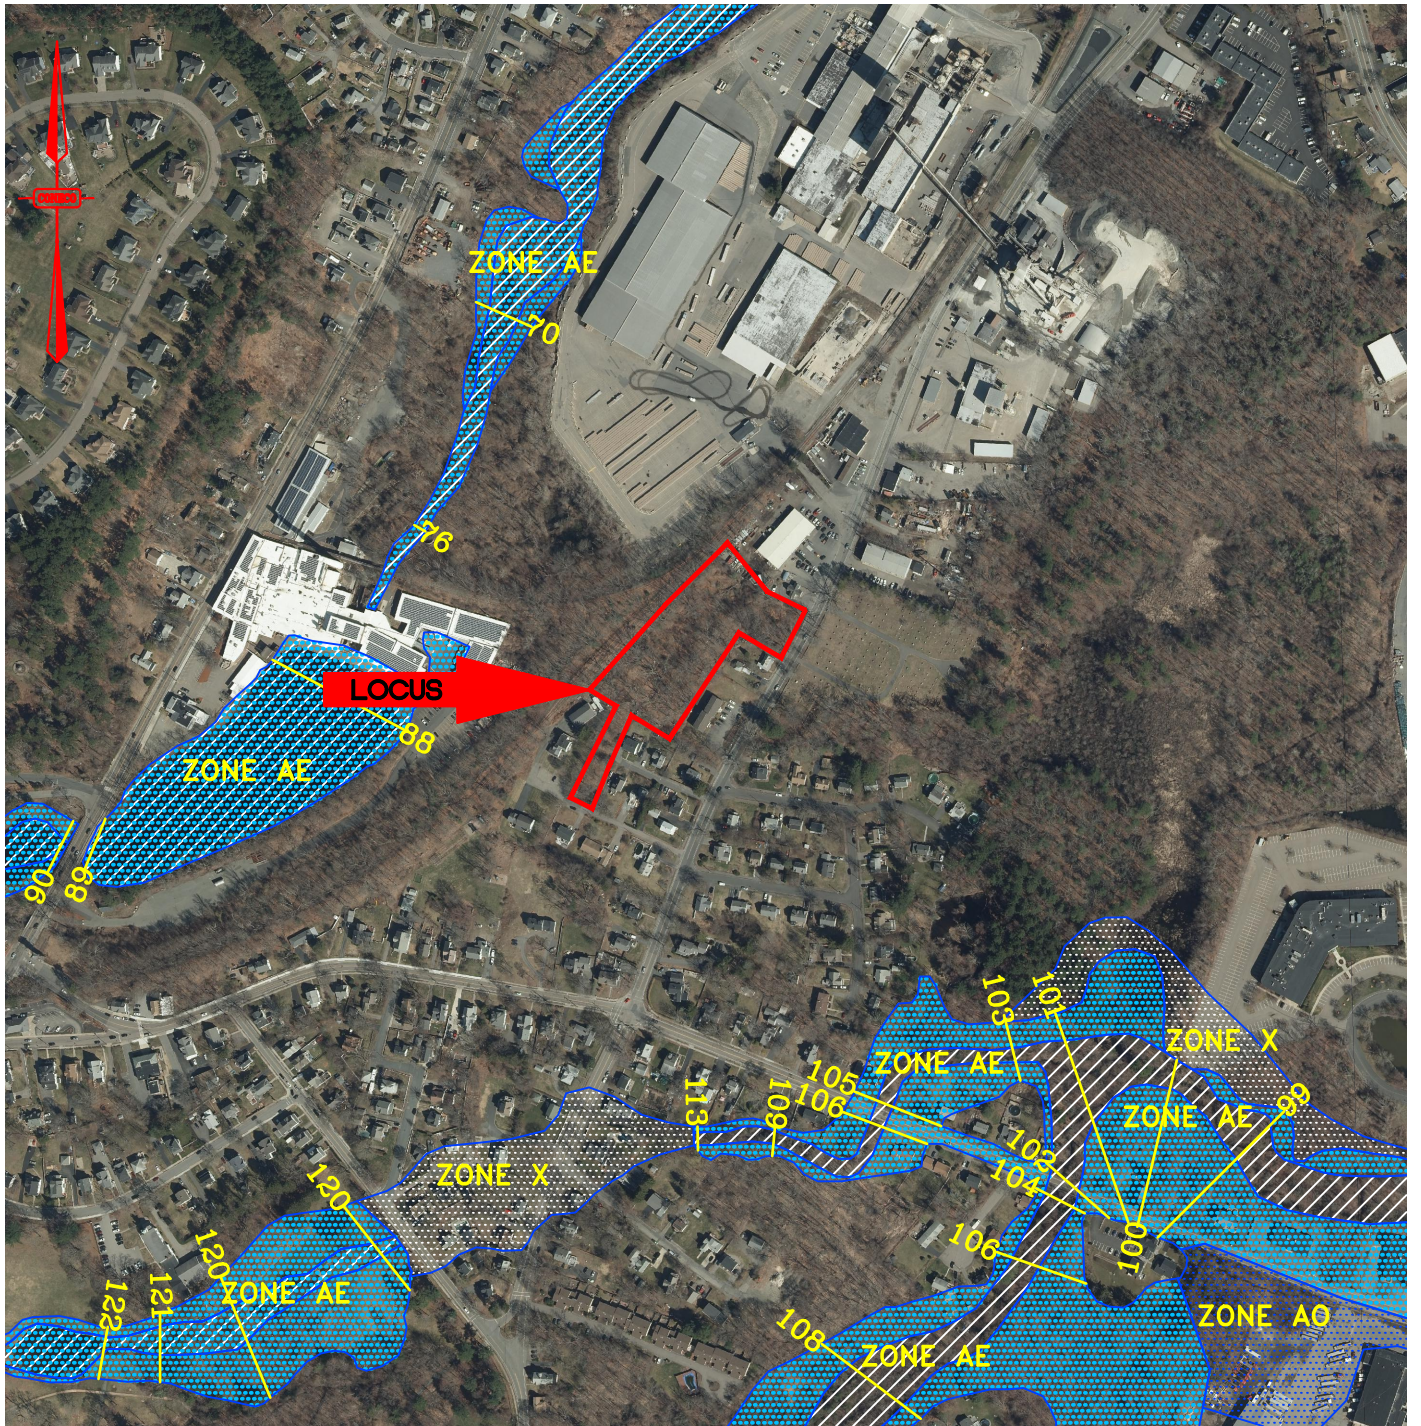

-  FLOOD ZONE X, AREAS BETWEEN THE LIMITS OF 100-YEAR AND 500-YEAR FLOODS
-  FLOODWAY AREAS IN ZONE AE
-  FLOOD ZONE AE, AREAS OF 100-YEAR FLOOD, BASE FLOOD ELEVATIONS DETERMINED
-  FLOOD ZONE AO, AREAS OF 100-YEAR FLOOD, SHEET FLOW FLOOD DEPTHS OF 1 TO 3 FEET

**NOTE:**

1. FEMA NATIONAL FLOOD HAZARD LAYER JULY 2017
2. FEMA FLOOD INSURANCE RATE MAP FOR NORFOLK COUNTY COMMUNITY MAP NO. 25021C0187E, EFFECTIVE JULY 17, 2012.

5 PLEASANT STREET, WALPOLE, MA 02032



PREPARED FOR:  
NEPONSET VILLAGE, LLC


PLAN SET:  
REPORT FIGURES

SCALE  
1" = 500'

DATE  
08/30/2023

PROJECT NO.  
10365.0

TITLE:  
FIGURE 3  
FLOOD INSURANCE  
RATE MAP

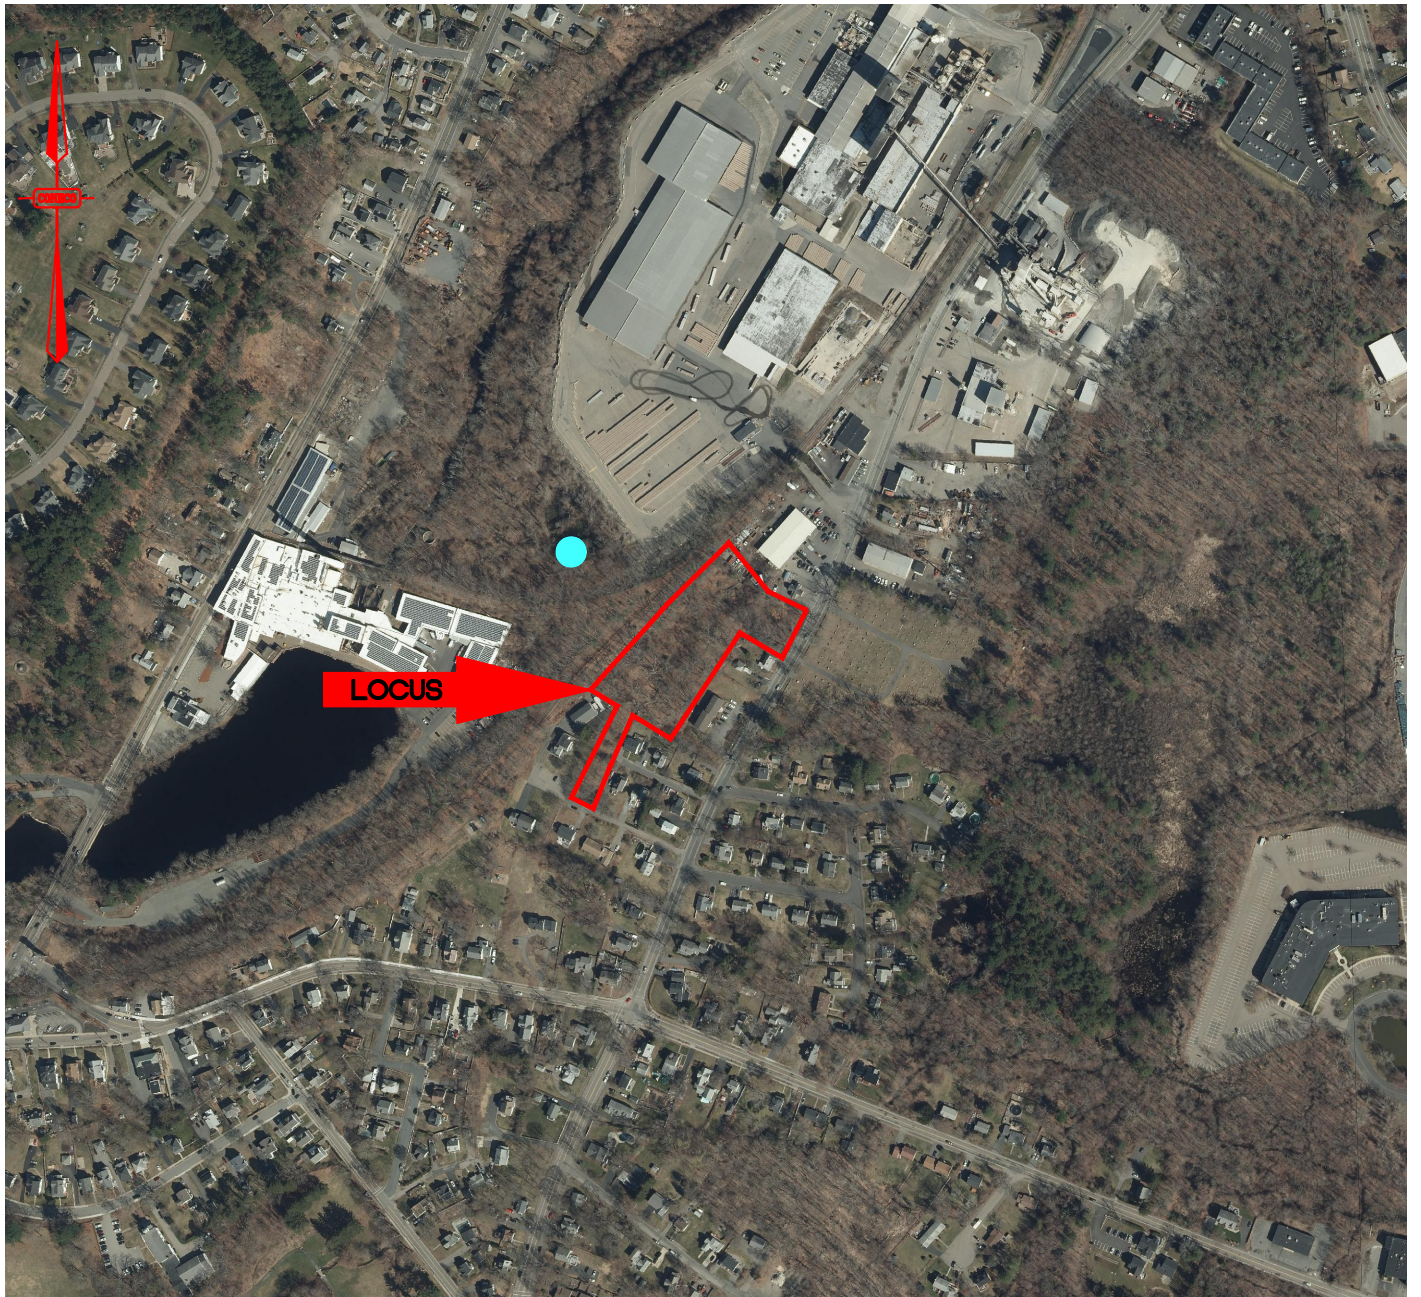

PRIORITY HABITAT OF RARE SPECIES



CERTIFIED VERNAL POOLS



ESTIMATED HABITATS OF RARE WILDLIFE



POTENTIAL VERNAL POOLS

**NOTES:**

1. ESTIMATED HABITATS OF RARE WILDLIFE AND PRIORITY HABITATS OF RARE SPECIES CAME FROM MASSGIS DATABASE LAST UPDATED AUGUST 2017.
2. CERTIFIED VERNAL POOL LOCATIONS WERE TAKEN FROM MASSGIS DATABASE ON JANUARY 18, 2023. THIS DATA IS UPDATED CONTINUALLY AND SHOWN CONDITIONS MAY VARY FROM THIS DATA.
3. POTENTIAL VERNAL POOL LOCATIONS WERE TAKEN FROM MASSGIS DATABASE LAST UPDATED DECEMBER 2000.
4. THERE ARE NO ESTIMATED HABITATS OF RARE WILDLIFE, PRIORITY HABITATS OF RARE SPECIES, POTENTIAL VERNAL POOLS, OR CERTIFIED VERNAL POOLS ON THE PROJECT SITE.

5 PLEASANT STREET, WALPOLE, MA 02032



PREPARED FOR:

NEPONSET VILLAGE, LLC

PLAN SET:

REPORT FIGURES


SCALE  
1" = 500'

DATE  
08/30/2023

PROJECT NO.  
10365.0

TITLE:

FIGURE 4  
NATURAL HERITAGE MAP

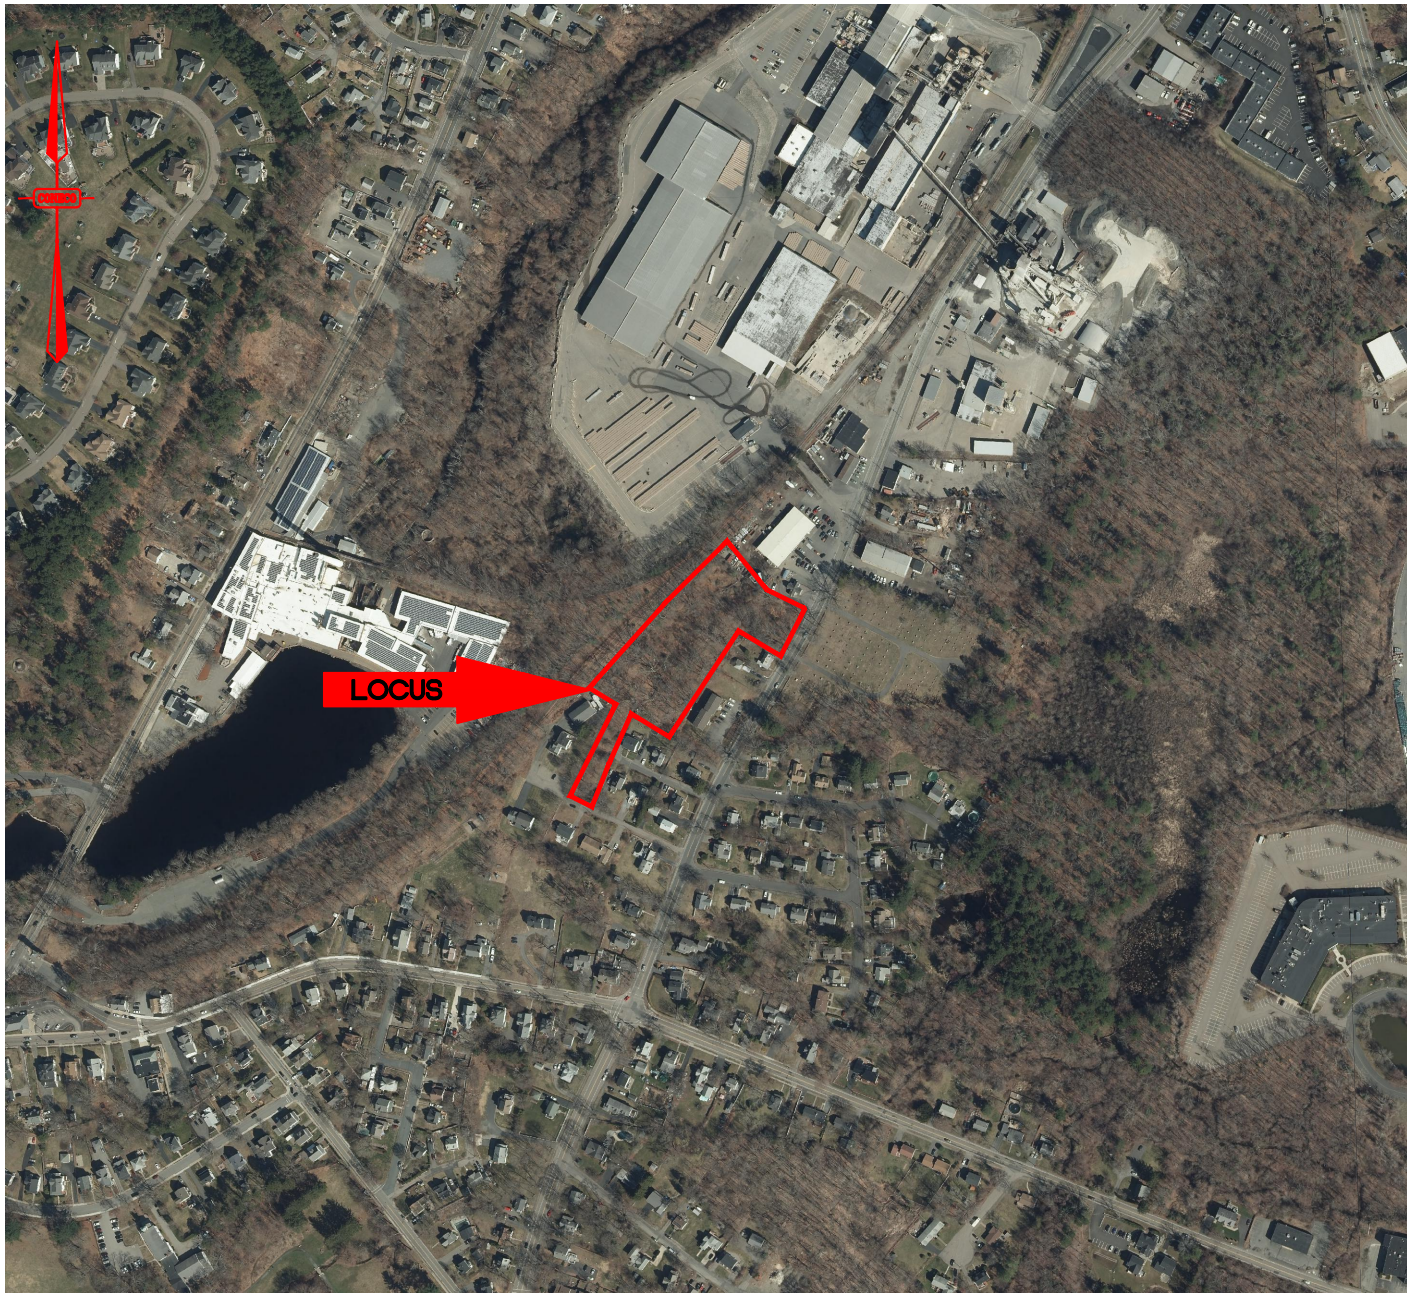

**NOTES:**


1. AREAS OF CRITICAL ENVIRONMENTAL CONCERN WERE TAKEN FROM MASSGIS DATABASE, LAST UPDATED APRIL 2009.
2. WELLHEAD PROTECTION AREAS WERE TAKEN FROM MASSGIS DATEBASE, LAST UPDATED FEBRUARY 2023.
3. OUTSTANDING RESOURCE WATERS WERE TAKEN FROM MASSGIS DATEBASE, LAST UPDATED MARCH 2010.
4. SURFACE WATER SUPPLY PROTECTION AREAS WERE TAKEN FROM MASSGIS DATEBASE, LAST UPDATED APRIL 2017
5. THERE ARE NO AREAS OF CRITICAL ENVIRONMENTAL CONCERN, WELLHEAD PROTECTION AREAS, OUTSTANDING RESOURCE WATERS, OR SURFACE WATER SUPPLY PROTECTION AREAS ON THIS PROJECT SITE.

5 PLEASANT STREET, WALPOLE, MA 02032



PREPARED FOR: NEPONSET VILLAGE, LLC		PLAN SET: REPORT FIGURES	
SCALE 1" = 500'	DATE 08/30/2023	PROJECT NO. 10365.0	TITLE: FIGURE 5 CRITICAL AREAS



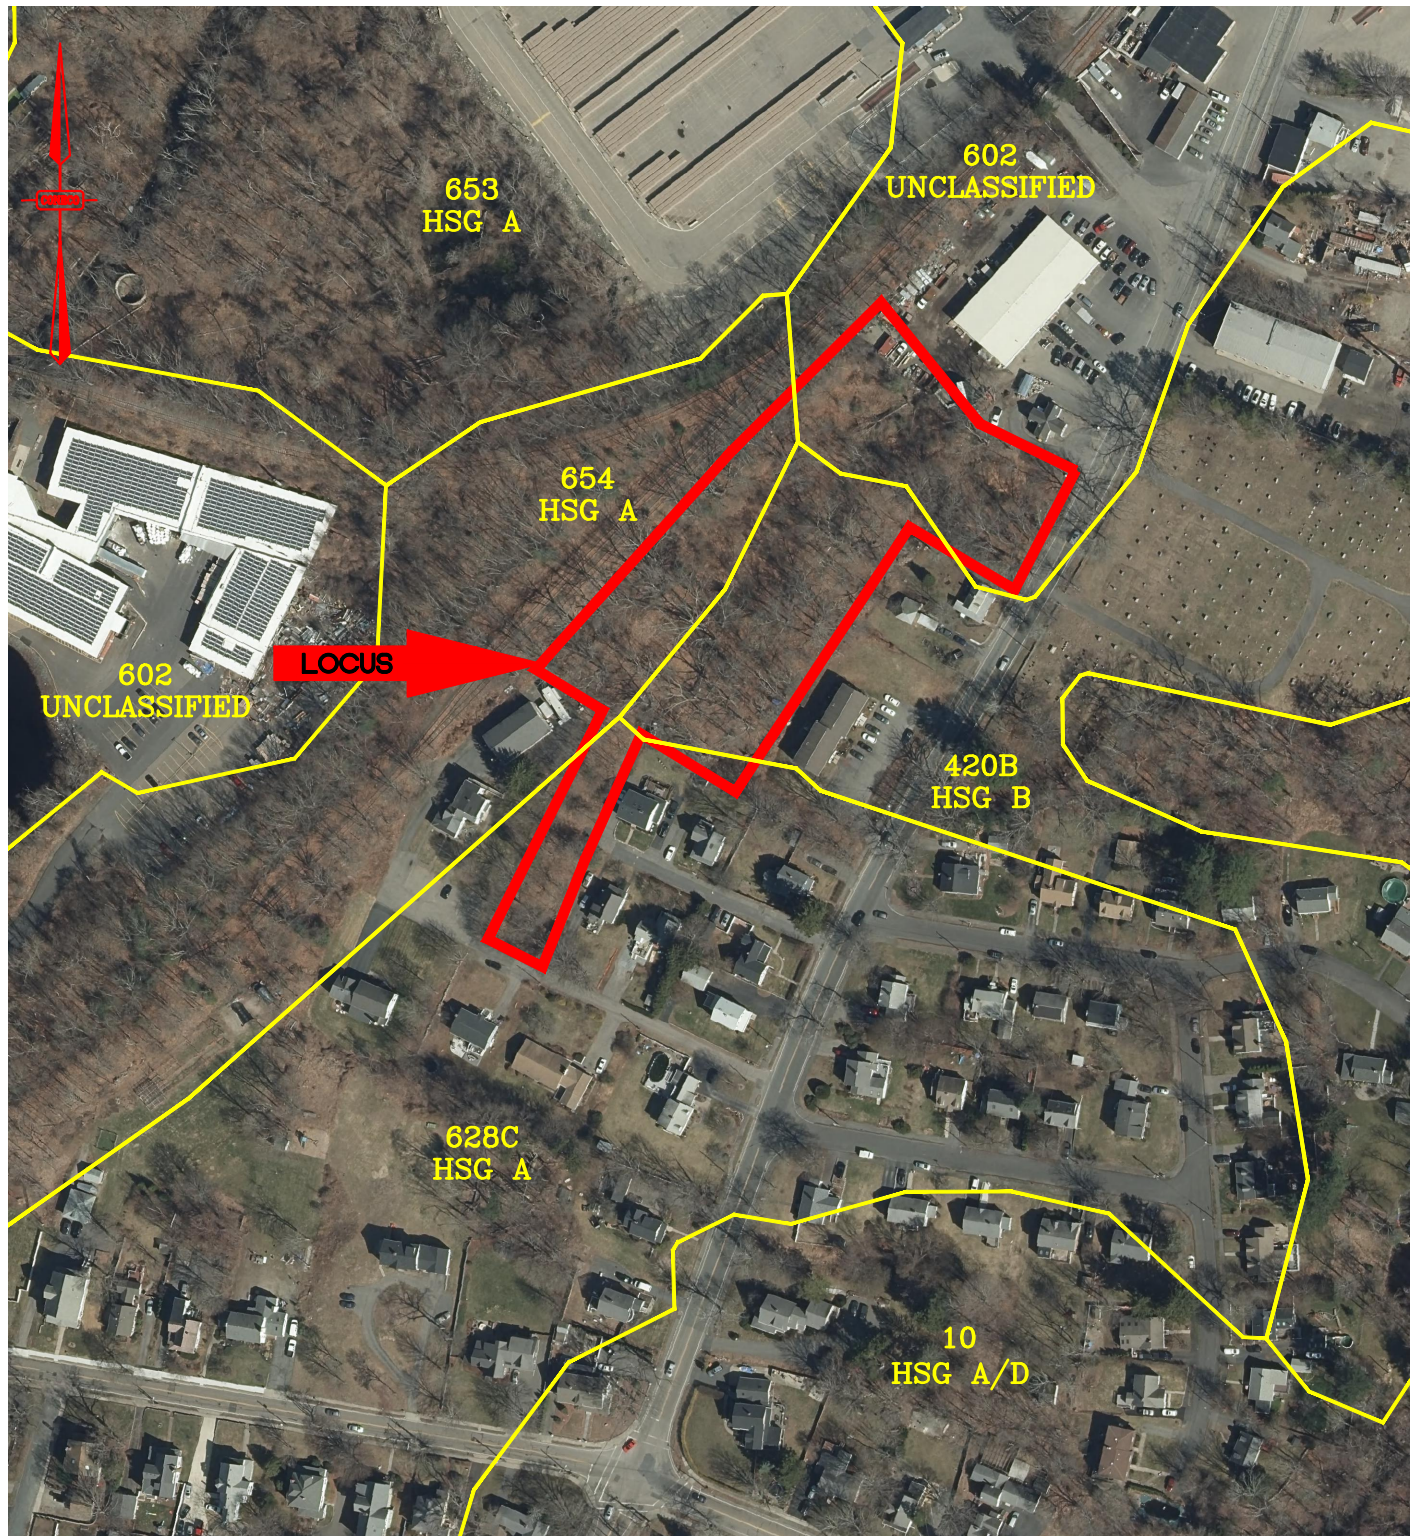

NOTE:  
 INFORMATION ON THIS PLAN WAS OBTAINED FROM THE MASSGIS DATABASE, NRCS SSURGO – CERTIFIED SOILS  
 WHICH WAS LAST UPDATED NOVEMBER 2012.

5 PLEASANT STREET, WALPOLE, MA 02032



PREPARED FOR:  
 NEPONSET VILLAGE, LLC

PLAN SET:  
 REPORT FIGURES

SCALE  
 1" = 200'


DATE  
 08/30/2023

PROJECT NO.  
 10365.0

TITLE:  
 FIGURE 6  
 SOIL SURVEY MAP

**LEGEND**

- SUBCATCHMENT BOUNDARY
- SOILS BOUNDARY
- FLOWPATH

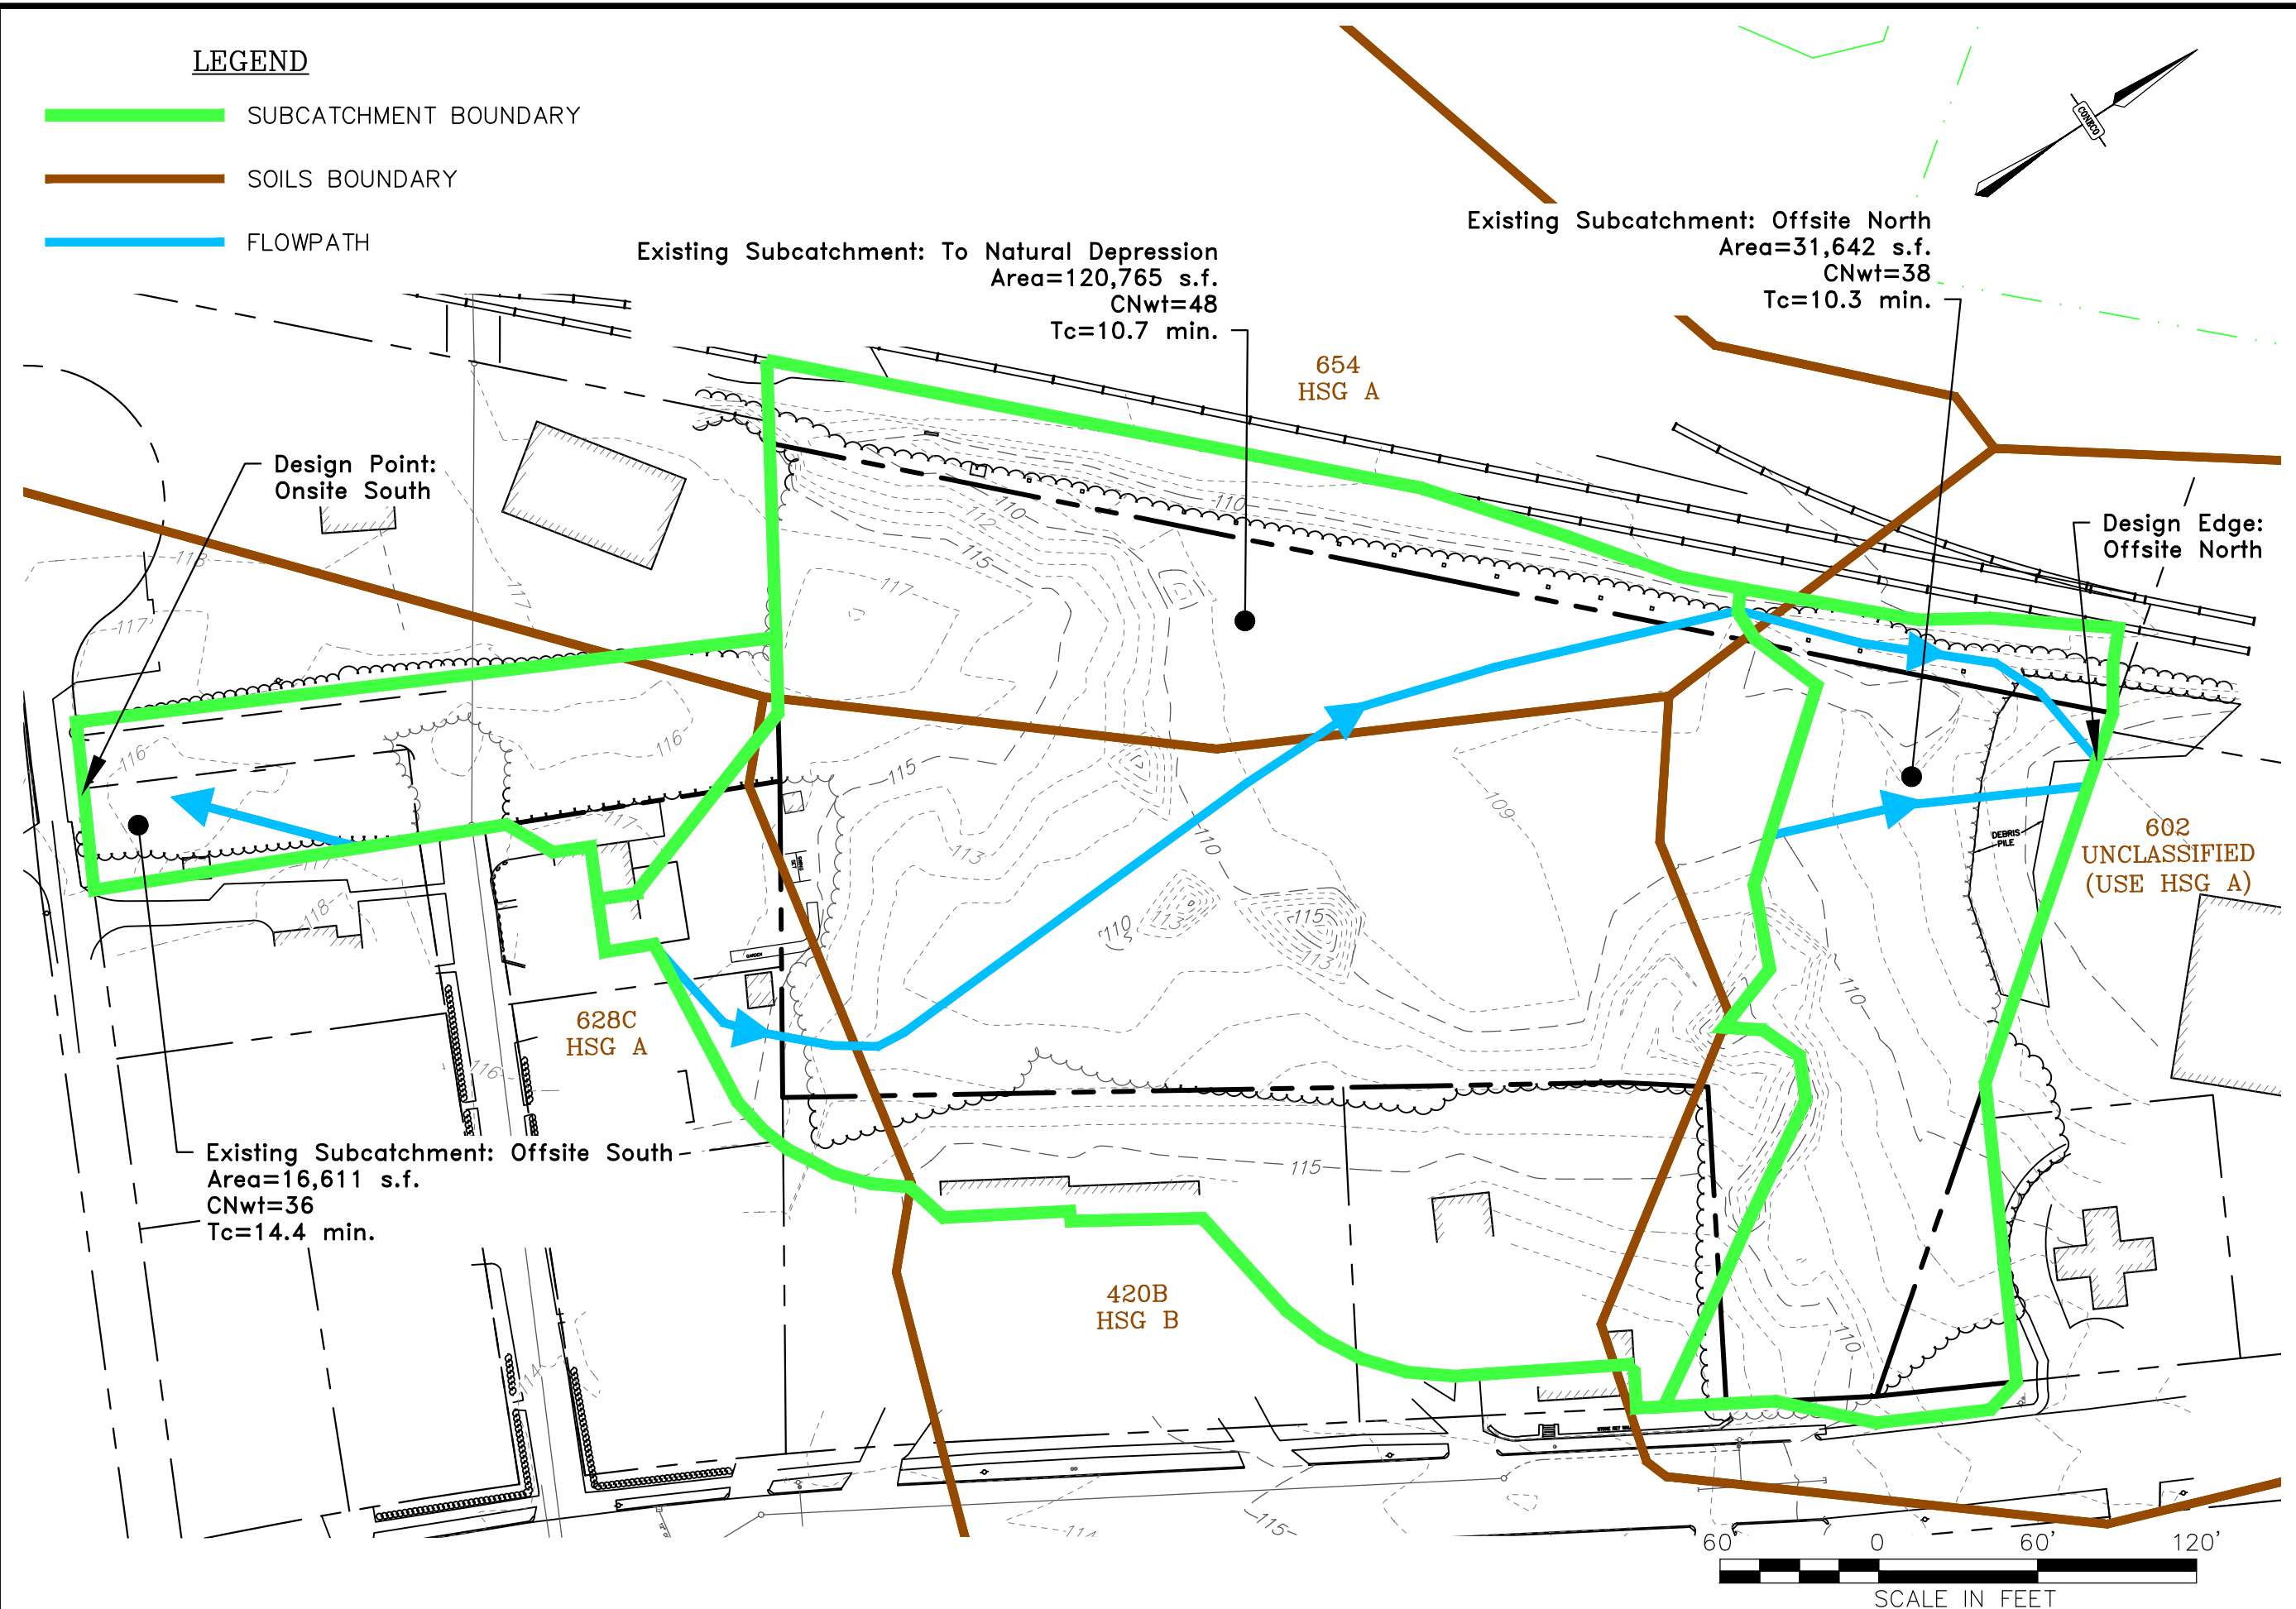

NO.	DATE	DESCRIPTION	DR/CK

PREPARED FOR:  
**NEPONSET VILLAGE, LLC**  
 P.O. BOX 206  
 ABINGTON, MA 02351

DRAWING:  
**EXISTING DRAINAGE AREAS**

PROJECT:  
**NEPONSET VILLAGE**  
 5 PLEASANT STREET  
 WALPOLE, MA 02032

PLAN SET:  
**REPORT FIGURES**



**CONECO**  
 Engineers & Scientists  
 PHONE: 800-548-3355 WEBSITE: www.coneco.com

DATE: 09/14/2023  
 DRAWN/CHECK: BTM/DJD  
 SCALE: 1" = 60'  
 PROJECT NO. 10365.0

FIGURE NO.  
**Figure 7**

**LEGEND**

- SUBCATCHMENT BOUNDARY
- SOILS BOUNDARY
- FLOWPATH

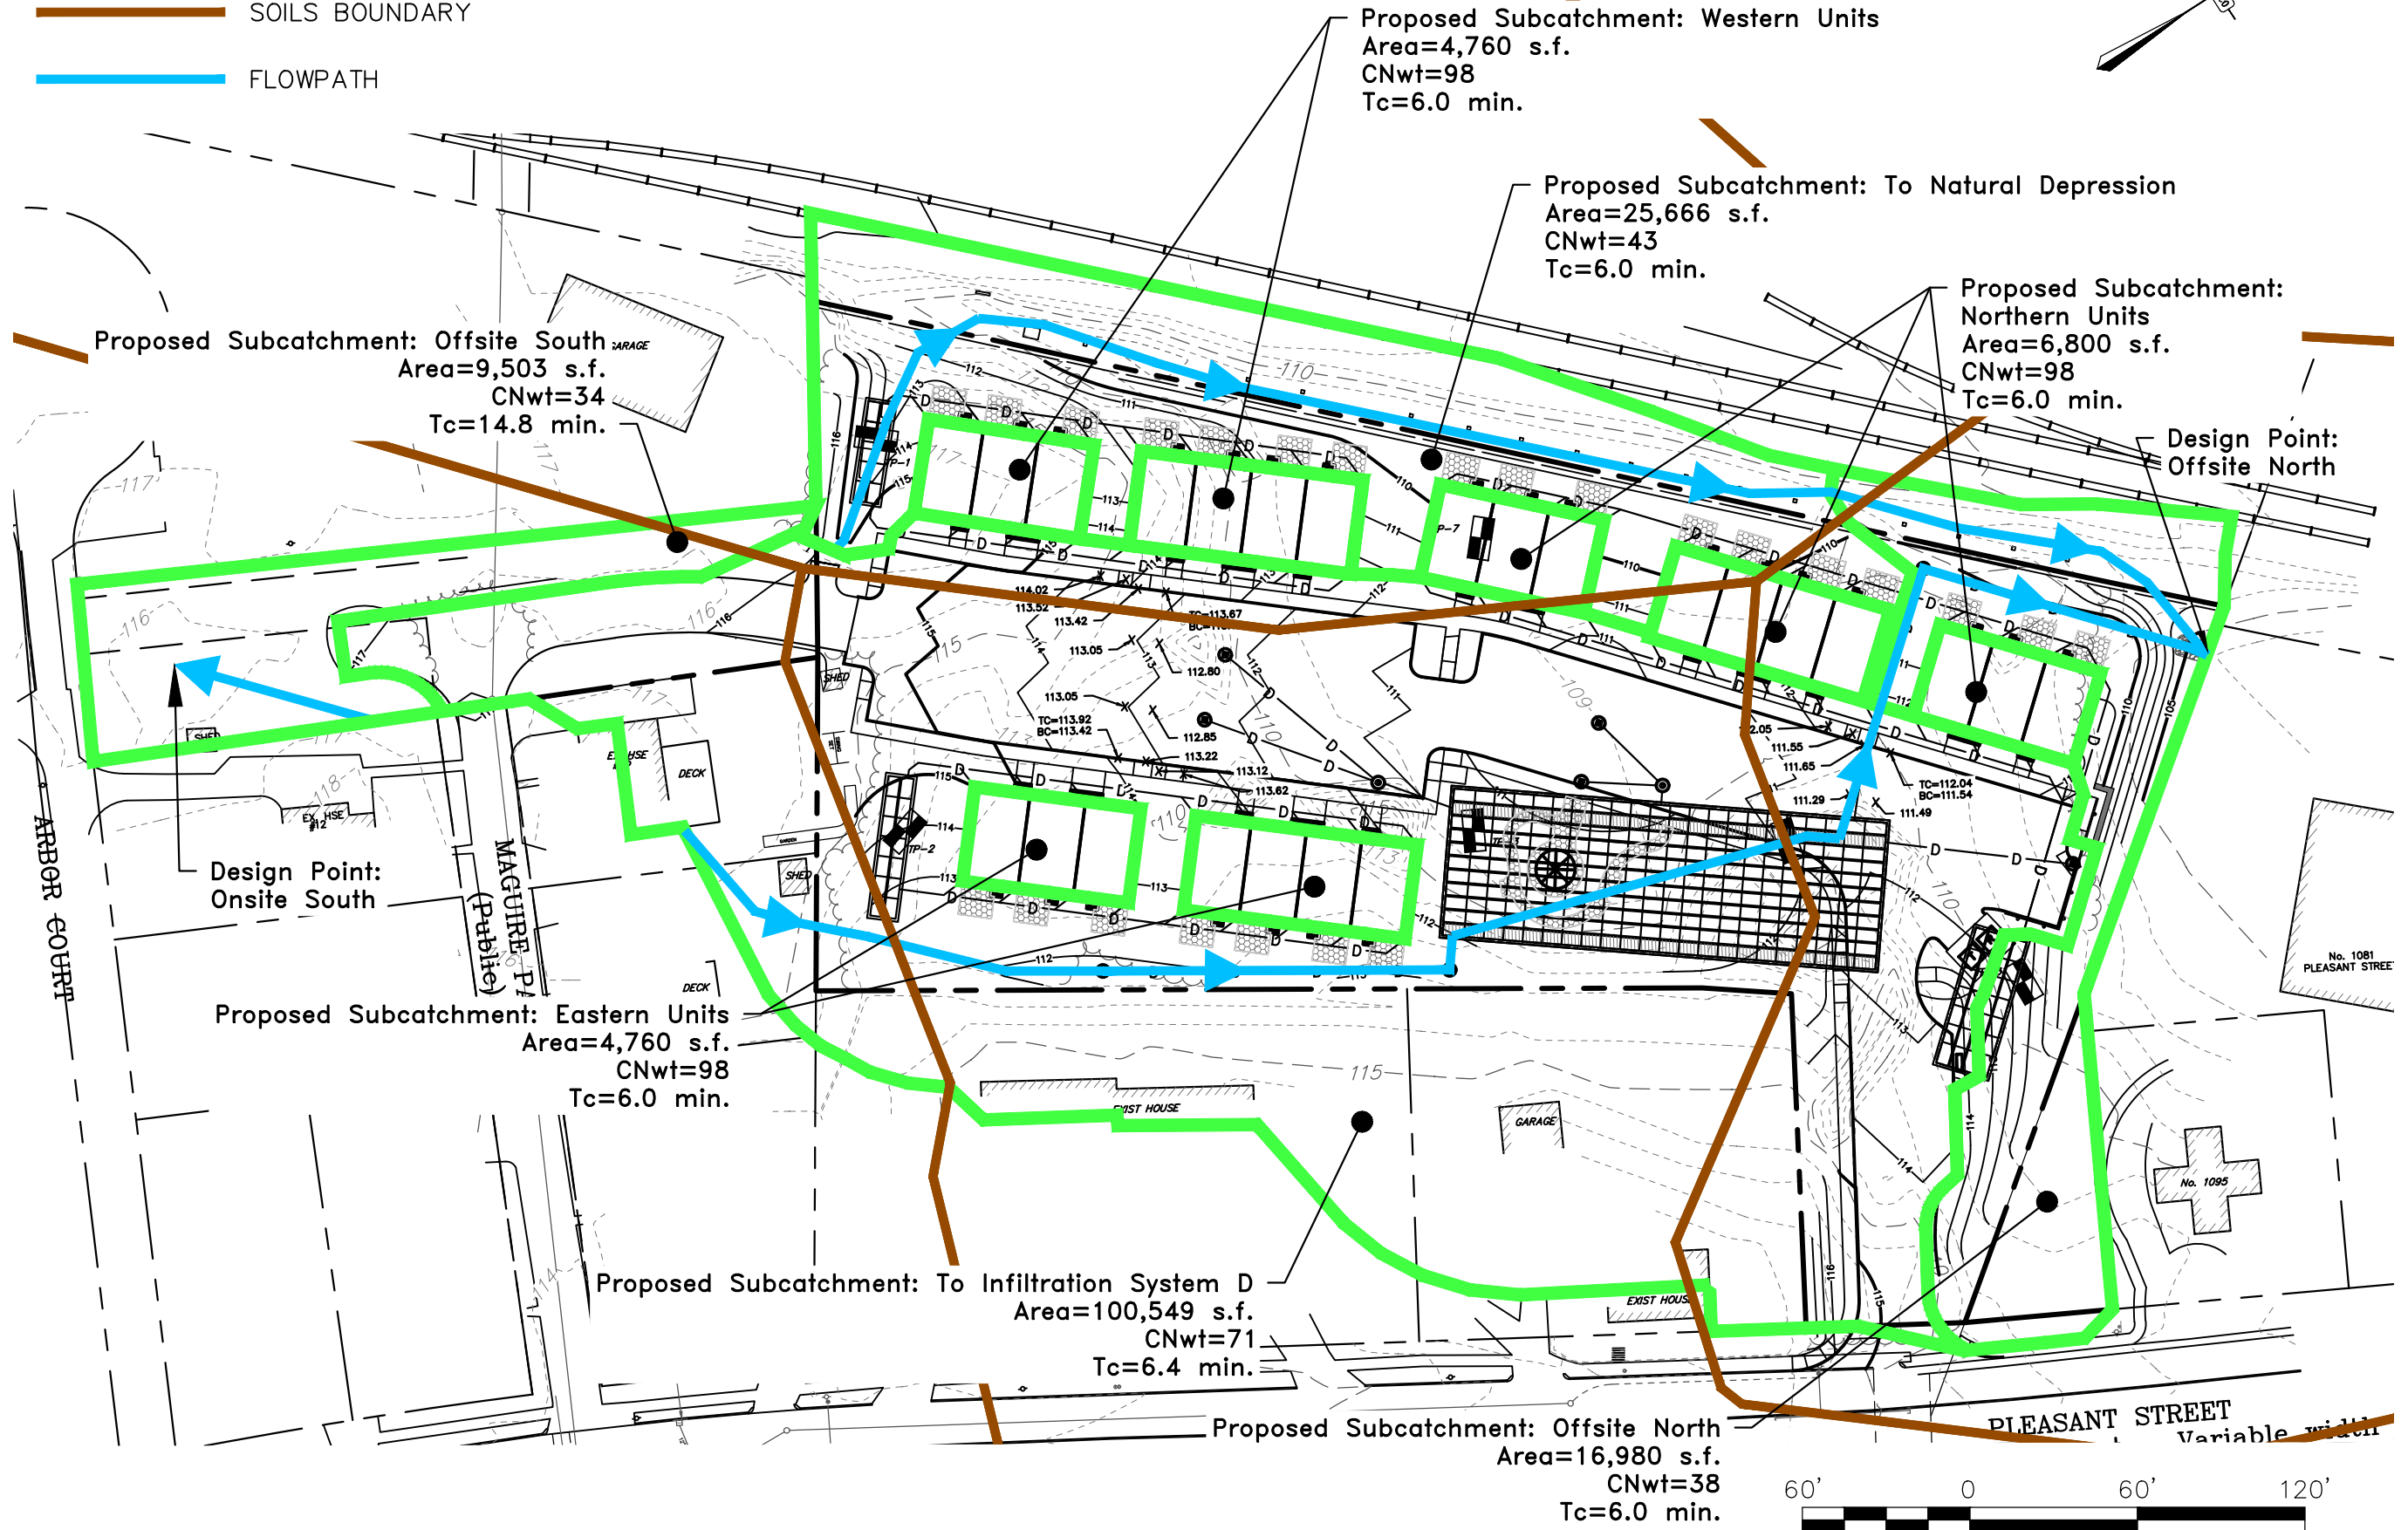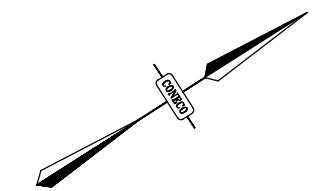

NO.	DATE	DESCRIPTION	DR/CK

PREPARED FOR:  
NEPONSET VILLAGE, LLC  
P.O. BOX 206  
ABINGTON, MA 02351

DRAWING:  
PROPOSED DRAINAGE AREAS

PROJECT:  
NEPONSET VILLAGE  
5 PLEASANT STREET  
WALPOLE, MA 02032

PLAN SET:  
REPORT FIGURES

**CONECO**  
Engineers & Scientists  
PHONE: 800-548-3355 WEBSITE: www.coneco.com

DATE: 09/14/2023  
DRAWN/CHECK: BTM/DJD  
SCALE: 1" = 60'  
PROJECT NO. 10365.0

FIGURE NO.  
**Figure 8**

# APPENDIX A








## EXISTING HYDROLOGICAL CONDITIONS

2-YEAR STORM EVENT

10-YEAR STORM EVENT

25-YEAR STORM EVENT

100-YEAR STORM EVENT

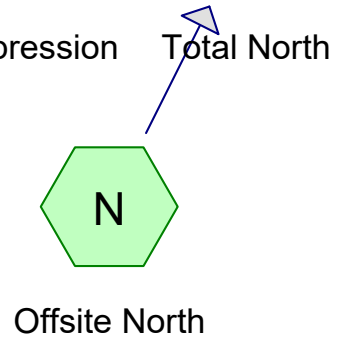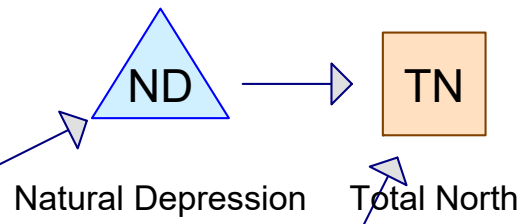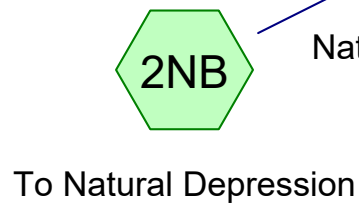

Routing Diagram for 10365 - Pleasant Street - Walpole -Existing Condition

Prepared by Coneco Engineers & Scientists, Printed 9/14/2023

HydroCAD® 10.10-5a s/n 03074 © 2020 HydroCAD Software Solutions LLC

**Summary for Subcatchment 2NB: To Natural Depression**

Runoff = 0.03 cfs @ 14.87 hrs, Volume= 535 cf, Depth> 0.05"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-Year Rainfall=3.20"

Area (sf)	CN	Adj	Description
35,288	30		Woods, Good, HSG A
16,322	39		>75% Grass cover, Good, HSG A
1,290	98		Unconnected pavement, HSG A
45,809	55		Woods, Good, HSG B
19,907	61		>75% Grass cover, Good, HSG B
2,149	98		Unconnected roofs, HSG B
120,765	48	47	Weighted Average, UI Adjusted
117,326			97.15% Pervious Area
3,439			2.85% Impervious Area
3,439			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.3	50	0.0400	0.20		<b>Sheet Flow, AB-Grass</b> Grass: Short n= 0.150 P2= 3.20"
1.1	76	0.0533	1.15		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
5.3	144	0.0083	0.46		<b>Shallow Concentrated Flow, CD-Woods</b> Woodland Kv= 5.0 fps
10.7	270	Total			

### Subcatchment 2NB: To Natural Depression

Hydrograph

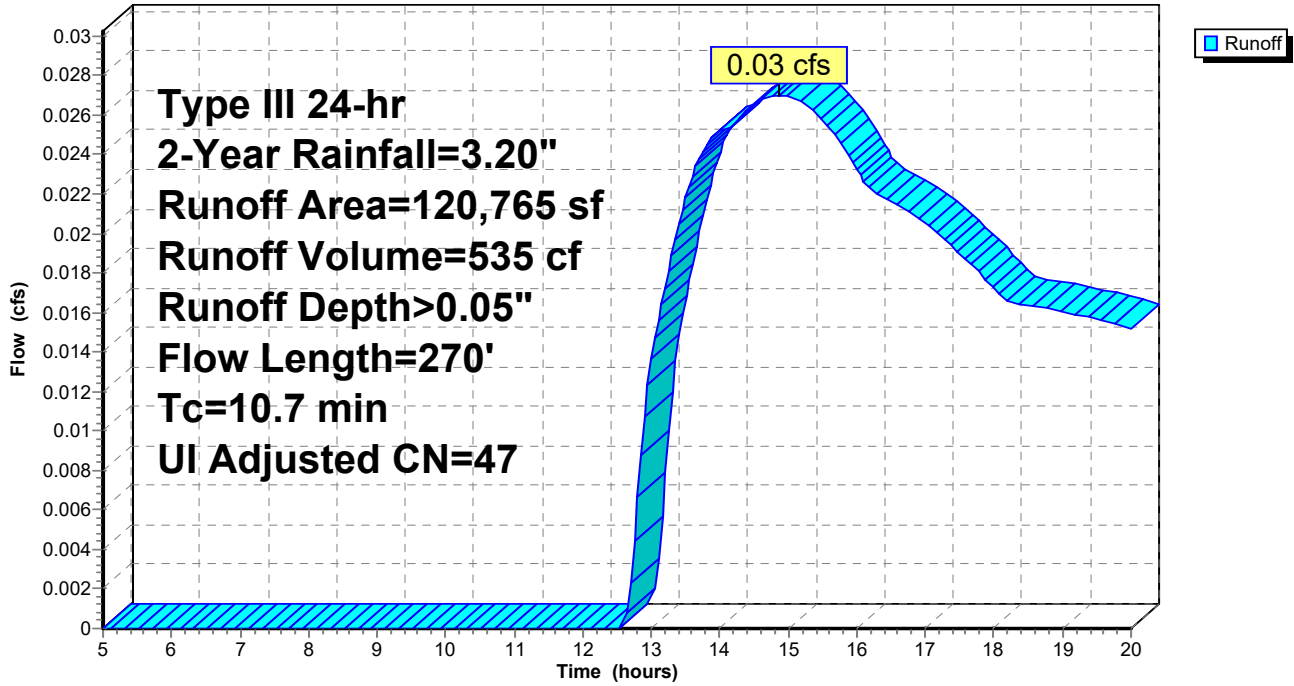

**Summary for Subcatchment N: Offsite North**

Runoff = 0.00 cfs @ 5.00 hrs, Volume= 0 cf, Depth= 0.00"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-Year Rainfall=3.20"

Area (sf)	CN	Adj	Description
25,134	30		Woods, Good, HSG A
2,727	39		>75% Grass cover, Good, HSG A
3,154	85		Gravel roads, HSG B
627	98		Unconnected pavement, HSG A
31,642	38	37	Weighted Average, UI Adjusted
31,015			98.02% Pervious Area
627			1.98% Impervious Area
627			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.3	50	0.0400	0.09		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
1.0	70	0.0500	1.12		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
10.3	120	Total			

**Subcatchment N: Offsite North**

Hydrograph

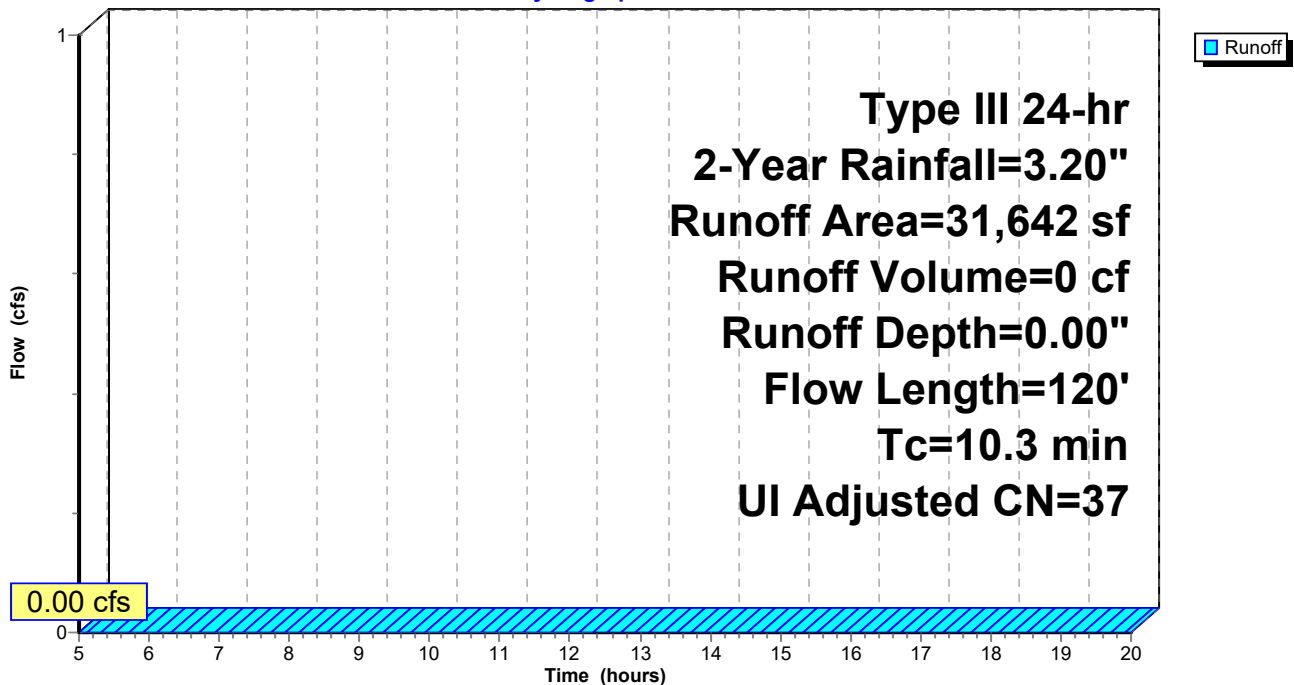



**Summary for Subcatchment S: Onsite South**

Runoff = 0.00 cfs @ 5.00 hrs, Volume= 0 cf, Depth= 0.00"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-Year Rainfall=3.20"

Area (sf)	CN	Adj	Description
13,154	30		Woods, Good, HSG A
2,356	39		>75% Grass cover, Good, HSG A
1,033	98		Unconnected roofs, HSG A
68	55		Woods, Good, HSG B
16,611	36	34	Weighted Average, UI Adjusted
15,578			93.78% Pervious Area
1,033			6.22% Impervious Area
1,033			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
13.8	50	0.0150	0.06		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
0.6	21	0.0150	0.61		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
14.4	71	Total			

**Subcatchment S: Onsite South**

Hydrograph

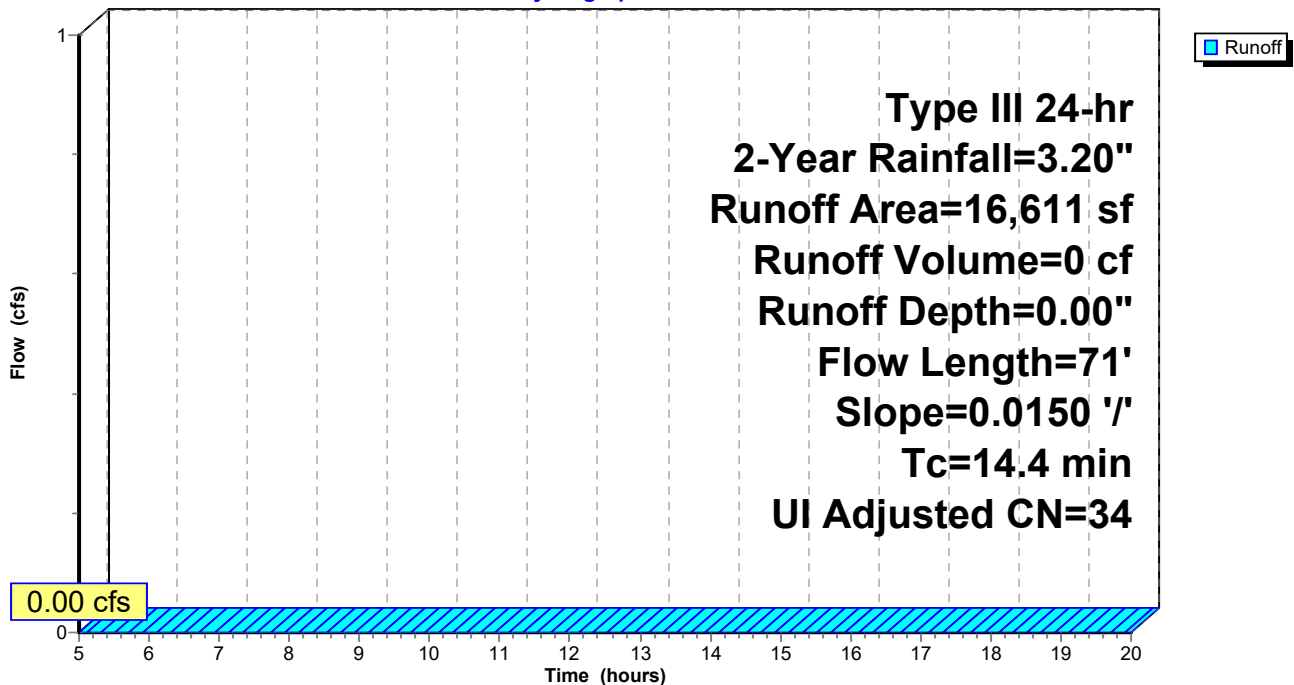


### Summary for Reach TN: Total North

Inflow Area = 152,407 sf, 2.67% Impervious, Inflow Depth = 0.00" for 2-Year event  
Inflow = 0.00 cfs @ 5.00 hrs, Volume= 0 cf  
Outflow = 0.00 cfs @ 5.00 hrs, Volume= 0 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

### Reach TN: Total North

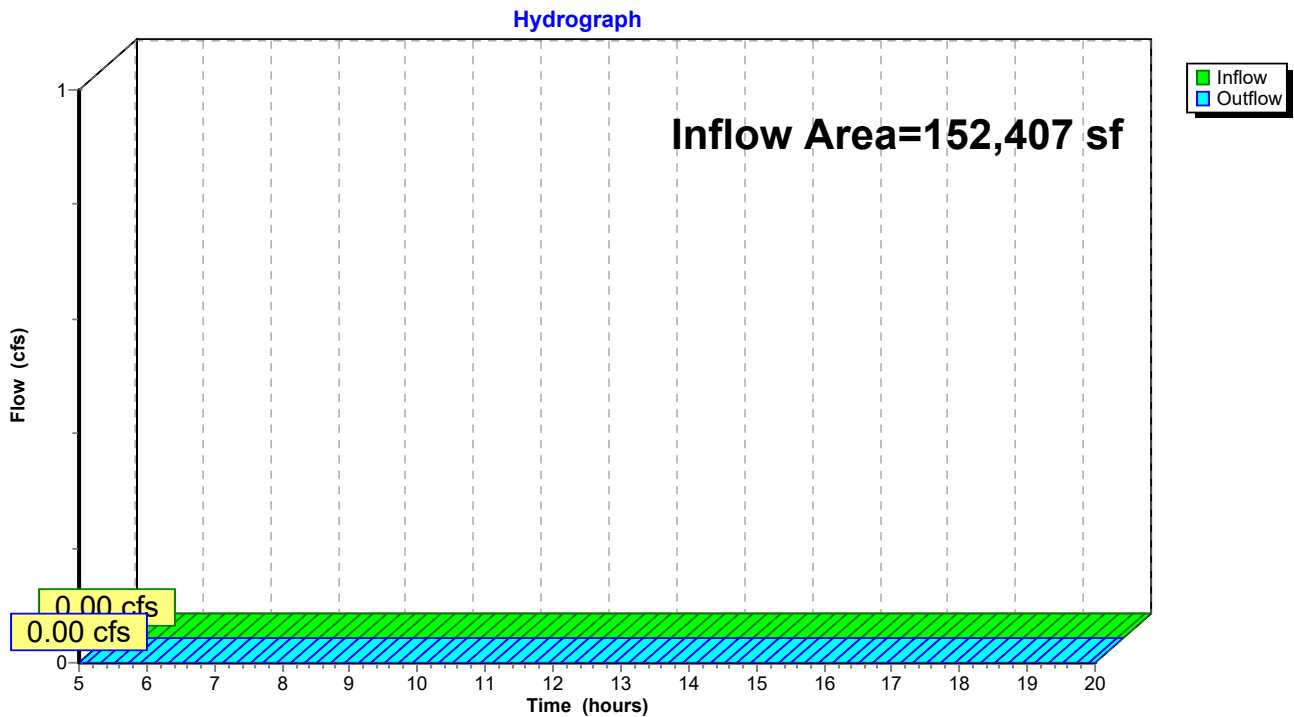

**Summary for Pond ND: Natural Depression**

Inflow Area = 120,765 sf, 2.85% Impervious, Inflow Depth > 0.05" for 2-Year event  
 Inflow = 0.03 cfs @ 14.87 hrs, Volume= 535 cf  
 Outflow = 0.02 cfs @ 15.87 hrs, Volume= 474 cf, Atten= 11%, Lag= 60.0 min  
 Discarded = 0.02 cfs @ 15.87 hrs, Volume= 474 cf  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 108.01' @ 15.87 hrs Surf.Area= 472 sf Storage= 89 cf

Plug-Flow detention time= 57.4 min calculated for 473 cf (88% of inflow)  
 Center-of-Mass det. time= 32.0 min ( 1,001.7 - 969.6 )

Volume	Invert	Avail.Storage	Storage Description			
#1	108.00'	15,537 cf	<b>Custom Stage Data (Irregular)</b> Listed below			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
108.00	235	88.4	0	0	235	
109.00	22,339	964.5	8,288	8,288	73,643	
109.30	26,033	945.2	7,249	15,537	76,590	


Device	Routing	Invert	Outlet Devices									
#1	Primary	109.00'	<b>2.0' long x 10.0' breadth Broad-Crested Rectangular Weir</b>									
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60									
			Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64									
#2	Discarded	108.00'	<b>2.410 in/hr Exfiltration over Surface area</b>									

**Discarded OutFlow** Max=0.03 cfs @ 15.87 hrs HW=108.01' (Free Discharge)  
 ↑**2=Exfiltration** (Exfiltration Controls 0.03 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=108.00' (Free Discharge)  
 ↑**1=Broad-Crested Rectangular Weir** ( Controls 0.00 cfs)

### Pond ND: Natural Depression

Hydrograph

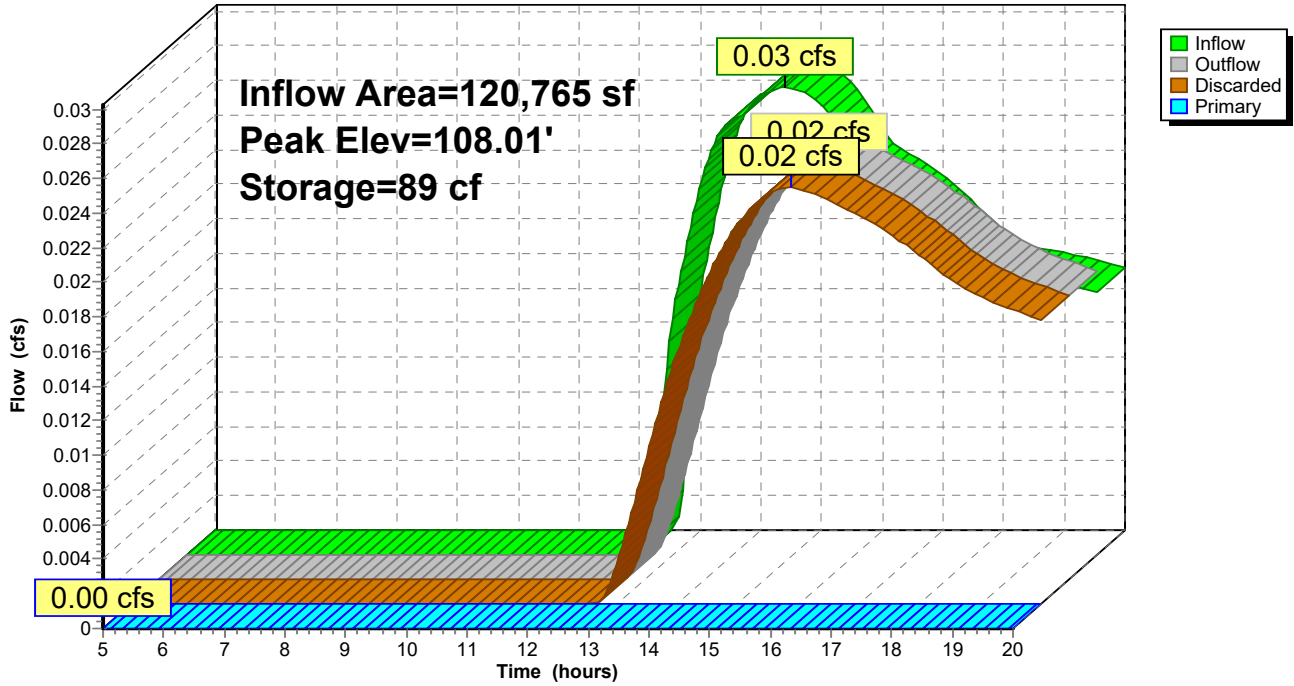

**10365 - Pleasant Street - Walpole -Existing Condition Type III 24-hr 2-Year Rainfall=3.20"**

Prepared by Coneco Engineers & Scientists

Printed 9/14/2023

HydroCAD® 10.10-5a s/n 03074 © 2020 HydroCAD Software Solutions LLC

Page 9

**Stage-Area-Storage for Pond ND: Natural Depression**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
108.00	235	0	109.06	23,078	9,738
108.02	677	166	109.08	23,324	10,221
108.04	1,119	332	109.10	23,570	10,705
108.06	1,561	497	109.12	23,817	11,188
108.08	2,003	663	109.14	24,063	11,671
108.10	2,445	829	109.16	24,309	12,154
108.12	2,887	995	109.18	24,555	12,638
108.14	3,330	1,160	109.20	24,802	13,121
108.16	3,772	1,326	109.22	25,048	13,604
108.18	4,214	1,492	109.24	25,294	14,087
108.20	4,656	1,658	109.26	25,540	14,571
108.22	5,098	1,823	109.28	25,787	15,054
108.24	5,540	1,989	109.30	<b>26,033</b>	<b>15,537</b>
108.26	5,982	2,155			
108.28	6,424	2,321			
108.30	6,866	2,487			
108.32	7,308	2,652			
108.34	7,750	2,818			
108.36	8,192	2,984			
108.38	8,635	3,150			
108.40	9,077	3,315			
108.42	9,519	3,481			
108.44	9,961	3,647			
108.46	10,403	3,813			
108.48	10,845	3,978			
108.50	11,287	4,144			
108.52	11,729	4,310			
108.54	12,171	4,476			
108.56	12,613	4,642			
108.58	13,055	4,807			
108.60	13,497	4,973			
108.62	13,939	5,139			
108.64	14,382	5,305			
108.66	14,824	5,470			
108.68	15,266	5,636			
108.70	15,708	5,802			
108.72	16,150	5,968			
108.74	16,592	6,133			
108.76	17,034	6,299			
108.78	17,476	6,465			
108.80	17,918	6,631			
108.82	18,360	6,796			
108.84	18,802	6,962			
108.86	19,244	7,128			
108.88	19,687	7,294			
108.90	20,129	7,460			
108.92	20,571	7,625			
108.94	21,013	7,791			
108.96	21,455	7,957			
108.98	21,897	8,123			
109.00	22,339	8,288			
109.02	22,585	8,772			
109.04	22,832	9,255			

**Summary for Subcatchment 2NB: To Natural Depression**


Runoff = 0.54 cfs @ 12.37 hrs, Volume= 3,717 cf, Depth> 0.37"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-Year Rainfall=4.70"

Area (sf)	CN	Adj	Description
35,288	30		Woods, Good, HSG A
16,322	39		>75% Grass cover, Good, HSG A
1,290	98		Unconnected pavement, HSG A
45,809	55		Woods, Good, HSG B
19,907	61		>75% Grass cover, Good, HSG B
2,149	98		Unconnected roofs, HSG B
120,765	48	47	Weighted Average, UI Adjusted
117,326			97.15% Pervious Area
3,439			2.85% Impervious Area
3,439			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.3	50	0.0400	0.20		<b>Sheet Flow, AB-Grass</b> Grass: Short n= 0.150 P2= 3.20"
1.1	76	0.0533	1.15		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
5.3	144	0.0083	0.46		<b>Shallow Concentrated Flow, CD-Woods</b> Woodland Kv= 5.0 fps
10.7	270	Total			

### Subcatchment 2NB: To Natural Depression

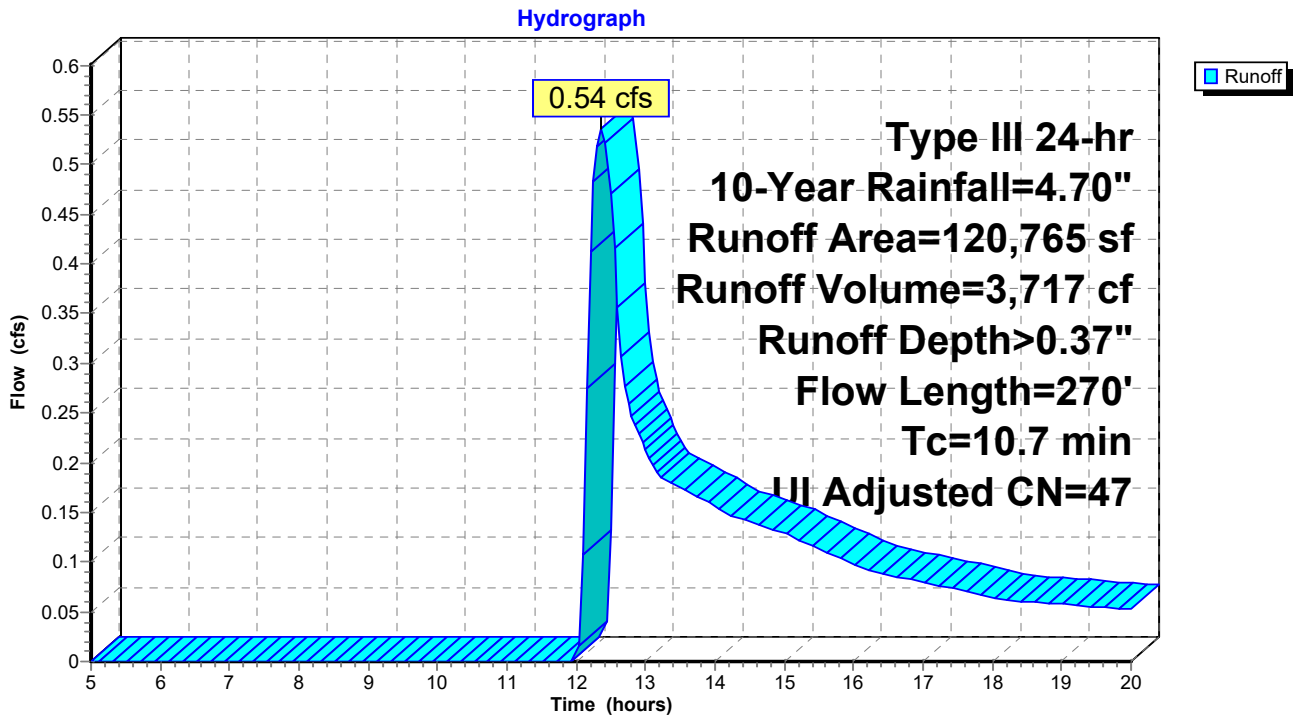

**Summary for Subcatchment N: Offsite North**

Runoff = 0.01 cfs @ 15.04 hrs, Volume= 171 cf, Depth> 0.06"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-Year Rainfall=4.70"

Area (sf)	CN	Adj	Description
25,134	30		Woods, Good, HSG A
2,727	39		>75% Grass cover, Good, HSG A
3,154	85		Gravel roads, HSG B
627	98		Unconnected pavement, HSG A
31,642	38	37	Weighted Average, UI Adjusted
31,015			98.02% Pervious Area
627			1.98% Impervious Area
627			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.3	50	0.0400	0.09		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
1.0	70	0.0500	1.12		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
10.3	120	Total			

**Subcatchment N: Offsite North**

Hydrograph

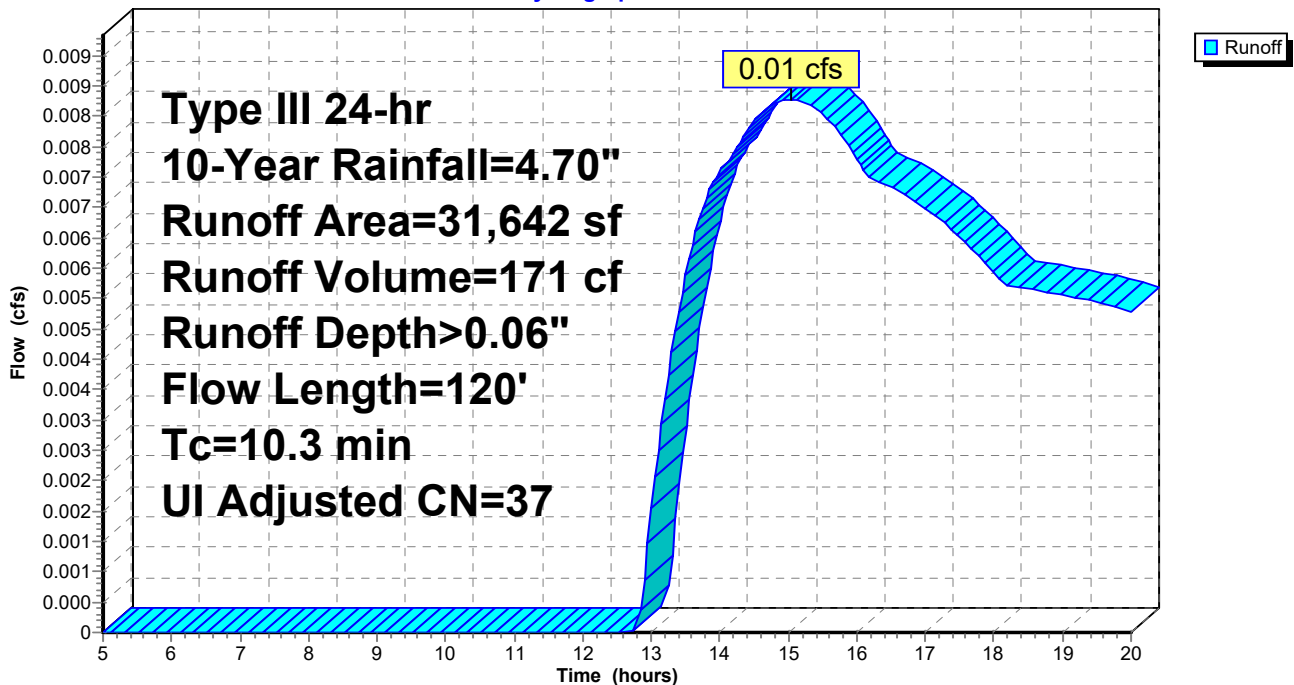



**Summary for Subcatchment S: Onsite South**

Runoff = 0.00 cfs @ 17.25 hrs, Volume= 25 cf, Depth> 0.02"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-Year Rainfall=4.70"

Area (sf)	CN	Adj	Description
13,154	30		Woods, Good, HSG A
2,356	39		>75% Grass cover, Good, HSG A
1,033	98		Unconnected roofs, HSG A
68	55		Woods, Good, HSG B
16,611	36	34	Weighted Average, UI Adjusted
15,578			93.78% Pervious Area
1,033			6.22% Impervious Area
1,033			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
13.8	50	0.0150	0.06		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
0.6	21	0.0150	0.61		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
14.4	71	Total			

**Subcatchment S: Onsite South**

Hydrograph

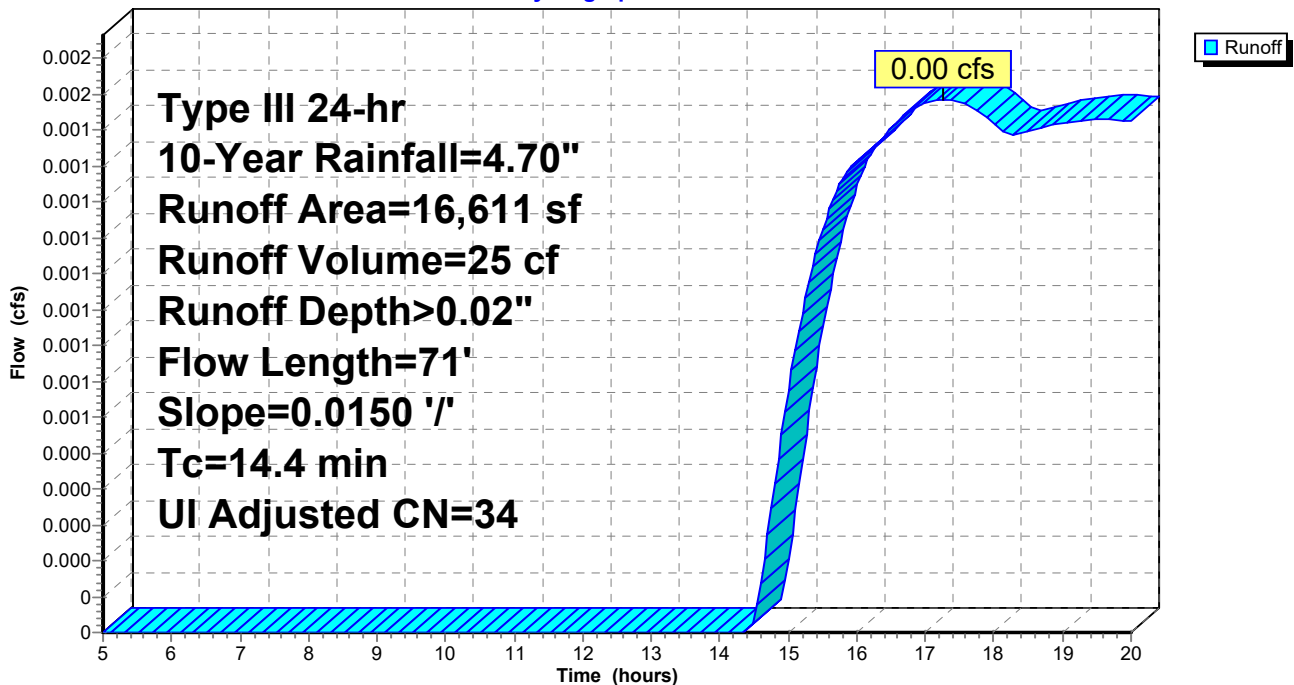


### Summary for Reach TN: Total North

Inflow Area = 152,407 sf, 2.67% Impervious, Inflow Depth > 0.01" for 10-Year event  
Inflow = 0.01 cfs @ 15.04 hrs, Volume= 171 cf  
Outflow = 0.01 cfs @ 15.04 hrs, Volume= 171 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

### Reach TN: Total North

Hydrograph

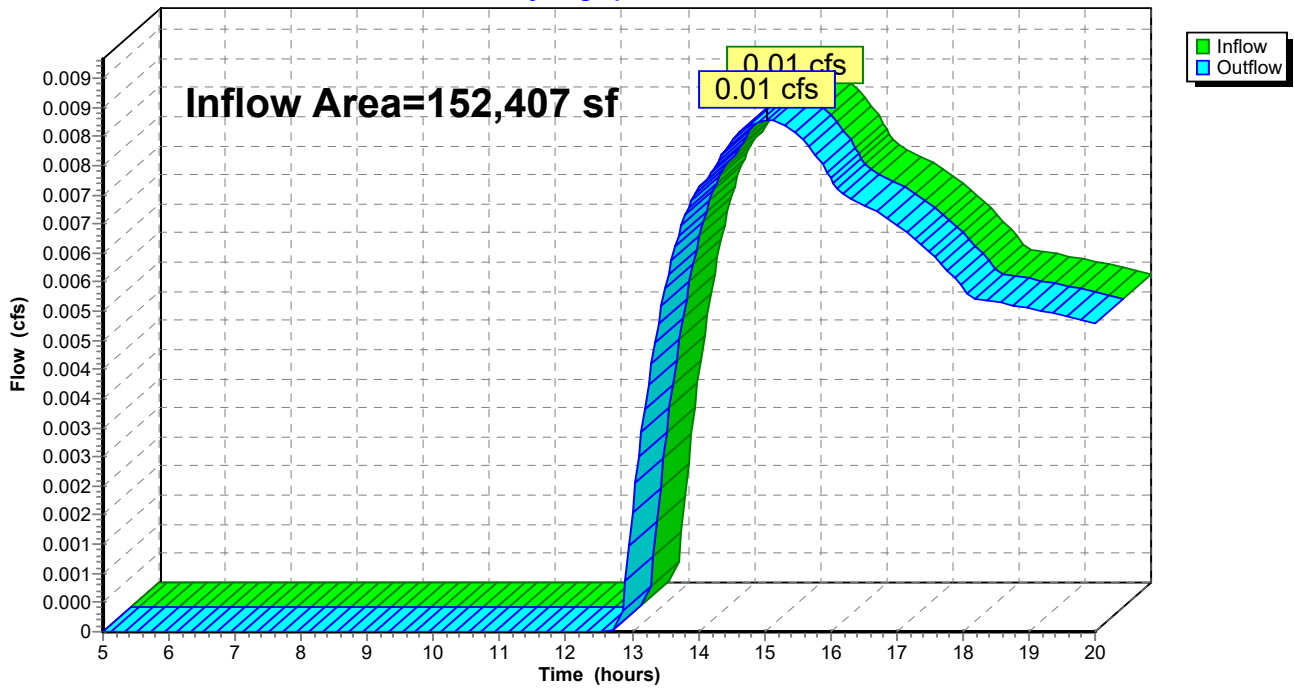

**Summary for Pond ND: Natural Depression**

Inflow Area = 120,765 sf, 2.85% Impervious, Inflow Depth > 0.37" for 10-Year event  
 Inflow = 0.54 cfs @ 12.37 hrs, Volume= 3,717 cf  
 Outflow = 0.16 cfs @ 13.98 hrs, Volume= 3,334 cf, Atten= 71%, Lag= 97.0 min  
 Discarded = 0.16 cfs @ 13.98 hrs, Volume= 3,334 cf  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 108.12' @ 13.98 hrs Surf.Area= 2,795 sf Storage= 960 cf

Plug-Flow detention time= 92.9 min calculated for 3,323 cf (89% of inflow)  
 Center-of-Mass det. time= 62.7 min ( 943.5 - 880.8 )


Volume	Invert	Avail.Storage	Storage Description			
#1	108.00'	15,537 cf	<b>Custom Stage Data (Irregular)</b> Listed below			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
108.00	235	88.4	0	0	235	
109.00	22,339	964.5	8,288	8,288	73,643	
109.30	26,033	945.2	7,249	15,537	76,590	

Device	Routing	Invert	Outlet Devices									
#1	Primary	109.00'	<b>2.0' long x 10.0' breadth Broad-Crested Rectangular Weir</b>									
			Head (feet)	0.20	0.40	0.60	0.80	1.00	1.20	1.40	1.60	
			Coef. (English)	2.49	2.56	2.70	2.69	2.68	2.69	2.67	2.64	
#2	Discarded	108.00'	<b>2.410 in/hr Exfiltration over Surface area</b>									

**Discarded OutFlow** Max=0.16 cfs @ 13.98 hrs HW=108.12' (Free Discharge)  
 ↑2=Exfiltration (Exfiltration Controls 0.16 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=108.00' (Free Discharge)  
 ↑1=Broad-Crested Rectangular Weir ( Controls 0.00 cfs)

### Pond ND: Natural Depression

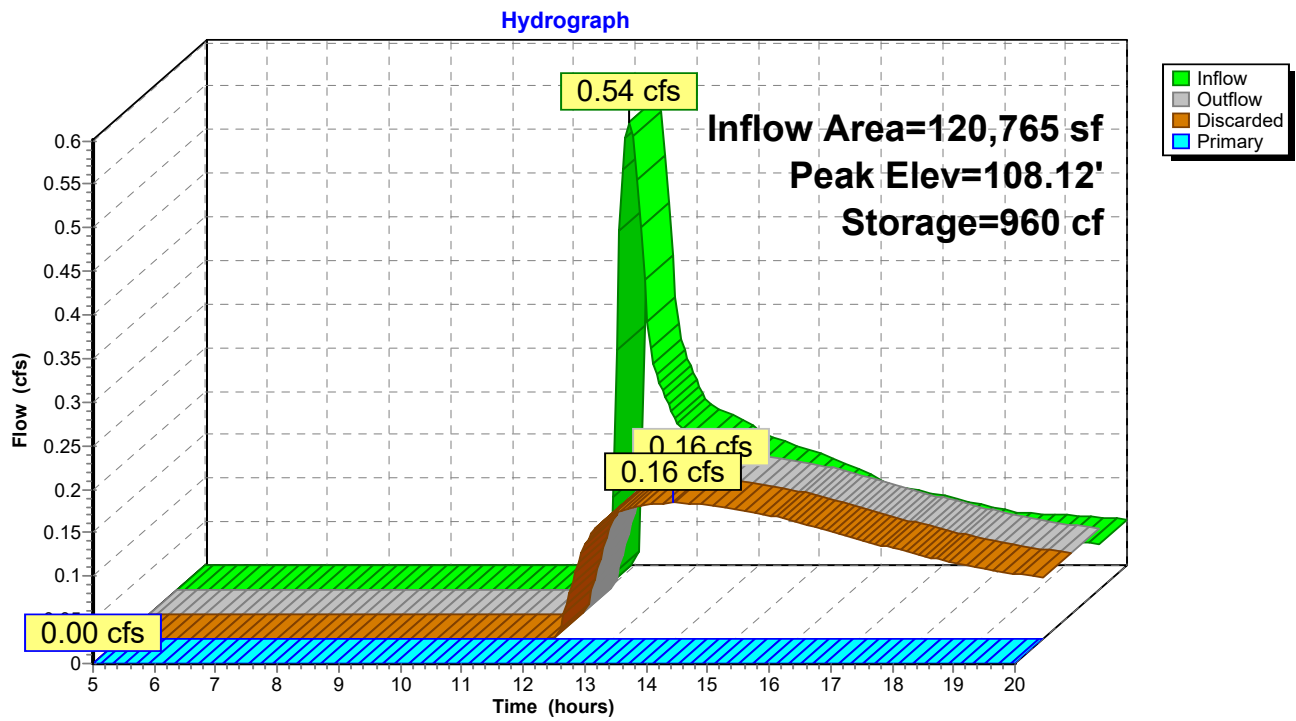

**Stage-Area-Storage for Pond ND: Natural Depression**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
108.00	235	0	109.06	23,078	9,738
108.02	677	166	109.08	23,324	10,221
108.04	1,119	332	109.10	23,570	10,705
108.06	1,561	497	109.12	23,817	11,188
108.08	2,003	663	109.14	24,063	11,671
108.10	2,445	829	109.16	24,309	12,154
108.12	2,887	995	109.18	24,555	12,638
108.14	3,330	1,160	109.20	24,802	13,121
108.16	3,772	1,326	109.22	25,048	13,604
108.18	4,214	1,492	109.24	25,294	14,087
108.20	4,656	1,658	109.26	25,540	14,571
108.22	5,098	1,823	109.28	25,787	15,054
108.24	5,540	1,989	109.30	<b>26,033</b>	<b>15,537</b>
108.26	5,982	2,155			
108.28	6,424	2,321			
108.30	6,866	2,487			
108.32	7,308	2,652			
108.34	7,750	2,818			
108.36	8,192	2,984			
108.38	8,635	3,150			
108.40	9,077	3,315			
108.42	9,519	3,481			
108.44	9,961	3,647			
108.46	10,403	3,813			
108.48	10,845	3,978			
108.50	11,287	4,144			
108.52	11,729	4,310			
108.54	12,171	4,476			
108.56	12,613	4,642			
108.58	13,055	4,807			
108.60	13,497	4,973			
108.62	13,939	5,139			
108.64	14,382	5,305			
108.66	14,824	5,470			
108.68	15,266	5,636			
108.70	15,708	5,802			
108.72	16,150	5,968			
108.74	16,592	6,133			
108.76	17,034	6,299			
108.78	17,476	6,465			
108.80	17,918	6,631			
108.82	18,360	6,796			
108.84	18,802	6,962			
108.86	19,244	7,128			
108.88	19,687	7,294			
108.90	20,129	7,460			
108.92	20,571	7,625			
108.94	21,013	7,791			
108.96	21,455	7,957			
108.98	21,897	8,123			
109.00	22,339	8,288			
109.02	22,585	8,772			
109.04	22,832	9,255			

**Summary for Subcatchment 2NB: To Natural Depression**


Runoff = 1.19 cfs @ 12.22 hrs, Volume= 6,337 cf, Depth> 0.63"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-Year Rainfall=5.50"

Area (sf)	CN	Adj	Description
35,288	30		Woods, Good, HSG A
16,322	39		>75% Grass cover, Good, HSG A
1,290	98		Unconnected pavement, HSG A
45,809	55		Woods, Good, HSG B
19,907	61		>75% Grass cover, Good, HSG B
2,149	98		Unconnected roofs, HSG B
120,765	48	47	Weighted Average, UI Adjusted
117,326			97.15% Pervious Area
3,439			2.85% Impervious Area
3,439			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.3	50	0.0400	0.20		<b>Sheet Flow, AB-Grass</b> Grass: Short n= 0.150 P2= 3.20"
1.1	76	0.0533	1.15		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
5.3	144	0.0083	0.46		<b>Shallow Concentrated Flow, CD-Woods</b> Woodland Kv= 5.0 fps
10.7	270	Total			

### Subcatchment 2NB: To Natural Depression

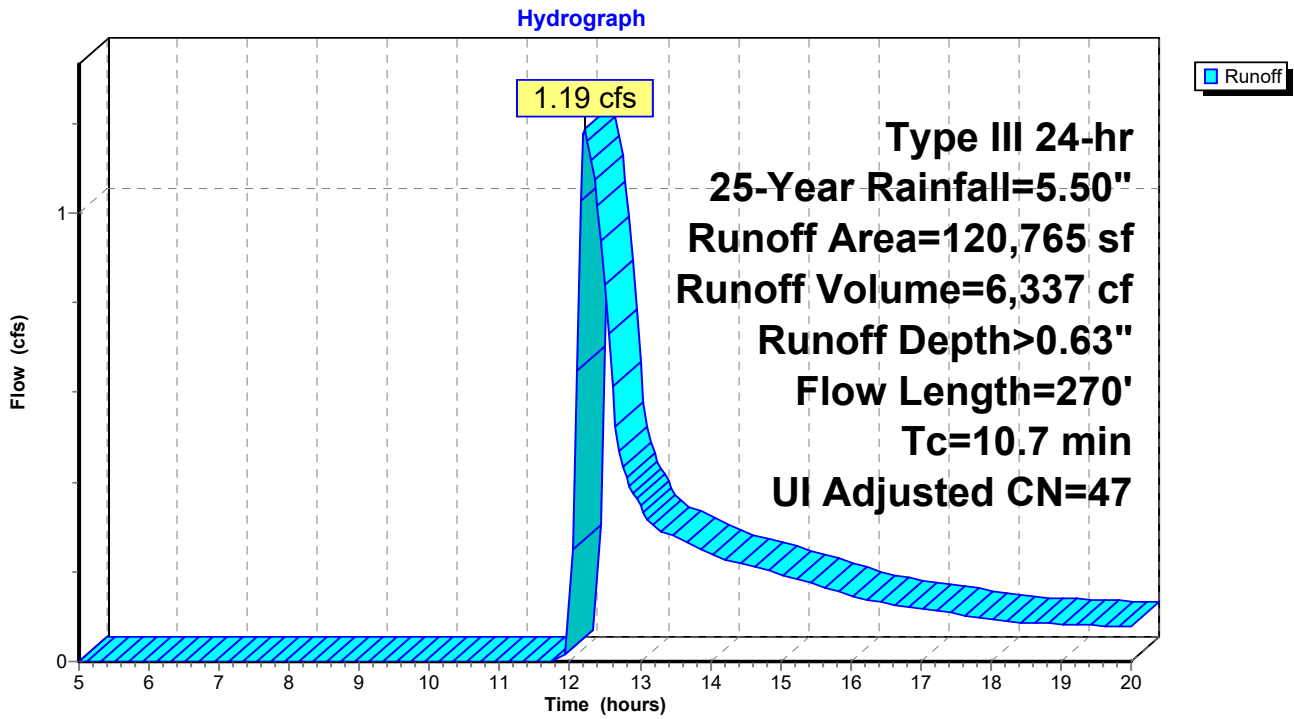

**Summary for Subcatchment N: Offsite North**

Runoff = 0.03 cfs @ 12.54 hrs, Volume= 477 cf, Depth> 0.18"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-Year Rainfall=5.50"

Area (sf)	CN	Adj	Description
25,134	30		Woods, Good, HSG A
2,727	39		>75% Grass cover, Good, HSG A
3,154	85		Gravel roads, HSG B
627	98		Unconnected pavement, HSG A
31,642	38	37	Weighted Average, UI Adjusted
31,015			98.02% Pervious Area
627			1.98% Impervious Area
627			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.3	50	0.0400	0.09		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
1.0	70	0.0500	1.12		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
10.3	120	Total			

**Subcatchment N: Offsite North**

Hydrograph

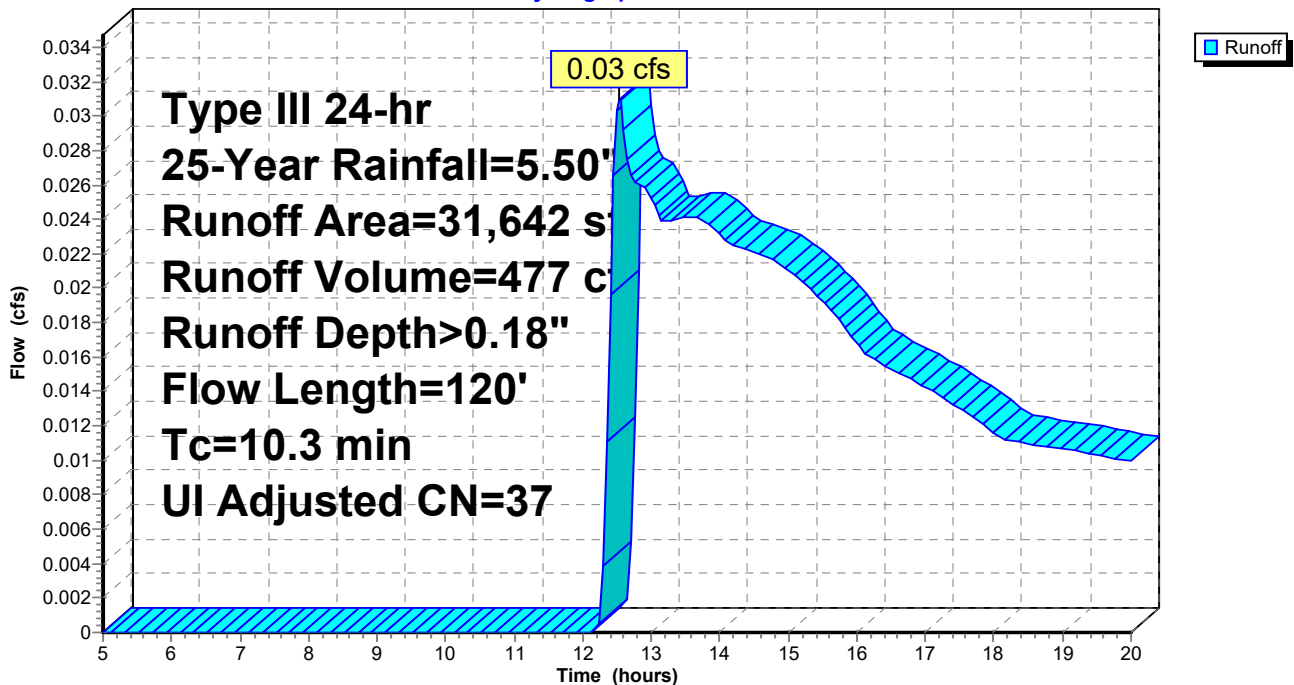



**Summary for Subcatchment S: Onsite South**

Runoff = 0.01 cfs @ 14.94 hrs, Volume= 124 cf, Depth> 0.09"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-Year Rainfall=5.50"

Area (sf)	CN	Adj	Description
13,154	30		Woods, Good, HSG A
2,356	39		>75% Grass cover, Good, HSG A
1,033	98		Unconnected roofs, HSG A
68	55		Woods, Good, HSG B
16,611	36	34	Weighted Average, UI Adjusted
15,578			93.78% Pervious Area
1,033			6.22% Impervious Area
1,033			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
13.8	50	0.0150	0.06		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
0.6	21	0.0150	0.61		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
14.4	71	Total			

**Subcatchment S: Onsite South**

Hydrograph

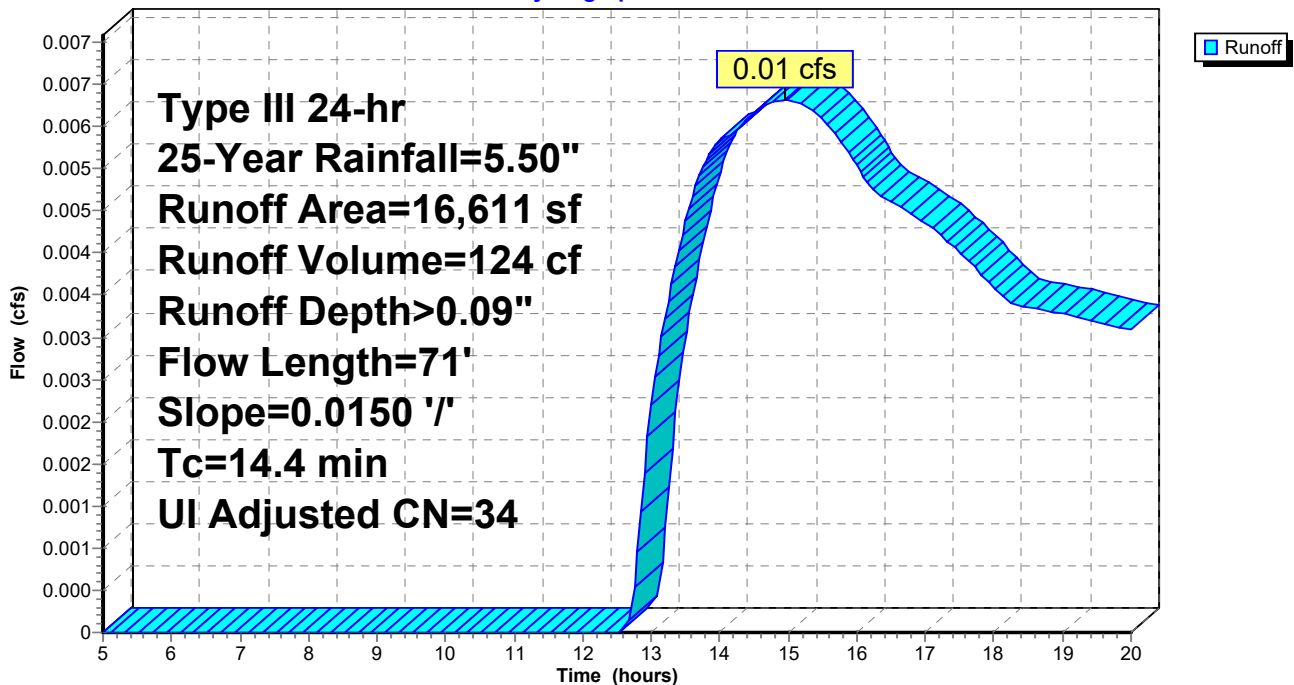


**Summary for Reach TN: Total North**

Inflow Area = 152,407 sf, 2.67% Impervious, Inflow Depth > 0.04" for 25-Year event  
 Inflow = 0.03 cfs @ 12.54 hrs, Volume= 477 cf  
 Outflow = 0.03 cfs @ 12.54 hrs, Volume= 477 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

**Reach TN: Total North**

Hydrograph

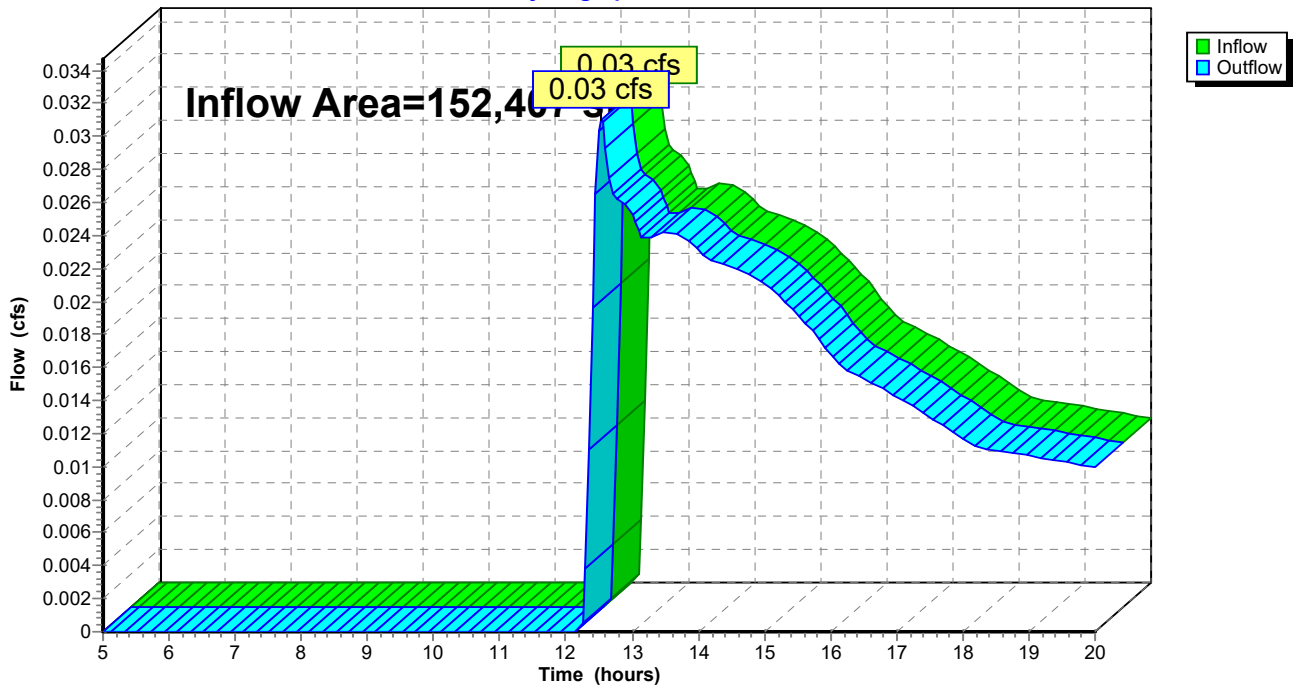

**Summary for Pond ND: Natural Depression**

Inflow Area = 120,765 sf, 2.85% Impervious, Inflow Depth > 0.63" for 25-Year event  
 Inflow = 1.19 cfs @ 12.22 hrs, Volume= 6,337 cf  
 Outflow = 0.29 cfs @ 13.35 hrs, Volume= 5,719 cf, Atten= 76%, Lag= 68.0 min  
 Discarded = 0.29 cfs @ 13.35 hrs, Volume= 5,719 cf  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 108.22' @ 13.35 hrs Surf.Area= 5,148 sf Storage= 1,842 cf

Plug-Flow detention time= 97.8 min calculated for 5,719 cf (90% of inflow)  
 Center-of-Mass det. time= 68.1 min ( 930.8 - 862.7 )


Volume	Invert	Avail.Storage	Storage Description			
#1	108.00'	15,537 cf	<b>Custom Stage Data (Irregular)</b> Listed below			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
108.00	235	88.4	0	0	235	
109.00	22,339	964.5	8,288	8,288	73,643	
109.30	26,033	945.2	7,249	15,537	76,590	

Device	Routing	Invert	Outlet Devices									
#1	Primary	109.00'	<b>2.0' long x 10.0' breadth Broad-Crested Rectangular Weir</b>									
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60									
			Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64									
#2	Discarded	108.00'	<b>2.410 in/hr Exfiltration over Surface area</b>									

**Discarded OutFlow** Max=0.29 cfs @ 13.35 hrs HW=108.22' (Free Discharge)  
 ↑**2=Exfiltration** (Exfiltration Controls 0.29 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=108.00' (Free Discharge)  
 ↑**1=Broad-Crested Rectangular Weir** ( Controls 0.00 cfs)

### Pond ND: Natural Depression

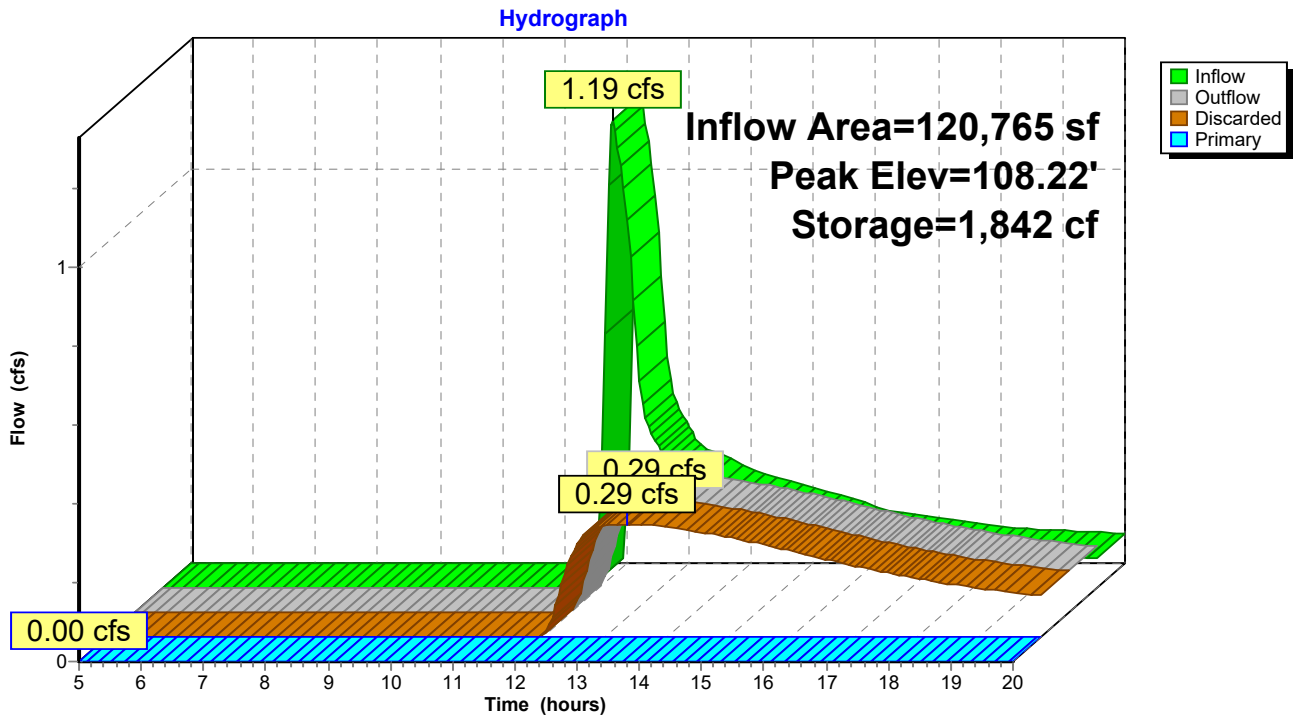

**Stage-Area-Storage for Pond ND: Natural Depression**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
108.00	235	0	109.06	23,078	9,738
108.02	677	166	109.08	23,324	10,221
108.04	1,119	332	109.10	23,570	10,705
108.06	1,561	497	109.12	23,817	11,188
108.08	2,003	663	109.14	24,063	11,671
108.10	2,445	829	109.16	24,309	12,154
108.12	2,887	995	109.18	24,555	12,638
108.14	3,330	1,160	109.20	24,802	13,121
108.16	3,772	1,326	109.22	25,048	13,604
108.18	4,214	1,492	109.24	25,294	14,087
108.20	4,656	1,658	109.26	25,540	14,571
108.22	5,098	1,823	109.28	25,787	15,054
108.24	5,540	1,989	109.30	<b>26,033</b>	<b>15,537</b>
108.26	5,982	2,155			
108.28	6,424	2,321			
108.30	6,866	2,487			
108.32	7,308	2,652			
108.34	7,750	2,818			
108.36	8,192	2,984			
108.38	8,635	3,150			
108.40	9,077	3,315			
108.42	9,519	3,481			
108.44	9,961	3,647			
108.46	10,403	3,813			
108.48	10,845	3,978			
108.50	11,287	4,144			
108.52	11,729	4,310			
108.54	12,171	4,476			
108.56	12,613	4,642			
108.58	13,055	4,807			
108.60	13,497	4,973			
108.62	13,939	5,139			
108.64	14,382	5,305			
108.66	14,824	5,470			
108.68	15,266	5,636			
108.70	15,708	5,802			
108.72	16,150	5,968			
108.74	16,592	6,133			
108.76	17,034	6,299			
108.78	17,476	6,465			
108.80	17,918	6,631			
108.82	18,360	6,796			
108.84	18,802	6,962			
108.86	19,244	7,128			
108.88	19,687	7,294			
108.90	20,129	7,460			
108.92	20,571	7,625			
108.94	21,013	7,791			
108.96	21,455	7,957			
108.98	21,897	8,123			
109.00	22,339	8,288			
109.02	22,585	8,772			
109.04	22,832	9,255			

**Summary for Subcatchment 2NB: To Natural Depression**


Runoff = 2.65 cfs @ 12.19 hrs, Volume= 11,208 cf, Depth> 1.11"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-Year Rainfall=6.70"

Area (sf)	CN	Adj	Description
35,288	30		Woods, Good, HSG A
16,322	39		>75% Grass cover, Good, HSG A
1,290	98		Unconnected pavement, HSG A
45,809	55		Woods, Good, HSG B
19,907	61		>75% Grass cover, Good, HSG B
2,149	98		Unconnected roofs, HSG B
120,765	48	47	Weighted Average, UI Adjusted
117,326			97.15% Pervious Area
3,439			2.85% Impervious Area
3,439			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.3	50	0.0400	0.20		<b>Sheet Flow, AB-Grass</b> Grass: Short n= 0.150 P2= 3.20"
1.1	76	0.0533	1.15		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
5.3	144	0.0083	0.46		<b>Shallow Concentrated Flow, CD-Woods</b> Woodland Kv= 5.0 fps
10.7	270	Total			

### Subcatchment 2NB: To Natural Depression

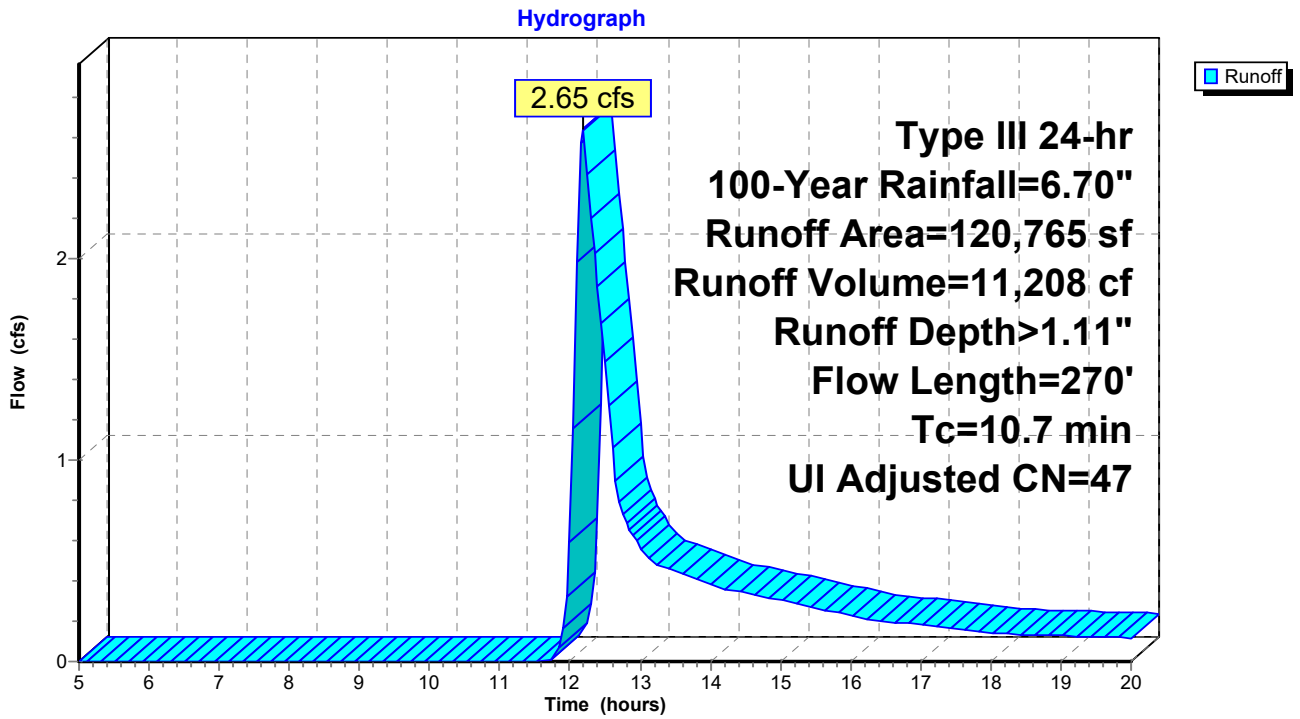

**Summary for Subcatchment N: Offsite North**

Runoff = 0.16 cfs @ 12.40 hrs, Volume= 1,181 cf, Depth> 0.45"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-Year Rainfall=6.70"

Area (sf)	CN	Adj	Description
25,134	30		Woods, Good, HSG A
2,727	39		>75% Grass cover, Good, HSG A
3,154	85		Gravel roads, HSG B
627	98		Unconnected pavement, HSG A
31,642	38	37	Weighted Average, UI Adjusted
31,015			98.02% Pervious Area
627			1.98% Impervious Area
627			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.3	50	0.0400	0.09		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
1.0	70	0.0500	1.12		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
10.3	120	Total			

**Subcatchment N: Offsite North**

Hydrograph

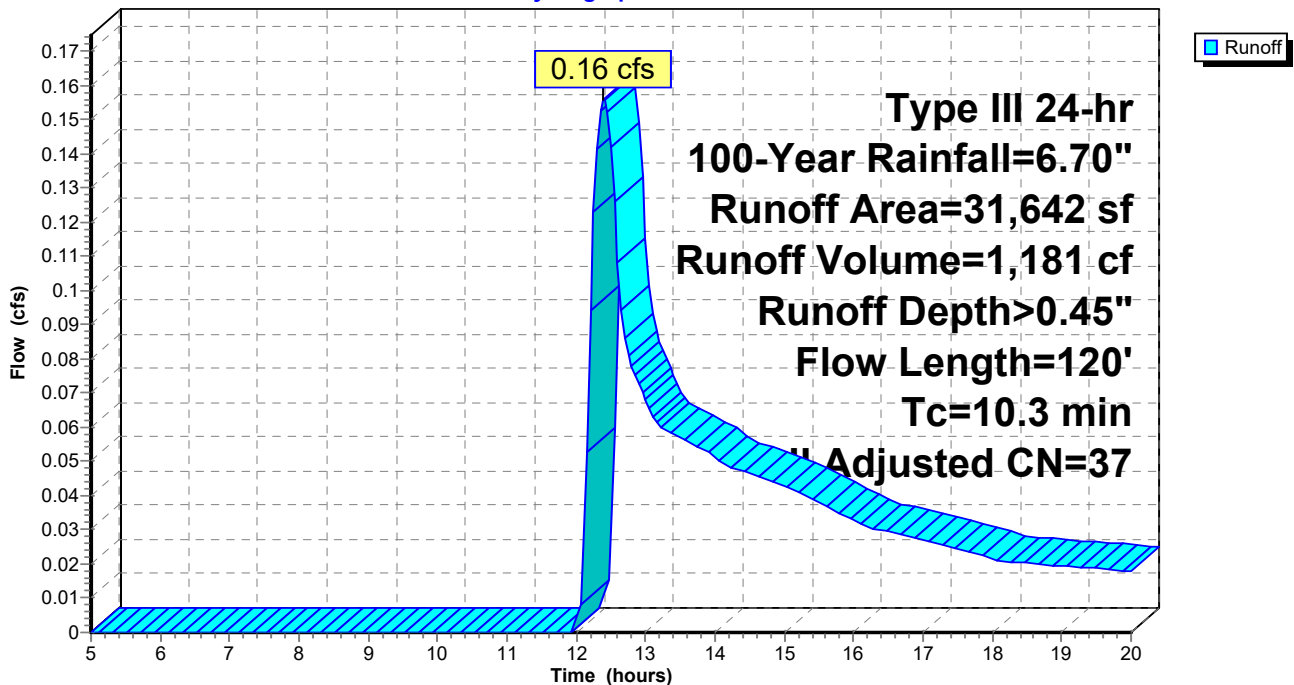



**Summary for Subcatchment S: Onsite South**

Runoff = 0.03 cfs @ 12.54 hrs, Volume= 398 cf, Depth> 0.29"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-Year Rainfall=6.70"

Area (sf)	CN	Adj	Description
13,154	30		Woods, Good, HSG A
2,356	39		>75% Grass cover, Good, HSG A
1,033	98		Unconnected roofs, HSG A
68	55		Woods, Good, HSG B
16,611	36	34	Weighted Average, UI Adjusted
15,578			93.78% Pervious Area
1,033			6.22% Impervious Area
1,033			100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
13.8	50	0.0150	0.06		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
0.6	21	0.0150	0.61		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
14.4	71	Total			

**Subcatchment S: Onsite South**

Hydrograph

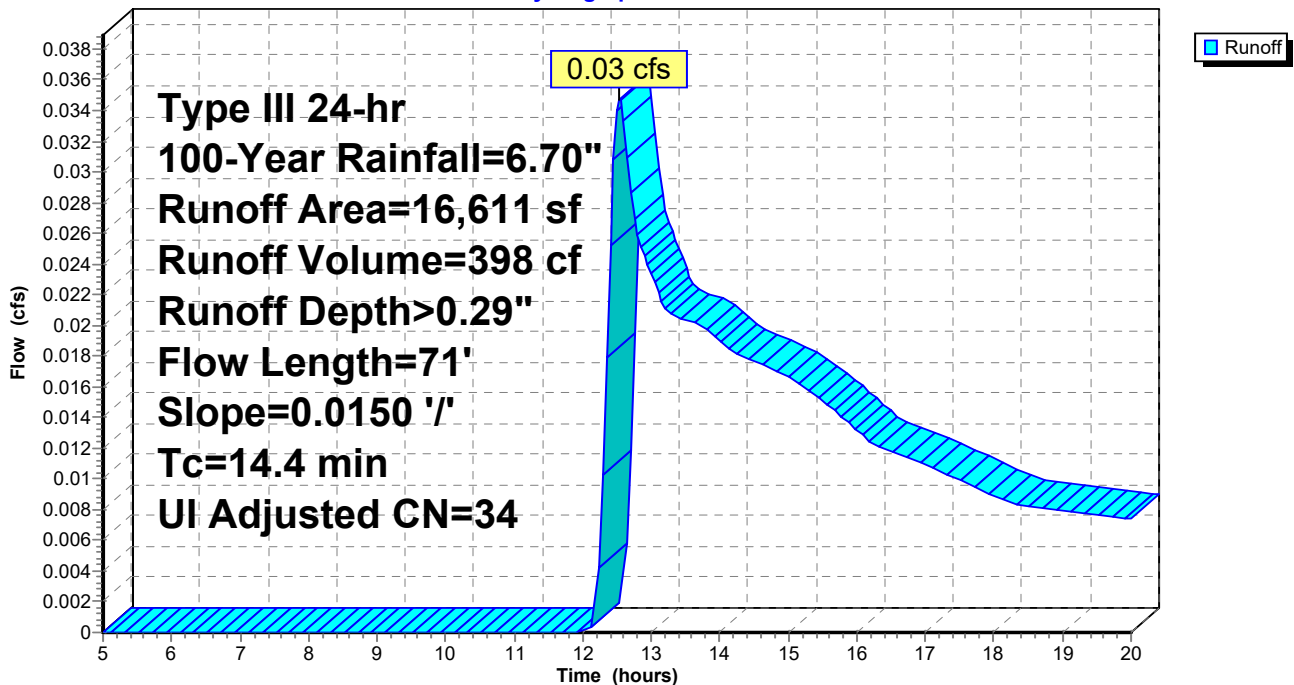


### Summary for Reach TN: Total North

Inflow Area = 152,407 sf, 2.67% Impervious, Inflow Depth > 0.09" for 100-Year event  
 Inflow = 0.16 cfs @ 12.40 hrs, Volume= 1,181 cf  
 Outflow = 0.16 cfs @ 12.40 hrs, Volume= 1,181 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

### Reach TN: Total North

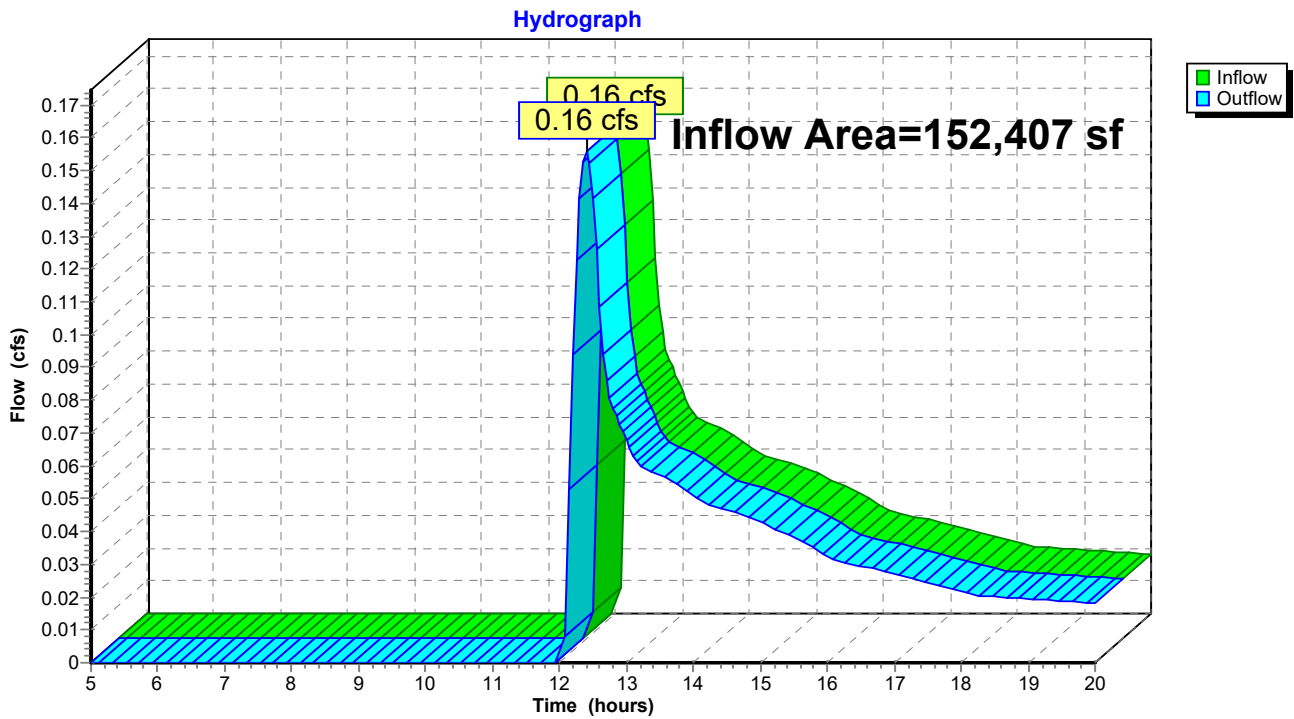

**Summary for Pond ND: Natural Depression**

Inflow Area = 120,765 sf, 2.85% Impervious, Inflow Depth > 1.11" for 100-Year event  
 Inflow = 2.65 cfs @ 12.19 hrs, Volume= 11,208 cf  
 Outflow = 0.56 cfs @ 13.02 hrs, Volume= 10,197 cf, Atten= 79%, Lag= 49.9 min  
 Discarded = 0.56 cfs @ 13.02 hrs, Volume= 10,197 cf  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 108.45' @ 13.02 hrs Surf.Area= 10,118 sf Storage= 3,706 cf

Plug-Flow detention time= 101.0 min calculated for 10,197 cf (91% of inflow)  
 Center-of-Mass det. time= 72.6 min ( 918.7 - 846.1 )


Volume	Invert	Avail.Storage	Storage Description			
#1	108.00'	15,537 cf	<b>Custom Stage Data (Irregular)</b> Listed below			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
108.00	235	88.4	0	0	235	
109.00	22,339	964.5	8,288	8,288	73,643	
109.30	26,033	945.2	7,249	15,537	76,590	

Device	Routing	Invert	Outlet Devices									
#1	Primary	109.00'	<b>2.0' long x 10.0' breadth Broad-Crested Rectangular Weir</b>									
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60									
			Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64									
#2	Discarded	108.00'	<b>2.410 in/hr Exfiltration over Surface area</b>									

**Discarded OutFlow** Max=0.56 cfs @ 13.02 hrs HW=108.45' (Free Discharge)  
 ↑2=Exfiltration (Exfiltration Controls 0.56 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=108.00' (Free Discharge)  
 ↑1=Broad-Crested Rectangular Weir ( Controls 0.00 cfs)

### Pond ND: Natural Depression

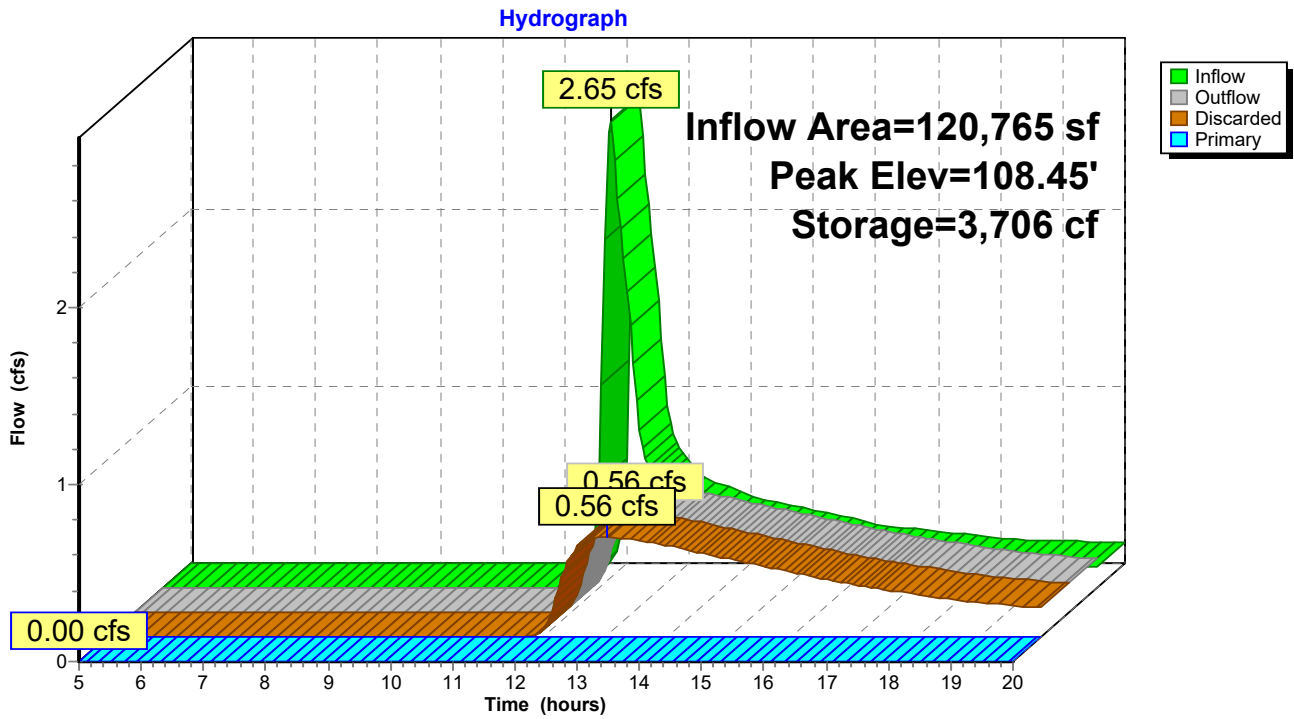

**Stage-Area-Storage for Pond ND: Natural Depression**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
108.00	235	0	109.06	23,078	9,738
108.02	677	166	109.08	23,324	10,221
108.04	1,119	332	109.10	23,570	10,705
108.06	1,561	497	109.12	23,817	11,188
108.08	2,003	663	109.14	24,063	11,671
108.10	2,445	829	109.16	24,309	12,154
108.12	2,887	995	109.18	24,555	12,638
108.14	3,330	1,160	109.20	24,802	13,121
108.16	3,772	1,326	109.22	25,048	13,604
108.18	4,214	1,492	109.24	25,294	14,087
108.20	4,656	1,658	109.26	25,540	14,571
108.22	5,098	1,823	109.28	25,787	15,054
108.24	5,540	1,989	109.30	<b>26,033</b>	<b>15,537</b>
108.26	5,982	2,155			
108.28	6,424	2,321			
108.30	6,866	2,487			
108.32	7,308	2,652			
108.34	7,750	2,818			
108.36	8,192	2,984			
108.38	8,635	3,150			
108.40	9,077	3,315			
108.42	9,519	3,481			
108.44	9,961	3,647			
108.46	10,403	3,813			
108.48	10,845	3,978			
108.50	11,287	4,144			
108.52	11,729	4,310			
108.54	12,171	4,476			
108.56	12,613	4,642			
108.58	13,055	4,807			
108.60	13,497	4,973			
108.62	13,939	5,139			
108.64	14,382	5,305			
108.66	14,824	5,470			
108.68	15,266	5,636			
108.70	15,708	5,802			
108.72	16,150	5,968			
108.74	16,592	6,133			
108.76	17,034	6,299			
108.78	17,476	6,465			
108.80	17,918	6,631			
108.82	18,360	6,796			
108.84	18,802	6,962			
108.86	19,244	7,128			
108.88	19,687	7,294			
108.90	20,129	7,460			
108.92	20,571	7,625			
108.94	21,013	7,791			
108.96	21,455	7,957			
108.98	21,897	8,123			
109.00	22,339	8,288			
109.02	22,585	8,772			
109.04	22,832	9,255			

# APPENDIX B




## PROPOSED HYDROLOGICAL CONDITIONS

2-YEAR STORM EVENT

10-YEAR STORM EVENT

25-YEAR STORM EVENT

100-YEAR STORM EVENT

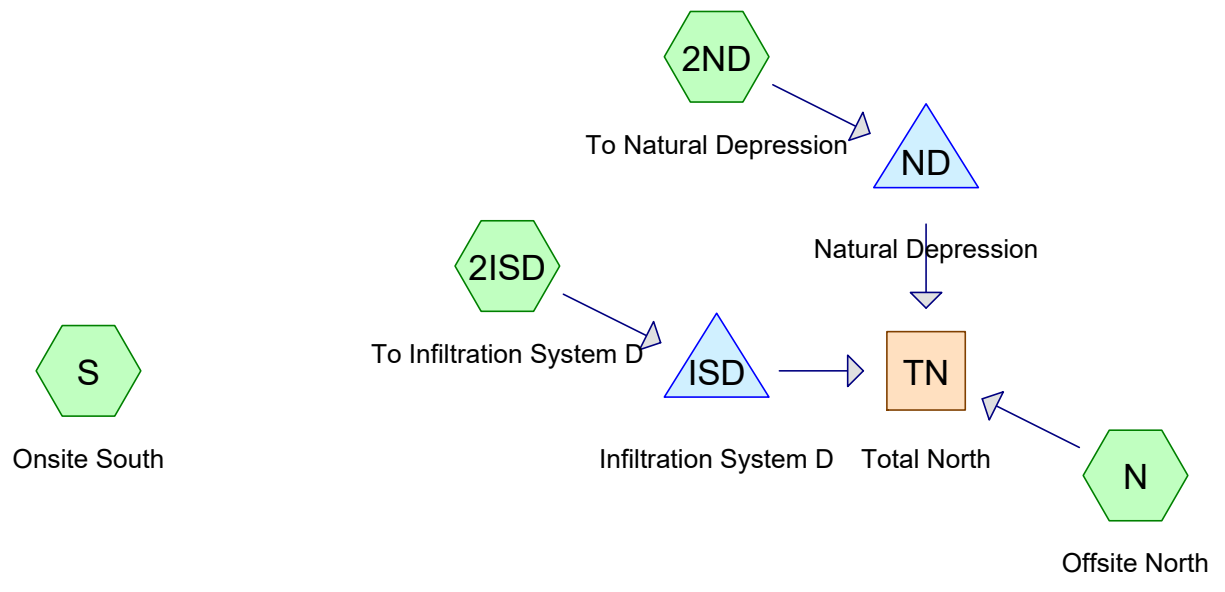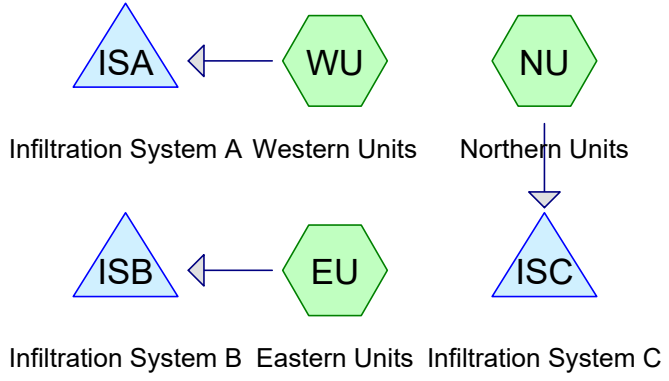

**Summary for Subcatchment 2ISD: To Infiltration System D**

Runoff = 2.11 cfs @ 12.11 hrs, Volume= 6,659 cf, Depth> 0.79"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-Year Rainfall=3.20"

Area (sf)	CN	Description
3,059	30	Woods, Good, HSG A
17,768	39	>75% Grass cover, Good, HSG A
17,904	98	Unconnected pavement, HSG A
1,960	55	Woods, Good, HSG B
35,785	61	>75% Grass cover, Good, HSG B
1,786	96	Gravel surface, HSG B
22,287	98	Unconnected pavement, HSG B
100,549	71	Weighted Average
60,358		60.03% Pervious Area
40,191		39.97% Impervious Area
40,191		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.3	50	0.0400	0.20		<b>Sheet Flow, Grass AB</b> Grass: Short n= 0.150 P2= 3.20"
1.6	115	0.0300	1.21		<b>Shallow Concentrated Flow, Grass BC</b> Short Grass Pasture Kv= 7.0 fps
0.5	136	0.0100	4.54	3.56	<b>Pipe Channel, Pipe CD</b> 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.013 Corrugated PE, smooth interior
6.4	301	Total			



### Subcatchment 2ISD: To Infiltration System D

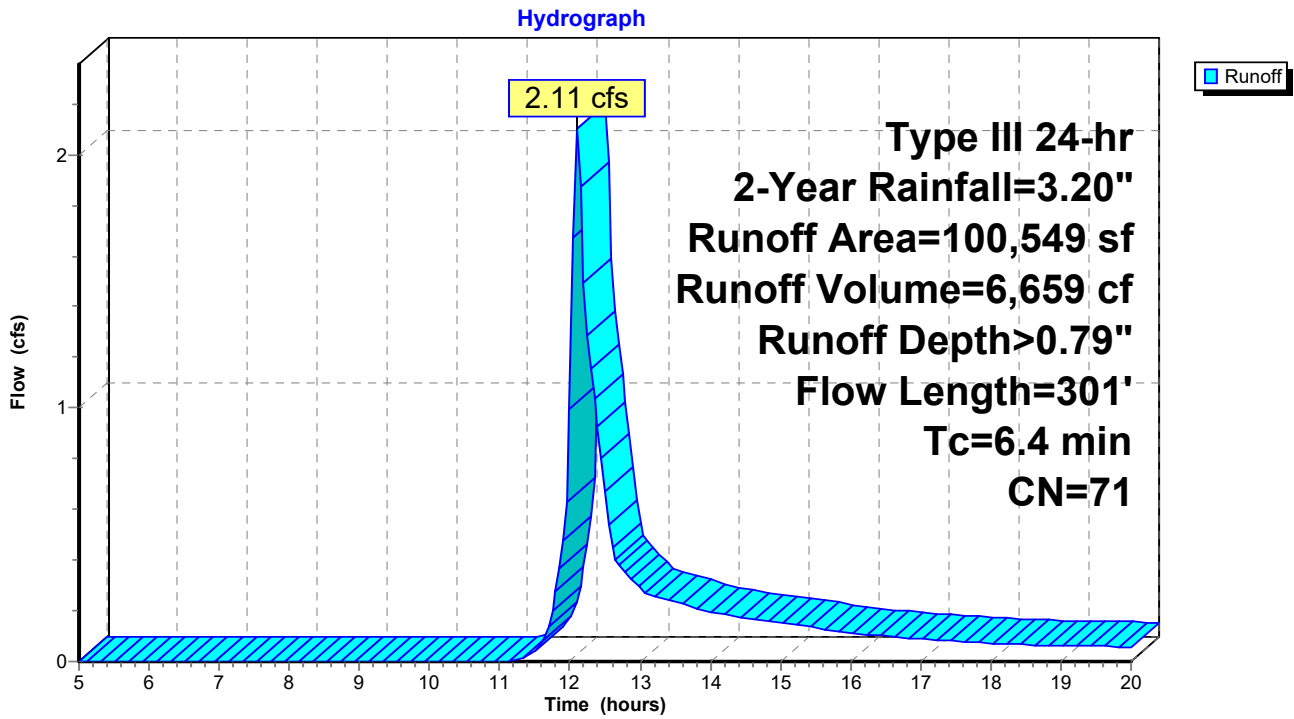

**Summary for Subcatchment 2ND: To Natural Depression**

Runoff = 0.00 cfs @ 17.17 hrs, Volume= 26 cf, Depth> 0.01"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-Year Rainfall=3.20"

Area (sf)	CN	Description
4,045	30	Woods, Good, HSG A
18,978	39	>75% Grass cover, Good, HSG A
1,946	96	Gravel surface, HSG A
224	98	Unconnected pavement, HSG A
473	61	>75% Grass cover, Good, HSG B
25,666	43	Weighted Average
25,442		99.13% Pervious Area
224		0.87% Impervious Area
224		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, AB-Grass

**Subcatchment 2ND: To Natural Depression**

Hydrograph

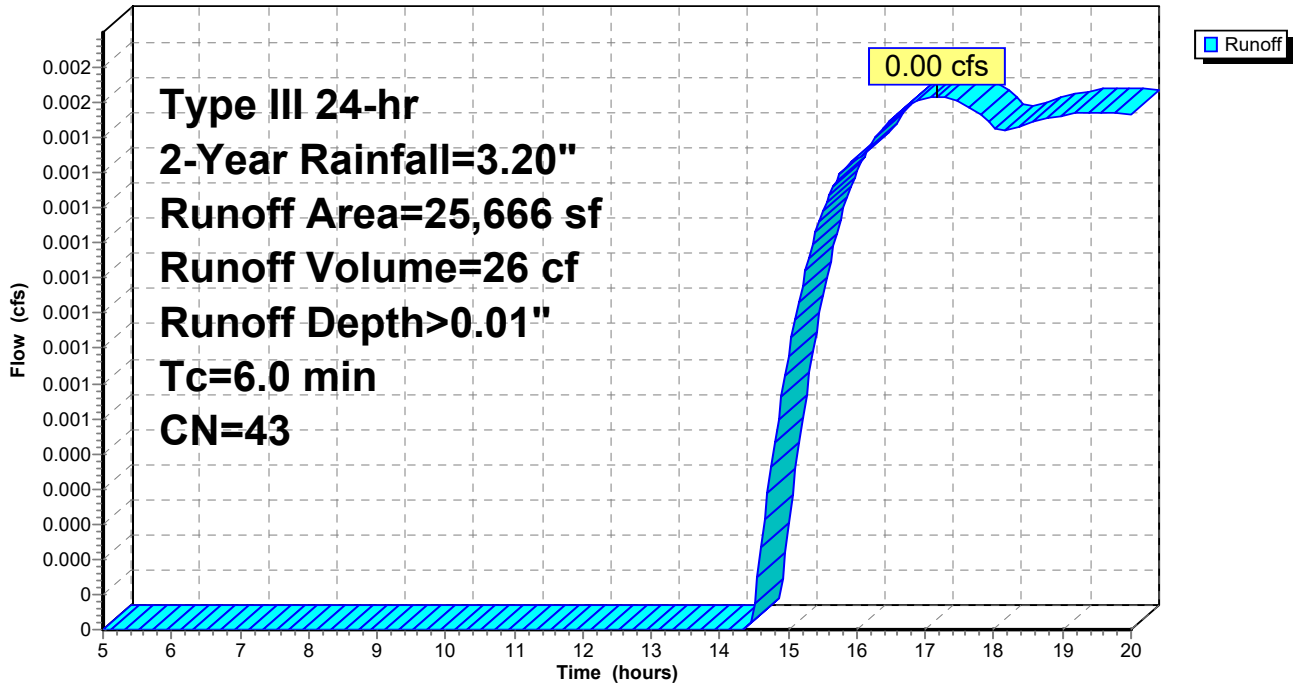

**Summary for Subcatchment EU: Eastern Units**

Runoff = 0.33 cfs @ 12.09 hrs, Volume= 1,100 cf, Depth> 2.77"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-Year Rainfall=3.20"

Area (sf)	CN	Description
4,760	98	Roofs, HSG D
4,760		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment EU: Eastern Units**

Hydrograph

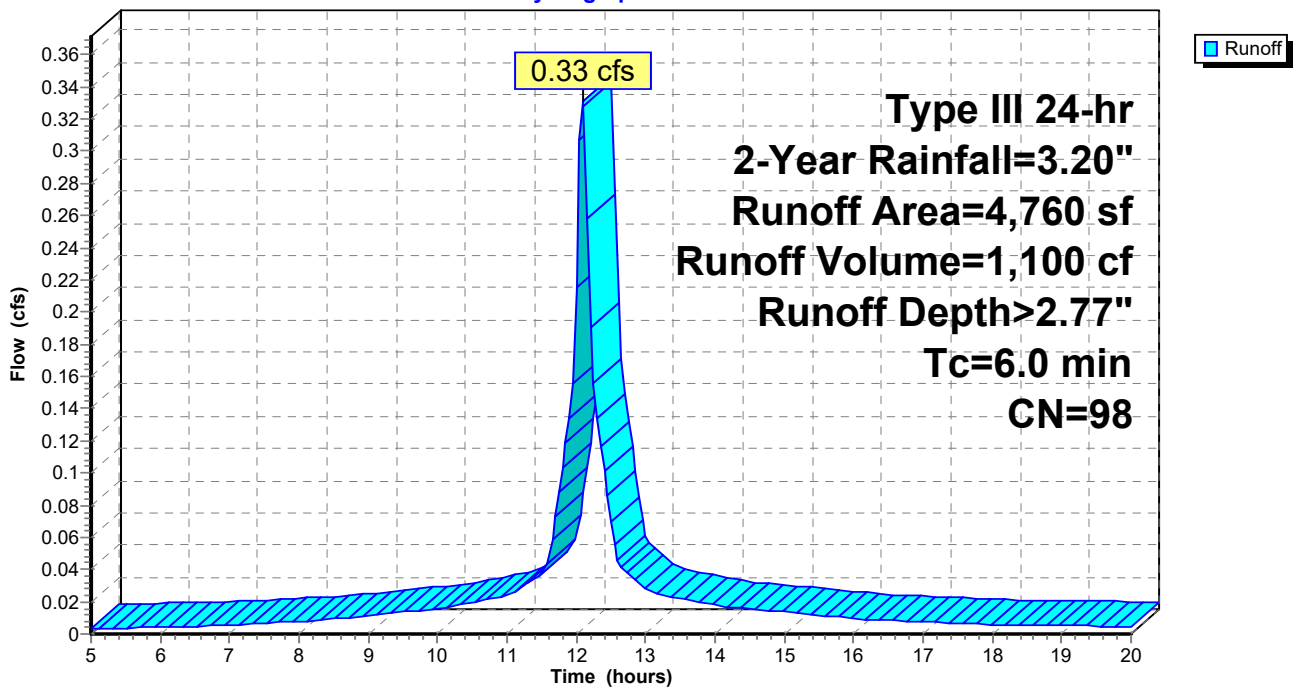

**Summary for Subcatchment N: Offsite North**


Runoff = 0.00 cfs @ 5.00 hrs, Volume= 0 cf, Depth= 0.00"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-Year Rainfall=3.20"

Area (sf)	CN	Description
4,653	30	Woods, Good, HSG A
11,862	39	>75% Grass cover, Good, HSG A
417	96	Gravel surface, HSG A
48	98	Unconnected pavement, HSG A
16,980	38	Weighted Average
16,932		99.72% Pervious Area
48		0.28% Impervious Area
48		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, AB-Grass

**Subcatchment N: Offsite North**

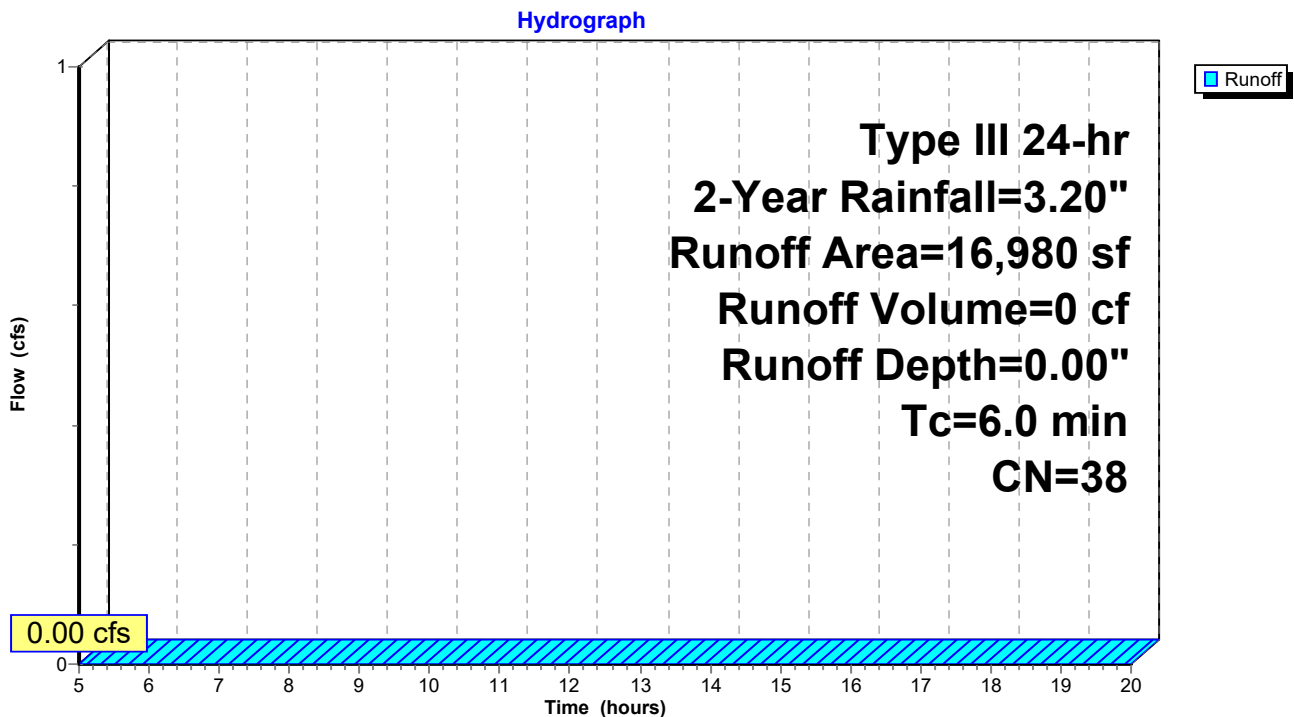

**Summary for Subcatchment NU: Northern Units**

Runoff = 0.47 cfs @ 12.09 hrs, Volume= 1,572 cf, Depth> 2.77"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-Year Rainfall=3.20"

Area (sf)	CN	Description
6,800	98	Roofs, HSG D
6,800		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment NU: Northern Units**

Hydrograph

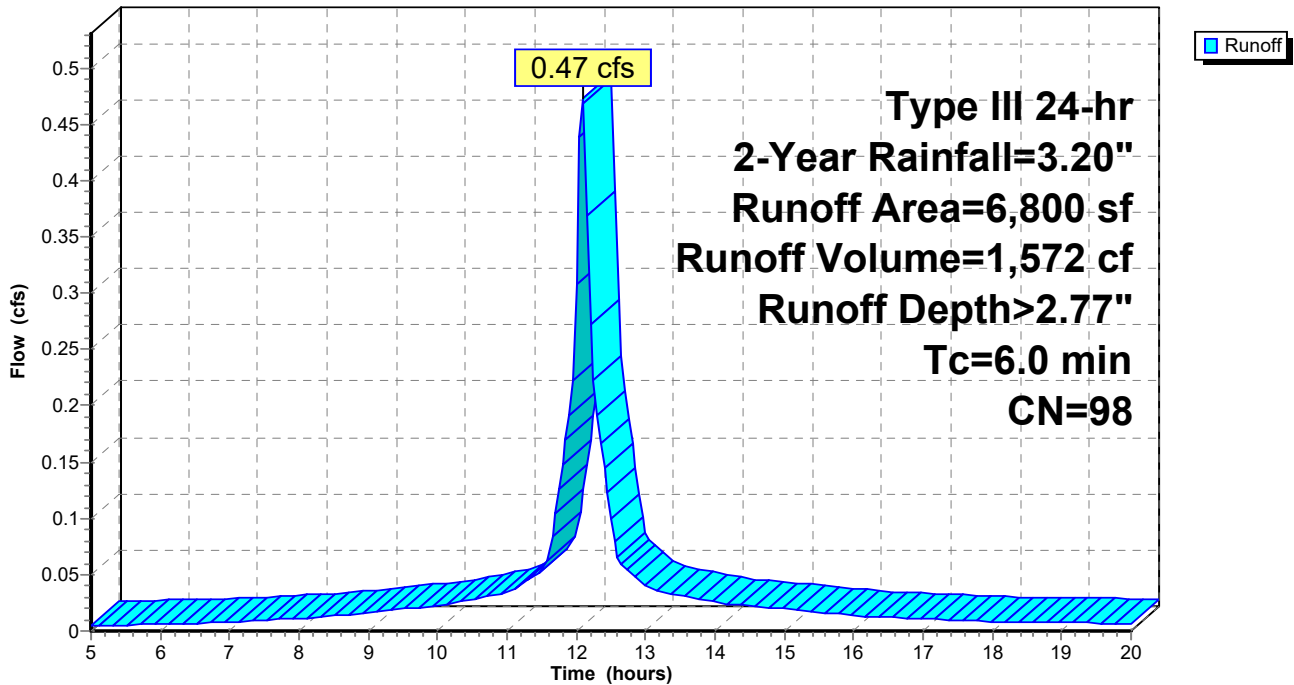

**Summary for Subcatchment S: Onsite South**

Runoff = 0.00 cfs @ 5.00 hrs, Volume= 0 cf, Depth= 0.00"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-Year Rainfall=3.20"

Area (sf)	CN	Description
5,286	30	Woods, Good, HSG A
4,154	39	>75% Grass cover, Good, HSG A
63	98	Unconnected roofs, HSG A
9,503	34	Weighted Average
9,440		99.34% Pervious Area
63		0.66% Impervious Area
63		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
13.8	50	0.0150	0.06		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
0.6	21	0.0150	0.61		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
14.4	71	Total			

**Subcatchment S: Onsite South**

Hydrograph

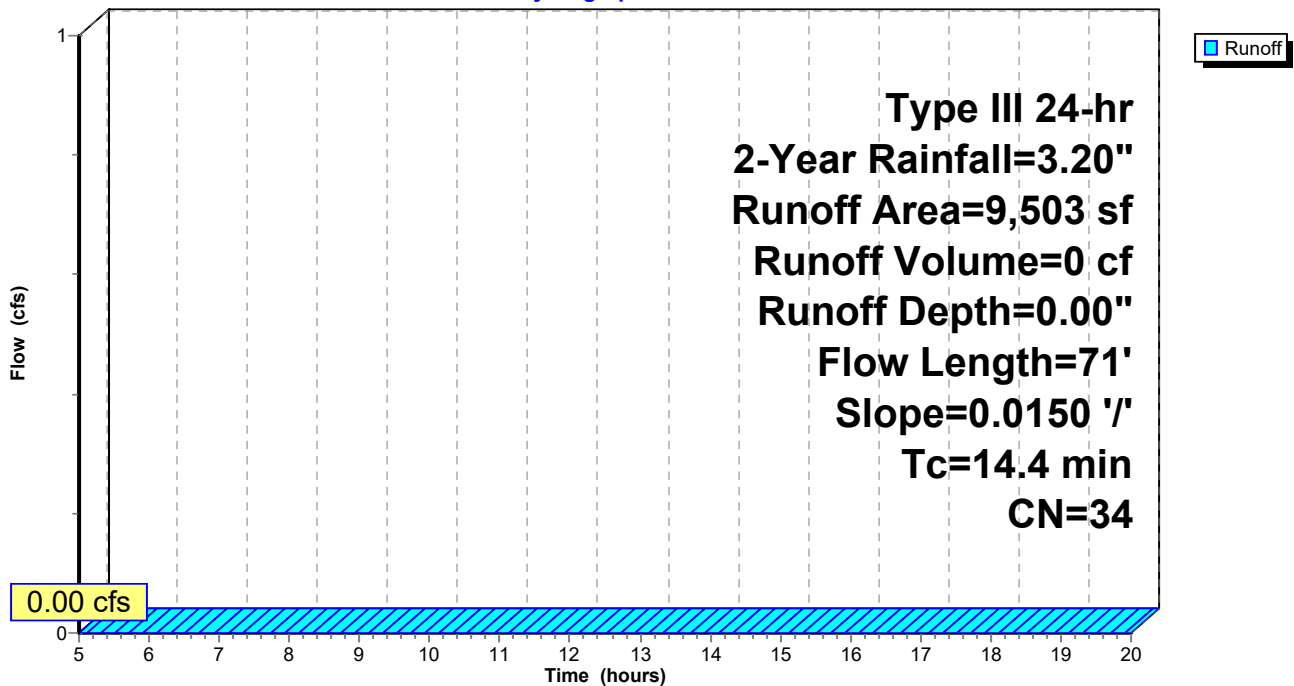

**Summary for Subcatchment WU: Western Units**

Runoff = 0.33 cfs @ 12.09 hrs, Volume= 1,100 cf, Depth> 2.77"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 2-Year Rainfall=3.20"

Area (sf)	CN	Description
4,760	98	Roofs, HSG D
4,760		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment WU: Western Units**

Hydrograph

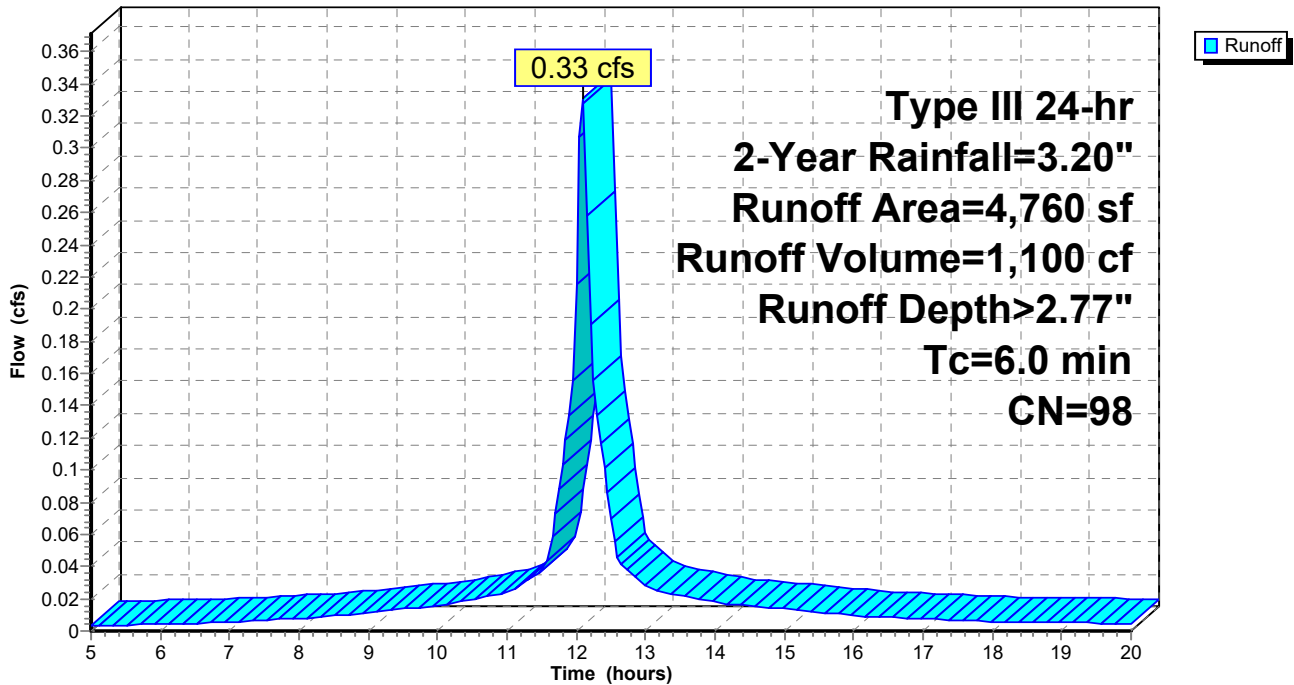


### Summary for Reach TN: Total North

Inflow Area = 143,195 sf, 28.26% Impervious, Inflow Depth = 0.00" for 2-Year event  
Inflow = 0.00 cfs @ 5.00 hrs, Volume= 0 cf  
Outflow = 0.00 cfs @ 5.00 hrs, Volume= 0 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

### Reach TN: Total North

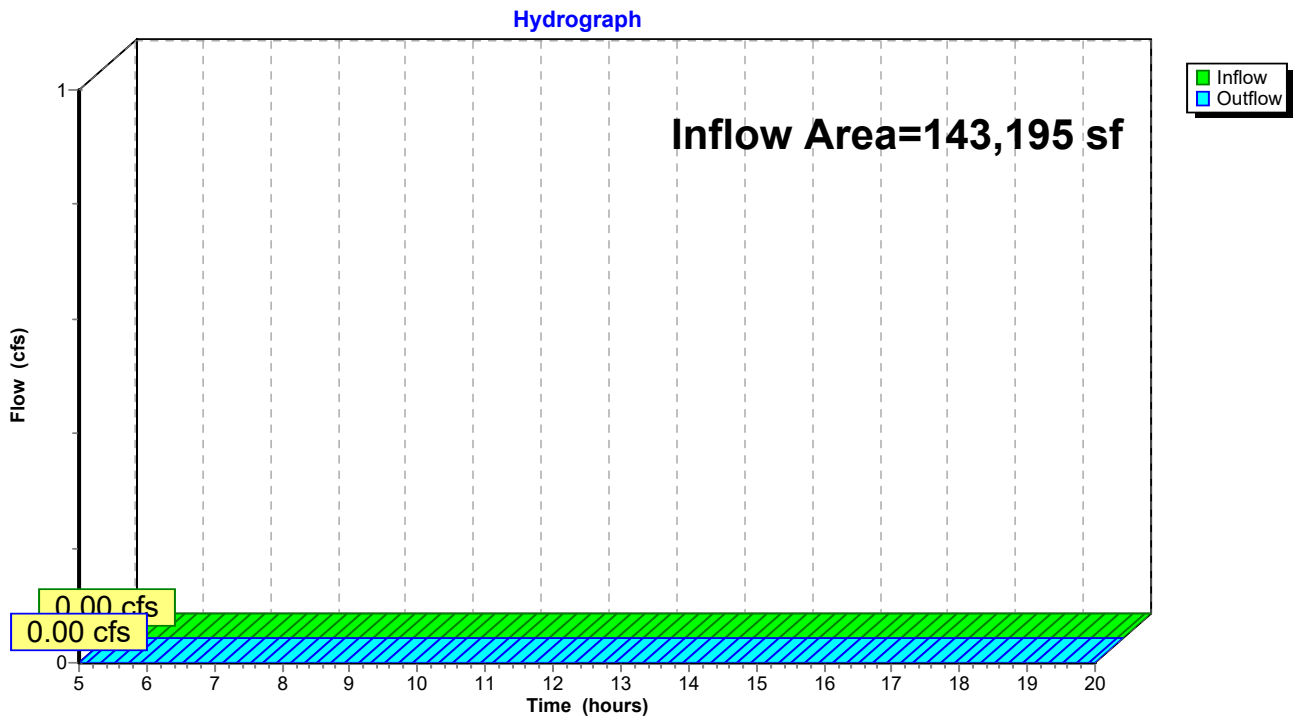



**Summary for Pond ISA: Infiltration System A**

Inflow Area = 4,760 sf, 100.00% Impervious, Inflow Depth > 2.77" for 2-Year event  
 Inflow = 0.33 cfs @ 12.09 hrs, Volume= 1,100 cf  
 Outflow = 0.08 cfs @ 11.80 hrs, Volume= 1,100 cf, Atten= 75%, Lag= 0.0 min  
 Discarded = 0.08 cfs @ 11.80 hrs, Volume= 1,100 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 106.92' @ 12.46 hrs Surf.Area= 430 sf Storage= 232 cf

Plug-Flow detention time= 14.4 min calculated for 1,100 cf (100% of inflow)  
 Center-of-Mass det. time= 14.2 min ( 752.7 - 738.6 )

Volume	Invert	Avail.Storage	Storage Description
#1A	106.00'	391 cf	<b>11.17'W x 38.50'L x 3.54'H Field A</b>
			1,523 cf Overall - 544 cf Embedded = 979 cf x 40.0% Voids
#2A	106.50'	544 cf	<b>Cultec R-330XLHD x 10 Inside #1</b>
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 2 rows
		935 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	106.00'	<b>8.270 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.08 cfs @ 11.80 hrs HW=106.05' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.08 cfs)

**Pond ISA: Infiltration System A - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 2 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

5 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 36.50' Row Length +12.0" End Stone x 2 = 38.50' Base Length

2 Rows x 52.0" Wide + 6.0" Spacing x 1 + 12.0" Side Stone x 2 = 11.17' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

10 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 2 Rows = 543.9 cf Chamber Storage

1,522.6 cf Field - 543.9 cf Chambers = 978.7 cf Stone x 40.0% Voids = 391.5 cf Stone Storage

Chamber Storage + Stone Storage = 935.4 cf = 0.021 af



Overall Storage Efficiency = 61.4%

Overall System Size = 38.50' x 11.17' x 3.54'


10 Chambers

56.4 cy Field

36.2 cy Stone

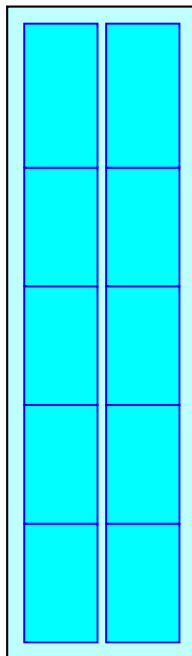

### Pond ISA: Infiltration System A

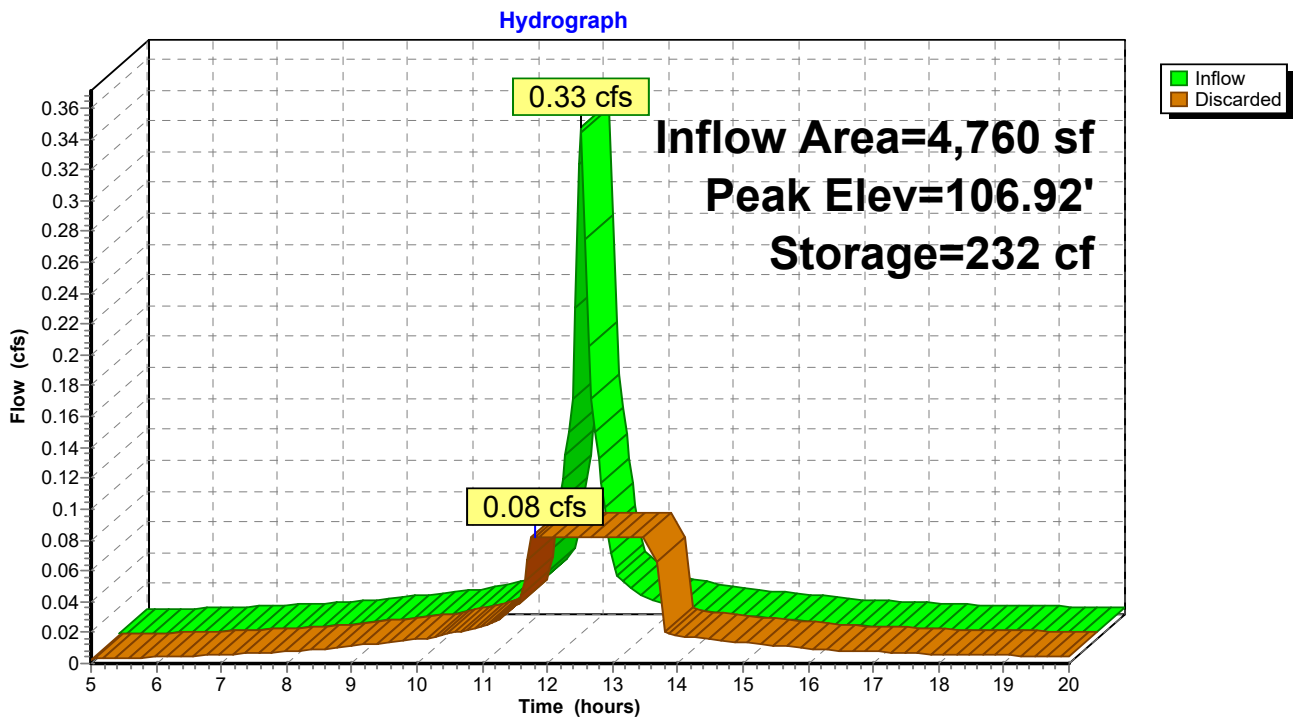

**Stage-Area-Storage for Pond ISA: Infiltration System A**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
106.00	430	0	108.65	430	769
106.05	430	9	108.70	430	781
106.10	430	17	108.75	430	792
106.15	430	26	108.80	430	803
106.20	430	34	108.85	430	814
106.25	430	43	108.90	430	824
106.30	430	52	108.95	430	833
106.35	430	60	109.00	430	842
106.40	430	69	109.05	430	851
106.45	430	77	109.10	430	859
106.50	430	86	109.15	430	868
106.55	430	103	109.20	430	877
106.60	430	121	109.25	430	885
106.65	430	138	109.30	430	894
106.70	430	155	109.35	430	902
106.75	430	172	109.40	430	911
106.80	430	189	109.45	430	920
106.85	430	206	109.50	430	<b>928</b>
106.90	430	223			
106.95	430	240			
107.00	430	257			
107.05	430	275			
107.10	430	291			
107.15	430	308			
107.20	430	325			
107.25	430	342			
107.30	430	358			
107.35	430	375			
107.40	430	391			
107.45	430	408			
107.50	430	424			
107.55	430	441			
107.60	430	457			
107.65	430	474			
107.70	430	490			
107.75	430	506			
107.80	430	522			
107.85	430	538			
107.90	430	554			
107.95	430	570			
108.00	430	585			
108.05	430	600			
108.10	430	616			
108.15	430	631			
108.20	430	645			
108.25	430	660			
108.30	430	675			
108.35	430	689			
108.40	430	703			
108.45	430	717			
108.50	430	730			
108.55	430	743			
108.60	430	756			

**Summary for Pond ISB: Infiltration System B**

Inflow Area = 4,760 sf, 100.00% Impervious, Inflow Depth > 2.77" for 2-Year event  
 Inflow = 0.33 cfs @ 12.09 hrs, Volume= 1,100 cf  
 Outflow = 0.03 cfs @ 11.45 hrs, Volume= 1,099 cf, Atten= 90%, Lag= 0.0 min  
 Discarded = 0.03 cfs @ 11.45 hrs, Volume= 1,099 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 106.61' @ 12.87 hrs Surf.Area= 586 sf Storage= 403 cf

Plug-Flow detention time= 90.9 min calculated for 1,099 cf (100% of inflow)  
 Center-of-Mass det. time= 90.2 min ( 828.8 - 738.6 )

Volume	Invert	Avail.Storage	Storage Description
#1A	105.50'	530 cf	<b>11.17'W x 52.50'L x 3.54'H Field A</b>
			2,076 cf Overall - 753 cf Embedded = 1,324 cf x 40.0% Voids
#2A	106.00'	753 cf	<b>Cultec R-330XLHD x 14 Inside #1</b>
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 2 rows
		1,282 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	105.50'	<b>2.410 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.03 cfs @ 11.45 hrs HW=105.54' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.03 cfs)

**Pond ISB: Infiltration System B - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 2 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

7 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 50.50' Row Length +12.0" End Stone x 2 = 52.50' Base Length

2 Rows x 52.0" Wide + 6.0" Spacing x 1 + 12.0" Side Stone x 2 = 11.17' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

14 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 2 Rows = 752.6 cf Chamber Storage

2,076.3 cf Field - 752.6 cf Chambers = 1,323.8 cf Stone x 40.0% Voids = 529.5 cf Stone Storage

Chamber Storage + Stone Storage = 1,282.1 cf = 0.029 af



Overall Storage Efficiency = 61.7%

Overall System Size = 52.50' x 11.17' x 3.54'


14 Chambers

76.9 cy Field

49.0 cy Stone



### Pond ISB: Infiltration System B

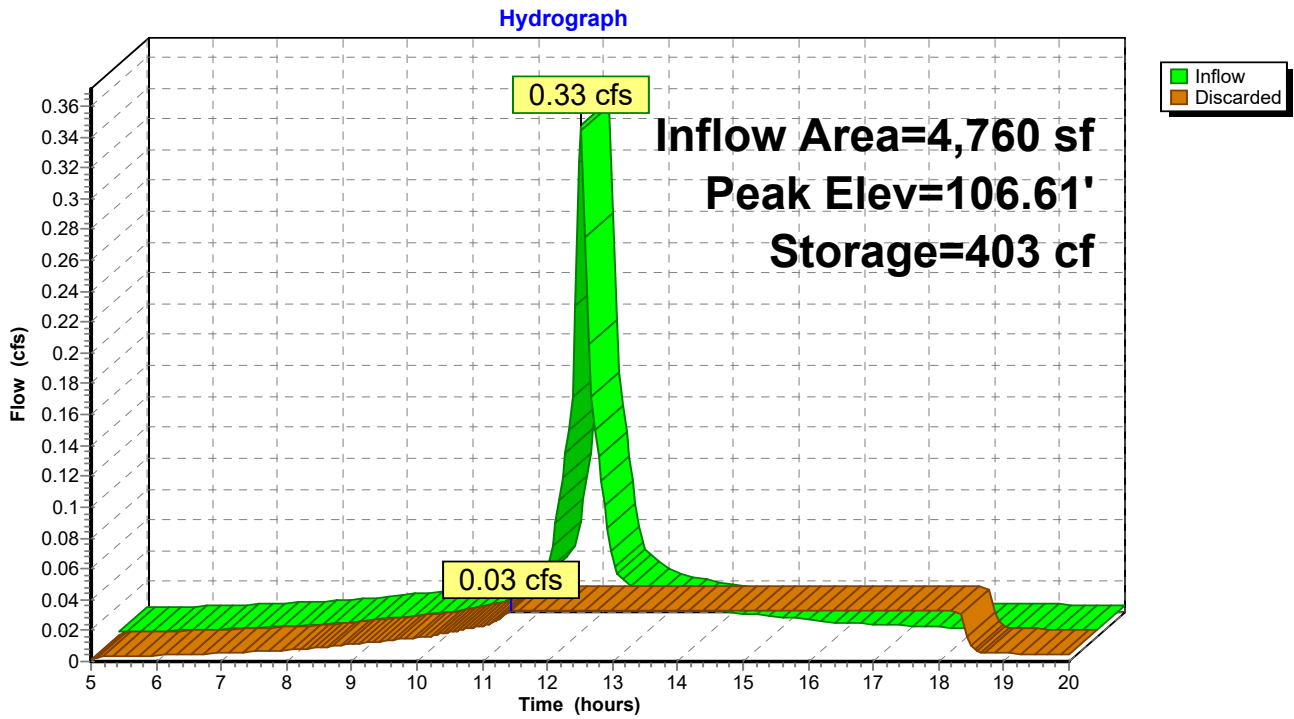

**Stage-Area-Storage for Pond ISB: Infiltration System B**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
105.50	<b>586</b>	0	108.15	586	1,055
105.55	586	12	108.20	586	1,071
105.60	586	23	108.25	586	1,087
105.65	586	35	108.30	586	1,102
105.70	586	47	108.35	586	1,116
105.75	586	59	108.40	586	1,130
105.80	586	70	108.45	586	1,143
105.85	586	82	108.50	586	1,155
105.90	586	94	108.55	586	1,167
105.95	586	106	108.60	586	1,178
106.00	586	117	108.65	586	1,190
106.05	586	141	108.70	586	1,202
106.10	586	165	108.75	586	1,214
106.15	586	188	108.80	586	1,225
106.20	586	212	108.85	586	1,237
106.25	586	235	108.90	586	1,249
106.30	586	259	108.95	586	1,261
106.35	586	282	109.00	586	<b>1,272</b>
106.40	586	306			
106.45	586	329			
106.50	586	353			
106.55	586	376			
106.60	586	399			
106.65	586	423			
106.70	586	446			
106.75	586	468			
106.80	586	491			
106.85	586	514			
106.90	586	537			
106.95	586	559			
107.00	586	582			
107.05	586	605			
107.10	586	627			
107.15	586	650			
107.20	586	672			
107.25	586	694			
107.30	586	717			
107.35	586	738			
107.40	586	760			
107.45	586	781			
107.50	586	803			
107.55	586	824			
107.60	586	844			
107.65	586	865			
107.70	586	885			
107.75	586	906			
107.80	586	925			
107.85	586	945			
107.90	586	964			
107.95	586	983			
108.00	586	1,002			
108.05	586	1,020			
108.10	586	1,037			



**Summary for Pond ISC: Infiltration System C**

Inflow Area = 6,800 sf, 100.00% Impervious, Inflow Depth > 2.77" for 2-Year event  
 Inflow = 0.47 cfs @ 12.09 hrs, Volume= 1,572 cf  
 Outflow = 0.03 cfs @ 10.50 hrs, Volume= 1,111 cf, Atten= 95%, Lag= 0.0 min  
 Discarded = 0.03 cfs @ 10.50 hrs, Volume= 1,111 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 105.58' @ 13.99 hrs Surf.Area= 1,094 sf Storage= 750 cf

Plug-Flow detention time= 163.1 min calculated for 1,111 cf (71% of inflow)  
 Center-of-Mass det. time= 95.7 min ( 834.3 - 738.6 )

Volume	Invert	Avail.Storage	Storage Description
#1A	104.50'	947 cf	<b>20.83'W x 52.50'L x 3.54'H Field A</b>
			3,874 cf Overall - 1,505 cf Embedded = 2,369 cf x 40.0% Voids
#2A	105.00'	1,505 cf	<b>Cultec R-330XLHD x 28</b> Inside #1
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 4 rows
		2,453 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	104.50'	<b>1.020 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.03 cfs @ 10.50 hrs HW=104.54' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.03 cfs)

### Pond ISC: Infiltration System C - Chamber Wizard Field A

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 4 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

7 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 50.50' Row Length +12.0" End Stone x 2 = 52.50' Base Length

4 Rows x 52.0" Wide + 6.0" Spacing x 3 + 12.0" Side Stone x 2 = 20.83' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

28 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 4 Rows = 1,505.1 cf Chamber Storage

3,873.7 cf Field - 1,505.1 cf Chambers = 2,368.6 cf Stone x 40.0% Voids = 947.4 cf Stone Storage

Chamber Storage + Stone Storage = 2,452.5 cf = 0.056 af


Overall Storage Efficiency = 63.3%

Overall System Size = 52.50' x 20.83' x 3.54'


28 Chambers

143.5 cy Field

87.7 cy Stone

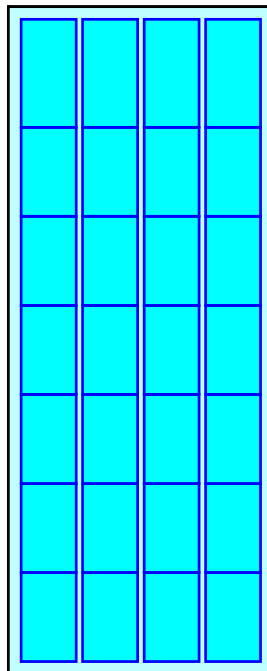

### Pond ISC: Infiltration System C

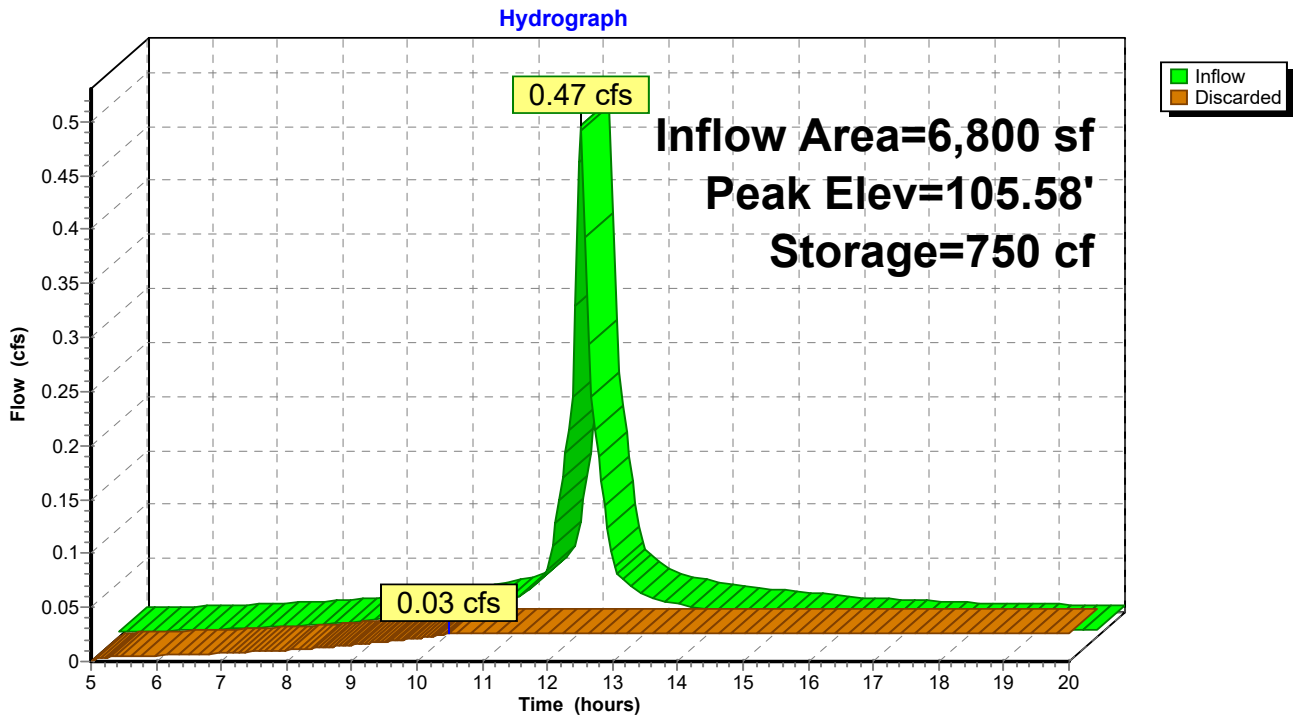

**Stage-Area-Storage for Pond ISC: Infiltration System C**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
104.50	<b>1,094</b>	0	107.15	1,094	2,026
104.55	1,094	22	107.20	1,094	2,057
104.60	1,094	44	107.25	1,094	2,087
104.65	1,094	66	107.30	1,094	2,116
104.70	1,094	88	107.35	1,094	2,143
104.75	1,094	109	107.40	1,094	2,169
104.80	1,094	131	107.45	1,094	2,193
104.85	1,094	153	107.50	1,094	2,216
104.90	1,094	175	107.55	1,094	2,237
104.95	1,094	197	107.60	1,094	2,259
105.00	1,094	219	107.65	1,094	2,281
105.05	1,094	265	107.70	1,094	2,303
105.10	1,094	311	107.75	1,094	2,325
105.15	1,094	356	107.80	1,094	2,347
105.20	1,094	402	107.85	1,094	2,369
105.25	1,094	447	107.90	1,094	2,391
105.30	1,094	493	107.95	1,094	2,412
105.35	1,094	538	108.00	1,094	<b>2,434</b>
105.40	1,094	584			
105.45	1,094	629			
105.50	1,094	674			
105.55	1,094	719			
105.60	1,094	764			
105.65	1,094	809			
105.70	1,094	853			
105.75	1,094	897			
105.80	1,094	941			
105.85	1,094	985			
105.90	1,094	1,029			
105.95	1,094	1,073			
106.00	1,094	1,117			
106.05	1,094	1,161			
106.10	1,094	1,204			
106.15	1,094	1,247			
106.20	1,094	1,291			
106.25	1,094	1,334			
106.30	1,094	1,376			
106.35	1,094	1,418			
106.40	1,094	1,460			
106.45	1,094	1,501			
106.50	1,094	1,542			
106.55	1,094	1,583			
106.60	1,094	1,623			
106.65	1,094	1,662			
106.70	1,094	1,702			
106.75	1,094	1,740			
106.80	1,094	1,778			
106.85	1,094	1,816			
106.90	1,094	1,853			
106.95	1,094	1,889			
107.00	1,094	1,924			
107.05	1,094	1,959			
107.10	1,094	1,993			

**Summary for Pond ISD: Infiltration System D**

Inflow Area = 100,549 sf, 39.97% Impervious, Inflow Depth > 0.79" for 2-Year event  
 Inflow = 2.11 cfs @ 12.11 hrs, Volume= 6,659 cf  
 Outflow = 0.20 cfs @ 11.90 hrs, Volume= 6,072 cf, Atten= 90%, Lag= 0.0 min  
 Discarded = 0.20 cfs @ 11.90 hrs, Volume= 6,072 cf  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 104.64' @ 13.91 hrs Surf.Area= 8,610 sf Storage= 2,790 cf

Plug-Flow detention time= 155.1 min calculated for 6,072 cf (91% of inflow)  
 Center-of-Mass det. time= 126.4 min ( 952.5 - 826.1 )

Volume	Invert	Avail.Storage	Storage Description
#1A	104.00'	7,100 cf	<b>54.67'W x 157.50'L x 3.54'H Field A</b> 30,494 cf Overall - 12,745 cf Embedded = 17,749 cf x 40.0% Voids
#2A	104.50'	12,745 cf	<b>Cultec R-330XLHD x 242 Inside #1</b> Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap Row Length Adjustment= +1.50' x 7.45 sf x 11 rows
		19,844 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	104.00'	<b>1.020 in/hr Exfiltration over Surface area</b>
#2	Primary	106.00'	<b>12.0" Round Culvert</b> L= 94.0' CMP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 106.00' / 105.00' S= 0.0106 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#3	Device 2	107.00'	<b>12.0" Round Culvert</b> L= 70.0' CMP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 107.00' / 106.30' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#4	Device 3	107.40'	<b>4.0' long Sharp-Crested Rectangular Weir 2 End Contraction(s)</b> 4.0' Crest Height

**Discarded OutFlow** Max=0.20 cfs @ 11.90 hrs HW=104.05' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.20 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=104.00' (Free Discharge)  
 ↑2=Culvert ( Controls 0.00 cfs)  
 ↑3=Culvert ( Controls 0.00 cfs)  
 ↑4=Sharp-Crested Rectangular Weir ( Controls 0.00 cfs)

**Pond ISD: Infiltration System D - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 11 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

22 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 155.50' Row Length +12.0" End Stone x 2 = 157.50' Base Length

11 Rows x 52.0" Wide + 6.0" Spacing x 10 + 12.0" Side Stone x 2 = 54.67' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

242 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 11 Rows = 12,744.9 cf Chamber Storage

30,493.8 cf Field - 12,744.9 cf Chambers = 17,748.8 cf Stone x 40.0% Voids = 7,099.5 cf Stone Storage

Chamber Storage + Stone Storage = 19,844.5 cf = 0.456 af


Overall Storage Efficiency = 65.1%

Overall System Size = 157.50' x 54.67' x 3.54'


242 Chambers

1,129.4 cy Field

657.4 cy Stone

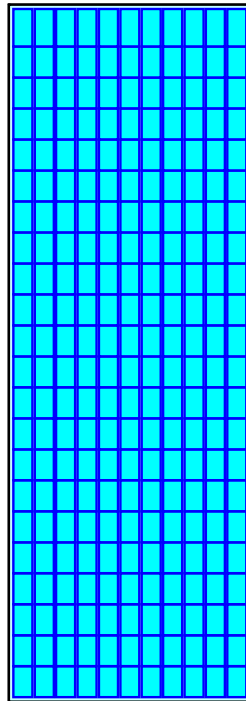

### Pond ISD: Infiltration System D

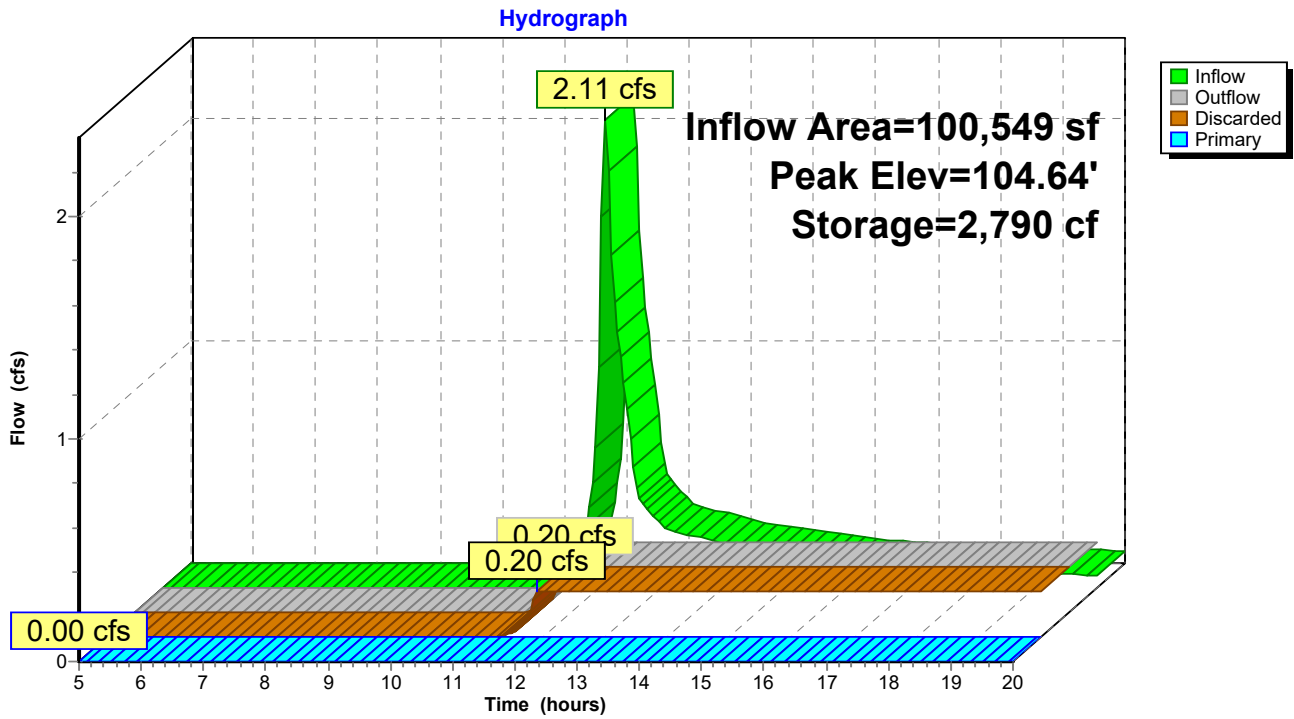

**Stage-Area-Storage for Pond ISD: Infiltration System D**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
104.00	<b>8,610</b>	0	106.65	8,610	16,461
104.05	8,610	172	106.70	8,610	16,716
104.10	8,610	344	106.75	8,610	16,958
104.15	8,610	517	106.80	8,610	17,187
104.20	8,610	689	106.85	8,610	17,403
104.25	8,610	861	106.90	8,610	17,607
104.30	8,610	1,033	106.95	8,610	17,799
104.35	8,610	1,205	107.00	8,610	17,979
104.40	8,610	1,378	107.05	8,610	18,151
104.45	8,610	1,550	107.10	8,610	18,323
104.50	8,610	1,722	107.15	8,610	18,496
104.55	8,610	2,098	107.20	8,610	18,668
104.60	8,610	2,473	107.25	8,610	18,840
104.65	8,610	2,847	107.30	8,610	19,012
104.70	8,610	3,220	107.35	8,610	19,184
104.75	8,610	3,593	107.40	8,610	19,357
104.80	8,610	3,964	107.45	8,610	19,529
104.85	8,610	4,336	107.50	8,610	19,701
104.90	8,610	4,707	107.55	8,610	<b>19,844</b>
104.95	8,610	5,078	107.60	8,610	19,844
105.00	8,610	5,448	107.65	8,610	19,844
105.05	8,610	5,817	107.70	8,610	19,844
105.10	8,610	6,185	107.75	8,610	19,844
105.15	8,610	6,550	107.80	8,610	19,844
105.20	8,610	6,913	107.85	8,610	19,844
105.25	8,610	7,274	107.90	8,610	19,844
105.30	8,610	7,633	107.95	8,610	19,844
105.35	8,610	7,992	108.00	8,610	19,844
105.40	8,610	8,351			
105.45	8,610	8,709			
105.50	8,610	9,066			
105.55	8,610	9,423			
105.60	8,610	9,778			
105.65	8,610	10,133			
105.70	8,610	10,486			
105.75	8,610	10,838			
105.80	8,610	11,185			
105.85	8,610	11,529			
105.90	8,610	11,869			
105.95	8,610	12,205			
106.00	8,610	12,538			
106.05	8,610	12,868			
106.10	8,610	13,194			
106.15	8,610	13,517			
106.20	8,610	13,835			
106.25	8,610	14,149			
106.30	8,610	14,459			
106.35	8,610	14,763			
106.40	8,610	15,063			
106.45	8,610	15,356			
106.50	8,610	15,644			
106.55	8,610	15,924			
106.60	8,610	16,197			



**Summary for Pond ND: Natural Depression**

Inflow Area = 25,666 sf, 0.87% Impervious, Inflow Depth > 0.01" for 2-Year event  
 Inflow = 0.00 cfs @ 17.17 hrs, Volume= 26 cf  
 Outflow = 0.00 cfs @ 17.60 hrs, Volume= 24 cf, Atten= 2%, Lag= 25.4 min  
 Discarded = 0.00 cfs @ 17.60 hrs, Volume= 24 cf  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 108.00' @ 17.60 hrs Surf.Area= 240 sf Storage= 2 cf

Plug-Flow detention time= 23.9 min calculated for 24 cf (91% of inflow)  
 Center-of-Mass det. time= 11.2 min ( 1,062.8 - 1,051.6 )

Volume	Invert	Avail.Storage	Storage Description			
#1	108.00'	3,293 cf	<b>Custom Stage Data (Irregular)</b> Listed below			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
108.00	235	88.4	0	0	235	
109.00	4,354	655.7	1,867	1,867	33,829	
109.30	5,162	671.6	1,426	3,293	35,520	


Device	Routing	Invert	Outlet Devices									
#1	Primary	109.00'	<b>2.0' long x 10.0' breadth Broad-Crested Rectangular Weir</b>									
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60									
			Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64									
#2	Discarded	108.00'	<b>2.410 in/hr Exfiltration over Surface area</b>									

**Discarded OutFlow** Max=0.01 cfs @ 17.60 hrs HW=108.00' (Free Discharge)  
 ↑2=Exfiltration (Exfiltration Controls 0.01 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=108.00' (Free Discharge)  
 ↑1=Broad-Crested Rectangular Weir ( Controls 0.00 cfs)

### Pond ND: Natural Depression

Hydrograph

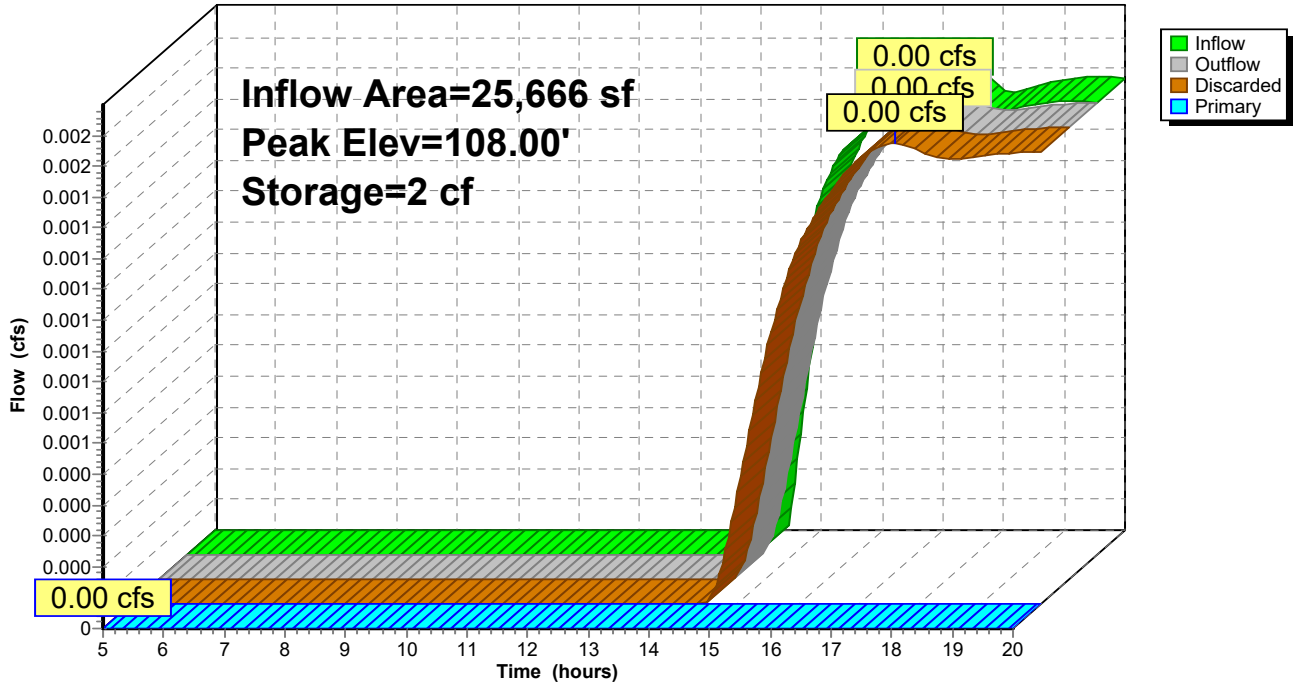

**Stage-Area-Storage for Pond ND: Natural Depression**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
108.00	235	0	109.06	4,516	2,152
108.02	317	37	109.08	4,569	2,247
108.04	400	75	109.10	4,623	2,342
108.06	482	112	109.12	4,677	2,437
108.08	565	149	109.14	4,731	2,532
108.10	647	187	109.16	4,785	2,627
108.12	729	224	109.18	4,839	2,722
108.14	812	261	109.20	4,893	2,817
108.16	894	299	109.22	4,947	2,912
108.18	976	336	109.24	5,000	3,007
108.20	1,059	373	109.26	5,054	3,102
108.22	1,141	411	109.28	5,108	3,197
108.24	1,224	448	109.30	<b>5,162</b>	<b>3,293</b>
108.26	1,306	485			
108.28	1,388	523			
108.30	1,471	560			
108.32	1,553	597			
108.34	1,635	635			
108.36	1,718	672			
108.38	1,800	709			
108.40	1,883	747			
108.42	1,965	784			
108.44	2,047	821			
108.46	2,130	859			
108.48	2,212	896			
108.50	2,295	933			
108.52	2,377	971			
108.54	2,459	1,008			
108.56	2,542	1,045			
108.58	2,624	1,083			
108.60	2,706	1,120			
108.62	2,789	1,157			
108.64	2,871	1,195			
108.66	2,954	1,232			
108.68	3,036	1,269			
108.70	3,118	1,307			
108.72	3,201	1,344			
108.74	3,283	1,381			
108.76	3,365	1,419			
108.78	3,448	1,456			
108.80	3,530	1,493			
108.82	3,613	1,531			
108.84	3,695	1,568			
108.86	3,777	1,605			
108.88	3,860	1,643			
108.90	3,942	1,680			
108.92	4,024	1,717			
108.94	4,107	1,755			
108.96	4,189	1,792			
108.98	4,272	1,830			
109.00	4,354	1,867			
109.02	4,408	1,962			
109.04	4,462	2,057			

**Summary for Subcatchment 2ISD: To Infiltration System D**


Runoff = 4.88 cfs @ 12.10 hrs, Volume= 14,593 cf, Depth> 1.74"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-Year Rainfall=4.70"

Area (sf)	CN	Description
3,059	30	Woods, Good, HSG A
17,768	39	>75% Grass cover, Good, HSG A
17,904	98	Unconnected pavement, HSG A
1,960	55	Woods, Good, HSG B
35,785	61	>75% Grass cover, Good, HSG B
1,786	96	Gravel surface, HSG B
22,287	98	Unconnected pavement, HSG B
100,549	71	Weighted Average
60,358		60.03% Pervious Area
40,191		39.97% Impervious Area
40,191		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.3	50	0.0400	0.20		<b>Sheet Flow, Grass AB</b> Grass: Short n= 0.150 P2= 3.20"
1.6	115	0.0300	1.21		<b>Shallow Concentrated Flow, Grass BC</b> Short Grass Pasture Kv= 7.0 fps
0.5	136	0.0100	4.54	3.56	<b>Pipe Channel, Pipe CD</b> 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.013 Corrugated PE, smooth interior
6.4	301	Total			

### Subcatchment 2ISD: To Infiltration System D

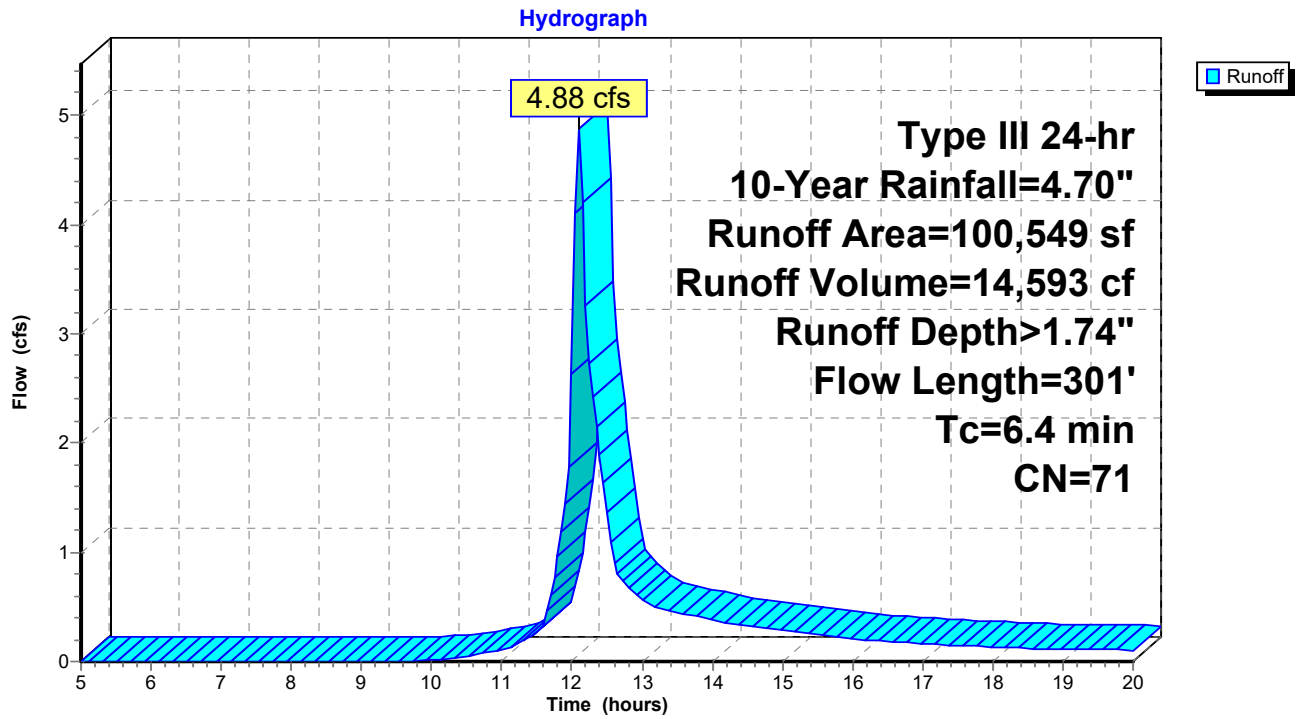

**Summary for Subcatchment 2ND: To Natural Depression**


Runoff = 0.05 cfs @ 12.39 hrs, Volume= 481 cf, Depth> 0.22"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-Year Rainfall=4.70"

Area (sf)	CN	Description
4,045	30	Woods, Good, HSG A
18,978	39	>75% Grass cover, Good, HSG A
1,946	96	Gravel surface, HSG A
224	98	Unconnected pavement, HSG A
473	61	>75% Grass cover, Good, HSG B
25,666	43	Weighted Average
25,442		99.13% Pervious Area
224		0.87% Impervious Area
224		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, AB-Grass

**Subcatchment 2ND: To Natural Depression**

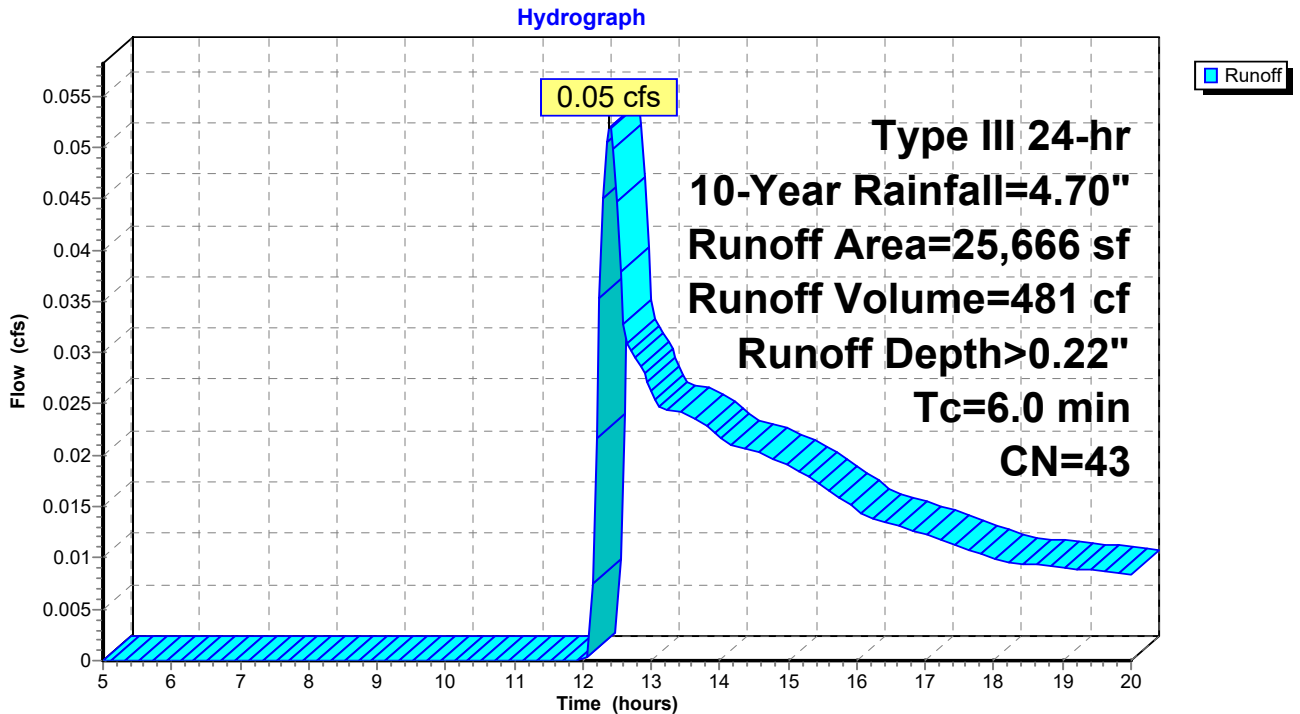

**Summary for Subcatchment EU: Eastern Units**


Runoff = 0.49 cfs @ 12.09 hrs, Volume= 1,644 cf, Depth> 4.15"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-Year Rainfall=4.70"

Area (sf)	CN	Description
4,760	98	Roofs, HSG D
4,760		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment EU: Eastern Units**

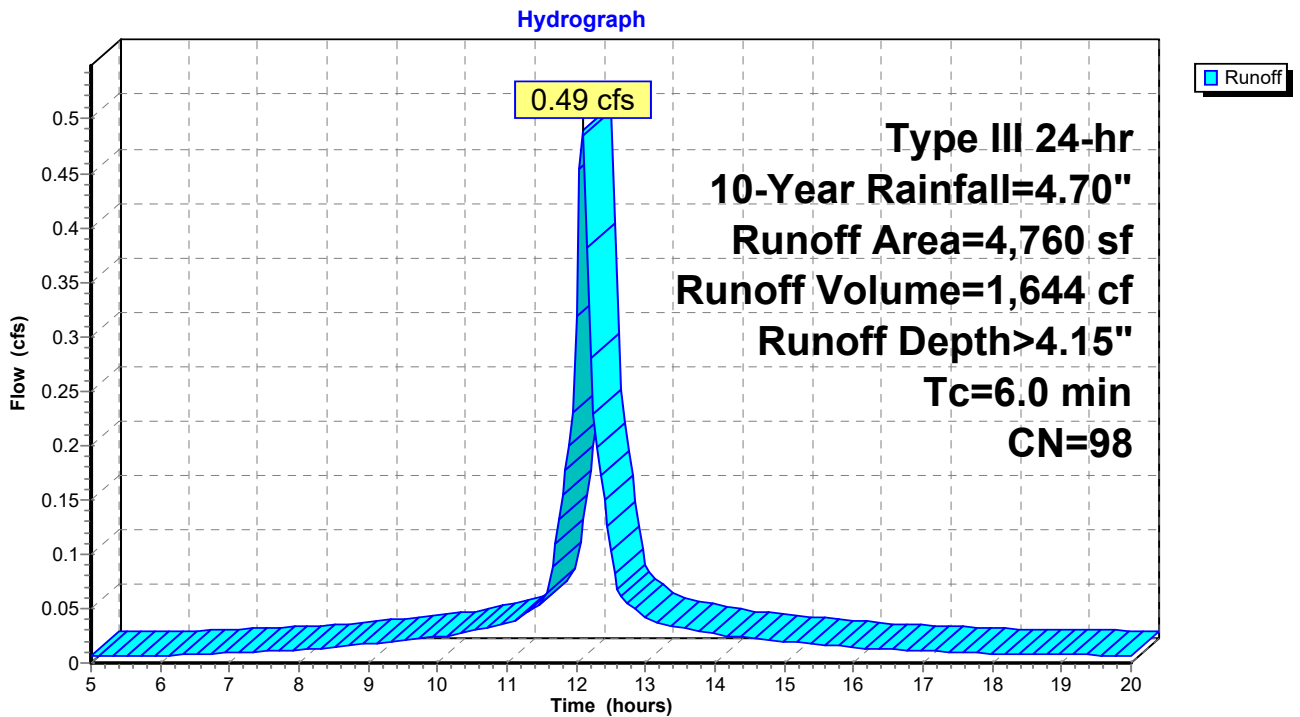

**Summary for Subcatchment N: Offsite North**

Runoff = 0.01 cfs @ 14.70 hrs, Volume= 122 cf, Depth> 0.09"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-Year Rainfall=4.70"

Area (sf)	CN	Description
4,653	30	Woods, Good, HSG A
11,862	39	>75% Grass cover, Good, HSG A
417	96	Gravel surface, HSG A
48	98	Unconnected pavement, HSG A
16,980	38	Weighted Average
16,932		99.72% Pervious Area
48		0.28% Impervious Area
48		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, AB-Grass

**Subcatchment N: Offsite North**

Hydrograph

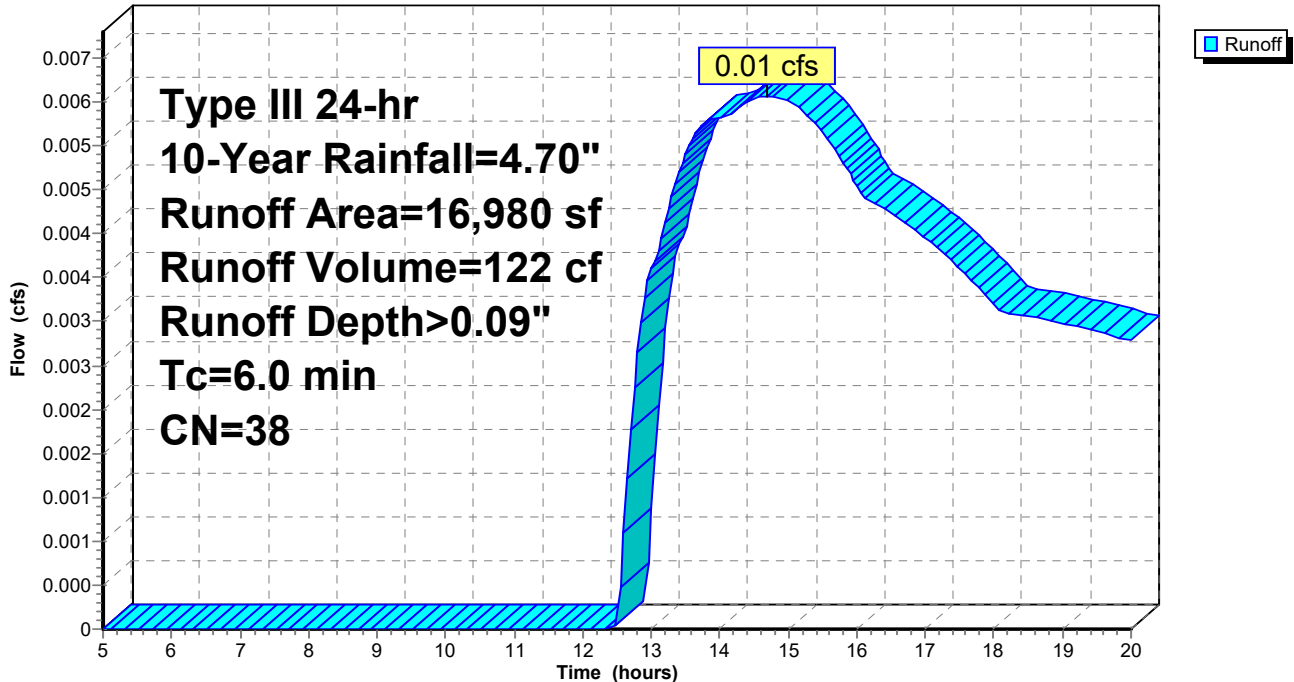



**Summary for Subcatchment NU: Northern Units**

Runoff = 0.70 cfs @ 12.09 hrs, Volume= 2,349 cf, Depth> 4.15"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-Year Rainfall=4.70"

Area (sf)	CN	Description
6,800	98	Roofs, HSG D
6,800		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment NU: Northern Units**

Hydrograph

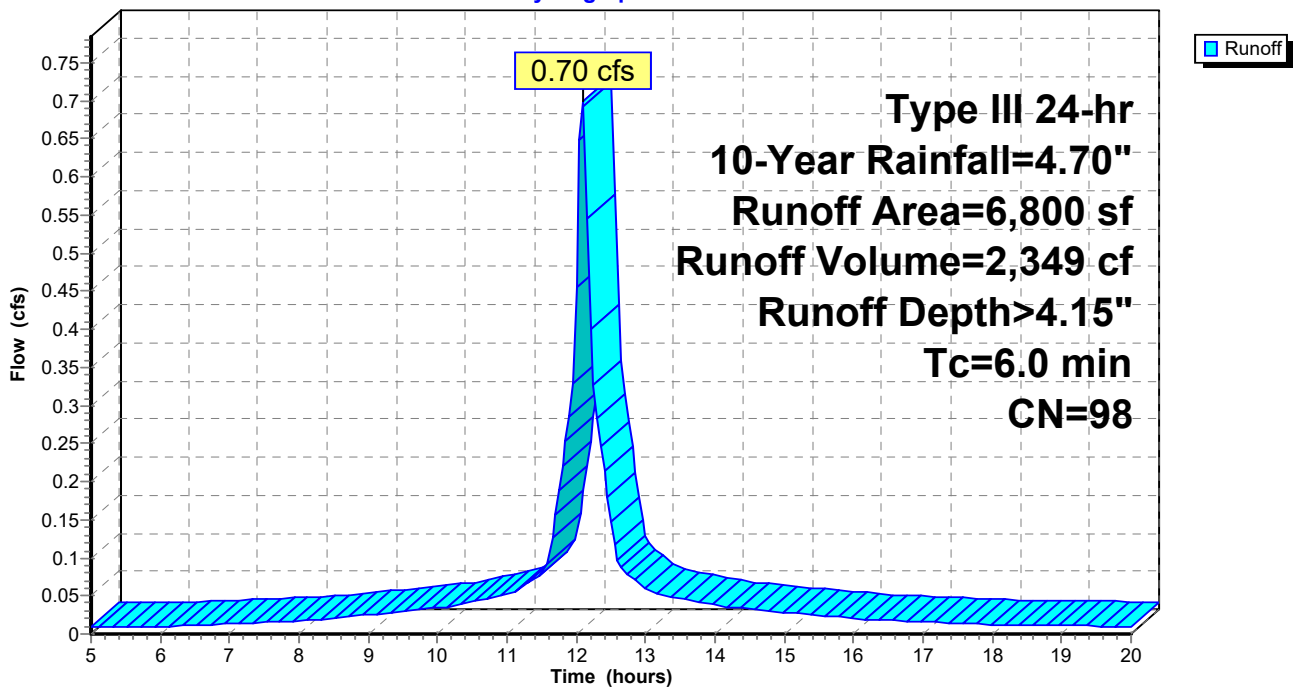

**Summary for Subcatchment S: Onsite South**

Runoff = 0.00 cfs @ 17.25 hrs, Volume= 14 cf, Depth> 0.02"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-Year Rainfall=4.70"

Area (sf)	CN	Description
5,286	30	Woods, Good, HSG A
4,154	39	>75% Grass cover, Good, HSG A
63	98	Unconnected roofs, HSG A
9,503	34	Weighted Average
9,440		99.34% Pervious Area
63		0.66% Impervious Area
63		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
13.8	50	0.0150	0.06		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
0.6	21	0.0150	0.61		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
14.4	71	Total			

**Subcatchment S: Onsite South**

Hydrograph

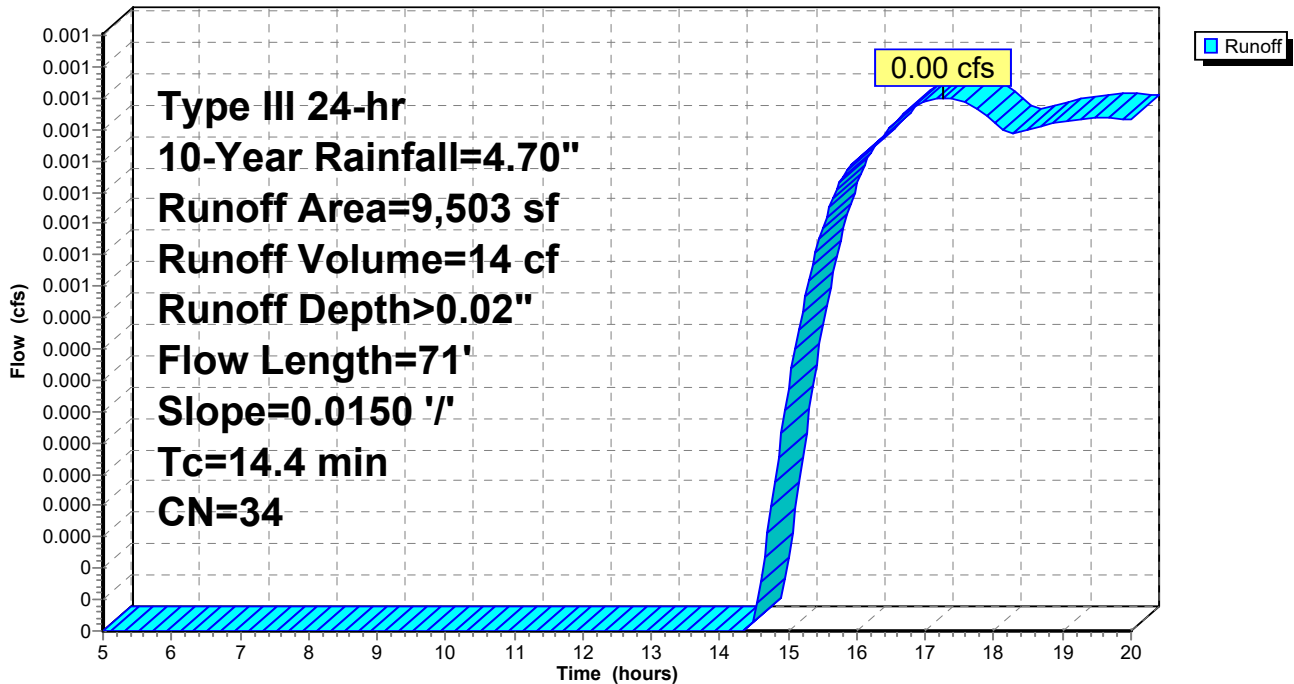

**Summary for Subcatchment WU: Western Units**

Runoff = 0.49 cfs @ 12.09 hrs, Volume= 1,644 cf, Depth> 4.15"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 10-Year Rainfall=4.70"

Area (sf)	CN	Description
4,760	98	Roofs, HSG D
4,760		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment WU: Western Units**

Hydrograph

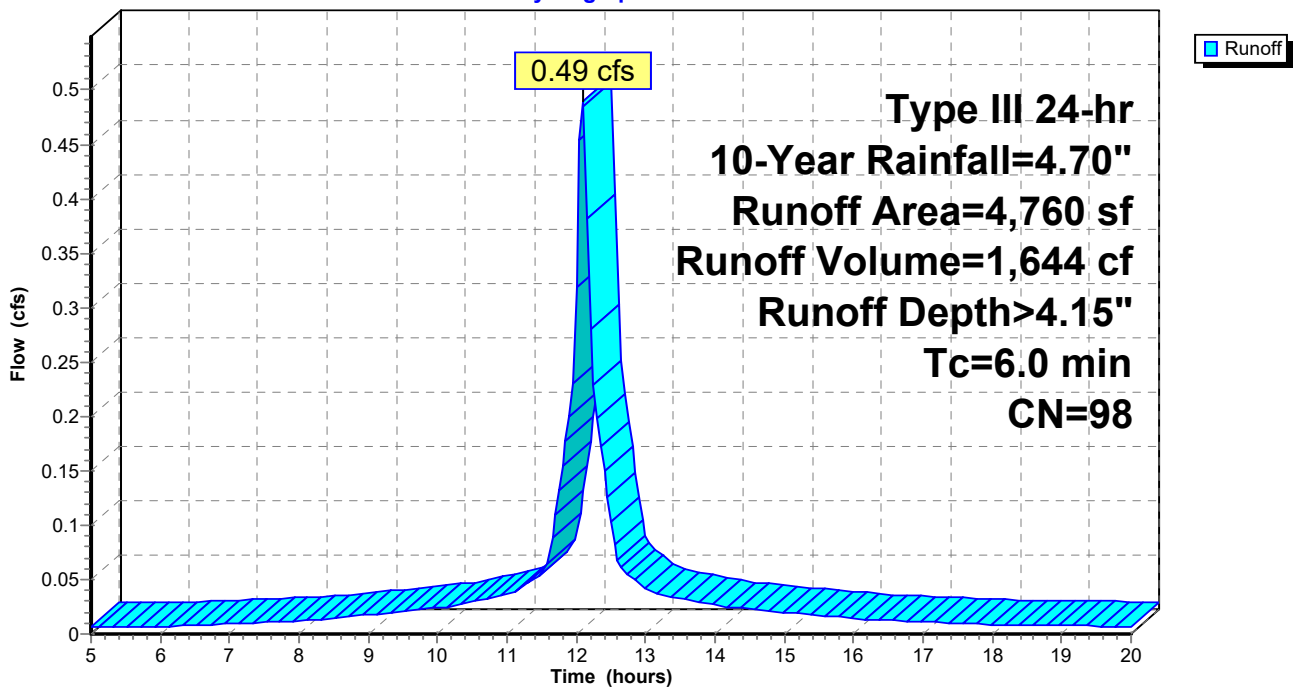


### Summary for Reach TN: Total North

Inflow Area = 143,195 sf, 28.26% Impervious, Inflow Depth > 0.01" for 10-Year event  
Inflow = 0.01 cfs @ 14.70 hrs, Volume= 122 cf  
Outflow = 0.01 cfs @ 14.70 hrs, Volume= 122 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

### Reach TN: Total North

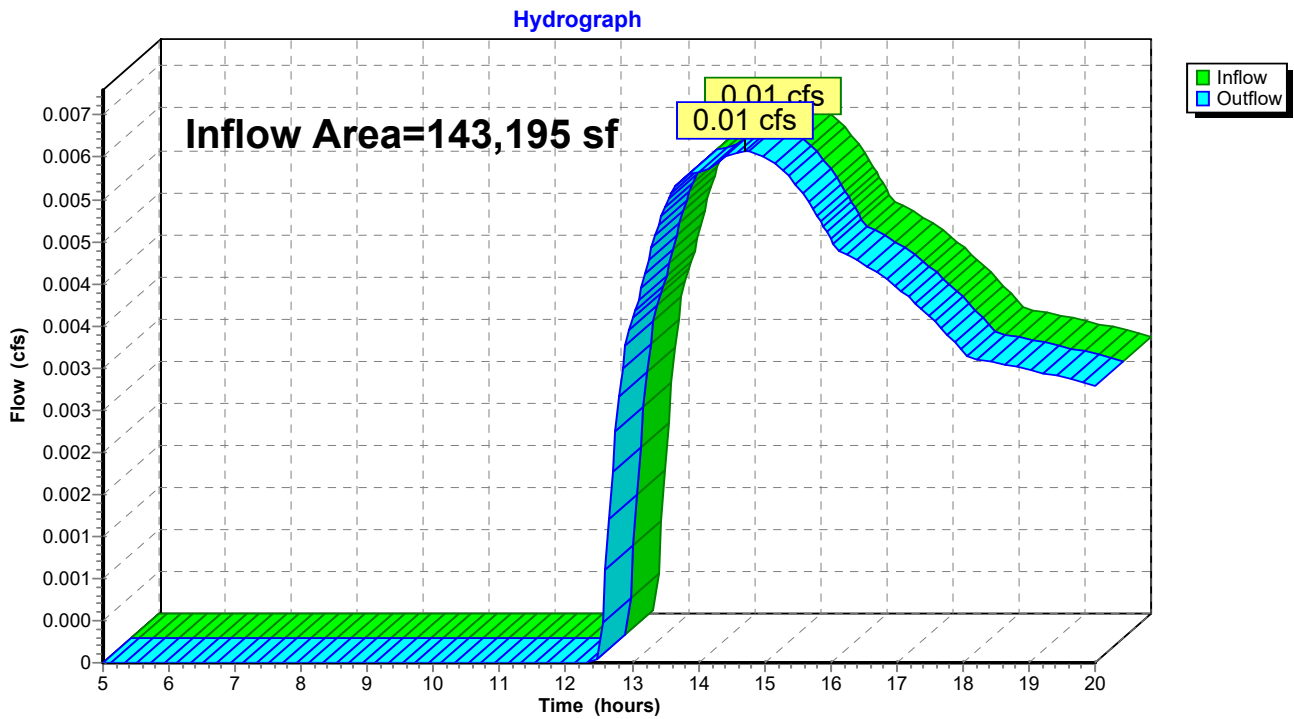

**Summary for Pond ISA: Infiltration System A**

Inflow Area = 4,760 sf, 100.00% Impervious, Inflow Depth > 4.15" for 10-Year event  
 Inflow = 0.49 cfs @ 12.09 hrs, Volume= 1,644 cf  
 Outflow = 0.08 cfs @ 11.70 hrs, Volume= 1,644 cf, Atten= 83%, Lag= 0.0 min  
 Discarded = 0.08 cfs @ 11.70 hrs, Volume= 1,644 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 107.60' @ 12.55 hrs Surf.Area= 430 sf Storage= 457 cf

Plug-Flow detention time= 32.3 min calculated for 1,638 cf (100% of inflow)  
 Center-of-Mass det. time= 31.9 min ( 767.4 - 735.5 )

Volume	Invert	Avail.Storage	Storage Description
#1A	106.00'	391 cf	<b>11.17'W x 38.50'L x 3.54'H Field A</b>
			1,523 cf Overall - 544 cf Embedded = 979 cf x 40.0% Voids
#2A	106.50'	544 cf	<b>Cultec R-330XLHD x 10 Inside #1</b>
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 2 rows
		935 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	106.00'	<b>8.270 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.08 cfs @ 11.70 hrs HW=106.05' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.08 cfs)

**Pond ISA: Infiltration System A - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 2 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

5 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 36.50' Row Length +12.0" End Stone x 2 = 38.50' Base Length

2 Rows x 52.0" Wide + 6.0" Spacing x 1 + 12.0" Side Stone x 2 = 11.17' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

10 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 2 Rows = 543.9 cf Chamber Storage

1,522.6 cf Field - 543.9 cf Chambers = 978.7 cf Stone x 40.0% Voids = 391.5 cf Stone Storage

Chamber Storage + Stone Storage = 935.4 cf = 0.021 af



Overall Storage Efficiency = 61.4%

Overall System Size = 38.50' x 11.17' x 3.54'


10 Chambers

56.4 cy Field

36.2 cy Stone

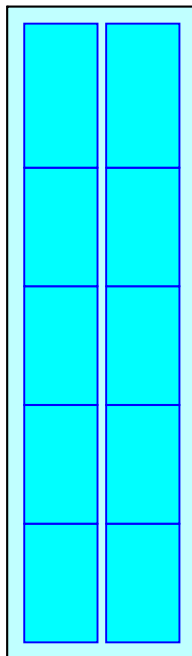

### Pond ISA: Infiltration System A

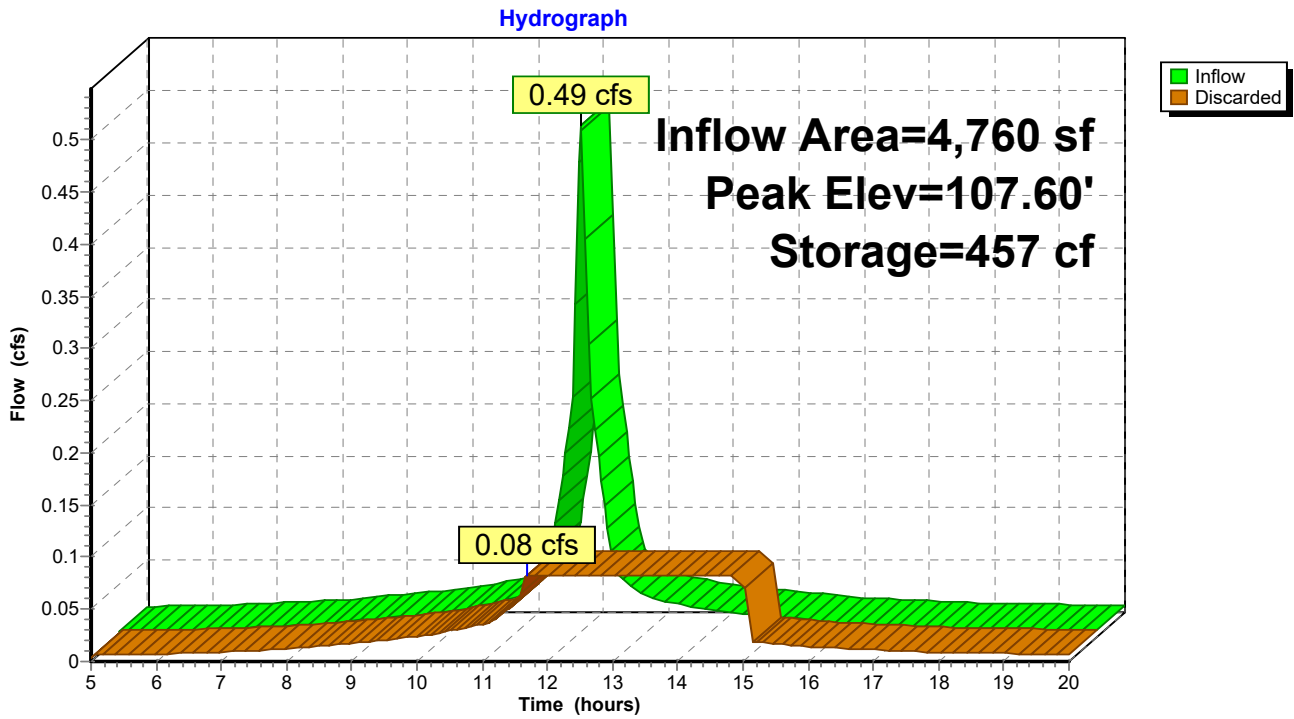

**Stage-Area-Storage for Pond ISA: Infiltration System A**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
106.00	430	0	108.65	430	769
106.05	430	9	108.70	430	781
106.10	430	17	108.75	430	792
106.15	430	26	108.80	430	803
106.20	430	34	108.85	430	814
106.25	430	43	108.90	430	824
106.30	430	52	108.95	430	833
106.35	430	60	109.00	430	842
106.40	430	69	109.05	430	851
106.45	430	77	109.10	430	859
106.50	430	86	109.15	430	868
106.55	430	103	109.20	430	877
106.60	430	121	109.25	430	885
106.65	430	138	109.30	430	894
106.70	430	155	109.35	430	902
106.75	430	172	109.40	430	911
106.80	430	189	109.45	430	920
106.85	430	206	109.50	430	928
106.90	430	223			
106.95	430	240			
107.00	430	257			
107.05	430	275			
107.10	430	291			
107.15	430	308			
107.20	430	325			
107.25	430	342			
107.30	430	358			
107.35	430	375			
107.40	430	391			
107.45	430	408			
107.50	430	424			
107.55	430	441			
107.60	430	457			
107.65	430	474			
107.70	430	490			
107.75	430	506			
107.80	430	522			
107.85	430	538			
107.90	430	554			
107.95	430	570			
108.00	430	585			
108.05	430	600			
108.10	430	616			
108.15	430	631			
108.20	430	645			
108.25	430	660			
108.30	430	675			
108.35	430	689			
108.40	430	703			
108.45	430	717			
108.50	430	730			
108.55	430	743			
108.60	430	756			



**Summary for Pond ISB: Infiltration System B**

Inflow Area = 4,760 sf, 100.00% Impervious, Inflow Depth > 4.15" for 10-Year event  
 Inflow = 0.49 cfs @ 12.09 hrs, Volume= 1,644 cf  
 Outflow = 0.03 cfs @ 10.85 hrs, Volume= 1,378 cf, Atten= 93%, Lag= 0.0 min  
 Discarded = 0.03 cfs @ 10.85 hrs, Volume= 1,378 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 107.27' @ 13.50 hrs Surf.Area= 586 sf Storage= 703 cf

Plug-Flow detention time= 152.2 min calculated for 1,373 cf (83% of inflow)  
 Center-of-Mass det. time= 104.7 min ( 840.2 - 735.5 )

Volume	Invert	Avail.Storage	Storage Description
#1A	105.50'	530 cf	<b>11.17'W x 52.50'L x 3.54'H Field A</b>
			2,076 cf Overall - 753 cf Embedded = 1,324 cf x 40.0% Voids
#2A	106.00'	753 cf	<b>Cultec R-330XLHD x 14 Inside #1</b>
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 2 rows
		1,282 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	105.50'	<b>2.410 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.03 cfs @ 10.85 hrs HW=105.54' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.03 cfs)

**Pond ISB: Infiltration System B - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 2 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

7 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 50.50' Row Length +12.0" End Stone x 2 = 52.50' Base Length

2 Rows x 52.0" Wide + 6.0" Spacing x 1 + 12.0" Side Stone x 2 = 11.17' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

14 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 2 Rows = 752.6 cf Chamber Storage

2,076.3 cf Field - 752.6 cf Chambers = 1,323.8 cf Stone x 40.0% Voids = 529.5 cf Stone Storage

Chamber Storage + Stone Storage = 1,282.1 cf = 0.029 af



Overall Storage Efficiency = 61.7%

Overall System Size = 52.50' x 11.17' x 3.54'


14 Chambers

76.9 cy Field

49.0 cy Stone



### Pond ISB: Infiltration System B

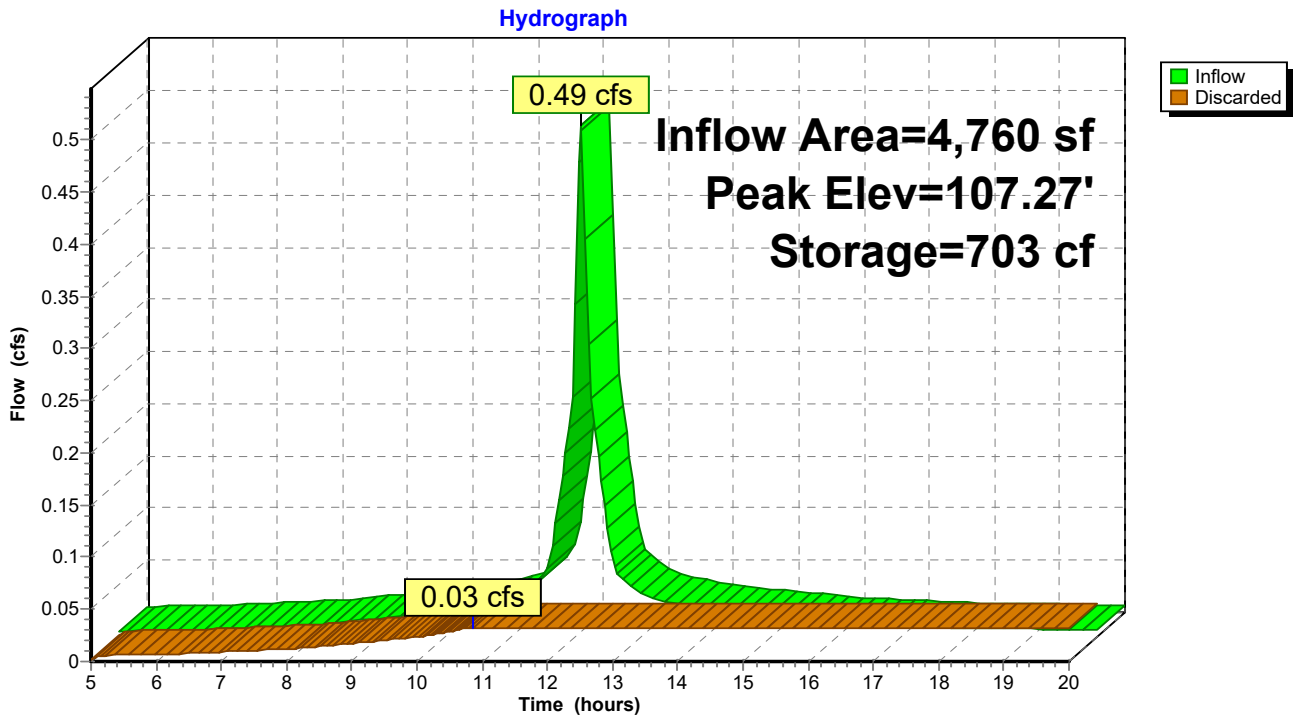

**Stage-Area-Storage for Pond ISB: Infiltration System B**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
105.50	<b>586</b>	0	108.15	586	1,055
105.55	586	12	108.20	586	1,071
105.60	586	23	108.25	586	1,087
105.65	586	35	108.30	586	1,102
105.70	586	47	108.35	586	1,116
105.75	586	59	108.40	586	1,130
105.80	586	70	108.45	586	1,143
105.85	586	82	108.50	586	1,155
105.90	586	94	108.55	586	1,167
105.95	586	106	108.60	586	1,178
106.00	586	117	108.65	586	1,190
106.05	586	141	108.70	586	1,202
106.10	586	165	108.75	586	1,214
106.15	586	188	108.80	586	1,225
106.20	586	212	108.85	586	1,237
106.25	586	235	108.90	586	1,249
106.30	586	259	108.95	586	1,261
106.35	586	282	109.00	586	<b>1,272</b>
106.40	586	306			
106.45	586	329			
106.50	586	353			
106.55	586	376			
106.60	586	399			
106.65	586	423			
106.70	586	446			
106.75	586	468			
106.80	586	491			
106.85	586	514			
106.90	586	537			
106.95	586	559			
107.00	586	582			
107.05	586	605			
107.10	586	627			
107.15	586	650			
107.20	586	672			
107.25	586	694			
107.30	586	717			
107.35	586	738			
107.40	586	760			
107.45	586	781			
107.50	586	803			
107.55	586	824			
107.60	586	844			
107.65	586	865			
107.70	586	885			
107.75	586	906			
107.80	586	925			
107.85	586	945			
107.90	586	964			
107.95	586	983			
108.00	586	1,002			
108.05	586	1,020			
108.10	586	1,037			

**Summary for Pond ISC: Infiltration System C**

Inflow Area = 6,800 sf, 100.00% Impervious, Inflow Depth > 4.15" for 10-Year event  
 Inflow = 0.70 cfs @ 12.09 hrs, Volume= 2,349 cf  
 Outflow = 0.03 cfs @ 9.25 hrs, Volume= 1,215 cf, Atten= 96%, Lag= 0.0 min  
 Discarded = 0.03 cfs @ 9.25 hrs, Volume= 1,215 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 106.24' @ 15.31 hrs Surf.Area= 1,094 sf Storage= 1,323 cf

Plug-Flow detention time= 161.9 min calculated for 1,214 cf (52% of inflow)  
 Center-of-Mass det. time= 68.7 min ( 804.2 - 735.5 )

Volume	Invert	Avail.Storage	Storage Description
#1A	104.50'	947 cf	<b>20.83'W x 52.50'L x 3.54'H Field A</b>
			3,874 cf Overall - 1,505 cf Embedded = 2,369 cf x 40.0% Voids
#2A	105.00'	1,505 cf	<b>Cultec R-330XLHD x 28 Inside #1</b>
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 4 rows
		2,453 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	104.50'	<b>1.020 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.03 cfs @ 9.25 hrs HW=104.54' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.03 cfs)

**Pond ISC: Infiltration System C - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 4 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

7 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 50.50' Row Length +12.0" End Stone x 2 = 52.50' Base Length

4 Rows x 52.0" Wide + 6.0" Spacing x 3 + 12.0" Side Stone x 2 = 20.83' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

28 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 4 Rows = 1,505.1 cf Chamber Storage

3,873.7 cf Field - 1,505.1 cf Chambers = 2,368.6 cf Stone x 40.0% Voids = 947.4 cf Stone Storage

Chamber Storage + Stone Storage = 2,452.5 cf = 0.056 af


Overall Storage Efficiency = 63.3%

Overall System Size = 52.50' x 20.83' x 3.54'


28 Chambers

143.5 cy Field

87.7 cy Stone

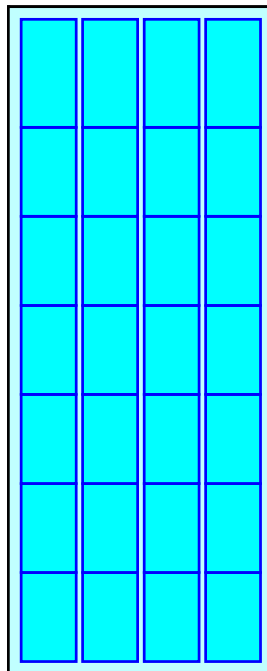

### Pond ISC: Infiltration System C

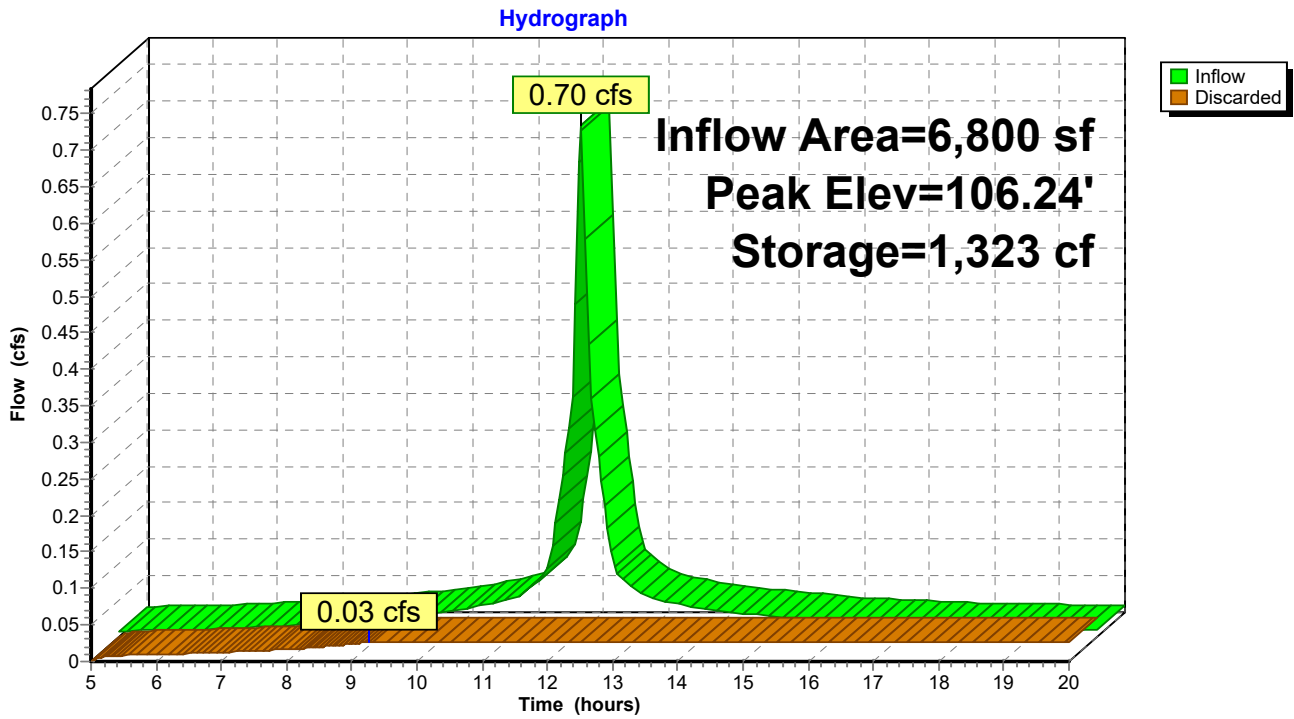

**Stage-Area-Storage for Pond ISC: Infiltration System C**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
104.50	<b>1,094</b>	0	107.15	1,094	2,026
104.55	1,094	22	107.20	1,094	2,057
104.60	1,094	44	107.25	1,094	2,087
104.65	1,094	66	107.30	1,094	2,116
104.70	1,094	88	107.35	1,094	2,143
104.75	1,094	109	107.40	1,094	2,169
104.80	1,094	131	107.45	1,094	2,193
104.85	1,094	153	107.50	1,094	2,216
104.90	1,094	175	107.55	1,094	2,237
104.95	1,094	197	107.60	1,094	2,259
105.00	1,094	219	107.65	1,094	2,281
105.05	1,094	265	107.70	1,094	2,303
105.10	1,094	311	107.75	1,094	2,325
105.15	1,094	356	107.80	1,094	2,347
105.20	1,094	402	107.85	1,094	2,369
105.25	1,094	447	107.90	1,094	2,391
105.30	1,094	493	107.95	1,094	2,412
105.35	1,094	538	108.00	1,094	<b>2,434</b>
105.40	1,094	584			
105.45	1,094	629			
105.50	1,094	674			
105.55	1,094	719			
105.60	1,094	764			
105.65	1,094	809			
105.70	1,094	853			
105.75	1,094	897			
105.80	1,094	941			
105.85	1,094	985			
105.90	1,094	1,029			
105.95	1,094	1,073			
106.00	1,094	1,117			
106.05	1,094	1,161			
106.10	1,094	1,204			
106.15	1,094	1,247			
106.20	1,094	1,291			
106.25	1,094	1,334			
106.30	1,094	1,376			
106.35	1,094	1,418			
106.40	1,094	1,460			
106.45	1,094	1,501			
106.50	1,094	1,542			
106.55	1,094	1,583			
106.60	1,094	1,623			
106.65	1,094	1,662			
106.70	1,094	1,702			
106.75	1,094	1,740			
106.80	1,094	1,778			
106.85	1,094	1,816			
106.90	1,094	1,853			
106.95	1,094	1,889			
107.00	1,094	1,924			
107.05	1,094	1,959			
107.10	1,094	1,993			



**Summary for Pond ISD: Infiltration System D**

Inflow Area = 100,549 sf, 39.97% Impervious, Inflow Depth > 1.74" for 10-Year event  
 Inflow = 4.88 cfs @ 12.10 hrs, Volume= 14,593 cf  
 Outflow = 0.20 cfs @ 11.55 hrs, Volume= 6,618 cf, Atten= 96%, Lag= 0.0 min  
 Discarded = 0.20 cfs @ 11.55 hrs, Volume= 6,618 cf  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 105.47' @ 16.05 hrs Surf.Area= 8,610 sf Storage= 8,888 cf

Plug-Flow detention time= 209.1 min calculated for 6,596 cf (45% of inflow)  
 Center-of-Mass det. time= 121.2 min ( 929.6 - 808.3 )

Volume	Invert	Avail.Storage	Storage Description
#1A	104.00'	7,100 cf	<b>54.67'W x 157.50'L x 3.54'H Field A</b> 30,494 cf Overall - 12,745 cf Embedded = 17,749 cf x 40.0% Voids
#2A	104.50'	12,745 cf	<b>Cultec R-330XLHD x 242 Inside #1</b> Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap Row Length Adjustment= +1.50' x 7.45 sf x 11 rows
		19,844 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	104.00'	<b>1.020 in/hr Exfiltration over Surface area</b>
#2	Primary	106.00'	<b>12.0" Round Culvert</b> L= 94.0' CMP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 106.00' / 105.00' S= 0.0106 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#3	Device 2	107.00'	<b>12.0" Round Culvert</b> L= 70.0' CMP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 107.00' / 106.30' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#4	Device 3	107.40'	<b>4.0' long Sharp-Crested Rectangular Weir 2 End Contraction(s)</b> 4.0' Crest Height

**Discarded OutFlow** Max=0.20 cfs @ 11.55 hrs HW=104.04' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.20 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=104.00' (Free Discharge)  
 ↑2=Culvert ( Controls 0.00 cfs)  
 ↑3=Culvert ( Controls 0.00 cfs)  
 ↑4=Sharp-Crested Rectangular Weir ( Controls 0.00 cfs)

### Pond ISD: Infiltration System D - Chamber Wizard Field A

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 11 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

22 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 155.50' Row Length +12.0" End Stone x 2 = 157.50' Base Length

11 Rows x 52.0" Wide + 6.0" Spacing x 10 + 12.0" Side Stone x 2 = 54.67' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

242 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 11 Rows = 12,744.9 cf Chamber Storage


30,493.8 cf Field - 12,744.9 cf Chambers = 17,748.8 cf Stone x 40.0% Voids = 7,099.5 cf Stone Storage

Chamber Storage + Stone Storage = 19,844.5 cf = 0.456 af


Overall Storage Efficiency = 65.1%

Overall System Size = 157.50' x 54.67' x 3.54'

242 Chambers  
1,129.4 cy Field  
657.4 cy Stone

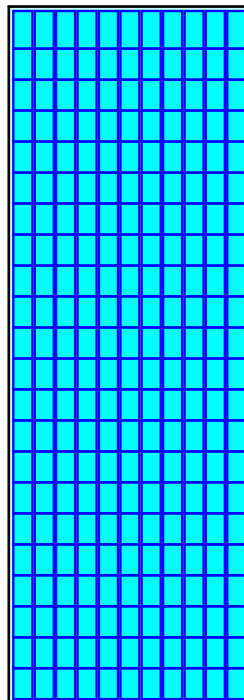

### Pond ISD: Infiltration System D

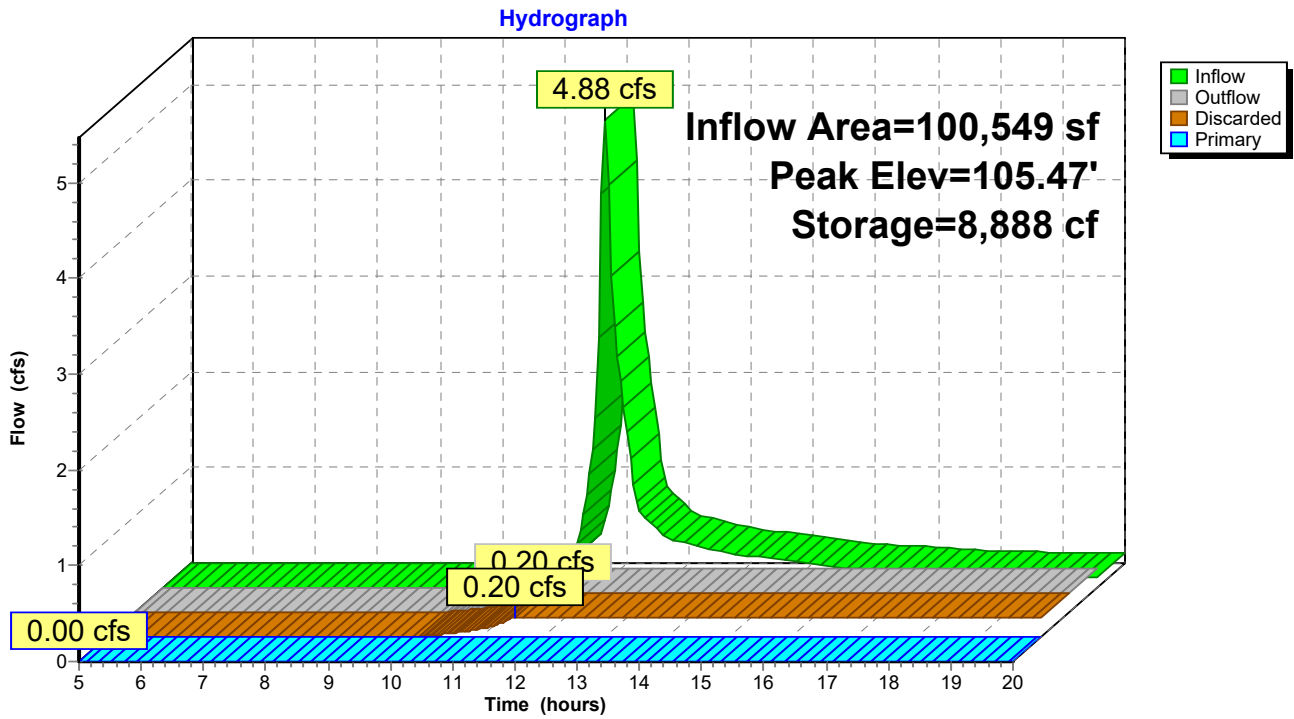

**Stage-Area-Storage for Pond ISD: Infiltration System D**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
104.00	8,610	0	106.65	8,610	16,461
104.05	8,610	172	106.70	8,610	16,716
104.10	8,610	344	106.75	8,610	16,958
104.15	8,610	517	106.80	8,610	17,187
104.20	8,610	689	106.85	8,610	17,403
104.25	8,610	861	106.90	8,610	17,607
104.30	8,610	1,033	106.95	8,610	17,799
104.35	8,610	1,205	107.00	8,610	17,979
104.40	8,610	1,378	107.05	8,610	18,151
104.45	8,610	1,550	107.10	8,610	18,323
104.50	8,610	1,722	107.15	8,610	18,496
104.55	8,610	2,098	107.20	8,610	18,668
104.60	8,610	2,473	107.25	8,610	18,840
104.65	8,610	2,847	107.30	8,610	19,012
104.70	8,610	3,220	107.35	8,610	19,184
104.75	8,610	3,593	107.40	8,610	19,357
104.80	8,610	3,964	107.45	8,610	19,529
104.85	8,610	4,336	107.50	8,610	19,701
104.90	8,610	4,707	107.55	8,610	<b>19,844</b>
104.95	8,610	5,078	107.60	8,610	19,844
105.00	8,610	5,448	107.65	8,610	19,844
105.05	8,610	5,817	107.70	8,610	19,844
105.10	8,610	6,185	107.75	8,610	19,844
105.15	8,610	6,550	107.80	8,610	19,844
105.20	8,610	6,913	107.85	8,610	19,844
105.25	8,610	7,274	107.90	8,610	19,844
105.30	8,610	7,633	107.95	8,610	19,844
105.35	8,610	7,992	108.00	8,610	19,844
105.40	8,610	8,351			
105.45	8,610	8,709			
105.50	8,610	9,066			
105.55	8,610	9,423			
105.60	8,610	9,778			
105.65	8,610	10,133			
105.70	8,610	10,486			
105.75	8,610	10,838			
105.80	8,610	11,185			
105.85	8,610	11,529			
105.90	8,610	11,869			
105.95	8,610	12,205			
106.00	8,610	12,538			
106.05	8,610	12,868			
106.10	8,610	13,194			
106.15	8,610	13,517			
106.20	8,610	13,835			
106.25	8,610	14,149			
106.30	8,610	14,459			
106.35	8,610	14,763			
106.40	8,610	15,063			
106.45	8,610	15,356			
106.50	8,610	15,644			
106.55	8,610	15,924			
106.60	8,610	16,197			

**Summary for Pond ND: Natural Depression**

Inflow Area = 25,666 sf, 0.87% Impervious, Inflow Depth > 0.22" for 10-Year event  
 Inflow = 0.05 cfs @ 12.39 hrs, Volume= 481 cf  
 Outflow = 0.02 cfs @ 14.03 hrs, Volume= 468 cf, Atten= 58%, Lag= 98.0 min  
 Discarded = 0.02 cfs @ 14.03 hrs, Volume= 468 cf  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 108.04' @ 14.03 hrs Surf.Area= 386 sf Storage= 69 cf

Plug-Flow detention time= 41.0 min calculated for 466 cf (97% of inflow)  
 Center-of-Mass det. time= 33.0 min ( 937.3 - 904.3 )


Volume	Invert	Avail.Storage	Storage Description			
#1	108.00'	3,293 cf	<b>Custom Stage Data (Irregular)</b> Listed below			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
108.00	235	88.4	0	0	235	
109.00	4,354	655.7	1,867	1,867	33,829	
109.30	5,162	671.6	1,426	3,293	35,520	

Device	Routing	Invert	Outlet Devices									
#1	Primary	109.00'	<b>2.0' long x 10.0' breadth Broad-Crested Rectangular Weir</b>									
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60									
			Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64									
#2	Discarded	108.00'	<b>2.410 in/hr Exfiltration over Surface area</b>									

**Discarded OutFlow** Max=0.02 cfs @ 14.03 hrs HW=108.04' (Free Discharge)  
 ↑**2=Exfiltration** (Exfiltration Controls 0.02 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=108.00' (Free Discharge)  
 ↑**1=Broad-Crested Rectangular Weir** ( Controls 0.00 cfs)

### Pond ND: Natural Depression

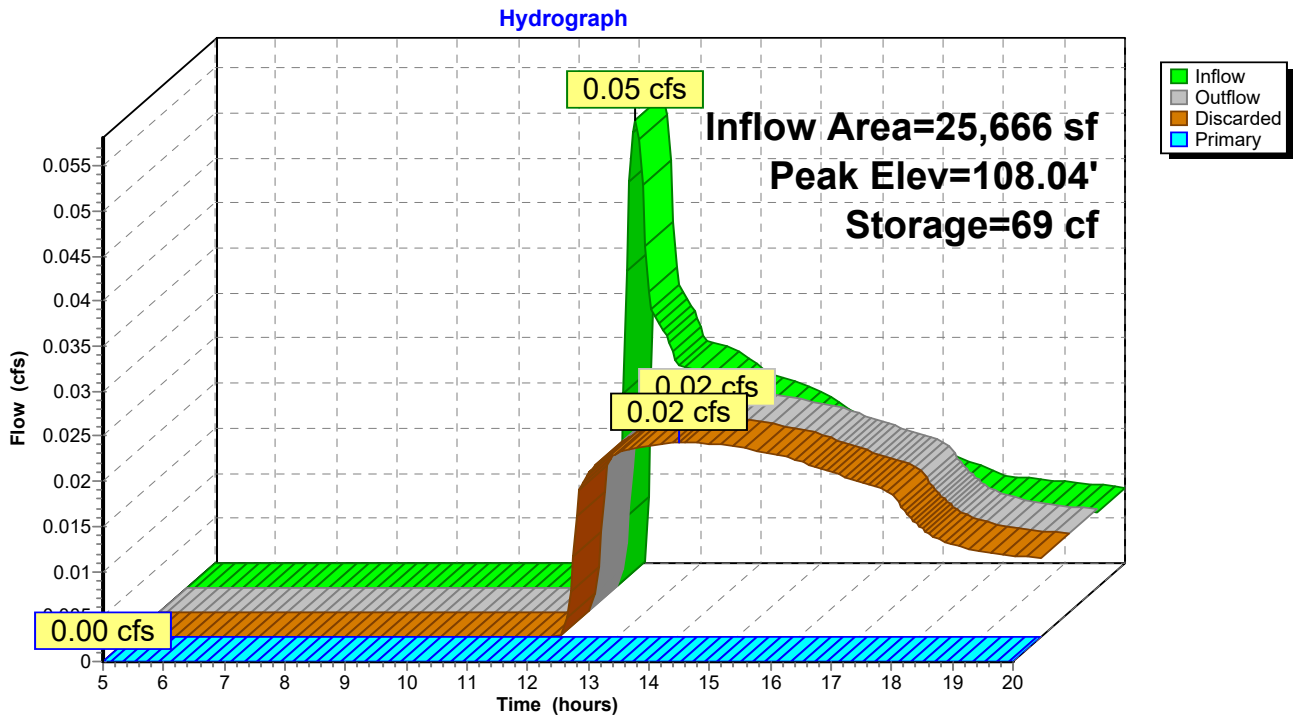

**Stage-Area-Storage for Pond ND: Natural Depression**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
108.00	235	0	109.06	4,516	2,152
108.02	317	37	109.08	4,569	2,247
108.04	400	75	109.10	4,623	2,342
108.06	482	112	109.12	4,677	2,437
108.08	565	149	109.14	4,731	2,532
108.10	647	187	109.16	4,785	2,627
108.12	729	224	109.18	4,839	2,722
108.14	812	261	109.20	4,893	2,817
108.16	894	299	109.22	4,947	2,912
108.18	976	336	109.24	5,000	3,007
108.20	1,059	373	109.26	5,054	3,102
108.22	1,141	411	109.28	5,108	3,197
108.24	1,224	448	109.30	<b>5,162</b>	<b>3,293</b>
108.26	1,306	485			
108.28	1,388	523			
108.30	1,471	560			
108.32	1,553	597			
108.34	1,635	635			
108.36	1,718	672			
108.38	1,800	709			
108.40	1,883	747			
108.42	1,965	784			
108.44	2,047	821			
108.46	2,130	859			
108.48	2,212	896			
108.50	2,295	933			
108.52	2,377	971			
108.54	2,459	1,008			
108.56	2,542	1,045			
108.58	2,624	1,083			
108.60	2,706	1,120			
108.62	2,789	1,157			
108.64	2,871	1,195			
108.66	2,954	1,232			
108.68	3,036	1,269			
108.70	3,118	1,307			
108.72	3,201	1,344			
108.74	3,283	1,381			
108.76	3,365	1,419			
108.78	3,448	1,456			
108.80	3,530	1,493			
108.82	3,613	1,531			
108.84	3,695	1,568			
108.86	3,777	1,605			
108.88	3,860	1,643			
108.90	3,942	1,680			
108.92	4,024	1,717			
108.94	4,107	1,755			
108.96	4,189	1,792			
108.98	4,272	1,830			
109.00	4,354	1,867			
109.02	4,408	1,962			
109.04	4,462	2,057			

**Summary for Subcatchment 2ISD: To Infiltration System D**

Runoff = 6.53 cfs @ 12.10 hrs, Volume= 19,386 cf, Depth> 2.31"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-Year Rainfall=5.50"

Area (sf)	CN	Description
3,059	30	Woods, Good, HSG A
17,768	39	>75% Grass cover, Good, HSG A
17,904	98	Unconnected pavement, HSG A
1,960	55	Woods, Good, HSG B
35,785	61	>75% Grass cover, Good, HSG B
1,786	96	Gravel surface, HSG B
22,287	98	Unconnected pavement, HSG B
100,549	71	Weighted Average
60,358		60.03% Pervious Area
40,191		39.97% Impervious Area
40,191		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.3	50	0.0400	0.20		<b>Sheet Flow, Grass AB</b> Grass: Short n= 0.150 P2= 3.20"
1.6	115	0.0300	1.21		<b>Shallow Concentrated Flow, Grass BC</b> Short Grass Pasture Kv= 7.0 fps
0.5	136	0.0100	4.54	3.56	<b>Pipe Channel, Pipe CD</b> 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.013 Corrugated PE, smooth interior
6.4	301	Total			



### Subcatchment 2ISD: To Infiltration System D

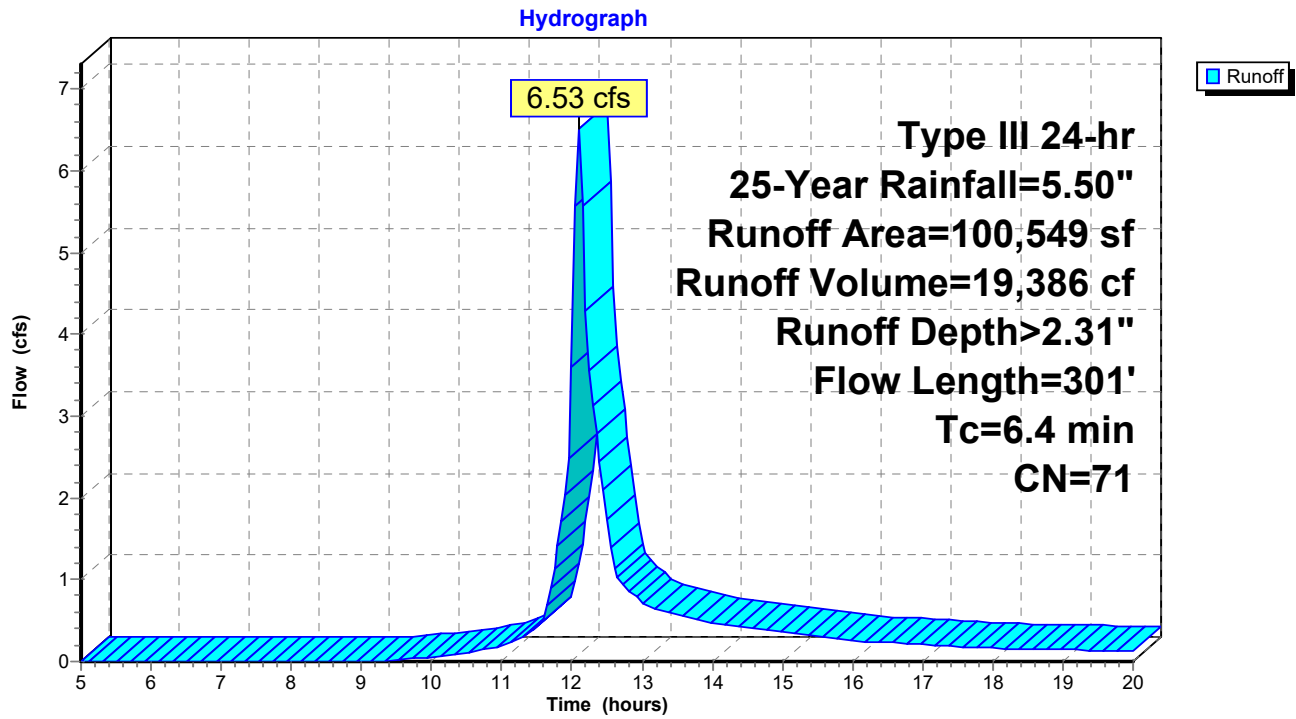

**Summary for Subcatchment 2ND: To Natural Depression**


Runoff = 0.14 cfs @ 12.29 hrs, Volume= 917 cf, Depth> 0.43"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-Year Rainfall=5.50"

Area (sf)	CN	Description
4,045	30	Woods, Good, HSG A
18,978	39	>75% Grass cover, Good, HSG A
1,946	96	Gravel surface, HSG A
224	98	Unconnected pavement, HSG A
473	61	>75% Grass cover, Good, HSG B
25,666	43	Weighted Average
25,442		99.13% Pervious Area
224		0.87% Impervious Area
224		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, AB-Grass

**Subcatchment 2ND: To Natural Depression**

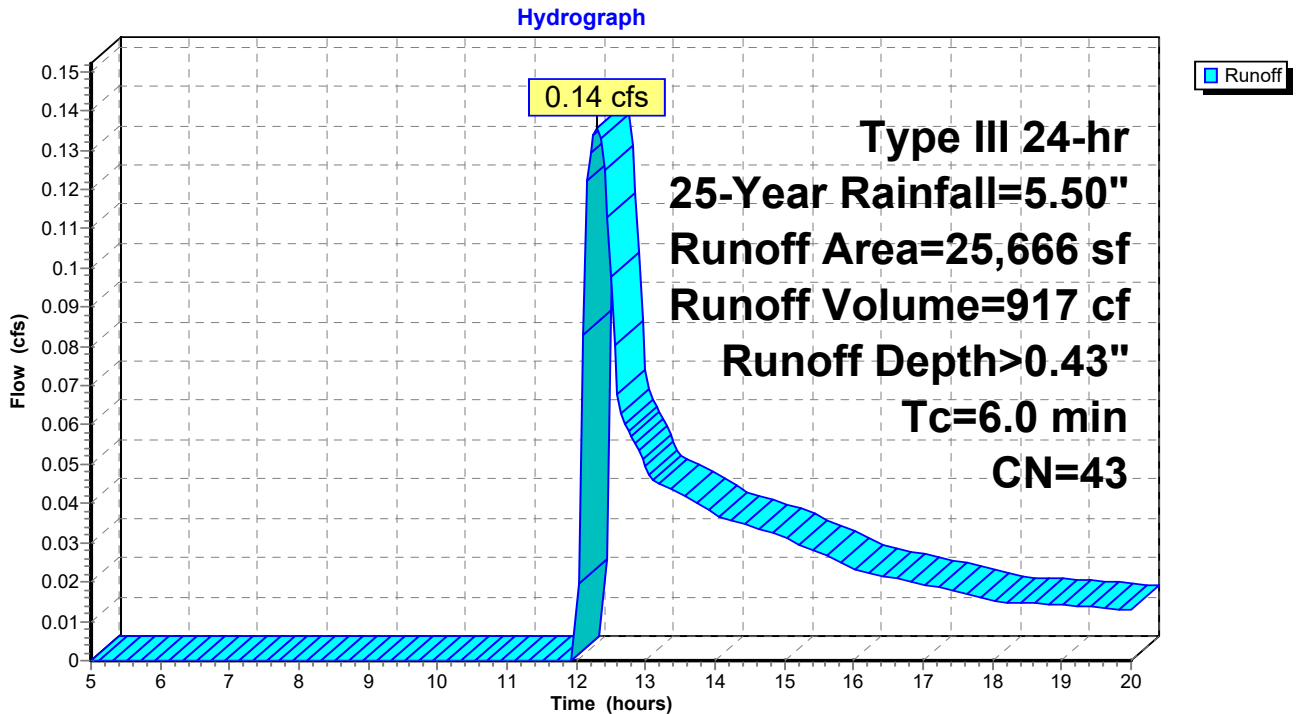

**Summary for Subcatchment EU: Eastern Units**

Runoff = 0.57 cfs @ 12.09 hrs, Volume= 1,933 cf, Depth> 4.87"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-Year Rainfall=5.50"

Area (sf)	CN	Description
4,760	98	Roofs, HSG D
4,760		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment EU: Eastern Units**

Hydrograph

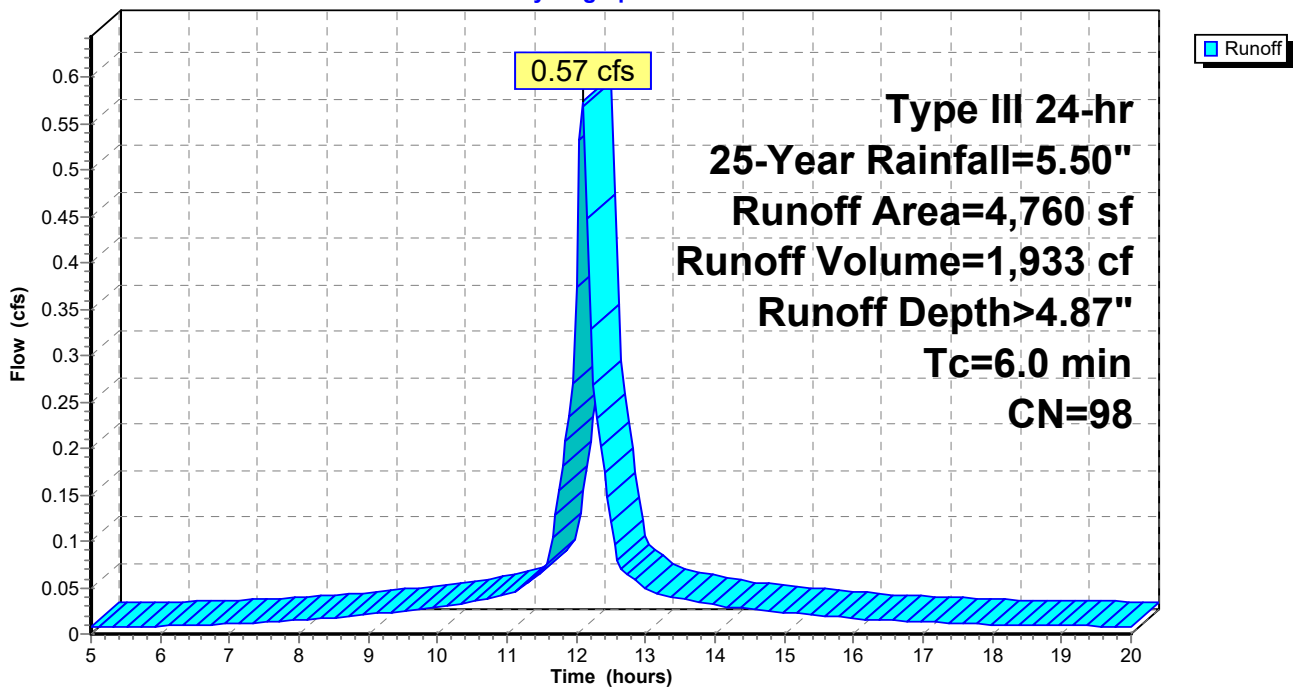

**Summary for Subcatchment N: Offsite North**


Runoff = 0.03 cfs @ 12.43 hrs, Volume= 308 cf, Depth> 0.22"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-Year Rainfall=5.50"

Area (sf)	CN	Description
4,653	30	Woods, Good, HSG A
11,862	39	>75% Grass cover, Good, HSG A
417	96	Gravel surface, HSG A
48	98	Unconnected pavement, HSG A
16,980	38	Weighted Average
16,932		99.72% Pervious Area
48		0.28% Impervious Area
48		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, AB-Grass

**Subcatchment N: Offsite North**

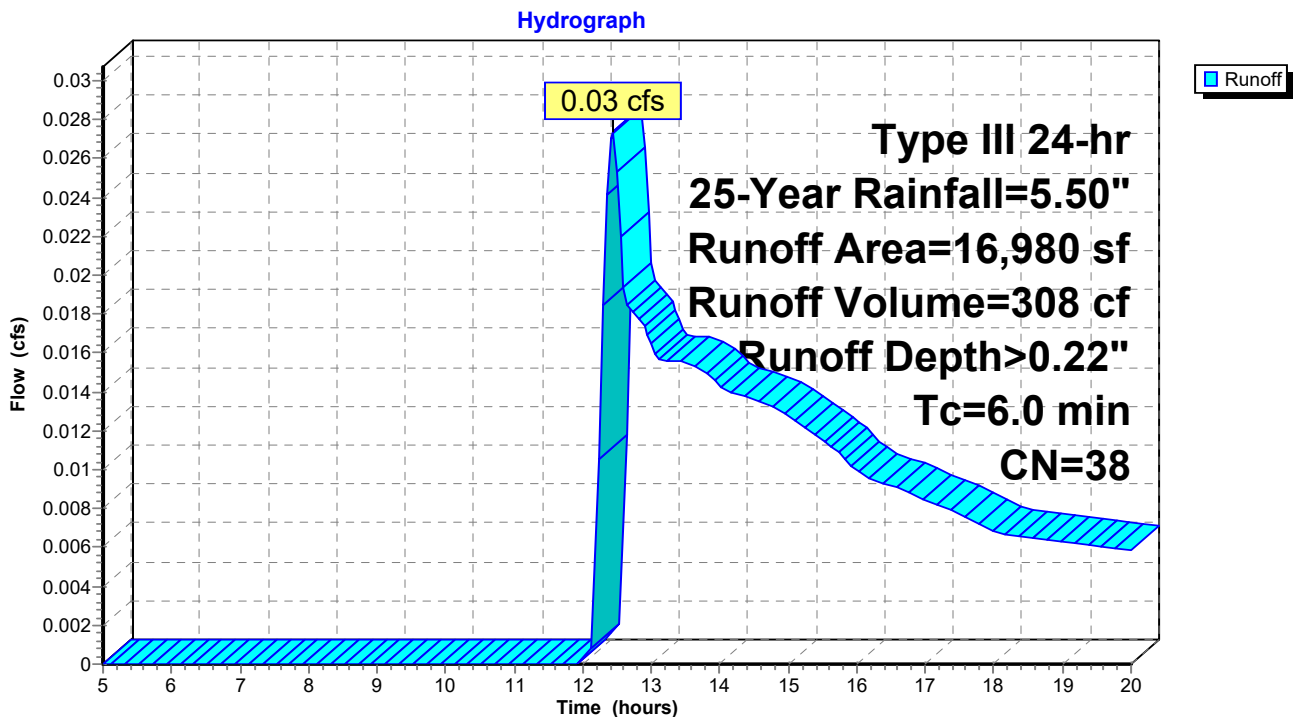

**Summary for Subcatchment NU: Northern Units**

Runoff = 0.82 cfs @ 12.09 hrs, Volume= 2,762 cf, Depth> 4.87"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-Year Rainfall=5.50"

Area (sf)	CN	Description
6,800	98	Roofs, HSG D
6,800		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment NU: Northern Units**

Hydrograph

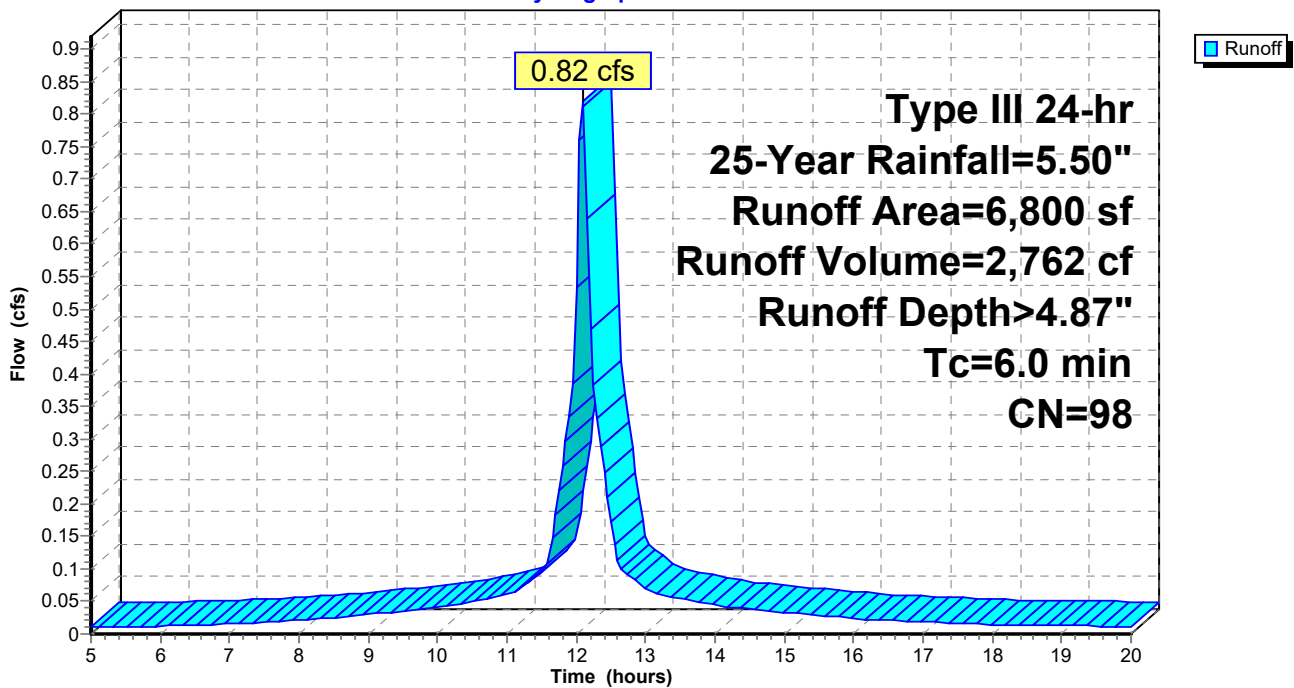

**Summary for Subcatchment S: Onsite South**

Runoff = 0.00 cfs @ 14.94 hrs, Volume= 71 cf, Depth> 0.09"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-Year Rainfall=5.50"

Area (sf)	CN	Description
5,286	30	Woods, Good, HSG A
4,154	39	>75% Grass cover, Good, HSG A
63	98	Unconnected roofs, HSG A
9,503	34	Weighted Average
9,440		99.34% Pervious Area
63		0.66% Impervious Area
63		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
13.8	50	0.0150	0.06		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
0.6	21	0.0150	0.61		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
14.4	71	Total			

**Subcatchment S: Onsite South**

Hydrograph

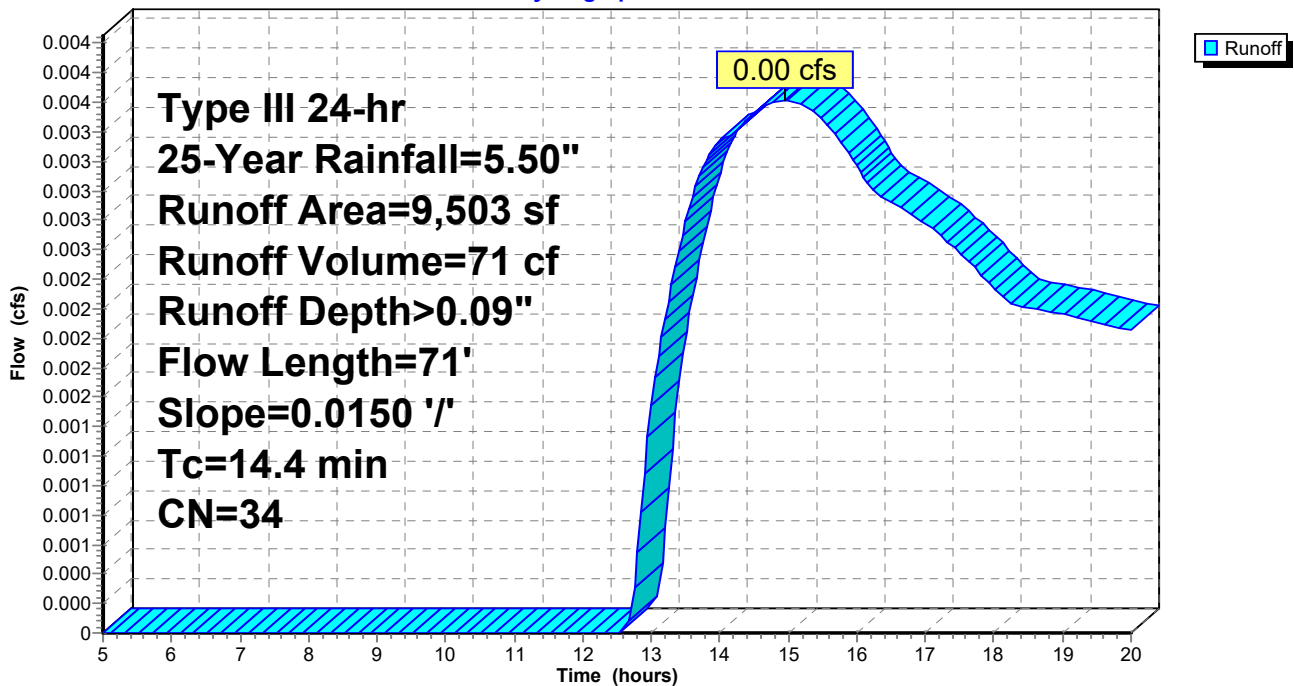

**Summary for Subcatchment WU: Western Units**

Runoff = 0.57 cfs @ 12.09 hrs, Volume= 1,933 cf, Depth> 4.87"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 25-Year Rainfall=5.50"

Area (sf)	CN	Description
4,760	98	Roofs, HSG D
4,760		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment WU: Western Units**

Hydrograph

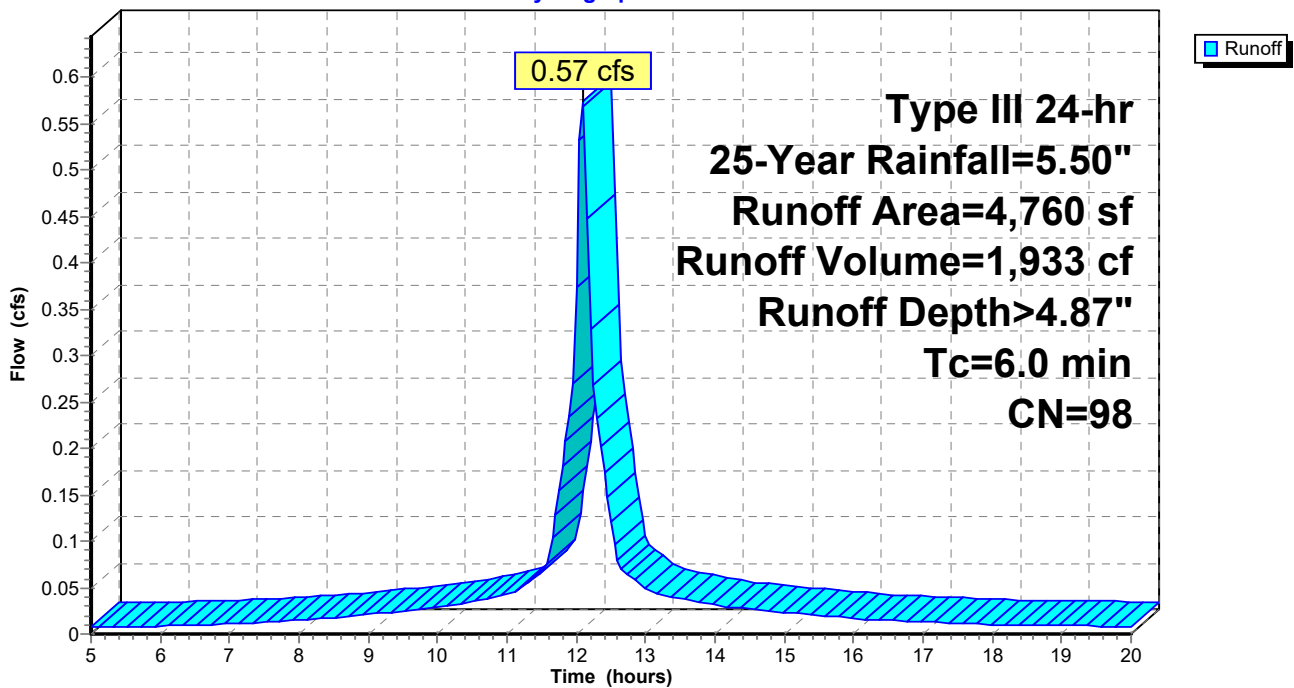


### Summary for Reach TN: Total North

Inflow Area = 143,195 sf, 28.26% Impervious, Inflow Depth > 0.03" for 25-Year event  
 Inflow = 0.03 cfs @ 12.43 hrs, Volume= 308 cf  
 Outflow = 0.03 cfs @ 12.43 hrs, Volume= 308 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

### Reach TN: Total North

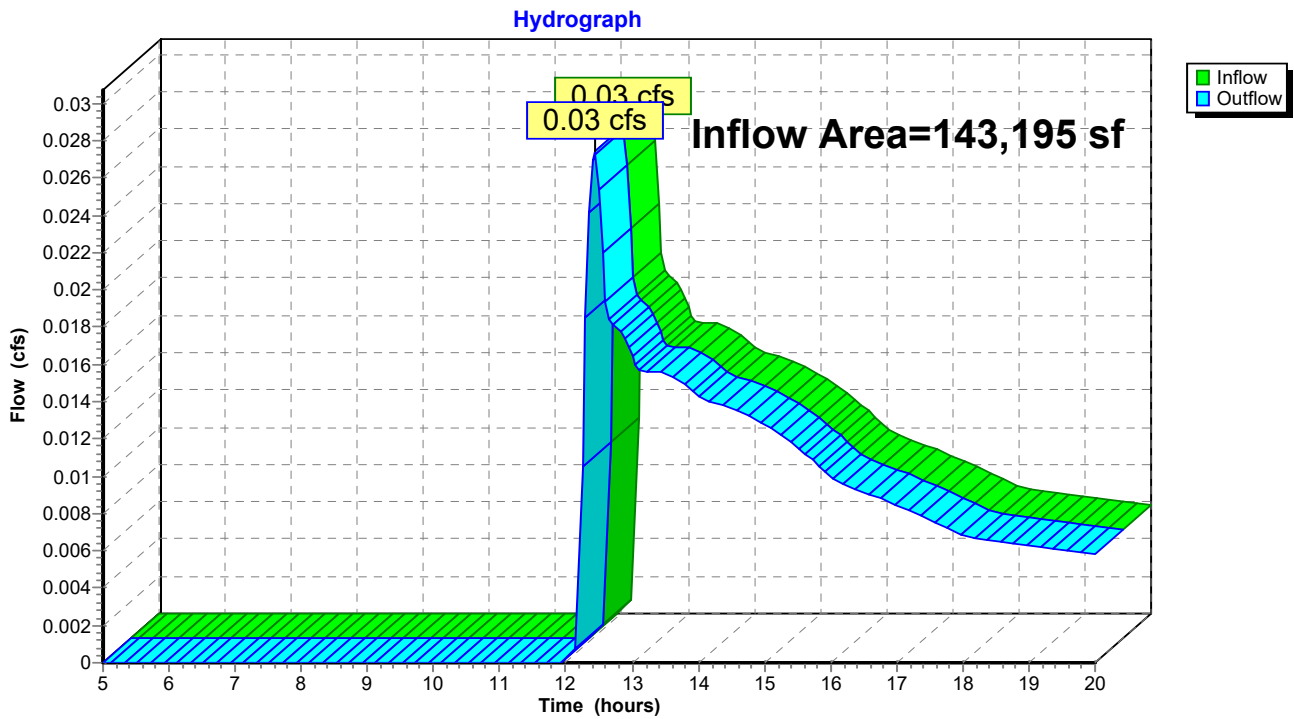



**Summary for Pond ISA: Infiltration System A**

Inflow Area = 4,760 sf, 100.00% Impervious, Inflow Depth > 4.87" for 25-Year event  
 Inflow = 0.57 cfs @ 12.09 hrs, Volume= 1,933 cf  
 Outflow = 0.08 cfs @ 11.65 hrs, Volume= 1,933 cf, Atten= 86%, Lag= 0.0 min  
 Discarded = 0.08 cfs @ 11.65 hrs, Volume= 1,933 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 107.99' @ 12.59 hrs Surf.Area= 430 sf Storage= 583 cf

Plug-Flow detention time= 43.7 min calculated for 1,933 cf (100% of inflow)  
 Center-of-Mass det. time= 43.5 min ( 778.0 - 734.6 )

Volume	Invert	Avail.Storage	Storage Description
#1A	106.00'	391 cf	<b>11.17'W x 38.50'L x 3.54'H Field A</b>
			1,523 cf Overall - 544 cf Embedded = 979 cf x 40.0% Voids
#2A	106.50'	544 cf	<b>Cultec R-330XLHD x 10 Inside #1</b>
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 2 rows
		935 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	106.00'	<b>8.270 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.08 cfs @ 11.65 hrs HW=106.05' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.08 cfs)

**Pond ISA: Infiltration System A - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 2 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

5 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 36.50' Row Length +12.0" End Stone x 2 = 38.50' Base Length

2 Rows x 52.0" Wide + 6.0" Spacing x 1 + 12.0" Side Stone x 2 = 11.17' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

10 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 2 Rows = 543.9 cf Chamber Storage

1,522.6 cf Field - 543.9 cf Chambers = 978.7 cf Stone x 40.0% Voids = 391.5 cf Stone Storage

Chamber Storage + Stone Storage = 935.4 cf = 0.021 af



Overall Storage Efficiency = 61.4%

Overall System Size = 38.50' x 11.17' x 3.54'


10 Chambers

56.4 cy Field

36.2 cy Stone

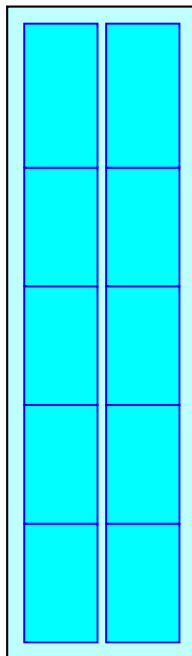

### Pond ISA: Infiltration System A

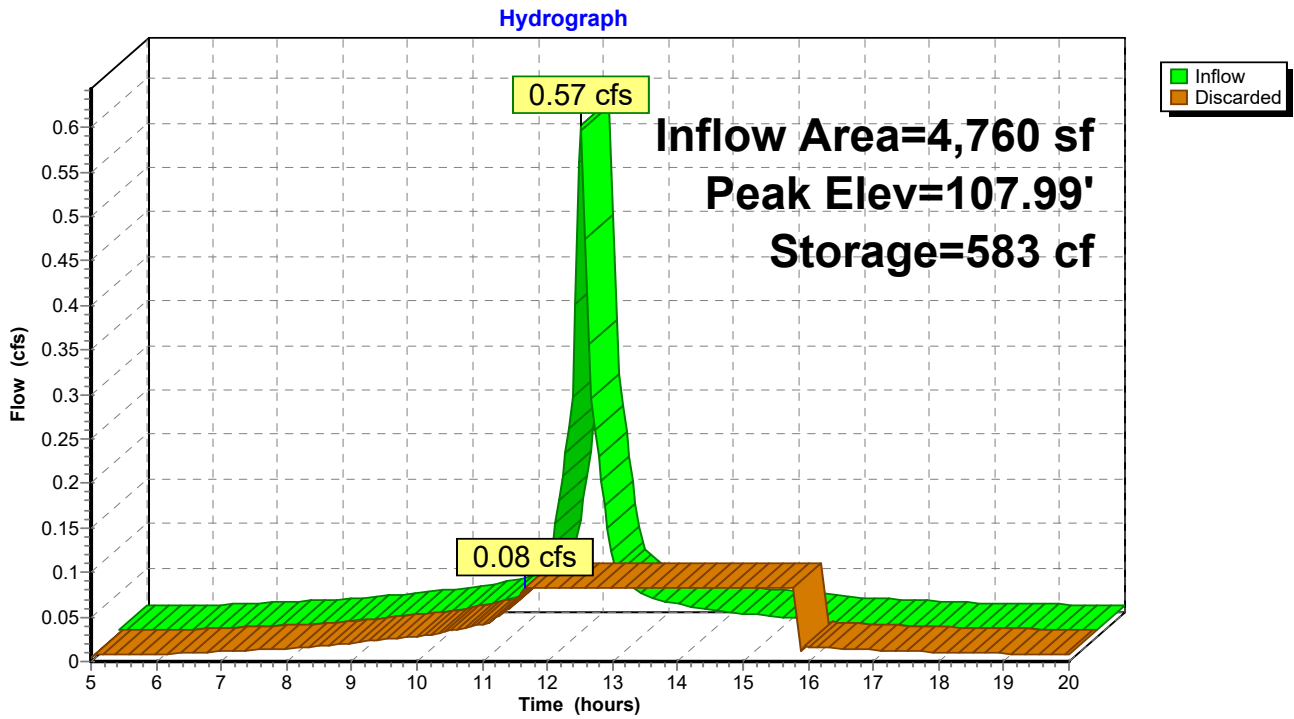

**Stage-Area-Storage for Pond ISA: Infiltration System A**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
106.00	430	0	108.65	430	769
106.05	430	9	108.70	430	781
106.10	430	17	108.75	430	792
106.15	430	26	108.80	430	803
106.20	430	34	108.85	430	814
106.25	430	43	108.90	430	824
106.30	430	52	108.95	430	833
106.35	430	60	109.00	430	842
106.40	430	69	109.05	430	851
106.45	430	77	109.10	430	859
106.50	430	86	109.15	430	868
106.55	430	103	109.20	430	877
106.60	430	121	109.25	430	885
106.65	430	138	109.30	430	894
106.70	430	155	109.35	430	902
106.75	430	172	109.40	430	911
106.80	430	189	109.45	430	920
106.85	430	206	109.50	430	<b>928</b>
106.90	430	223			
106.95	430	240			
107.00	430	257			
107.05	430	275			
107.10	430	291			
107.15	430	308			
107.20	430	325			
107.25	430	342			
107.30	430	358			
107.35	430	375			
107.40	430	391			
107.45	430	408			
107.50	430	424			
107.55	430	441			
107.60	430	457			
107.65	430	474			
107.70	430	490			
107.75	430	506			
107.80	430	522			
107.85	430	538			
107.90	430	554			
107.95	430	570			
108.00	430	585			
108.05	430	600			
108.10	430	616			
108.15	430	631			
108.20	430	645			
108.25	430	660			
108.30	430	675			
108.35	430	689			
108.40	430	703			
108.45	430	717			
108.50	430	730			
108.55	430	743			
108.60	430	756			

**Summary for Pond ISB: Infiltration System B**

Inflow Area = 4,760 sf, 100.00% Impervious, Inflow Depth > 4.87" for 25-Year event  
 Inflow = 0.57 cfs @ 12.09 hrs, Volume= 1,933 cf  
 Outflow = 0.03 cfs @ 10.45 hrs, Volume= 1,430 cf, Atten= 94%, Lag= 0.0 min  
 Discarded = 0.03 cfs @ 10.45 hrs, Volume= 1,430 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 107.70' @ 13.88 hrs Surf.Area= 586 sf Storage= 887 cf

Plug-Flow detention time= 157.2 min calculated for 1,429 cf (74% of inflow)  
 Center-of-Mass det. time= 93.5 min ( 828.1 - 734.6 )

Volume	Invert	Avail.Storage	Storage Description
#1A	105.50'	530 cf	<b>11.17'W x 52.50'L x 3.54'H Field A</b>
			2,076 cf Overall - 753 cf Embedded = 1,324 cf x 40.0% Voids
#2A	106.00'	753 cf	<b>Cultec R-330XLHD x 14 Inside #1</b>
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 2 rows
		1,282 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	105.50'	<b>2.410 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.03 cfs @ 10.45 hrs HW=105.54' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.03 cfs)

**Pond ISB: Infiltration System B - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 2 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

7 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 50.50' Row Length +12.0" End Stone x 2 = 52.50' Base Length

2 Rows x 52.0" Wide + 6.0" Spacing x 1 + 12.0" Side Stone x 2 = 11.17' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

14 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 2 Rows = 752.6 cf Chamber Storage

2,076.3 cf Field - 752.6 cf Chambers = 1,323.8 cf Stone x 40.0% Voids = 529.5 cf Stone Storage

Chamber Storage + Stone Storage = 1,282.1 cf = 0.029 af



Overall Storage Efficiency = 61.7%

Overall System Size = 52.50' x 11.17' x 3.54'


14 Chambers

76.9 cy Field

49.0 cy Stone



### Pond ISB: Infiltration System B

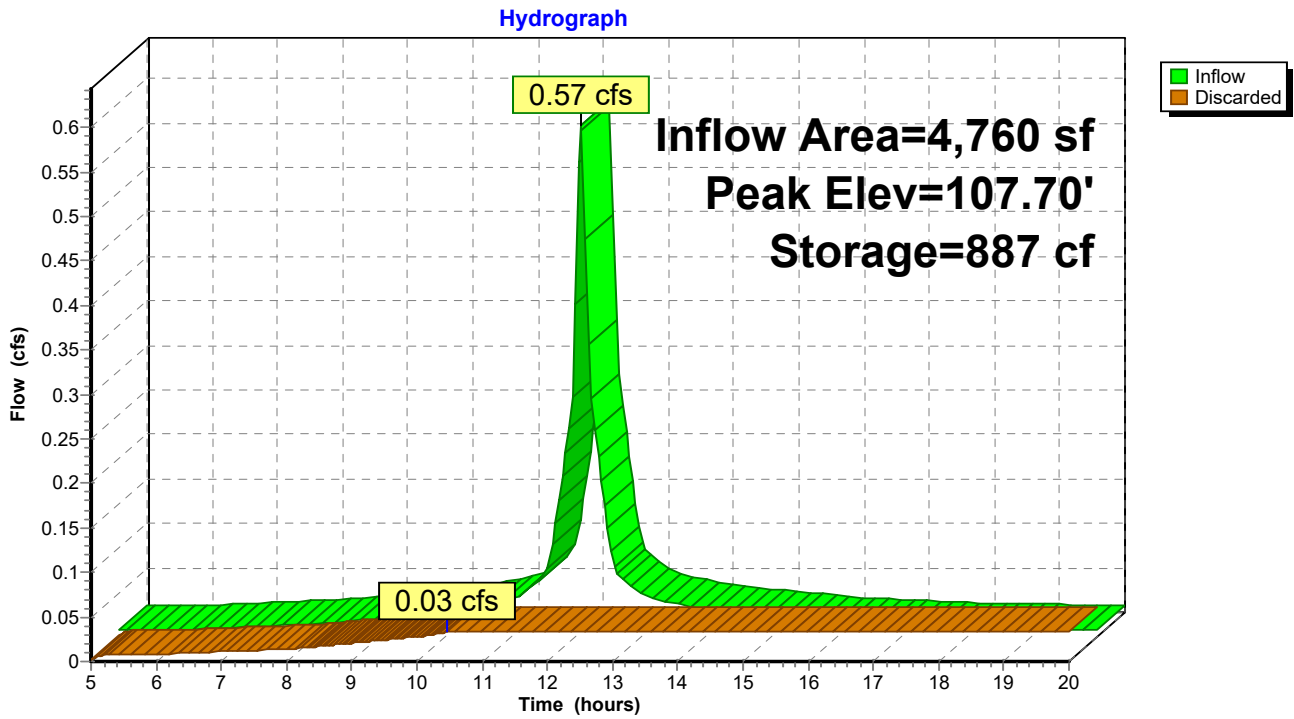

**Stage-Area-Storage for Pond ISB: Infiltration System B**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
105.50	<b>586</b>	0	108.15	586	1,055
105.55	586	12	108.20	586	1,071
105.60	586	23	108.25	586	1,087
105.65	586	35	108.30	586	1,102
105.70	586	47	108.35	586	1,116
105.75	586	59	108.40	586	1,130
105.80	586	70	108.45	586	1,143
105.85	586	82	108.50	586	1,155
105.90	586	94	108.55	586	1,167
105.95	586	106	108.60	586	1,178
106.00	586	117	108.65	586	1,190
106.05	586	141	108.70	586	1,202
106.10	586	165	108.75	586	1,214
106.15	586	188	108.80	586	1,225
106.20	586	212	108.85	586	1,237
106.25	586	235	108.90	586	1,249
106.30	586	259	108.95	586	1,261
106.35	586	282	109.00	586	<b>1,272</b>
106.40	586	306			
106.45	586	329			
106.50	586	353			
106.55	586	376			
106.60	586	399			
106.65	586	423			
106.70	586	446			
106.75	586	468			
106.80	586	491			
106.85	586	514			
106.90	586	537			
106.95	586	559			
107.00	586	582			
107.05	586	605			
107.10	586	627			
107.15	586	650			
107.20	586	672			
107.25	586	694			
107.30	586	717			
107.35	586	738			
107.40	586	760			
107.45	586	781			
107.50	586	803			
107.55	586	824			
107.60	586	844			
107.65	586	865			
107.70	586	885			
107.75	586	906			
107.80	586	925			
107.85	586	945			
107.90	586	964			
107.95	586	983			
108.00	586	1,002			
108.05	586	1,020			
108.10	586	1,037			



**Summary for Pond ISC: Infiltration System C**

Inflow Area = 6,800 sf, 100.00% Impervious, Inflow Depth > 4.87" for 25-Year event  
 Inflow = 0.82 cfs @ 12.09 hrs, Volume= 2,762 cf  
 Outflow = 0.03 cfs @ 8.75 hrs, Volume= 1,253 cf, Atten= 97%, Lag= 0.0 min  
 Discarded = 0.03 cfs @ 8.75 hrs, Volume= 1,253 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 106.64' @ 15.76 hrs Surf.Area= 1,094 sf Storage= 1,658 cf

Plug-Flow detention time= 163.9 min calculated for 1,252 cf (45% of inflow)  
 Center-of-Mass det. time= 58.4 min ( 793.0 - 734.6 )

Volume	Invert	Avail.Storage	Storage Description
#1A	104.50'	947 cf	<b>20.83'W x 52.50'L x 3.54'H Field A</b>
			3,874 cf Overall - 1,505 cf Embedded = 2,369 cf x 40.0% Voids
#2A	105.00'	1,505 cf	<b>Cultec R-330XLHD x 28 Inside #1</b>
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 4 rows
		2,453 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	104.50'	<b>1.020 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.03 cfs @ 8.75 hrs HW=104.54' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.03 cfs)

**Pond ISC: Infiltration System C - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 4 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

7 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 50.50' Row Length +12.0" End Stone x 2 = 52.50' Base Length

4 Rows x 52.0" Wide + 6.0" Spacing x 3 + 12.0" Side Stone x 2 = 20.83' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

28 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 4 Rows = 1,505.1 cf Chamber Storage

3,873.7 cf Field - 1,505.1 cf Chambers = 2,368.6 cf Stone x 40.0% Voids = 947.4 cf Stone Storage

Chamber Storage + Stone Storage = 2,452.5 cf = 0.056 af



Overall Storage Efficiency = 63.3%

Overall System Size = 52.50' x 20.83' x 3.54'


28 Chambers

143.5 cy Field

87.7 cy Stone

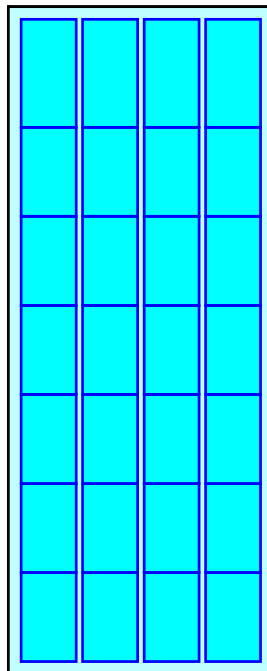

### Pond ISC: Infiltration System C

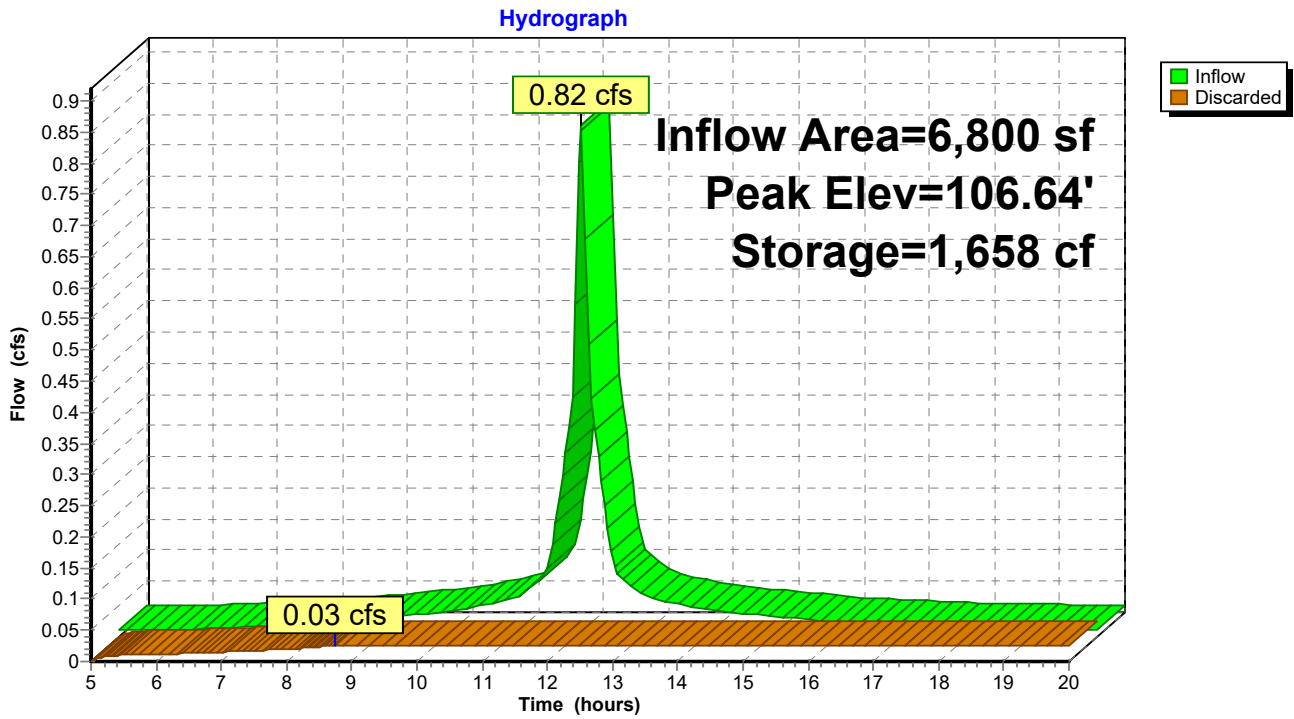

**Stage-Area-Storage for Pond ISC: Infiltration System C**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
104.50	<b>1,094</b>	0	107.15	1,094	2,026
104.55	1,094	22	107.20	1,094	2,057
104.60	1,094	44	107.25	1,094	2,087
104.65	1,094	66	107.30	1,094	2,116
104.70	1,094	88	107.35	1,094	2,143
104.75	1,094	109	107.40	1,094	2,169
104.80	1,094	131	107.45	1,094	2,193
104.85	1,094	153	107.50	1,094	2,216
104.90	1,094	175	107.55	1,094	2,237
104.95	1,094	197	107.60	1,094	2,259
105.00	1,094	219	107.65	1,094	2,281
105.05	1,094	265	107.70	1,094	2,303
105.10	1,094	311	107.75	1,094	2,325
105.15	1,094	356	107.80	1,094	2,347
105.20	1,094	402	107.85	1,094	2,369
105.25	1,094	447	107.90	1,094	2,391
105.30	1,094	493	107.95	1,094	2,412
105.35	1,094	538	108.00	1,094	<b>2,434</b>
105.40	1,094	584			
105.45	1,094	629			
105.50	1,094	674			
105.55	1,094	719			
105.60	1,094	764			
105.65	1,094	809			
105.70	1,094	853			
105.75	1,094	897			
105.80	1,094	941			
105.85	1,094	985			
105.90	1,094	1,029			
105.95	1,094	1,073			
106.00	1,094	1,117			
106.05	1,094	1,161			
106.10	1,094	1,204			
106.15	1,094	1,247			
106.20	1,094	1,291			
106.25	1,094	1,334			
106.30	1,094	1,376			
106.35	1,094	1,418			
106.40	1,094	1,460			
106.45	1,094	1,501			
106.50	1,094	1,542			
106.55	1,094	1,583			
106.60	1,094	1,623			
106.65	1,094	1,662			
106.70	1,094	1,702			
106.75	1,094	1,740			
106.80	1,094	1,778			
106.85	1,094	1,816			
106.90	1,094	1,853			
106.95	1,094	1,889			
107.00	1,094	1,924			
107.05	1,094	1,959			
107.10	1,094	1,993			

**Summary for Pond ISD: Infiltration System D**

Inflow Area = 100,549 sf, 39.97% Impervious, Inflow Depth > 2.31" for 25-Year event  
 Inflow = 6.53 cfs @ 12.10 hrs, Volume= 19,386 cf  
 Outflow = 0.20 cfs @ 11.25 hrs, Volume= 6,970 cf, Atten= 97%, Lag= 0.0 min  
 Discarded = 0.20 cfs @ 11.25 hrs, Volume= 6,970 cf  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 106.06' @ 17.10 hrs Surf.Area= 8,610 sf Storage= 12,920 cf

Plug-Flow detention time= 204.2 min calculated for 6,947 cf (36% of inflow)  
 Center-of-Mass det. time= 112.9 min ( 914.9 - 802.0 )

Volume	Invert	Avail.Storage	Storage Description
#1A	104.00'	7,100 cf	<b>54.67'W x 157.50'L x 3.54'H Field A</b> 30,494 cf Overall - 12,745 cf Embedded = 17,749 cf x 40.0% Voids
#2A	104.50'	12,745 cf	<b>Cultec R-330XLHD x 242 Inside #1</b> Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap Row Length Adjustment= +1.50' x 7.45 sf x 11 rows
		19,844 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	104.00'	<b>1.020 in/hr Exfiltration over Surface area</b>
#2	Primary	106.00'	<b>12.0" Round Culvert</b> L= 94.0' CMP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 106.00' / 105.00' S= 0.0106 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#3	Device 2	107.00'	<b>12.0" Round Culvert</b> L= 70.0' CMP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 107.00' / 106.30' S= 0.0100 '/' Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#4	Device 3	107.40'	<b>4.0' long Sharp-Crested Rectangular Weir 2 End Contraction(s)</b> 4.0' Crest Height

**Discarded OutFlow** Max=0.20 cfs @ 11.25 hrs HW=104.04' (Free Discharge)  
 ↳ **1=Exfiltration** (Exfiltration Controls 0.20 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=104.00' (Free Discharge)  
 ↳ **2=Culvert** ( Controls 0.00 cfs)  
 ↳ **3=Culvert** ( Controls 0.00 cfs)  
 ↳ **4=Sharp-Crested Rectangular Weir** ( Controls 0.00 cfs)

### Pond ISD: Infiltration System D - Chamber Wizard Field A

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 11 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

22 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 155.50' Row Length +12.0" End Stone x 2 = 157.50' Base Length

11 Rows x 52.0" Wide + 6.0" Spacing x 10 + 12.0" Side Stone x 2 = 54.67' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

242 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 11 Rows = 12,744.9 cf Chamber Storage

30,493.8 cf Field - 12,744.9 cf Chambers = 17,748.8 cf Stone x 40.0% Voids = 7,099.5 cf Stone Storage

Chamber Storage + Stone Storage = 19,844.5 cf = 0.456 af


Overall Storage Efficiency = 65.1%

Overall System Size = 157.50' x 54.67' x 3.54'


242 Chambers

1,129.4 cy Field

657.4 cy Stone

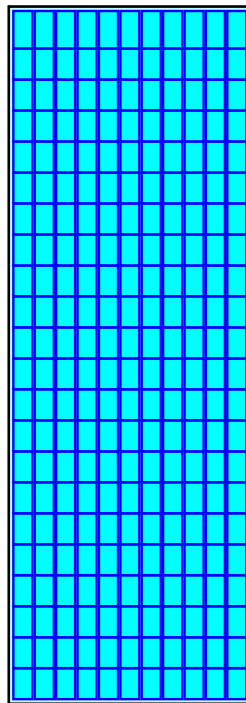

### Pond ISD: Infiltration System D

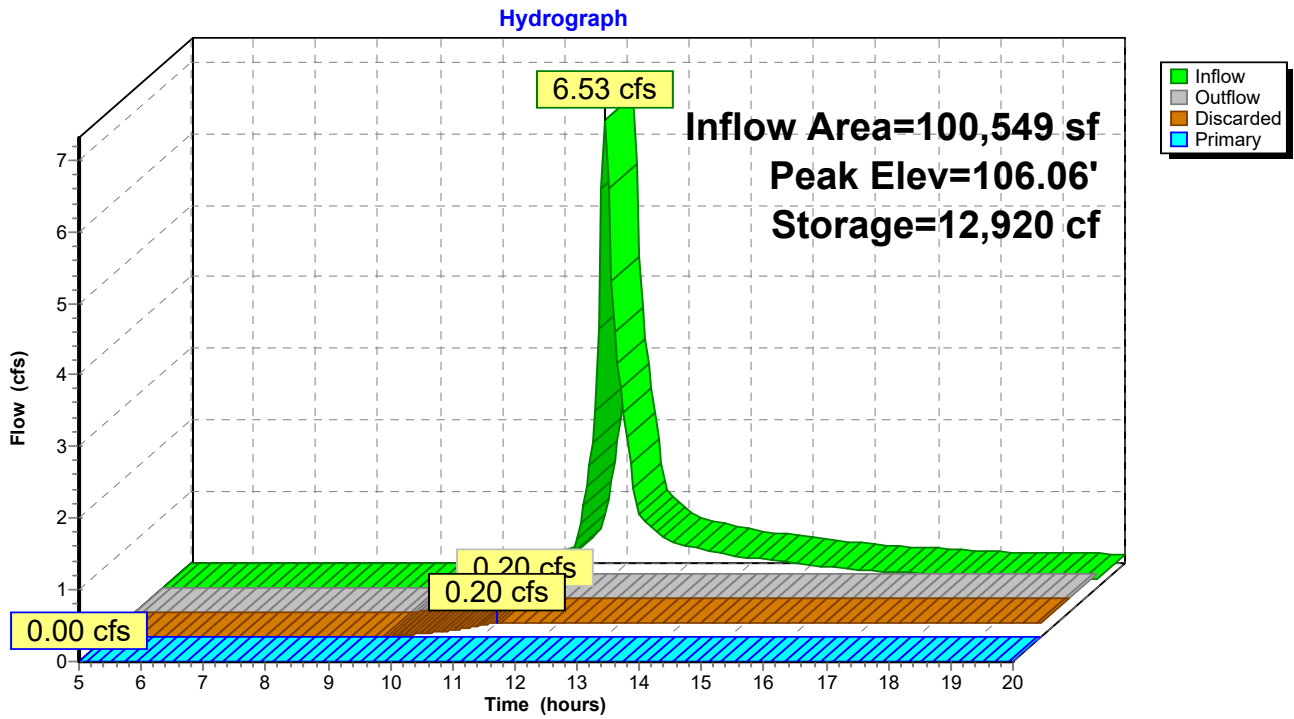

**Stage-Area-Storage for Pond ISD: Infiltration System D**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
104.00	8,610	0	106.65	8,610	16,461
104.05	8,610	172	106.70	8,610	16,716
104.10	8,610	344	106.75	8,610	16,958
104.15	8,610	517	106.80	8,610	17,187
104.20	8,610	689	106.85	8,610	17,403
104.25	8,610	861	106.90	8,610	17,607
104.30	8,610	1,033	106.95	8,610	17,799
104.35	8,610	1,205	107.00	8,610	17,979
104.40	8,610	1,378	107.05	8,610	18,151
104.45	8,610	1,550	107.10	8,610	18,323
104.50	8,610	1,722	107.15	8,610	18,496
104.55	8,610	2,098	107.20	8,610	18,668
104.60	8,610	2,473	107.25	8,610	18,840
104.65	8,610	2,847	107.30	8,610	19,012
104.70	8,610	3,220	107.35	8,610	19,184
104.75	8,610	3,593	107.40	8,610	19,357
104.80	8,610	3,964	107.45	8,610	19,529
104.85	8,610	4,336	107.50	8,610	19,701
104.90	8,610	4,707	107.55	8,610	<b>19,844</b>
104.95	8,610	5,078	107.60	8,610	19,844
105.00	8,610	5,448	107.65	8,610	19,844
105.05	8,610	5,817	107.70	8,610	19,844
105.10	8,610	6,185	107.75	8,610	19,844
105.15	8,610	6,550	107.80	8,610	19,844
105.20	8,610	6,913	107.85	8,610	19,844
105.25	8,610	7,274	107.90	8,610	19,844
105.30	8,610	7,633	107.95	8,610	19,844
105.35	8,610	7,992	108.00	8,610	19,844
105.40	8,610	8,351			
105.45	8,610	8,709			
105.50	8,610	9,066			
105.55	8,610	9,423			
105.60	8,610	9,778			
105.65	8,610	10,133			
105.70	8,610	10,486			
105.75	8,610	10,838			
105.80	8,610	11,185			
105.85	8,610	11,529			
105.90	8,610	11,869			
105.95	8,610	12,205			
106.00	8,610	12,538			
106.05	8,610	12,868			
106.10	8,610	13,194			
106.15	8,610	13,517			
106.20	8,610	13,835			
106.25	8,610	14,149			
106.30	8,610	14,459			
106.35	8,610	14,763			
106.40	8,610	15,063			
106.45	8,610	15,356			
106.50	8,610	15,644			
106.55	8,610	15,924			
106.60	8,610	16,197			



**Summary for Pond ND: Natural Depression**

Inflow Area = 25,666 sf, 0.87% Impervious, Inflow Depth > 0.43" for 25-Year event  
 Inflow = 0.14 cfs @ 12.29 hrs, Volume= 917 cf  
 Outflow = 0.04 cfs @ 13.82 hrs, Volume= 873 cf, Atten= 71%, Lag= 91.6 min  
 Discarded = 0.04 cfs @ 13.82 hrs, Volume= 873 cf  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 108.11' @ 13.82 hrs Surf.Area= 708 sf Storage= 214 cf

Plug-Flow detention time= 76.1 min calculated for 873 cf (95% of inflow)  
 Center-of-Mass det. time= 61.4 min ( 939.7 - 878.2 )


Volume	Invert	Avail.Storage	Storage Description			
#1	108.00'	3,293 cf	<b>Custom Stage Data (Irregular)</b> Listed below			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
108.00	235	88.4	0	0	235	
109.00	4,354	655.7	1,867	1,867	33,829	
109.30	5,162	671.6	1,426	3,293	35,520	

Device	Routing	Invert	Outlet Devices									
#1	Primary	109.00'	<b>2.0' long x 10.0' breadth Broad-Crested Rectangular Weir</b>									
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60									
			Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64									
#2	Discarded	108.00'	<b>2.410 in/hr Exfiltration over Surface area</b>									

**Discarded OutFlow** Max=0.04 cfs @ 13.82 hrs HW=108.11' (Free Discharge)  
 ↑**2=Exfiltration** (Exfiltration Controls 0.04 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=108.00' (Free Discharge)  
 ↑**1=Broad-Crested Rectangular Weir** ( Controls 0.00 cfs)

### Pond ND: Natural Depression

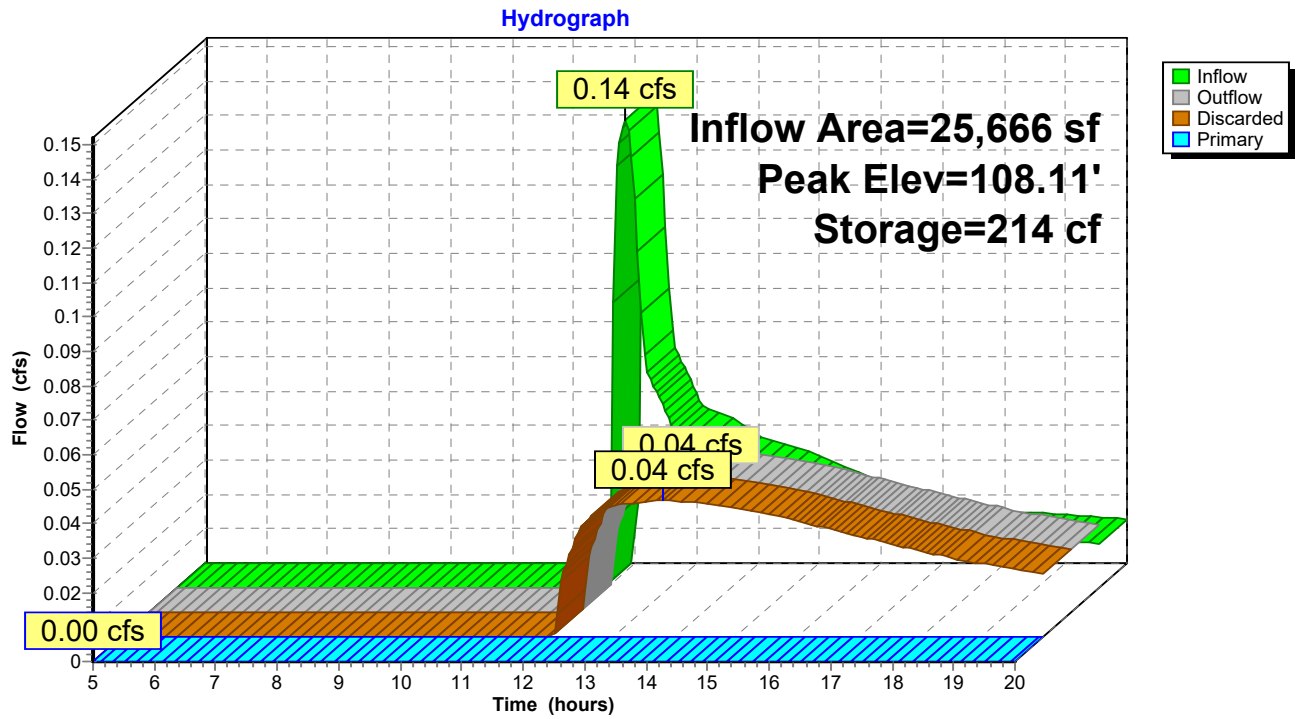

**Stage-Area-Storage for Pond ND: Natural Depression**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
108.00	235	0	109.06	4,516	2,152
108.02	317	37	109.08	4,569	2,247
108.04	400	75	109.10	4,623	2,342
108.06	482	112	109.12	4,677	2,437
108.08	565	149	109.14	4,731	2,532
108.10	647	187	109.16	4,785	2,627
108.12	729	224	109.18	4,839	2,722
108.14	812	261	109.20	4,893	2,817
108.16	894	299	109.22	4,947	2,912
108.18	976	336	109.24	5,000	3,007
108.20	1,059	373	109.26	5,054	3,102
108.22	1,141	411	109.28	5,108	3,197
108.24	1,224	448	109.30	<b>5,162</b>	<b>3,293</b>
108.26	1,306	485			
108.28	1,388	523			
108.30	1,471	560			
108.32	1,553	597			
108.34	1,635	635			
108.36	1,718	672			
108.38	1,800	709			
108.40	1,883	747			
108.42	1,965	784			
108.44	2,047	821			
108.46	2,130	859			
108.48	2,212	896			
108.50	2,295	933			
108.52	2,377	971			
108.54	2,459	1,008			
108.56	2,542	1,045			
108.58	2,624	1,083			
108.60	2,706	1,120			
108.62	2,789	1,157			
108.64	2,871	1,195			
108.66	2,954	1,232			
108.68	3,036	1,269			
108.70	3,118	1,307			
108.72	3,201	1,344			
108.74	3,283	1,381			
108.76	3,365	1,419			
108.78	3,448	1,456			
108.80	3,530	1,493			
108.82	3,613	1,531			
108.84	3,695	1,568			
108.86	3,777	1,605			
108.88	3,860	1,643			
108.90	3,942	1,680			
108.92	4,024	1,717			
108.94	4,107	1,755			
108.96	4,189	1,792			
108.98	4,272	1,830			
109.00	4,354	1,867			
109.02	4,408	1,962			
109.04	4,462	2,057			

**Summary for Subcatchment 2ISD: To Infiltration System D**


Runoff = 9.12 cfs @ 12.10 hrs, Volume= 27,054 cf, Depth> 3.23"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-Year Rainfall=6.70"

Area (sf)	CN	Description
3,059	30	Woods, Good, HSG A
17,768	39	>75% Grass cover, Good, HSG A
17,904	98	Unconnected pavement, HSG A
1,960	55	Woods, Good, HSG B
35,785	61	>75% Grass cover, Good, HSG B
1,786	96	Gravel surface, HSG B
22,287	98	Unconnected pavement, HSG B
100,549	71	Weighted Average
60,358		60.03% Pervious Area
40,191		39.97% Impervious Area
40,191		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
4.3	50	0.0400	0.20		<b>Sheet Flow, Grass AB</b> Grass: Short n= 0.150 P2= 3.20"
1.6	115	0.0300	1.21		<b>Shallow Concentrated Flow, Grass BC</b> Short Grass Pasture Kv= 7.0 fps
0.5	136	0.0100	4.54	3.56	<b>Pipe Channel, Pipe CD</b> 12.0" Round Area= 0.8 sf Perim= 3.1' r= 0.25' n= 0.013 Corrugated PE, smooth interior
6.4	301	Total			

### Subcatchment 2ISD: To Infiltration System D

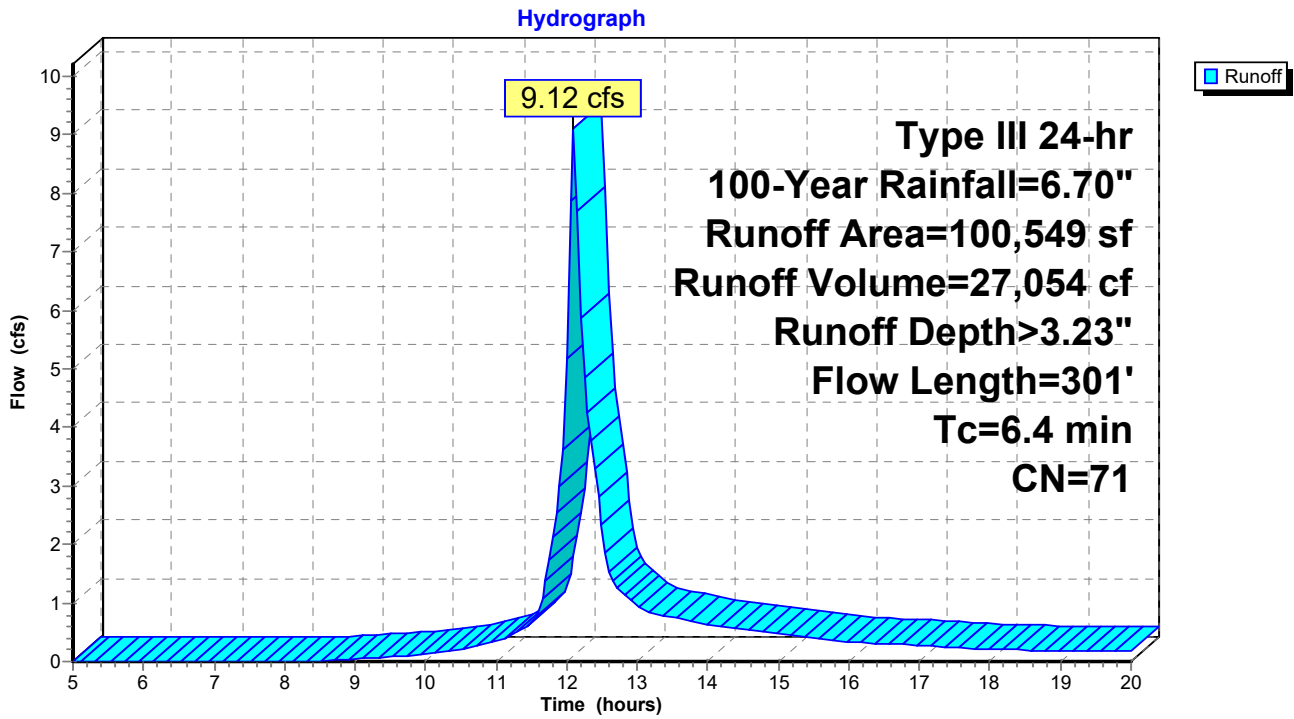

**Summary for Subcatchment 2ND: To Natural Depression**


Runoff = 0.41 cfs @ 12.12 hrs, Volume= 1,773 cf, Depth> 0.83"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-Year Rainfall=6.70"

Area (sf)	CN	Description
4,045	30	Woods, Good, HSG A
18,978	39	>75% Grass cover, Good, HSG A
1,946	96	Gravel surface, HSG A
224	98	Unconnected pavement, HSG A
473	61	>75% Grass cover, Good, HSG B
25,666	43	Weighted Average
25,442		99.13% Pervious Area
224		0.87% Impervious Area
224		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, AB-Grass

**Subcatchment 2ND: To Natural Depression**

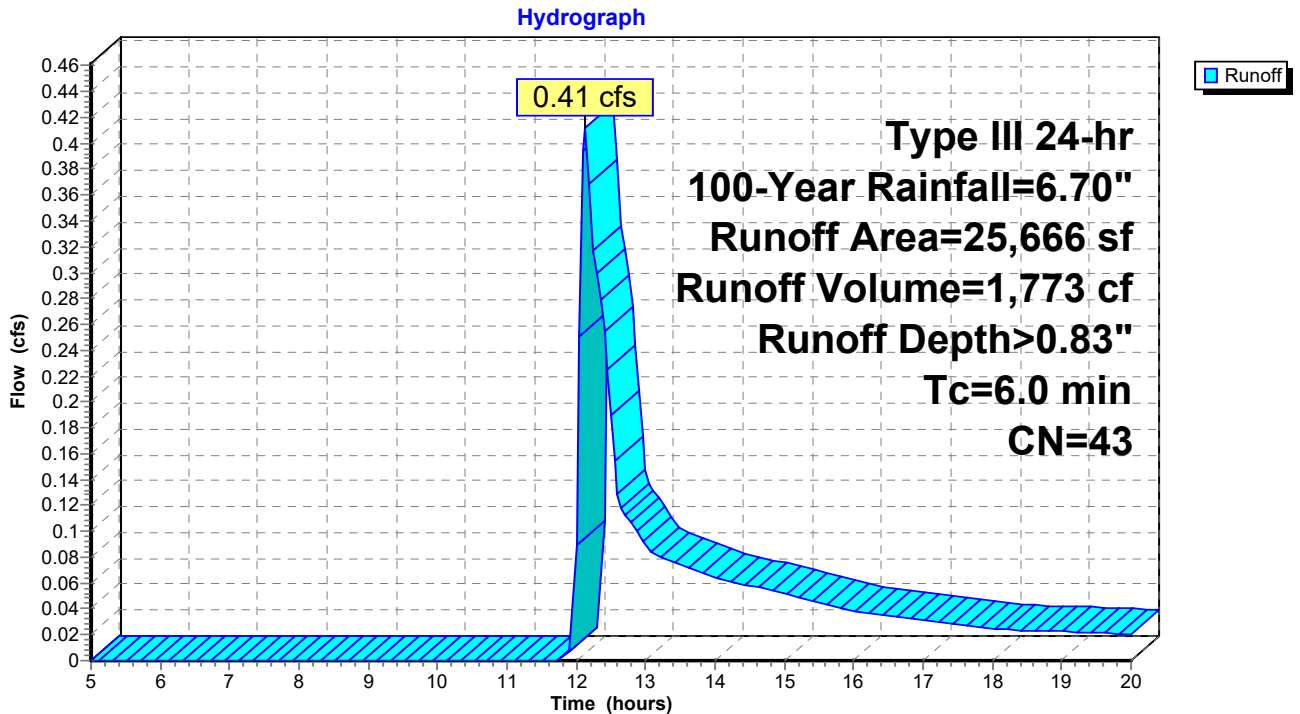

**Summary for Subcatchment EU: Eastern Units**

Runoff = 0.70 cfs @ 12.09 hrs, Volume= 2,366 cf, Depth> 5.97"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-Year Rainfall=6.70"

Area (sf)	CN	Description
4,760	98	Roofs, HSG D
4,760		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment EU: Eastern Units**

Hydrograph

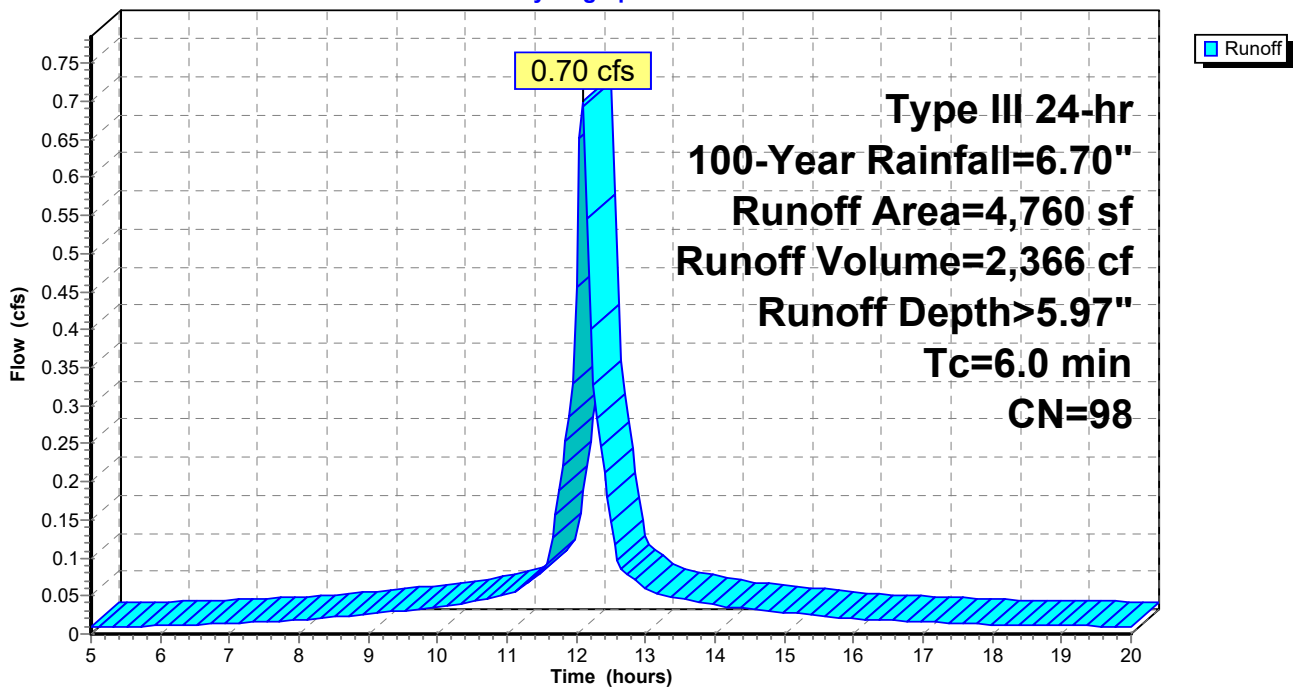

**Summary for Subcatchment N: Offsite North**


Runoff = 0.10 cfs @ 12.30 hrs, Volume= 718 cf, Depth> 0.51"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-Year Rainfall=6.70"

Area (sf)	CN	Description
4,653	30	Woods, Good, HSG A
11,862	39	>75% Grass cover, Good, HSG A
417	96	Gravel surface, HSG A
48	98	Unconnected pavement, HSG A
16,980	38	Weighted Average
16,932		99.72% Pervious Area
48		0.28% Impervious Area
48		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, AB-Grass

**Subcatchment N: Offsite North**

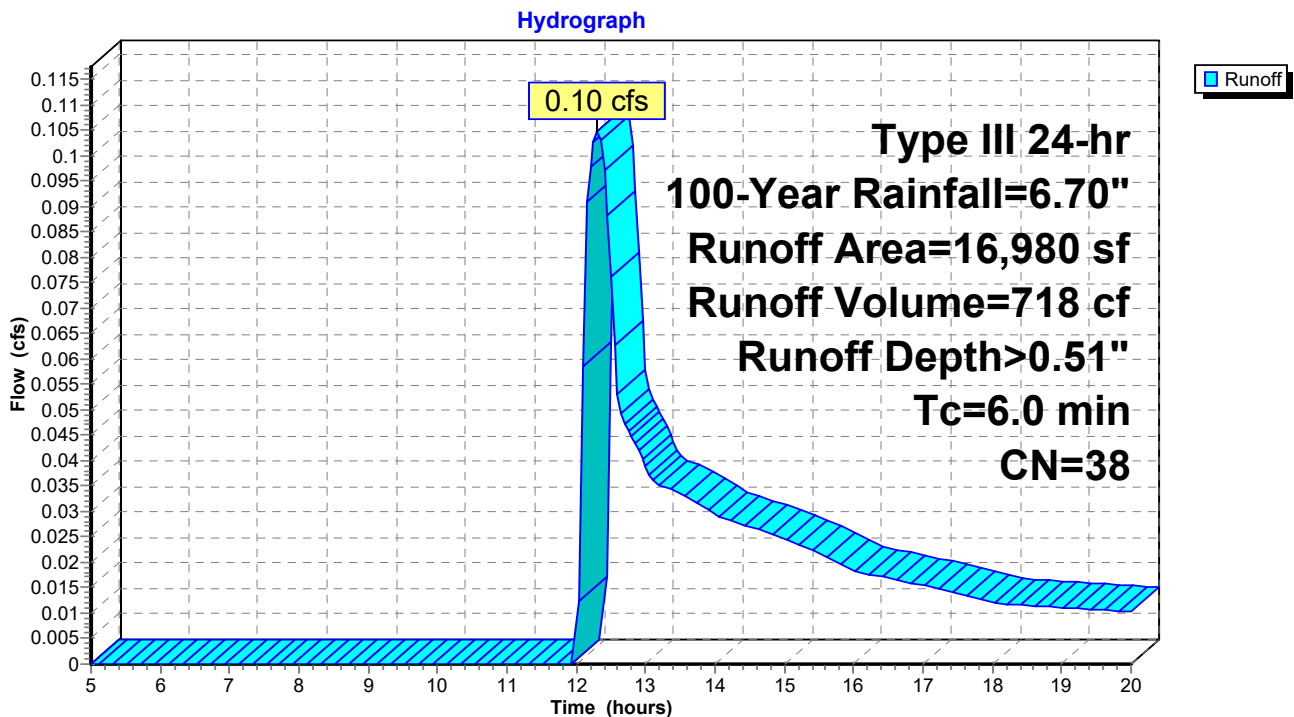



**Summary for Subcatchment NU: Northern Units**


Runoff = 1.00 cfs @ 12.09 hrs, Volume= 3,380 cf, Depth> 5.97"

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-Year Rainfall=6.70"

Area (sf)	CN	Description
6,800	98	Roofs, HSG D
6,800		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment NU: Northern Units**

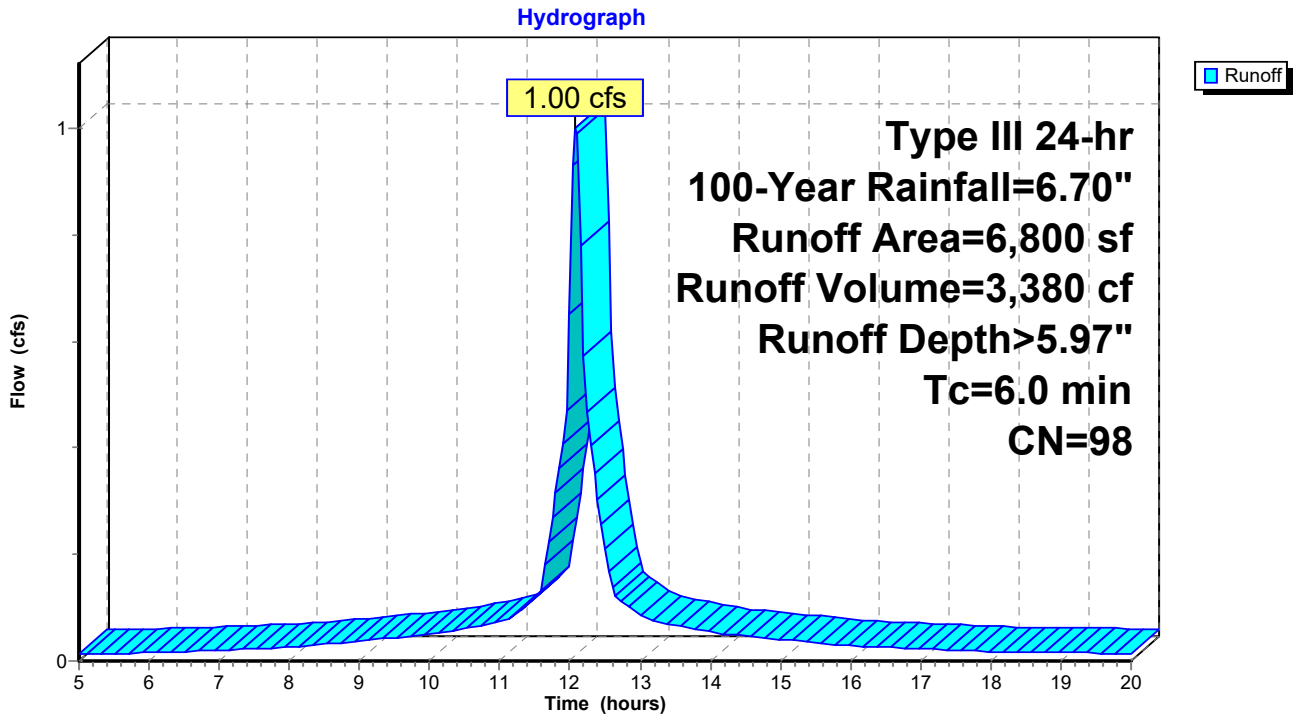

**Summary for Subcatchment S: Onsite South**

Runoff = 0.02 cfs @ 12.54 hrs, Volume= 228 cf, Depth> 0.29"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-Year Rainfall=6.70"

Area (sf)	CN	Description
5,286	30	Woods, Good, HSG A
4,154	39	>75% Grass cover, Good, HSG A
63	98	Unconnected roofs, HSG A
9,503	34	Weighted Average
9,440		99.34% Pervious Area
63		0.66% Impervious Area
63		100.00% Unconnected

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
13.8	50	0.0150	0.06		<b>Sheet Flow, AB-Woods</b> Woods: Light underbrush n= 0.400 P2= 3.20"
0.6	21	0.0150	0.61		<b>Shallow Concentrated Flow, BC-Woods</b> Woodland Kv= 5.0 fps
14.4	71	Total			

**Subcatchment S: Onsite South**

Hydrograph

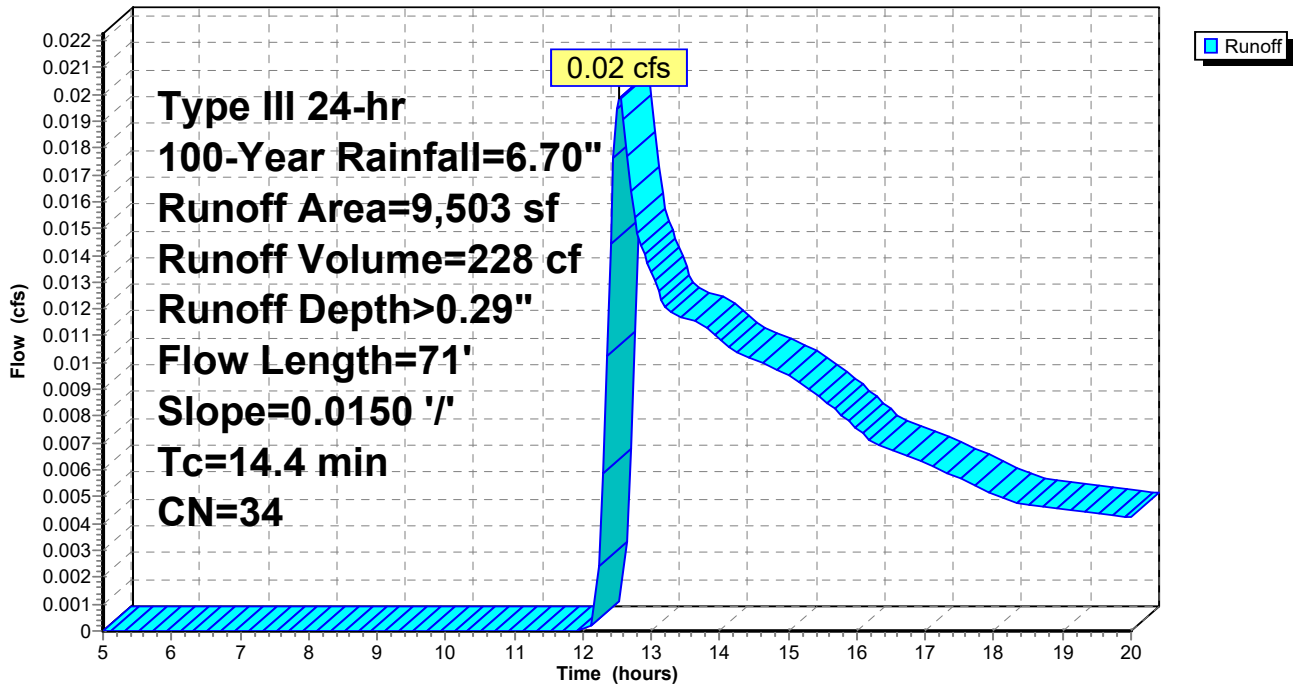

**Summary for Subcatchment WU: Western Units**

Runoff = 0.70 cfs @ 12.09 hrs, Volume= 2,366 cf, Depth> 5.97"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Type III 24-hr 100-Year Rainfall=6.70"

Area (sf)	CN	Description
4,760	98	Roofs, HSG D
4,760		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry, Direct

**Subcatchment WU: Western Units**

Hydrograph

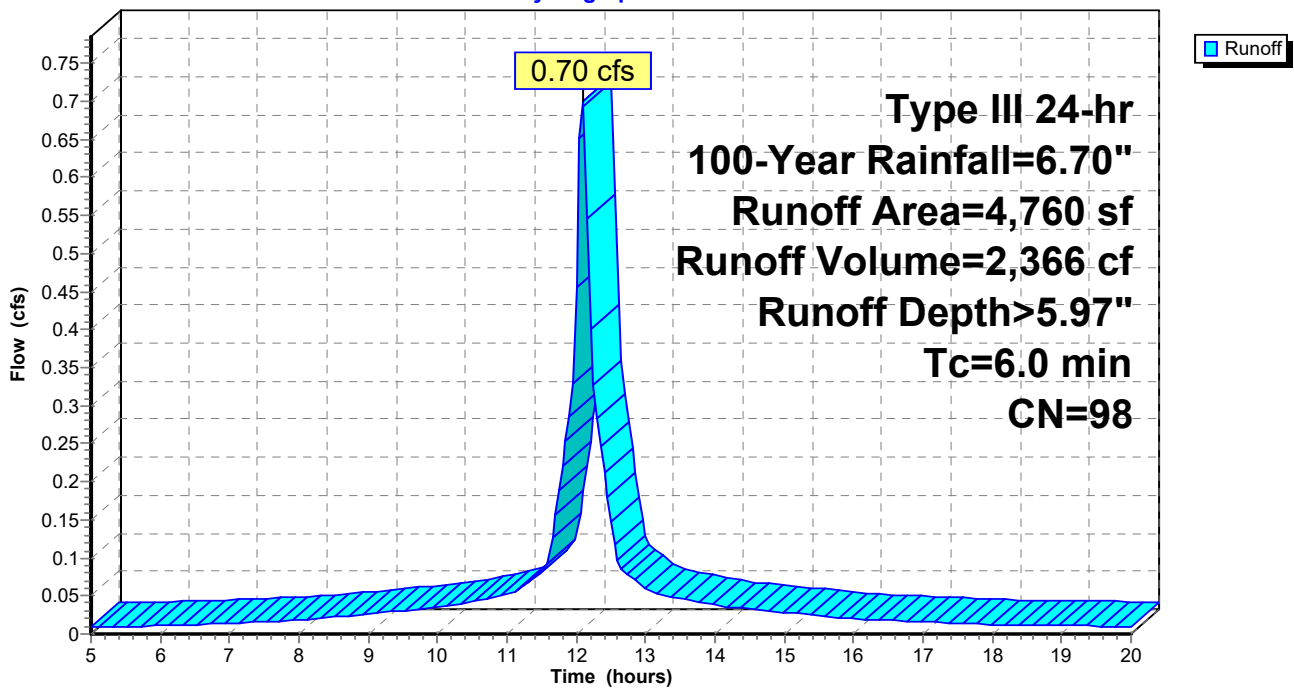


### Summary for Reach TN: Total North

Inflow Area = 143,195 sf, 28.26% Impervious, Inflow Depth > 0.09" for 100-Year event  
 Inflow = 0.10 cfs @ 12.30 hrs, Volume= 1,052 cf  
 Outflow = 0.10 cfs @ 12.30 hrs, Volume= 1,052 cf, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs

### Reach TN: Total North

Hydrograph

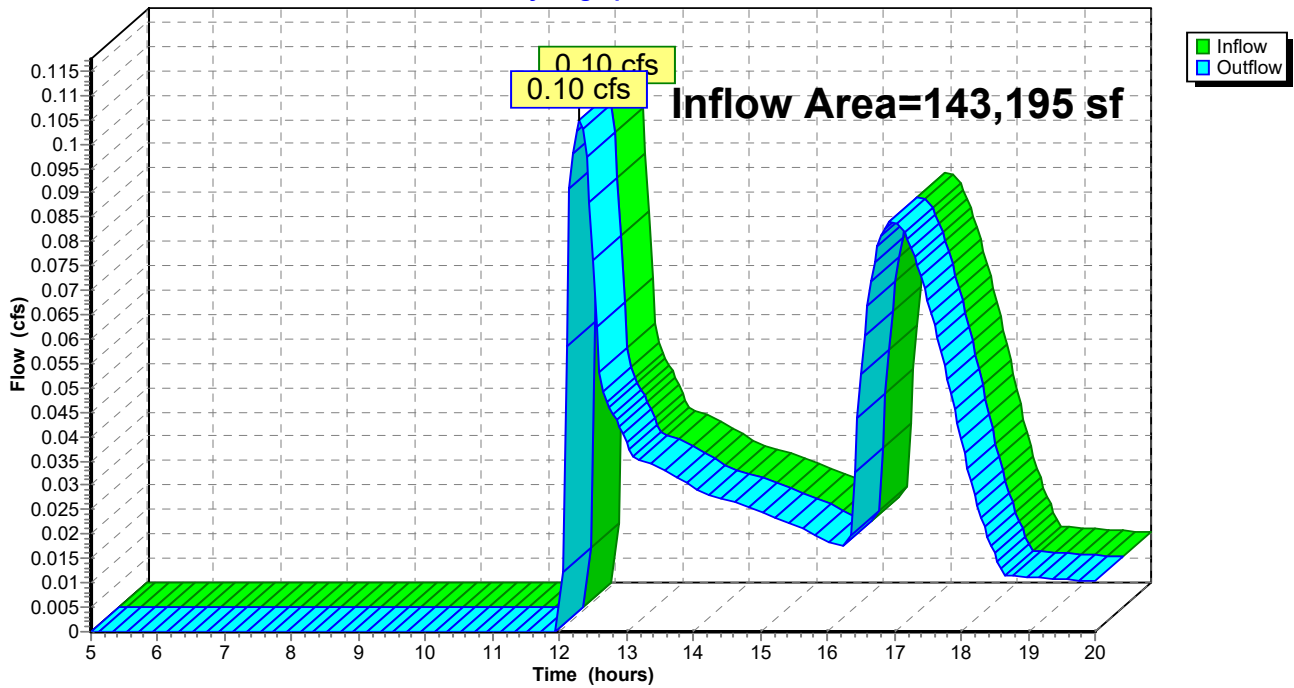

**Summary for Pond ISA: Infiltration System A**

Inflow Area = 4,760 sf, 100.00% Impervious, Inflow Depth > 5.97" for 100-Year event  
 Inflow = 0.70 cfs @ 12.09 hrs, Volume= 2,366 cf  
 Outflow = 0.08 cfs @ 11.55 hrs, Volume= 2,365 cf, Atten= 88%, Lag= 0.0 min  
 Discarded = 0.08 cfs @ 11.55 hrs, Volume= 2,365 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 108.70' @ 12.69 hrs Surf.Area= 430 sf Storage= 780 cf

Plug-Flow detention time= 63.1 min calculated for 2,365 cf (100% of inflow)  
 Center-of-Mass det. time= 62.8 min ( 796.5 - 733.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	106.00'	391 cf	<b>11.17'W x 38.50'L x 3.54'H Field A</b>
			1,523 cf Overall - 544 cf Embedded = 979 cf x 40.0% Voids
#2A	106.50'	544 cf	<b>Cultec R-330XLHD x 10 Inside #1</b>
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 2 rows
		935 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	106.00'	<b>8.270 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.08 cfs @ 11.55 hrs HW=106.04' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.08 cfs)

**Pond ISA: Infiltration System A - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf  
 Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap  
 Row Length Adjustment= +1.50' x 7.45 sf x 2 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

5 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 36.50' Row Length +12.0" End Stone x 2 = 38.50' Base Length

2 Rows x 52.0" Wide + 6.0" Spacing x 1 + 12.0" Side Stone x 2 = 11.17' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

10 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 2 Rows = 543.9 cf Chamber Storage



1,522.6 cf Field - 543.9 cf Chambers = 978.7 cf Stone x 40.0% Voids = 391.5 cf Stone Storage

Chamber Storage + Stone Storage = 935.4 cf = 0.021 af


Overall Storage Efficiency = 61.4%

Overall System Size = 38.50' x 11.17' x 3.54'

10 Chambers  
 56.4 cy Field  
 36.2 cy Stone

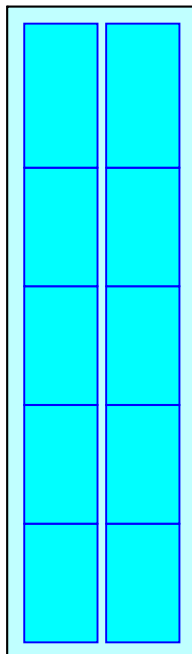

### Pond ISA: Infiltration System A

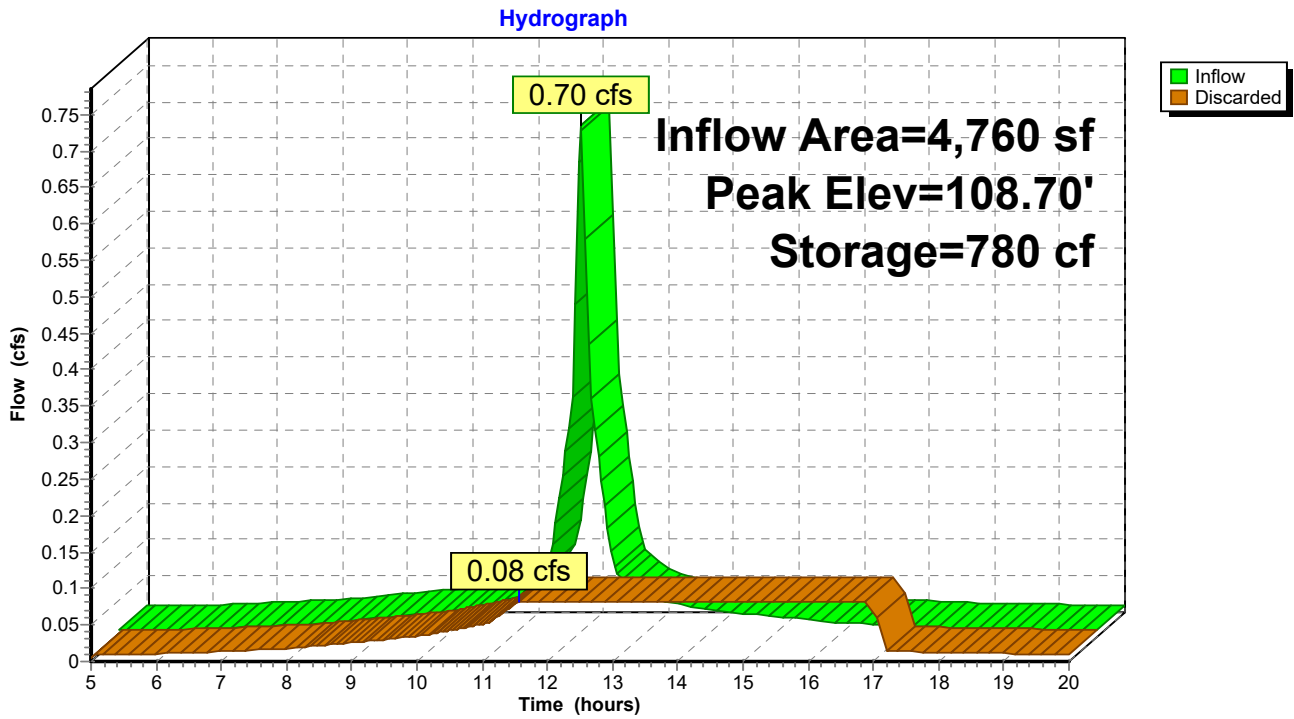

**Stage-Area-Storage for Pond ISA: Infiltration System A**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
106.00	430	0	108.65	430	769
106.05	430	9	108.70	430	781
106.10	430	17	108.75	430	792
106.15	430	26	108.80	430	803
106.20	430	34	108.85	430	814
106.25	430	43	108.90	430	824
106.30	430	52	108.95	430	833
106.35	430	60	109.00	430	842
106.40	430	69	109.05	430	851
106.45	430	77	109.10	430	859
106.50	430	86	109.15	430	868
106.55	430	103	109.20	430	877
106.60	430	121	109.25	430	885
106.65	430	138	109.30	430	894
106.70	430	155	109.35	430	902
106.75	430	172	109.40	430	911
106.80	430	189	109.45	430	920
106.85	430	206	109.50	430	<b>928</b>
106.90	430	223			
106.95	430	240			
107.00	430	257			
107.05	430	275			
107.10	430	291			
107.15	430	308			
107.20	430	325			
107.25	430	342			
107.30	430	358			
107.35	430	375			
107.40	430	391			
107.45	430	408			
107.50	430	424			
107.55	430	441			
107.60	430	457			
107.65	430	474			
107.70	430	490			
107.75	430	506			
107.80	430	522			
107.85	430	538			
107.90	430	554			
107.95	430	570			
108.00	430	585			
108.05	430	600			
108.10	430	616			
108.15	430	631			
108.20	430	645			
108.25	430	660			
108.30	430	675			
108.35	430	689			
108.40	430	703			
108.45	430	717			
108.50	430	730			
108.55	430	743			
108.60	430	756			



**Summary for Pond ISB: Infiltration System B**

Inflow Area = 4,760 sf, 100.00% Impervious, Inflow Depth > 5.97" for 100-Year event  
 Inflow = 0.70 cfs @ 12.09 hrs, Volume= 2,366 cf  
 Outflow = 0.03 cfs @ 9.85 hrs, Volume= 1,496 cf, Atten= 95%, Lag= 0.0 min  
 Discarded = 0.03 cfs @ 9.85 hrs, Volume= 1,496 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 108.63' @ 14.50 hrs Surf.Area= 586 sf Storage= 1,186 cf

Plug-Flow detention time= 155.7 min calculated for 1,491 cf (63% of inflow)  
 Center-of-Mass det. time= 79.4 min ( 813.1 - 733.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	105.50'	530 cf	<b>11.17'W x 52.50'L x 3.54'H Field A</b>
			2,076 cf Overall - 753 cf Embedded = 1,324 cf x 40.0% Voids
#2A	106.00'	753 cf	<b>Cultec R-330XLHD x 14 Inside #1</b>
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 2 rows
		1,282 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	105.50'	<b>2.410 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.03 cfs @ 9.85 hrs HW=105.54' (Free Discharge)  
 ↑**1=Exfiltration** (Exfiltration Controls 0.03 cfs)

**Pond ISB: Infiltration System B - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 2 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

7 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 50.50' Row Length +12.0" End Stone x 2 = 52.50' Base Length

2 Rows x 52.0" Wide + 6.0" Spacing x 1 + 12.0" Side Stone x 2 = 11.17' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

14 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 2 Rows = 752.6 cf Chamber Storage

2,076.3 cf Field - 752.6 cf Chambers = 1,323.8 cf Stone x 40.0% Voids = 529.5 cf Stone Storage

Chamber Storage + Stone Storage = 1,282.1 cf = 0.029 af



Overall Storage Efficiency = 61.7%

Overall System Size = 52.50' x 11.17' x 3.54'


14 Chambers

76.9 cy Field

49.0 cy Stone



### Pond ISB: Infiltration System B

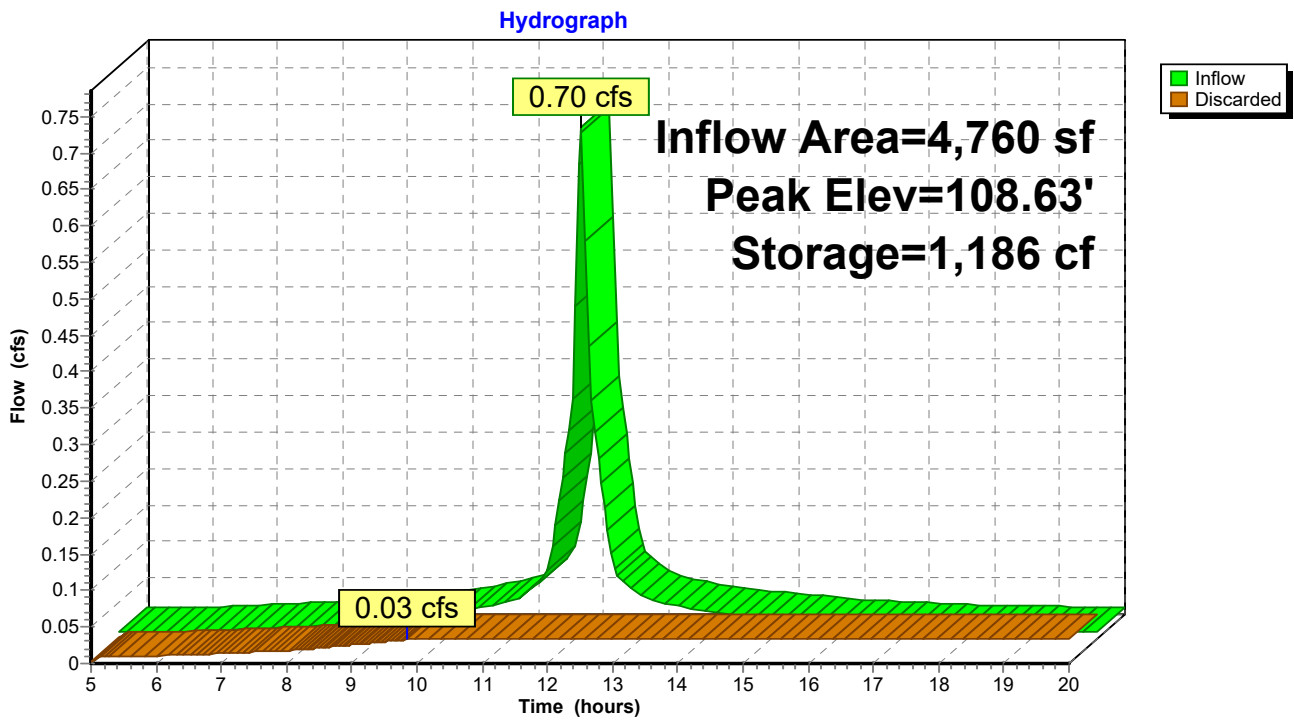

**Stage-Area-Storage for Pond ISB: Infiltration System B**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
105.50	<b>586</b>	0	108.15	586	1,055
105.55	586	12	108.20	586	1,071
105.60	586	23	108.25	586	1,087
105.65	586	35	108.30	586	1,102
105.70	586	47	108.35	586	1,116
105.75	586	59	108.40	586	1,130
105.80	586	70	108.45	586	1,143
105.85	586	82	108.50	586	1,155
105.90	586	94	108.55	586	1,167
105.95	586	106	108.60	586	1,178
106.00	586	117	108.65	586	1,190
106.05	586	141	108.70	586	1,202
106.10	586	165	108.75	586	1,214
106.15	586	188	108.80	586	1,225
106.20	586	212	108.85	586	1,237
106.25	586	235	108.90	586	1,249
106.30	586	259	108.95	586	1,261
106.35	586	282	109.00	586	<b>1,272</b>
106.40	586	306			
106.45	586	329			
106.50	586	353			
106.55	586	376			
106.60	586	399			
106.65	586	423			
106.70	586	446			
106.75	586	468			
106.80	586	491			
106.85	586	514			
106.90	586	537			
106.95	586	559			
107.00	586	582			
107.05	586	605			
107.10	586	627			
107.15	586	650			
107.20	586	672			
107.25	586	694			
107.30	586	717			
107.35	586	738			
107.40	586	760			
107.45	586	781			
107.50	586	803			
107.55	586	824			
107.60	586	844			
107.65	586	865			
107.70	586	885			
107.75	586	906			
107.80	586	925			
107.85	586	945			
107.90	586	964			
107.95	586	983			
108.00	586	1,002			
108.05	586	1,020			
108.10	586	1,037			

**Summary for Pond ISC: Infiltration System C**

Inflow Area = 6,800 sf, 100.00% Impervious, Inflow Depth > 5.97" for 100-Year event  
 Inflow = 1.00 cfs @ 12.09 hrs, Volume= 3,380 cf  
 Outflow = 0.03 cfs @ 8.20 hrs, Volume= 1,299 cf, Atten= 97%, Lag= 0.0 min  
 Discarded = 0.03 cfs @ 8.20 hrs, Volume= 1,299 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 107.43' @ 16.39 hrs Surf.Area= 1,094 sf Storage= 2,182 cf

Plug-Flow detention time= 169.1 min calculated for 1,298 cf (38% of inflow)  
 Center-of-Mass det. time= 46.1 min ( 779.8 - 733.7 )

Volume	Invert	Avail.Storage	Storage Description
#1A	104.50'	947 cf	<b>20.83'W x 52.50'L x 3.54'H Field A</b>
			3,874 cf Overall - 1,505 cf Embedded = 2,369 cf x 40.0% Voids
#2A	105.00'	1,505 cf	<b>Cultec R-330XLHD x 28 Inside #1</b>
			Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf
			Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap
			Row Length Adjustment= +1.50' x 7.45 sf x 4 rows
		2,453 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	104.50'	<b>1.020 in/hr Exfiltration over Surface area</b>

**Discarded OutFlow** Max=0.03 cfs @ 8.20 hrs HW=104.54' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.03 cfs)

**Pond ISC: Infiltration System C - Chamber Wizard Field A**

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 4 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

7 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 50.50' Row Length +12.0" End Stone x 2 = 52.50' Base Length

4 Rows x 52.0" Wide + 6.0" Spacing x 3 + 12.0" Side Stone x 2 = 20.83' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

28 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 4 Rows = 1,505.1 cf Chamber Storage

3,873.7 cf Field - 1,505.1 cf Chambers = 2,368.6 cf Stone x 40.0% Voids = 947.4 cf Stone Storage

Chamber Storage + Stone Storage = 2,452.5 cf = 0.056 af


Overall Storage Efficiency = 63.3%

Overall System Size = 52.50' x 20.83' x 3.54'


28 Chambers

143.5 cy Field

87.7 cy Stone

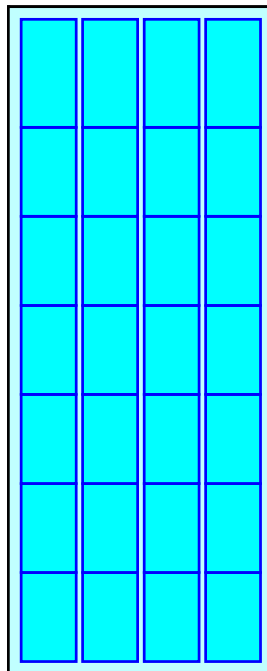

### Pond ISC: Infiltration System C

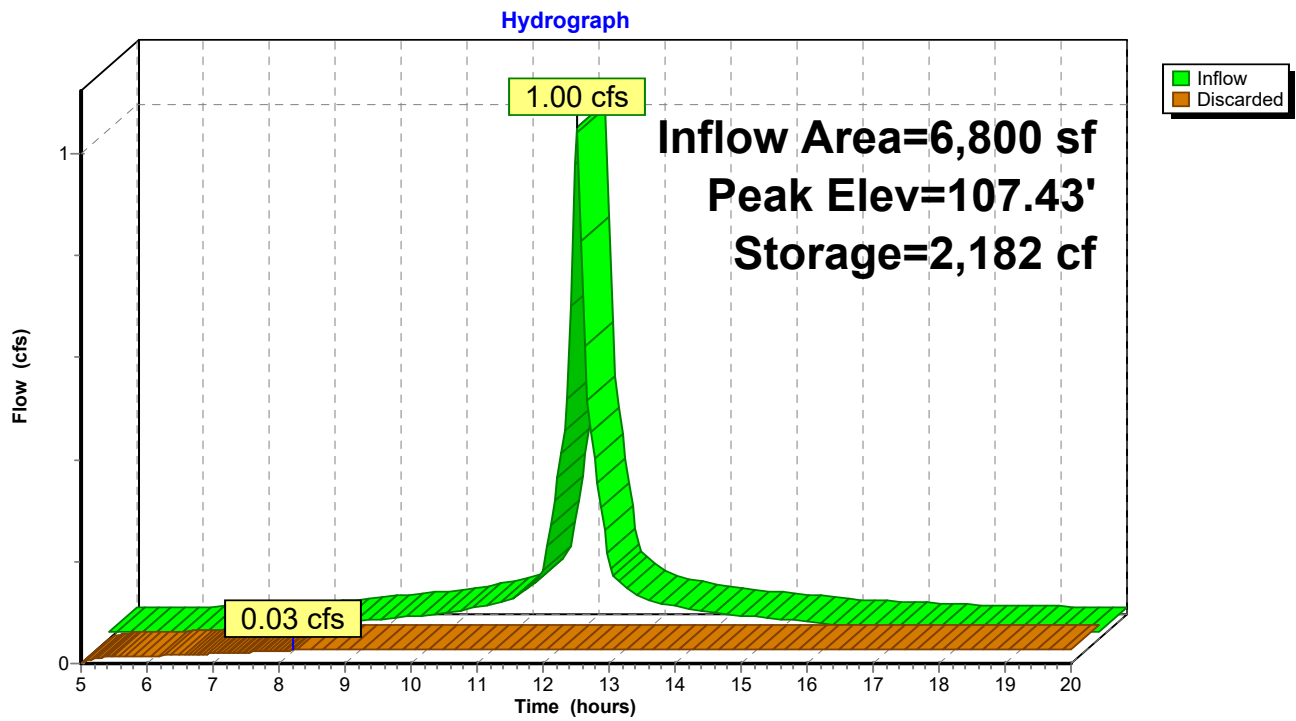

**Stage-Area-Storage for Pond ISC: Infiltration System C**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
104.50	<b>1,094</b>	0	107.15	1,094	2,026
104.55	1,094	22	107.20	1,094	2,057
104.60	1,094	44	107.25	1,094	2,087
104.65	1,094	66	107.30	1,094	2,116
104.70	1,094	88	107.35	1,094	2,143
104.75	1,094	109	107.40	1,094	2,169
104.80	1,094	131	107.45	1,094	2,193
104.85	1,094	153	107.50	1,094	2,216
104.90	1,094	175	107.55	1,094	2,237
104.95	1,094	197	107.60	1,094	2,259
105.00	1,094	219	107.65	1,094	2,281
105.05	1,094	265	107.70	1,094	2,303
105.10	1,094	311	107.75	1,094	2,325
105.15	1,094	356	107.80	1,094	2,347
105.20	1,094	402	107.85	1,094	2,369
105.25	1,094	447	107.90	1,094	2,391
105.30	1,094	493	107.95	1,094	2,412
105.35	1,094	538	108.00	1,094	<b>2,434</b>
105.40	1,094	584			
105.45	1,094	629			
105.50	1,094	674			
105.55	1,094	719			
105.60	1,094	764			
105.65	1,094	809			
105.70	1,094	853			
105.75	1,094	897			
105.80	1,094	941			
105.85	1,094	985			
105.90	1,094	1,029			
105.95	1,094	1,073			
106.00	1,094	1,117			
106.05	1,094	1,161			
106.10	1,094	1,204			
106.15	1,094	1,247			
106.20	1,094	1,291			
106.25	1,094	1,334			
106.30	1,094	1,376			
106.35	1,094	1,418			
106.40	1,094	1,460			
106.45	1,094	1,501			
106.50	1,094	1,542			
106.55	1,094	1,583			
106.60	1,094	1,623			
106.65	1,094	1,662			
106.70	1,094	1,702			
106.75	1,094	1,740			
106.80	1,094	1,778			
106.85	1,094	1,816			
106.90	1,094	1,853			
106.95	1,094	1,889			
107.00	1,094	1,924			
107.05	1,094	1,959			
107.10	1,094	1,993			



**Summary for Pond ISD: Infiltration System D**

Inflow Area = 100,549 sf, 39.97% Impervious, Inflow Depth > 3.23" for 100-Year event  
 Inflow = 9.12 cfs @ 12.10 hrs, Volume= 27,054 cf  
 Outflow = 0.27 cfs @ 16.99 hrs, Volume= 7,809 cf, Atten= 97%, Lag= 293.4 min  
 Discarded = 0.20 cfs @ 10.65 hrs, Volume= 7,476 cf  
 Primary = 0.07 cfs @ 16.99 hrs, Volume= 333 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 107.43' @ 16.99 hrs Surf.Area= 8,610 sf Storage= 19,447 cf

Plug-Flow detention time= 203.6 min calculated for 7,809 cf (29% of inflow)  
 Center-of-Mass det. time= 105.6 min ( 900.1 - 794.5 )

Volume	Invert	Avail.Storage	Storage Description
#1A	104.00'	7,100 cf	<b>54.67'W x 157.50'L x 3.54'H Field A</b> 30,494 cf Overall - 12,745 cf Embedded = 17,749 cf x 40.0% Voids
#2A	104.50'	12,745 cf	<b>Cultec R-330XLHD x 242 Inside #1</b> Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap Row Length Adjustment= +1.50' x 7.45 sf x 11 rows
		19,844 cf	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	104.00'	<b>1.020 in/hr Exfiltration over Surface area</b>
#2	Primary	106.00'	<b>12.0" Round Culvert</b> L= 94.0' CMP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 106.00' / 105.00' S= 0.0106 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#3	Device 2	107.00'	<b>12.0" Round Culvert</b> L= 70.0' CMP, mitered to conform to fill, Ke= 0.700 Inlet / Outlet Invert= 107.00' / 106.30' S= 0.0100 '/ Cc= 0.900 n= 0.013 Corrugated PE, smooth interior, Flow Area= 0.79 sf
#4	Device 3	107.40'	<b>4.0' long Sharp-Crested Rectangular Weir 2 End Contraction(s)</b> 4.0' Crest Height

**Discarded OutFlow** Max=0.20 cfs @ 10.65 hrs HW=104.04' (Free Discharge)  
 ↑1=Exfiltration (Exfiltration Controls 0.20 cfs)

**Primary OutFlow** Max=0.06 cfs @ 16.99 hrs HW=107.43' (Free Discharge)  
 ↑2=Culvert (Passes 0.06 cfs of 3.21 cfs potential flow)  
 ↑3=Culvert (Passes 0.06 cfs of 0.63 cfs potential flow)  
 ↑4=Sharp-Crested Rectangular Weir (Weir Controls 0.06 cfs @ 0.53 fps)

### Pond ISD: Infiltration System D - Chamber Wizard Field A

**Chamber Model = Cultec R-330XLHD (Cultec Recharger® 330XLHD)**

Effective Size= 47.8"W x 30.0"H => 7.45 sf x 7.00'L = 52.2 cf

Overall Size= 52.0"W x 30.5"H x 8.50'L with 1.50' Overlap

Row Length Adjustment= +1.50' x 7.45 sf x 11 rows

52.0" Wide + 6.0" Spacing = 58.0" C-C Row Spacing

22 Chambers/Row x 7.00' Long +1.50' Row Adjustment = 155.50' Row Length +12.0" End Stone x 2 = 157.50' Base Length

11 Rows x 52.0" Wide + 6.0" Spacing x 10 + 12.0" Side Stone x 2 = 54.67' Base Width

6.0" Stone Base + 30.5" Chamber Height + 6.0" Stone Cover = 3.54' Field Height

242 Chambers x 52.2 cf +1.50' Row Adjustment x 7.45 sf x 11 Rows = 12,744.9 cf Chamber Storage


30,493.8 cf Field - 12,744.9 cf Chambers = 17,748.8 cf Stone x 40.0% Voids = 7,099.5 cf Stone Storage

Chamber Storage + Stone Storage = 19,844.5 cf = 0.456 af


Overall Storage Efficiency = 65.1%

Overall System Size = 157.50' x 54.67' x 3.54'

242 Chambers  
1,129.4 cy Field  
657.4 cy Stone

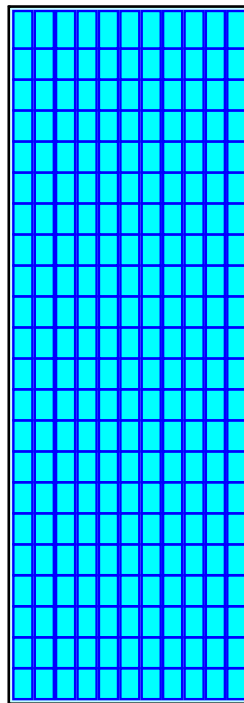

### Pond ISD: Infiltration System D

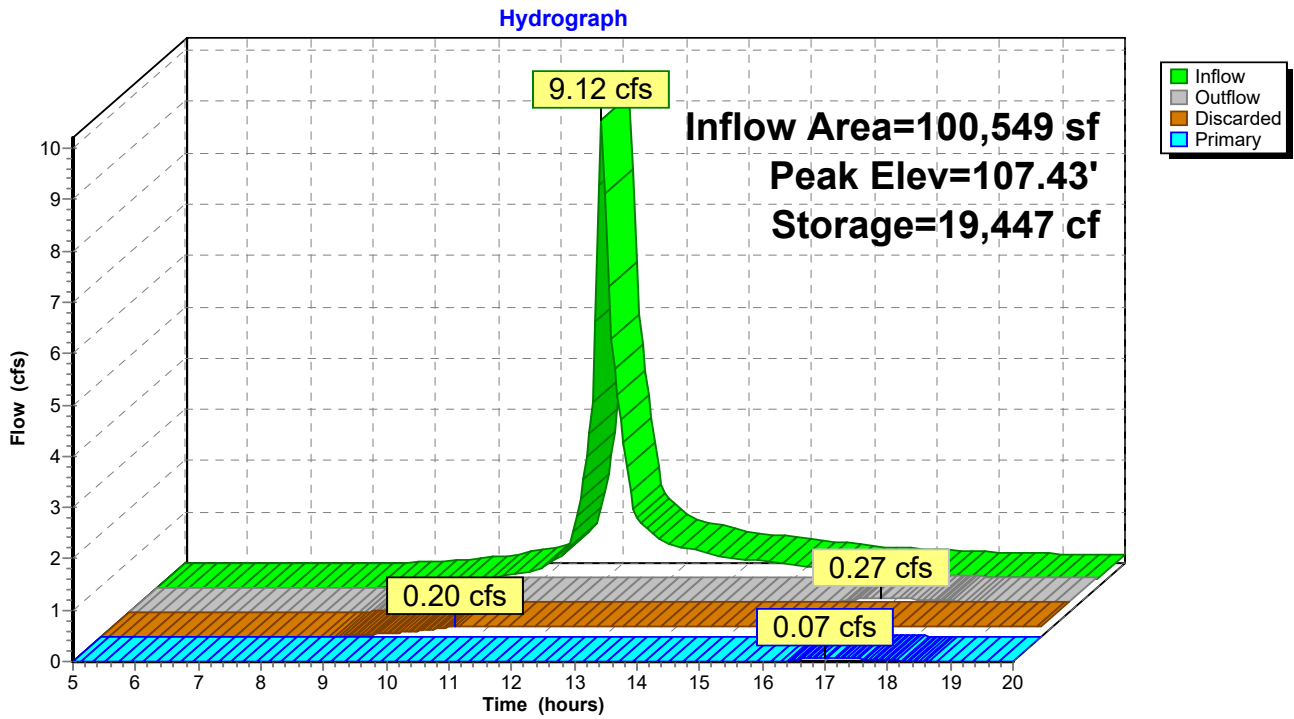

**Stage-Area-Storage for Pond ISD: Infiltration System D**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
104.00	8,610	0	106.65	8,610	16,461
104.05	8,610	172	106.70	8,610	16,716
104.10	8,610	344	106.75	8,610	16,958
104.15	8,610	517	106.80	8,610	17,187
104.20	8,610	689	106.85	8,610	17,403
104.25	8,610	861	106.90	8,610	17,607
104.30	8,610	1,033	106.95	8,610	17,799
104.35	8,610	1,205	107.00	8,610	17,979
104.40	8,610	1,378	107.05	8,610	18,151
104.45	8,610	1,550	107.10	8,610	18,323
104.50	8,610	1,722	107.15	8,610	18,496
104.55	8,610	2,098	107.20	8,610	18,668
104.60	8,610	2,473	107.25	8,610	18,840
104.65	8,610	2,847	107.30	8,610	19,012
104.70	8,610	3,220	107.35	8,610	19,184
104.75	8,610	3,593	107.40	8,610	19,357
104.80	8,610	3,964	107.45	8,610	19,529
104.85	8,610	4,336	107.50	8,610	19,701
104.90	8,610	4,707	107.55	8,610	<b>19,844</b>
104.95	8,610	5,078	107.60	8,610	19,844
105.00	8,610	5,448	107.65	8,610	19,844
105.05	8,610	5,817	107.70	8,610	19,844
105.10	8,610	6,185	107.75	8,610	19,844
105.15	8,610	6,550	107.80	8,610	19,844
105.20	8,610	6,913	107.85	8,610	19,844
105.25	8,610	7,274	107.90	8,610	19,844
105.30	8,610	7,633	107.95	8,610	19,844
105.35	8,610	7,992	108.00	8,610	19,844
105.40	8,610	8,351			
105.45	8,610	8,709			
105.50	8,610	9,066			
105.55	8,610	9,423			
105.60	8,610	9,778			
105.65	8,610	10,133			
105.70	8,610	10,486			
105.75	8,610	10,838			
105.80	8,610	11,185			
105.85	8,610	11,529			
105.90	8,610	11,869			
105.95	8,610	12,205			
106.00	8,610	12,538			
106.05	8,610	12,868			
106.10	8,610	13,194			
106.15	8,610	13,517			
106.20	8,610	13,835			
106.25	8,610	14,149			
106.30	8,610	14,459			
106.35	8,610	14,763			
106.40	8,610	15,063			
106.45	8,610	15,356			
106.50	8,610	15,644			
106.55	8,610	15,924			
106.60	8,610	16,197			

**Summary for Pond ND: Natural Depression**

Inflow Area = 25,666 sf, 0.87% Impervious, Inflow Depth > 0.83" for 100-Year event  
 Inflow = 0.41 cfs @ 12.12 hrs, Volume= 1,773 cf  
 Outflow = 0.08 cfs @ 13.29 hrs, Volume= 1,630 cf, Atten= 81%, Lag= 70.0 min  
 Discarded = 0.08 cfs @ 13.29 hrs, Volume= 1,630 cf  
 Primary = 0.00 cfs @ 5.00 hrs, Volume= 0 cf

Routing by Stor-Ind method, Time Span= 5.00-20.00 hrs, dt= 0.05 hrs  
 Peak Elev= 108.28' @ 13.29 hrs Surf.Area= 1,408 sf Storage= 532 cf

Plug-Flow detention time= 99.1 min calculated for 1,630 cf (92% of inflow)  
 Center-of-Mass det. time= 73.7 min ( 929.7 - 856.0 )


Volume	Invert	Avail.Storage	Storage Description			
#1	108.00'	3,293 cf	<b>Custom Stage Data (Irregular)</b> Listed below			
Elevation (feet)	Surf.Area (sq-ft)	Perim. (feet)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)	Wet.Area (sq-ft)	
108.00	235	88.4	0	0	235	
109.00	4,354	655.7	1,867	1,867	33,829	
109.30	5,162	671.6	1,426	3,293	35,520	

Device	Routing	Invert	Outlet Devices									
#1	Primary	109.00'	<b>2.0' long x 10.0' breadth Broad-Crested Rectangular Weir</b>									
			Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60									
			Coef. (English) 2.49 2.56 2.70 2.69 2.68 2.69 2.67 2.64									
#2	Discarded	108.00'	<b>2.410 in/hr Exfiltration over Surface area</b>									

**Discarded OutFlow** Max=0.08 cfs @ 13.29 hrs HW=108.28' (Free Discharge)  
 ↑**2=Exfiltration** (Exfiltration Controls 0.08 cfs)

**Primary OutFlow** Max=0.00 cfs @ 5.00 hrs HW=108.00' (Free Discharge)  
 ↑**1=Broad-Crested Rectangular Weir** ( Controls 0.00 cfs)

### Pond ND: Natural Depression

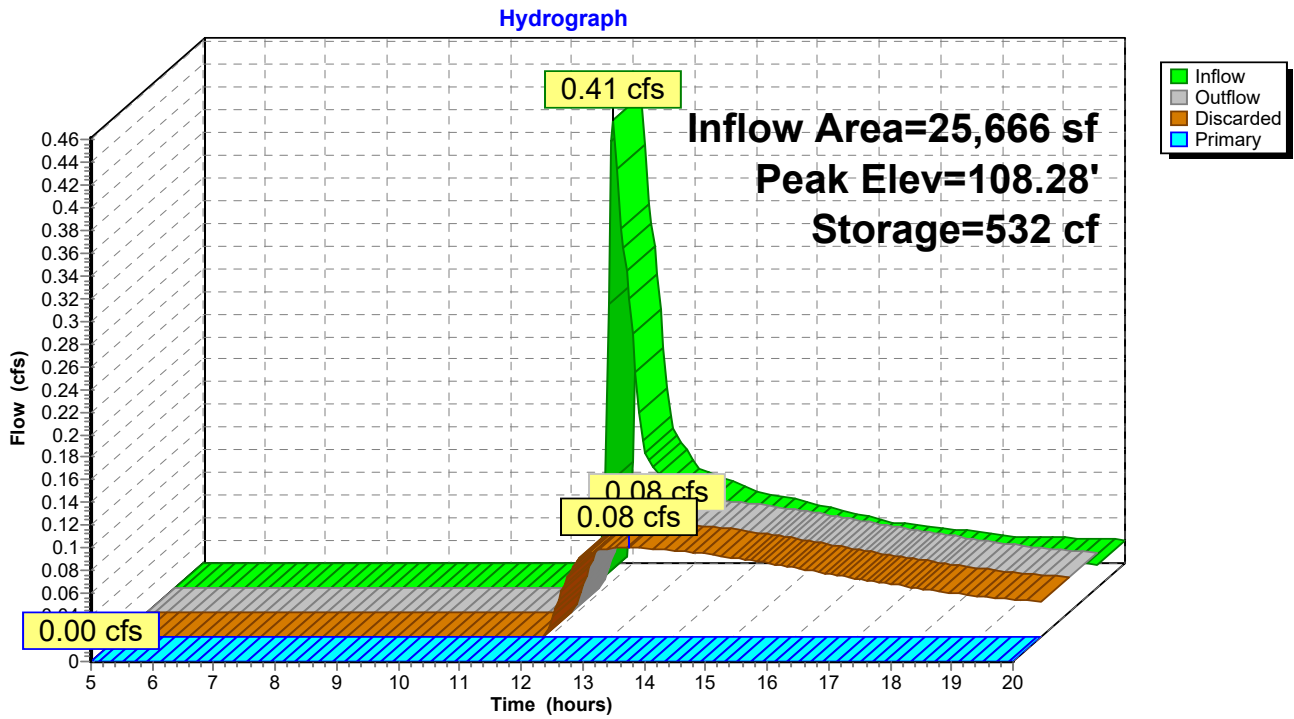

**Stage-Area-Storage for Pond ND: Natural Depression**

Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)	Elevation (feet)	Surface (sq-ft)	Storage (cubic-feet)
108.00	235	0	109.06	4,516	2,152
108.02	317	37	109.08	4,569	2,247
108.04	400	75	109.10	4,623	2,342
108.06	482	112	109.12	4,677	2,437
108.08	565	149	109.14	4,731	2,532
108.10	647	187	109.16	4,785	2,627
108.12	729	224	109.18	4,839	2,722
108.14	812	261	109.20	4,893	2,817
108.16	894	299	109.22	4,947	2,912
108.18	976	336	109.24	5,000	3,007
108.20	1,059	373	109.26	5,054	3,102
108.22	1,141	411	109.28	5,108	3,197
108.24	1,224	448	109.30	<b>5,162</b>	<b>3,293</b>
108.26	1,306	485			
108.28	1,388	523			
108.30	1,471	560			
108.32	1,553	597			
108.34	1,635	635			
108.36	1,718	672			
108.38	1,800	709			
108.40	1,883	747			
108.42	1,965	784			
108.44	2,047	821			
108.46	2,130	859			
108.48	2,212	896			
108.50	2,295	933			
108.52	2,377	971			
108.54	2,459	1,008			
108.56	2,542	1,045			
108.58	2,624	1,083			
108.60	2,706	1,120			
108.62	2,789	1,157			
108.64	2,871	1,195			
108.66	2,954	1,232			
108.68	3,036	1,269			
108.70	3,118	1,307			
108.72	3,201	1,344			
108.74	3,283	1,381			
108.76	3,365	1,419			
108.78	3,448	1,456			
108.80	3,530	1,493			
108.82	3,613	1,531			
108.84	3,695	1,568			
108.86	3,777	1,605			
108.88	3,860	1,643			
108.90	3,942	1,680			
108.92	4,024	1,717			
108.94	4,107	1,755			
108.96	4,189	1,792			
108.98	4,272	1,830			
109.00	4,354	1,867			
109.02	4,408	1,962			
109.04	4,462	2,057			

# **APPENDIX C**

## **DRAINAGE SYSTEM CALCULATIONS**

STORMWATER MANAGEMENT STANDARD 2 – PEAK RATE OF RUNOFF

STORMWATER MANAGEMENT STANDARD 3 – RECHARGE VOLUME

DRAWDOWN CALCULATIONS

STORMWATER MANAGEMENT STANDARD 4 – WATER QUALITY VOLUME

CLOSED DRAINAGE SYSTEM/PIPE SIZING CALCULATIONS





<b>Project Number:</b>	10365.0	<b>Date:</b>	September 11, 2023
<b>Project Name:</b>	Neponset Village	<b>Calculations by:</b>	BTM
<b>Project Address:</b>	5 Pleasant St.	<b>Calculations date:</b>	September 11, 2023
<b>Client:</b>	McSharry Brothers, Inc.	<b>Checked by:</b>	DJD
<b>Location:</b>	Walpole, Massachusetts	<b>Checked Date:</b>	September 12, 2023

**STORMWATER MANAGEMENT STANDARD 2 - PEAK RATE OF RUNOFF**

**ONSITE SOUTH**

DESIGN STORM (YEAR)	EXISTING PEAK RUNOFF (CFS)	PROPOSED PEAK RUNOFF (CFS)	REDUCTION IN PEAK RUNOFF
2	0.00	0.00	N/A
10	0.00	0.00	N/A
25	0.01	0.00	100.0%
100	0.03	0.02	33.3%

**OFFSITE NORTH**

DESIGN STORM (YEAR)	EXISTING PEAK RUNOFF (CFS)	PROPOSED PEAK RUNOFF (CFS)	REDUCTION IN PEAK RUNOFF
2	0.00	0.00	N/A
10	0.01	0.01	0.0%
25	0.03	0.03	0.0%
100	0.16	0.10	37.5%

NOTE: PEAK RATES AND VOLUMES SHOWN WERE TAKEN FROM THE EXISTING AND PROPOSED



**Project Number:** 10365.0  
**Project Name:** Neponset Village  
**Project Address:** 5 Pleasant St.  
**Client:** McSharry Brothers, Inc.  
**Location:** Walpole, Massachusetts

**Date:** September 11, 2023  
**Calculations by:** BTM  
**Calculations date:** September 11, 2023  
**Checked by:** DJD  
**Checked Date:** September 12, 2023

**STORMWATER MANAGEMENT STANDARD 3 - RECHARGE VOLUME**

	HYDROLOGIC SOIL GROUP				TOTAL
	A	B	C	D	
IMPERVIOUS AREA (S.F.)	28,917	27,929	0	0	56,846
INCHES OF RUNOFF TO BE RECHARGED	0.60	0.35	0.25	0.10	
<b>REQUIRED RECHARGE VOLUME (FT<sup>3</sup>)</b>	1,446	815	0	0	<b>2,260</b>

**CAPTURE AREA ADJUSTMENT - ADJUSTED MINIMUM REQUIRED RECHARGE VOLUME**

MINIMUM OF 65% OF IMPERVIOUS AREA MUST BE DIRECTED TO THE RECHARGE BMP; 65 % IS =	36,950	SF		
IMPERVIOUS SITE AREA DRAINING TO BMP =	56,511	SF	99.4%	PERCENTAGE OF IMPERVIOUS AREA DIVERTED TO INFILTRATION FACILITY
RATIO OF TOTAL IMPERVIOUS AREA TO IMPERVIOUS AREA DRAINING TO RECHARGE BMP =	1.01		= $\frac{\text{TOTAL IMPERVIOUS AREA}}{\text{IMPERVIOUS AREA DRAINING TO THE RECHARGE AREA}}$	
<b>ADJUSTED REQUIRED RECHARGE VOLUME=</b>	<b>2,274</b>	CF	= RATIO OF IMPERVIOUS AREA x REQUIRED RECHARGE VOLUME	
<b>PROPOSED RECHARGE VOLUME</b>	<b>24,027</b>	CF	TOTAL AVAILABLE STATIC RECHARGE VOLUME	



<b>Project Number:</b>	10365.0	<b>Date:</b>	September 11, 2023
<b>Project Name:</b>	Neponset Village	<b>Calculations by:</b>	BTM
<b>Project Address:</b>	5 Pleasant St.	<b>Calculations date:</b>	September 11, 2023
<b>Client:</b>	McSharry Brothers, Inc.	<b>Checked by:</b>	DJD
<b>Location:</b>	Walpole, Massachusetts	<b>Checked Date:</b>	September 12, 2023

**STORMWATER MANAGEMENT STANDARD 4 - WATER QUALITY VOLUME**

	DEPTH TO TREAT (IN.)	IMPERVIOUS AREA (SF)	WATER VOLUME (CF)
Infiltration System A (IS-A)	1	4760	397
Infiltration System B (IS-B)	1	4760	397
Infiltration System C (IS-C)	1	6800	567
Infiltration System D (IS-D)	0.5	40191	1,675
Offsite South	0.5	63	3
Offsite West	0.5	224	9
Offsite North	0.5	48	2
<b>NET WATER QUALITY VOLUME</b>			<b>3,049</b>



**Project Number:** 10365.0  
**Project Name:** Neponset Village  
**Project Address:** 5 Pleasant St.  
**Client:** McSharry Brothers, Inc.  
**Location:** Walpole, Massachusetts

**Date:** September 11, 2023  
**Calculations by:** BTM  
**Calculations date:** September 11, 2023  
**Checked by:** DJD  
**Checked Date:** September 12, 2023

**PROPOSED DRAWDOWN FOR RECHARGE STRUCTURES**

**Infiltration Basin IS-A**

A = AREA OF PROPOSED LEACHING STRUCTURE	430	SQ. FT.
R <sub>v</sub> = STORAGE VOLUME =	935	CU. FT.
K= SATURATED HYDRAULIC CONDUCTIVITY (RAWLS RATE) = VALUE IS BASED ON A HYDRAULIC SOIL GROUP	8.27	INCHES/HOUR
T = ALLOWABLE DRAWDOWN DURING PEAK (USE 2 HRS) =	72	HRS

DRAWDOWN TIME  $T = \frac{R_v}{K \times A} =$  **3.2 HOURS TO EMPTY THE RECHARGE BMP**  
 <72 HOURS, SO DRAWDOWN IS OK

**Infiltration Basin IS-B**

A = AREA OF PROPOSED LEACHING STRUCTURE	586	SQ. FT.
R <sub>v</sub> = STORAGE VOLUME =	1,282	CU. FT.
K= SATURATED HYDRAULIC CONDUCTIVITY (RAWLS RATE) = VALUE IS BASED ON A HYDRAULIC SOIL GROUP	2.41	INCHES/HOUR
T = ALLOWABLE DRAWDOWN DURING PEAK (USE 2 HRS) =	72	HRS

DRAWDOWN TIME  $T = \frac{R_v}{K \times A} =$  **10.9 HOURS TO EMPTY THE RECHARGE BMP**  
 <72 HOURS, SO DRAWDOWN IS OK

**Infiltration Basin IS-C**

A = AREA OF PROPOSED LEACHING STRUCTURE	1,094	SQ. FT.
R <sub>v</sub> = STORAGE VOLUME =	2,453	CU. FT.
K= SATURATED HYDRAULIC CONDUCTIVITY (RAWLS RATE) = VALUE IS BASED ON A HYDRAULIC SOIL GROUP	1.02	INCHES/HOUR
T = ALLOWABLE DRAWDOWN DURING PEAK (USE 2 HRS) =	72	HRS

DRAWDOWN TIME  $T = \frac{R_v}{K \times A} =$  **26.4 HOURS TO EMPTY THE RECHARGE BMP**  
 <72 HOURS, SO DRAWDOWN IS OK

**Infiltration Basin IS-D**

A = AREA OF PROPOSED LEACHING STRUCTURE	8,610	SQ. FT.
R <sub>v</sub> = STORAGE VOLUME =	19,357	CU. FT.
K= SATURATED HYDRAULIC CONDUCTIVITY (RAWLS RATE) = VALUE IS BASED ON A HYDRAULIC SOIL GROUP	1.02	INCHES/HOUR
T = ALLOWABLE DRAWDOWN DURING PEAK (USE 2 HRS) =	72	HRS

DRAWDOWN TIME  $T = \frac{R_v}{K \times A} =$  **26.4 HOURS TO EMPTY THE RECHARGE BMP**  
 <72 HOURS, SO DRAWDOWN IS OK



Project Number: 10365  
 Client: Mcsharry Brothers, INC  
 Project Name: Neponsett Village  
 Project Address: 5 Pleasant Street  
 Location: Walpole, MA

Calculations by: BTM  
 Calculations Date: 9/14/2023  
 Checked By: DJD  
 Checked Date: 09/14/2023

TO INFILTRATION CHAMBER SYSTEM A - 25 YEAR STORM

WATERSHED CHARACTERISTICS												PIPE CHARACTERISTICS										FLOW CHARACTERISTICS				
LOCATION			LAND USE			FLOW TIME			FLOW			R = hydraulic radius = area/wetted perimeter														
Description	Cover	Increm. (ACRE)	Total_A (ACRE)	C	CA	Total CA	To Inlet (MIN)	In Pipe (MIN)	Tc (MIN)	I (IPH)	Q (CFS)	Structure	Invert	Pipe	Size (IN)	Length (FT)	Area (SF)	R (FT)	Slope	n	Qf (CFS)	Vf (FT/S)	Q/Qf	V/Vf	V (FT/S)	Tc L/V (MIN)
WS RD-A1	LANDSCAPED IMPERVIOUS	0.000 0.055	0.400 0.850 0.055	0.400 0.850	0.046		6.00	NONE	6.00	6.39	0.3	From: RD-A1 To: IS-A	Out: In:	HDPE	6	182	0.20	0.125	0.010	0.013	0.56	2.86	0.53	0.87	2.49	1.22
WS RD-A2	LANDSCAPED IMPERVIOUS	0.000 0.055	0.400 0.850 0.055	0.400 0.850	0.046		6.00	NONE	6.00	6.39	0.3	From: RD-A2 To: IS-A	Out: In:	HDPE	6	178	0.20	0.125	0.010	0.013	0.56	2.86	0.53	0.87	2.49	1.19



Project Number: 10365  
 Client: Mcsharry Brothers, INC  
 Project Name: Neponsett Village  
 Project Address: 5 Pleasant Street  
 Location: Walpole, MA

Calculations by: BTM  
 Calculations Date: 09/14/2023  
 Checked By: DJD  
 Checked Date: 09/14/2023

### TO INFILTRATION CHAMBER SYSTEM B - 25 YEAR STORM

WATERSHED CHARACTERISTICS												PIPE CHARACTERISTICS								FLOW CHARACTERISTICS							
LOCATION				LAND USE			FLOW TIME			FLOW		R = hydraulic radius = area/wetted perimeter															
Description	Cover	Increm. (ACRE)	Total_A (ACRE)	C	CA	Total CA	To Inlet (MIN)	In Pipe (MIN)	Tc (MIN)	I (IPH)	Q (CFS)	Structure	Invert	Pipe	Size (IN)	Length (FT)	Area (SF)	R (FT)	Slope	n	Qf (CFS)	Vf (FT/S)	Q/Qf	V/Vf	V (FT/S)	Tc L/V (MIN)	
WS RD-B1	LANDSCAPED IMPERVIOUS	0.000 0.055		0.400 0.850								From: RD-B1	Out:														
			0.055	0.850	0.046		6.00	NONE	6.00	6.39	<b>0.30</b>	To: IS-B	In:	HDPE	6	191	0.20	0.125	0.010	0.013	<b>0.56</b>	<b>2.86</b>	0.53	0.87	2.49	1.28	
WS RD-B2	LANDSCAPED IMPERVIOUS	0.000 0.055		0.400 0.850								From: RD-B2	Out:														
			0.055	0.850	0.046		6.00	NONE	6.00	6.39	<b>0.30</b>	To: IS-B	In:	HDPE	6	184	0.20	0.125	0.011	0.013	<b>0.59</b>	<b>3.00</b>	0.50	0.86	2.57	1.19	



Project Number: 10365  
 Client: Mcsharry Brothers, INC  
 Project Name: Neponsett Village  
 Project Address: 5 Pleasant Street  
 Location: Walpole, MA

Calculations by: BTM  
 Calculations Date: 09/14/2023  
 Checked By: DJD  
 Checked Date: 09/14/2023

### TO INFILTRATION CHAMBER SYSTEM C - 25 YEAR STORM

WATERSHED CHARACTERISTICS													PIPE CHARACTERISTICS								FLOW CHARACTERISTICS					
LOCATION				LAND USE			FLOW TIME			FLOW		Structure	Invert	Pipe	Size (IN)	Length (FT)	Area (SF)	R (FT)	Slope	n	Qf (CFS)	Vf (FT/S)	Q/Qf	V/Vf	V (FT/S)	Tc L/V (MIN)
Description	Cover	Increm. (ACRE)	Total_A (ACRE)	C	CA	Total CA	To Inlet (MIN)	In Pipe (MIN)	Tc (MIN)	I (IPH)	Q (CFS)															
WS RD-C1	LANDSCAPED IMPERVIOUS	0.000 0.078	0.400 0.850 0.078	0.400 0.850	0.066		6.00	NONE	6.00	6.39	<b>0.42</b>	From: RD-C1 To: IS-C	Out: In:	HDPE	6	300	0.20	0.125	0.015	0.013	<b>0.69</b>	<b>3.50</b>	0.62	0.91	3.19	1.57
WS RD-C2	LANDSCAPED IMPERVIOUS	0.000 0.078	0.400 0.850 0.078	0.400 0.850	0.066		6.00	NONE	6.00	6.39	<b>0.42</b>	From: RD-C2 To: IS-C	Out: In:	HDPE	6	356	0.20	0.125	0.007	0.013	<b>0.47</b>	<b>2.39</b>	0.90	1.02	2.43	2.44





# APPENDIX D

## LONG TERM POLLUTION PREVENTION PLAN – REQUIRED BY STANDARDS 4-6

# LONG TERM POLLUTION PREVENTION PLAN

To keep the Stormwater Management System (SMS) functioning properly and to ensure that the stormwater Total Suspended Solids (TSS) are reduced, a long-term pollution prevention is required. The owner/operator of the facility is responsible for the adherence to this long-term plan. The following is a guideline of the specific requirements of the plan to maintain the long term viability of the stormwater management system.

The Stormwater Pollution Prevention Plan for the site addresses many of the items in the Long Term Pollution Prevention Plan.

## *Good Housekeeping Practices*

Employees shall be instructed in the importance of not spilling fluids and chemicals such as oil, antifreeze, etc. onto the bare ground. All areas exposed to the weather shall be kept clean.

## *Provisions for Storing Materials and Waste Products Inside or Under Cover*

Liquid waste products shall be captured when draining from vehicles, and stored in sealed containers under cover until they are disposed of. Waste products shall be disposed of in a legal manner, at a state licensed recycling center or landfill.

## *Motor Vehicle controls*

Repair, maintenance, and washing of motor vehicles is prohibited from being performed on the property.

## *Requirements for routine inspections and maintenance of stormwater BMPs*

BMPs shall be inspected and maintained per the Operations and Maintenance Plan.

## *Spill prevention and response plans*

### First responders

### Phone Numbers

- |   |                                    |
|---|------------------------------------|
| • Walpole Fire Department   | 911 if emergency or (508) 668-0260 |
| • Walpole Police Department   | 911 if emergency or (508) 668-1212 |
| • Mass Department of Environmental Protection<br>Emergency Response | 1-888-304-1133                     |

## *Requirements for storage and use of fertilizers, herbicides, and pesticides*

All fertilizer, herbicides, and pesticides shall be used in accordance with the manufacturer guidelines. Excess materials shall be swept up from all impervious surfaces and not allowed to run into the drainage system. All fertilizer, herbicides, and pesticides shall be stored in a wrapped or sealed container and kept under cover out of the rain and snow.

### *Provisions for solid waste management*

Solid waste shall be collected at a minimum of once per week and disposed of in an appropriate dumpster or garbage truck. Waste shall be disposed of in a legal manner, at a state licensed recycling center or landfill.

### *Snow disposal and plowing plans relative to Wetland Resource Areas*

Where possible, snow shall be placed onto grassed and landscaped areas adjacent to the area it was removed from. During snow events in which excessive snow cannot be stored within open landscaped areas, snow shall be stored in the designated "Overburden Snow Stockpile Area" as indicated on the Site Plans. During extreme snow events, in which snow cannot be stored on site, snow will be trucked off and disposed of in a legal manner.

### *Street sweeping schedule*

Street sweeping shall be performed on paved surfaces no less than once per year, preferably in the spring months.

### *Training for staff or personnel involved with implementing Long-Term Pollution Prevention Plan.*

Training shall be conducted during the hiring of all new site employees and site maintenance contractors. Training shall be performed by the owner of the property or a qualified representative. Training records shall be kept on file.

# APPENDIX E

## OPERATION AND MAINTENANCE PLAN - REQUIRED BY STANDARD 9

# OPERATION AND MAINTENANCE PLAN

## NEPONSET VILLAGE

5 Pleasant Street, Walpole, Massachusetts

**OWNER NAME:** Neponset Village, LLC

**ADDRESS:** 4 First Street, Bridgewater, MA 02324

**TEL. NUMBER:** (508) 962-6291

To keep the Stormwater Management System (SMS) functioning properly and to ensure that the Total Suspended Solids (TSS) are reduced, periodic maintenance is required. The owner/operator of the facility is responsible for the periodic maintenance requirements of the SMS. Neponset Village, LLC is the owner and will be the party responsible for the maintenance of the SMS. The following is a guideline of the specific maintenance schedules and tasks required to keep the SMS functioning properly.

- Deep Sump Catch Basins
  - General Maintenance
    - Remove any accumulated debris from the grates during the fall and spring.
  - Quarterly Maintenance
    - Inspect sumps for accumulated sediment. If sediment has reached a depth of eighteen inches (18"), remove via clamshell bucket or vacuum truck and dispose of removed materials per local, state, and federal regulations.
  - Annual Maintenance
    - Inspect hood to ensure that it is properly secured.
    - Remove accumulated sediment via clamshell bucket or vacuum truck and dispose of removed materials per local, state, and federal regulations.
- Infiltration Chambers
  - General Maintenance
    - Inspect subsurface infiltration facilities twice a year.
    - Remove any debris that may clog the system via vacuum truck.
- Plunge Pools/Splash Pads
  - General Maintenance
    - During the fall and the spring remove any accumulated leaves or large debris.
  - Annual Maintenance
    - Check for signs of erosion and repair as needed.
    - Remove any branches, trash, or other large debris that could interfere with the proper operation of the inlet or outlet of the basin. Remove any accumulated sediment, by the use of hand tools (shovels, rakes, wheelbarrows, etc.) when it exceeds three inches (3") but not less than annually.



# APPENDIX F

## ILLICIT DISCHARGE COMPLIANCE STATEMENT- REQUIRED BY STANDARD 10

## Illicit Discharge Compliance Statement

### Responsibility:

The Owner is responsible for ultimate compliance with all provisions of the Massachusetts Stormwater Management Policy, the USEPA NPDES Construction General Permit and responsible for identifying and eliminating illicit discharges (as defined by the USEPA).

**OWNER NAME:** Neponset Village, LLC


**ADDRESS:** 5 Pleasant St  
Walpole, MA, 02081

**TEL. NUMBER:** (508) 697-3191

### Engineer's Compliance Statement:

To the best of my knowledge, the attached plans, computations and specifications meet the requirements of Standard 10 of the Massachusetts Stormwater Handbook regarding illicit discharges to the stormwater management system and that no detectable illicit discharges exist on the site. All documents and attachments were prepared under my direction and qualified personnel properly gathered and evaluated the information submitted, to the best of my knowledge.

Included with this statement are site plans, drawn to scale, that identify the location of systems for conveying stormwater on the site and show that these systems do not allow the entry of any illicit discharges into the stormwater management system. The plans also show any systems for conveying wastewater and/or groundwater on the site and show that there are no connections between the stormwater and wastewater systems.

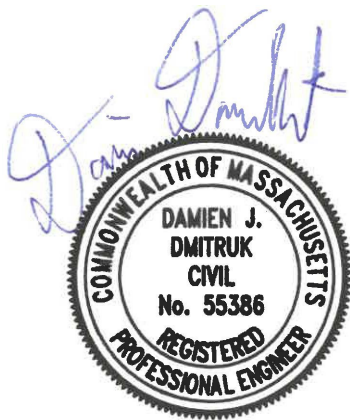

Damien J. Dmitruk, P.E.  
Civil Engineer



# APPENDIX G

## SOIL LOGS

Job No.: 10365.0

Soil Evaluator: Brannon McMullen, E.I.T.

Client: Neponset Village LLC

Witness: Carl Balduf, P.E.

Site Location: 5 Pleasant St., Walpole, MA

Excavator: ADH Contracting

Land Use: Vacant lot

Date: August 31, 2019

Parent Material: \_\_\_\_\_

Weather: Sunny, 75°

Water Resource Conditions: Normal: \_\_\_\_\_ Above: \_\_\_\_\_ Below: \_\_\_\_\_

**TP # 1**

Depth	Horizon	Texture	Color	Comments	Infiltration Test		Groundwater	
					Depth		Mottling	
0-2	O				0-15 Min.		Mottling	N/E
2-8	Ap	Course Sand	10YR 5/4		15-30 Min.		Weeping	N/E
8-28	Bw	Course Sand	10YR 3/4	10% Gravel, 25% Cob./Stones	30-45 Min.		Standing	N/E
28-126	C1	Coarse Sand	10YR 4/3	20% Cob./Stones	45-60 Min.			
126-176	C2	Sand			60-75 Min.			

**Rate** 8.27 "/hr

**TP # 2**

Depth	Horizon	Texture	Color	Comments	Infiltration Test		Groundwater	
					Depth		Mottling	
0-5	O				0-15 Min.		Mottling	N/E
5-11	Ap	Loamy Sand	10YR 5/2		15-30 Min.		Weeping	139"
11-40	Bw	Loamy Sand	10YR 4/4		30-45 Min.		Standing	N/E
40-102	C1	Loamy Sand	10YR 6/4		45-60 Min.			
102-140	C2	Loamy Sand			60-75 Min.			

**Rate** 2.41 "/hr

**TP # 3**

Depth	Horizon	Texture	Color	Comments	Infiltration Test		Groundwater	
					Depth		Mottling	
0-6	O				0-15 Min.		Mottling	N/E
6-11	Ap	Loamy Sand	10YR 4/6		15-30 Min.		Weeping	N/E
11-41	Bw	Loamy Sand	10YR 5/6		30-45 Min.		Standing	N/E
41-68	C1	Loamy Sand	10YR 6/1		45-60 Min.			
68-102	C2	Loamy Sand	10YR 6/4	10% Gravel, 10% Cob./Stones	60-75 Min.			
102-142	C3	Sandy Loam		10% Gravel, 10% Cob./Stones				

**Rate** 2.41 "/hr

**TP # 4**

Depth	Horizon	Texture	Color	Comments	Infiltration Test		Groundwater	
					Depth		Mottling	
0-108	Fill				0-15 Min.		Mottling	N/E
108-141	C	Sandy Loam			15-30 Min.		Weeping	N/E
					30-45 Min.		Standing	N/E
					45-60 Min.			
					60-75 Min.			

**Rate** 1.02 "/hr

TP # 5

Depth	Horizon	Texture	Color	Comments	Infiltration Test		Groundwater	
0-5	O				Depth		Mottling	N/E
5-14	Ap	Sandy Loam	10YR 5/2		0-15 Min.			
14-41	Bw	Sandy Loam	10YR 4/3		15-30 Min.		Weeping	N/E
41-60	C1	Sandy Loam	10YR 4/4		30-45 Min.			
60-128	C2	Sandy Loam			45-60 Min.		Standing	N/E
					60-75 Min.			

Rate 1.02 "/hr

TP # 7

Depth	Horizon	Texture	Color	Comments	Infiltration Test		Groundwater	
0-14	A	Sandy Loam	10YR 5/2		Depth		Mottling	N/E
14-31	Bw	Sandy Loam	10YR 4/4		0-15 Min.			
31-128	C1	Sandy Loam	10YR 3/4		15-30 Min.		Weeping	N/E
					30-45 Min.			
					45-60 Min.		Standing	N/E
					60-75 Min.			

Rate 2.41 "/hr