

STORM WATER REPORT
THE RESIDENCES AT DARWIN COMMON
PROPOSED 28 UNIT MULTI FAMILY
RESIDENTIAL DEVELOPMENT
A COMPREHENSIVE PERMIT M.G.L. c. 40B
WALPOLE, MA
AUGUST 28, 2023
REVISED DECEMBER 7, 2023



OWNER: JOHN HASENJAEGER
P.O. BOX 661
NORWOOD, MA 02062

APPLICANT: WALL STREET DEVELOPMENT CORP.
P.O. BOX 272
WESTWOOD, MA 02090

ENGINEER: GLOSSA ENGINEERING INC
46 EAST STREET
EAST WALPOLE, MA 02032

Table of Contents

Narrative / Summary	1
Construction Period Pollution Prevention Plan	2
Operation and Maintenance Plan	4
Long Term Pollution Prevention Plan	6
Drainage Works Inspection Form	Appendix I
Recharge / Drawdown Calculation	Appendix I
Water Quality Volume	Appendix I
TSS Removal Rate	Appendix I
Pipe Size computation	Appendix I
Soils Evaluations	Appendix I
Existing Conditions Model	Appendix II
Proposed Conditions Model	Appendix III
Watershed Plans	Back Pocket

NARRATIVE

The proposal is for a 28 unit multi family residential development to be constructed on 3.44 acres of vacant land in Walpole, MA.

The property is located at the end of Darwin Lane which is a public street running off of Common Street. The vacant property is mostly wooded, natural ground cover exists at all areas of the site. The property slopes essentially from north to south at a slope of approximately 10 percent. The landform appears to be the side of an esker. Soils at the site were found to be glacial outwash made up of coarse sand and gravel. Soils at the site are classified as Merrimac sand and gravel. Two drainage watersheds were identified at the site. One watershed is the stormwater management system for the existing subdivision. This watershed consists of roadways, driveways, rooftops, lawns and natural wooded areas. The runoff from this watershed is collected in catch basins and delivered to a stormwater infiltration basin behind the homes at #27 and #31 Darwin Lane. The stormwater infiltration basin when overtopped would discharge to the subject property. The second watershed at the site is the bulk of the undisturbed land found at the site which discharges overland toward School Meadow Brook.

The proposal is to construct 28 residential units in 6 buildings. Each unit will have a garage and one parking stall in front of the garage. There will be a 24 foot wide access driveway with two 82 foot diameter cul de sacs to allow for turning and reversing direction. Storm water will be managed in accordance with MA DEP Stormwater management regulations. The system consists of deep sump catch basins with hooded outlet pipes, stormceptor water quality units, an infiltration basin and an infiltration trench.

STANDARD #2 – PEAK RATE ATTENUATION:

EXISTING CONDITIONS:

Subarea	Stormwater Runoff Summary				
	Storm Event				
Pre-development.	2-yr	10-yr	25-yr	50-yr	100-yr
EX-1 (cfs)	0.0	0.0	0.06	0.25	1.18
EX -1 (ac-ft.)	0.0	0.001	0.040	0.119	0.262
EX-2 (cfs)	0.0	0.0	0.0	0.0	0.02
EX -2 (ac-ft.)	0.0	0.0	0.0	0.001	0.003
EX-3 (cfs)	0.0	0.0	0.0	0.0	0.02
EX -3 (ac-ft.)	0.0	0.0	0.001	0.002	0.004
OS -1 (cfs)	2.27	7.85	13.19	18.68	25.75
OS -1 (ac-ft.)	0.255	0.688	1.104	1.535	2.095
Total to the South (cfs)	0.0	0.0	1.41	8.80	19.72
Total to the South (ac-ft.)	0.0	0.001	0.124	0.516	1.094
Existing Basin					
Infiltrated (cfs)	0.42	0.85	1.11	1.18	1.27
Infiltrated (ac-ft.)	0.184	0.617	0.948	1.066	1.193
Outflow (cfs)	0.0	0.0	1.41	8.72	19.15
Outflow (as-ft.)	0.0	0.0	0.085	0.398	0.832
Elevation	220.76	223.63	225.14	225.44	225.70
Total Area 10.207 acres					

PROPOSED CONDITIONS:

Subarea	Stormwater Runoff Summary				
	Storm Event				
Post-development.	2-yr	10-yr	25-yr	50-yr	100-yr
P-1 (cfs)	0.12	0.25	0.35	0.45	0.57
P-1 (ac-ft.)	0.009	0.017	0.025	0.32	0.041
P-2 (cfs)	0.11	0.19	0.24	0.30	0.37
P-2 (ac-ft.)	0.008	0.014	0.018	0.023	0.028
P-3 (cfs)	0.58	0.94	1.23	1.49	1.81
P-3 (ac-ft.)	0.042	0.071	0.093	0.115	0.141
OS-1 (cfs)	2.27	7.85	13.19	18.68	25.75
OS 1 (ac-ft.)	0.255	0.688	1.104	1.535	2.095
OS-2 (cfs)	0.0	0.0	0.01	0.06	0.28
OS 2 (ac-ft.)	0.0	0.0	0.009	0.028	0.061
P-4 (cfs)	0.59	1.24	1.78	2.31	2.95
P-4 (ac-ft.)	0.043	0.088	0.127	0.165	0.231

P-5 (cfs)	0.19	0.40	0.58	0.75	0.96
P-5 (ac-ft.)	0.014	0.029	0.041	0.054	0.069
P-6 (cfs)	0.31	0.71	1.07	1.41	1.83
P-6 (ac-ft.)	0.023	0.051	0.076	0.10	0.131
P-7 (cfs)	0.0	0.0	0.04	0.11	0.30
P-7 (ac-ft.)	0.0	0.003	0.009	0.019	0.034
P-8 (cfs)	0.0	0.02	0.12	0.34	0.75
P-8 (ac-ft.)	0.0	0.008	0.023	0.042	0.070
P-9 (cfs)	2.01	3.08	3.91	4.69	5.65
P-9 (ac-ft.)	0.160	0.250	0.320	0.386	0.466
P-9A (cfs)	0.44	0.67	0.85	1.02	1.23
P-9A (ac-ft.)	0.035	0.054	0.069	0.084	0.101
P-10 (cfs)	0.0	0.0	0.03	0.10	0.27
P-10 (ac-ft.)	0.0	0.002	0.009	0.019	0.035
P-10A (cfs)	0.0	0.02	0.11	0.33	0.72
P-10A (ac-ft.)	0.0	0.008	0.022	0.040	0.067
Headwall (cfs)	0.0	0.0	1.41	8.75	19.33
Total to the South (cfs)	0.0	0.0	1.42	8.84	19.54
Total to the South (ac-ft.)	0.0	0.003	0.103	0.445	0.928
Existing Basin					
Infiltrated (cfs)	0.42	0.85	1.11	1.18	1.27
Infiltrated (ac-ft.)	0.184	0.617	0.948	1.066	1.193
Outflow (cfs)	0.0	0.0	1.41	8.72	19.15
Outflow (as-ft.)	0.0	0.0	0.085	0.398	0.832
Elevation	220.76	223.63	225.14	225.44	225.70
Proposed Galleys					
Infiltrated (cfs)	1.21	1.21	1.21	1.21	1.21
Infiltrated (ac-ft.)	0.299	0.530	0.733	0.935	1.193
Outflow (cfs)	0.0	0.0	0.0	0.0	0.0
Outflow (as-ft.)	0.0	0.0	0.0	0.0	0.0
Elevation	209.69	210.51	211.29	212.17	213.98
Proposed Infiltration Trench					
Infiltrated (cfs)	0.18	0.18	0.18	0.18	0.18
Infiltrated (ac-ft.)	0.035	0.062	0.091	0.124	0.168
Outflow (cfs)	0.0	0.0	0.0	0.0	0.0
Outflow (as-ft.)	0.0	0.0	0.0	0.0	0.0
Elevation	195.43	196.10	196.76	197.52	199.92
Total Area = 10.207 acres					

CONSTRUCTION PERIOD POLLUTION PREVENTION PLAN

Given the proximity of the municipal drain system, care shall be taken to assure that eroded soil will not be deposited into the nearby drain system. Care shall be taken also to assure that eroded soil will not be deposited onto abutting properties.

The entity for the construction period pollution prevention and erosion and sedimentation control plan is Wall Street Development Corp., their successors and assigns, P.O. Box 272, Westwood, MA 02090. Construction period pollution control measures shall include a siltation barrier (compost filled sock). A designated materials stockpile area and a construction staging area have also been depicted on the plans. Construction sequencing shall be as follows:

- 1) The limit of work shall be clearly marked in the field by the design engineer.
- 2) Designate the material stockpile areas in the field.
- 3) Install silt controls as shown on the plan.
- 4) Install stabilized construction entrances.
- 5) Install silt sacks in all existing nearby catch basins.
- 6) Remove and stockpile top and sub soils from all areas to be disturbed.
This will require the temporary stockpiling of about 14,000 c.y. of material. Any material to be deemed as not suitable shall be removed from the site. Material to remain on site shall be stockpiled in the location of Building 6-9 and Building 10-12. During construction, once an area is finished and will not need to be regraded, that area shall be covered with stockpiled loam and covered with seed or sod.
- 7) Bring the site to sub grade. Install retaining walls.
- 8) Install temporary sedimentation areas.
- 9) Install the infiltration basin.
- 10) Bring roadway to sub grade with bank gravel.
- 11) Install sewer, water and other underground utilities.
- 12) Use silt sacks for silt control, bring roadway to gravel grade and pave with binder course.
- 13) Construct buildings.
- 14) Install curbing, sidewalks and loam strips.
- 15) Install the infiltration trench.
- 16) Loam and seed all side slopes and other disturbed areas.
- 17) Install final pavement
- 18) Remove siltation controls and clean up areas including catch basin sumps.

CONSTRUCTION NOTES

- 1) All areas to be altered shall be brought to sub grade or final grade at the start of construction.
- 2) Areas once brought to grade that will not be altered again shall be loamed and seeded and protected with Straw Guard as needed.
- 3) Infiltration basins as shown shall not become operational until the site is finished and swept of all debris.
- 4) Temporary sediment basins shall be used and maintained until all proposed paved areas are complete and swept of all debris.
- 5) Catch basins shall be protected from sediments at all times until construction is complete.
- 6) Install silt sacks in all existing and proposed catch basins.
- 7) The developer shall maintain erosion / sedimentation controls during construction and until the sale of the units.
- 8) Erosion / sedimentation controls shall be inspected weekly and immediately after rainfall events greater than ½".

9) Temporary ground cover or erosion / siltation control shall be established on any unbuilt units or buildings where required by the Zoning Board.

VEGETATION PLANNING

Vegetation shall be installed per the approved plans in accordance with the construction sequencing plan. No plants shall be planted in the drainage easements except as shown on the approved plans.

EROSION AND SEDIMENTATION CONTROLS

The operation and maintenance of the erosion and sedimentation controls shall be the responsibility of the site contractor, who will report to Wall Street Development Corp. their successors and assigns. The erosion and sedimentation controls shall be inspected daily by the site contractor. Repairs as needed shall be made immediately. The inspection of erosion and sedimentation controls shall also be done weekly and after every 1/2" or more rain event by an independent person trained in erosion control practices at construction sites. This independent person shall file weekly reports with Wall Street Development Corp., their successors and assigns. These reports shall be made available to the Zoning Board, Conservation Commission, Mass DEP and the EPA.

**PROPOSED 28 UNIT
RESIDENTIAL DEVELOPMENT
DARWIN LANE
WALPOLE, MA**

**OPERATION AND MAINTENANCE PLAN STORM WATER CONTROL AND MITIGATION
SYSTEM**

The entity responsible for the implementation of the operation and maintenance plan for the storm water management system is:

Darwin Commons Home Owners Association
Address to be determined
Walpole, MA 02081

The storm water system is shown on an as built plan on file with the with the Walpole Zoning Board. The system consists of the following components:

- 1) Catch Basins (8)
- 2) Drain Manholes (11)
- 3) Headwalls (2)
- 4) Stormceptor water quality units (2)
- 5) Drainage infiltration basin (1)
- 6) Drainage infiltration trench (1)
- 7) Retaining walls (3)

INSPECTIONS

1) Storm water system components shall be inspected every three months during the first year of operation. Inspection reports shall be submitted to the Zoning Board within 30 days of the inspection. These inspections shall be conducted by a qualified civil engineering firm and/or an environmental firm to be commissioned by the Darwin Commons Home Owners Association.

2) The drainage infiltration basins and infiltration trench shall be inspected once per year by a qualified civil engineering firm and/or a qualified environment firm commissioned by the Darwin Commons Home Owners Association. Any repairs shall be made within 30 days of the inspection. The Association shall consult with a Registered Professional Engineer regarding any anticipated repairs. They shall notify the Walpole Zoning Board prior to the undertaking of any repairs.

3) Catch basins shall be cleaned and inspected every year.

4) Drainage manholes, drainage piping, and the flared end section shall be inspected every year.

5) Any repairs deemed to be critical shall be made immediately. Any other repairs shall be made within 30 days of the inspection.

6) Any proposed changes to the storm water management system shall be approved in writing by the Walpole Zoning Board.

7) The Association shall have on hand at all times \$5,000.00 (2023 dollar value) for inspections and emergency repairs.

MAINTENANCE

1) Paved areas shall be swept twice per year, once in the Spring and once in the Fall by the Association.

2) Mowing of the grass and care of any planned shrubs within the site shall be routinely done by the Association.

3) Trash and other debris shall be routinely picked up and removed from the access driveway and parking areas by the Association.


4) The Association shall have a revolving fund with money on hand at all times to perform their required tasks.

REPLACEMENT

1) The Association shall have a replacement fund for the infiltration basin and infiltration trench. The amount of money needs to be \$100,000 (in 2023 value) within 50 years of the start of construction.

Stormceptor[®]

Owner's Manual

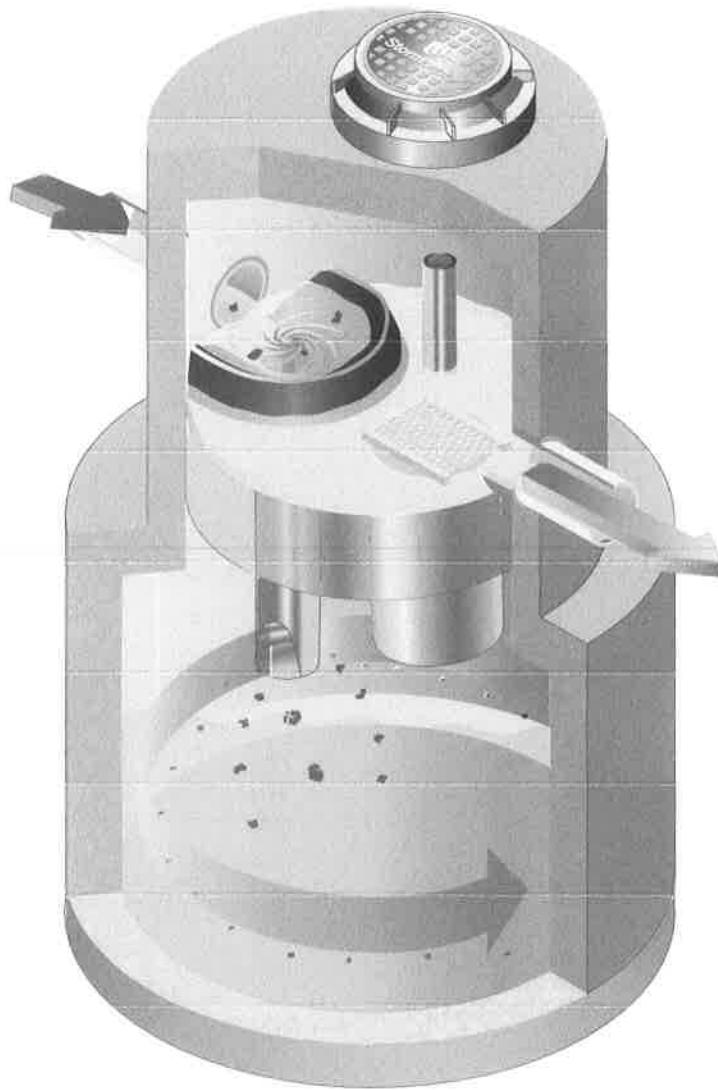

Stormceptor is protected by one or more of the following patents:

Canadian Patent No. 2,137,942
Canadian Patent No. 2,175,277
Canadian Patent No. 2,180,305
Canadian Patent No. 2,180,338
Canadian Patent No. 2,206,338
Canadian Patent No. 2,327,768
U.S. Patent No. 5,753,115
U.S. Patent No. 5,849,181
U.S. Patent No. 6,068,765
U.S. Patent No. 6,371,690
U.S. Patent No. 7,582,216
U.S. Patent No. 7,666,303
Australia Patent No. 693,164
Australia Patent No. 707,133
Australia Patent No. 729,096
Australia Patent No. 779,401
Australia Patent No. 2008,279,378
Australia Patent No. 2008,288,900
Indonesia Patent No. 0007058
Japan Patent No. 3581233
Japan Patent No. 9-11476
Korean Patent No. 0519212
Malaysia Patent No. 118987
New Zealand Patent No. 314,646
New Zealand Patent No. 583,008
New Zealand Patent No. 583,583
South African Patent No. 2010/00682
South African Patent No. 2010/01796
Other Patents Pending

Table of Contents

1 – Stormceptor Overview

2 – Stormceptor Operation & Components

3 – Stormceptor Identification

4 – Stormceptor Inspection & Maintenance

 Recommended Stormceptor Inspection Procedure

 Recommended Stormceptor Maintenance Procedure

5 – Contact Information (Stormceptor Licensees)

Congratulations!

Your selection of a Stormceptor® means that you have chosen the most recognized and efficient stormwater oil/sediment separator available for protecting the environment. Stormceptor is a pollution control device often referred to as a “Hydrodynamic Separator (HDS)” or an “Oil Grit Separator (OGS)”, engineered to remove and retain pollutants from stormwater runoff to protect our lakes, rivers and streams from the harmful effects of non-point source pollution.

1 – Stormceptor Overview

Stormceptor is a patented stormwater quality structure most often utilized as a treatment component of the underground storm drain network for stormwater pollution prevention. Stormceptor is designed to remove sediment, total suspended solids (TSS), other pollutants attached to sediment, hydrocarbons and free oil from stormwater runoff. Collectively the Stormceptor provides spill protection and prevents non-point source pollution from entering downstream waterways.

Key benefits of Stormceptor include:

- Removes sediment, suspended solids, debris, nutrients, heavy metals, and hydrocarbons (oil and grease) from runoff and snowmelt.
- Will not scour or re-suspend trapped pollutants.
- Provides sediment and oil storage.
- Provides spill control for accidents, commercial and industrial developments.
- Easy to inspect and maintain (vacuum truck).
- “STORMCEPTOR” is *clearly* marked on the access cover (excluding inlet designs).
- Relatively small footprint.
- 3rd Party tested and independently verified.
- Dedicated team of experts available to provide support.

Model Types:

- STC (Standard)
- STF (Fiberglass)
- EOS (Extended Oil Storage)
- OSR (Oil and Sand Removal)
- MAX (Custom designed unit, specific to site)

Configuration Types:

- Inlet unit (accommodates inlet flow entry, and multi-pipe entry)
- In-Line (accommodates multi-pipe entry)
- Submerged Unit (accommodates the site’s tailwater conditions)
- Series Unit (combines treatment in two systems)

Please Maintain Your Stormceptor

To ensure long-term environmental protection through continued performance as originally designed for your site, **Stormceptor must be maintained**, as any stormwater treatment practice does. The need for maintenance is determined through inspection of the Stormceptor. Procedures for inspection are provided within this document. Maintenance of the Stormceptor is performed from the surface via vacuum truck.

If you require information about Stormceptor, or assistance in finding resources to facilitate inspections or maintenance of your Stormceptor please call your local Stormceptor Licensee or Imbrium® Systems.

2 – Stormceptor Operation & Components

Stormceptor is a flexibly designed underground stormwater quality treatment device that is unparalleled in its effectiveness for pollutant capture and retention using patented flow separation technology.

Stormceptor creates a non-turbulent treatment environment below the insert platform within the system. The insert diverts water into the lower chamber, allowing free oils and debris to rise, and sediment to settle under relatively low velocity conditions. These pollutants are trapped and stored below the insert and protected from large runoff events for later removal during the maintenance procedure.

With thousands of units operating worldwide, Stormceptor delivers reliable protection every day, in every storm. The patented Stormceptor design prohibits the scour and release of captured pollutants, ensuring superior water quality treatment and protection during even the most extreme storm events. Stormceptor's proven performance is backed by the longest record of lab and field verification in the industry.

Stormceptor Schematic and Component Functions

Below are schematics of two common Stormceptor configurations with key components identified and their functions briefly described.

Figure 1.


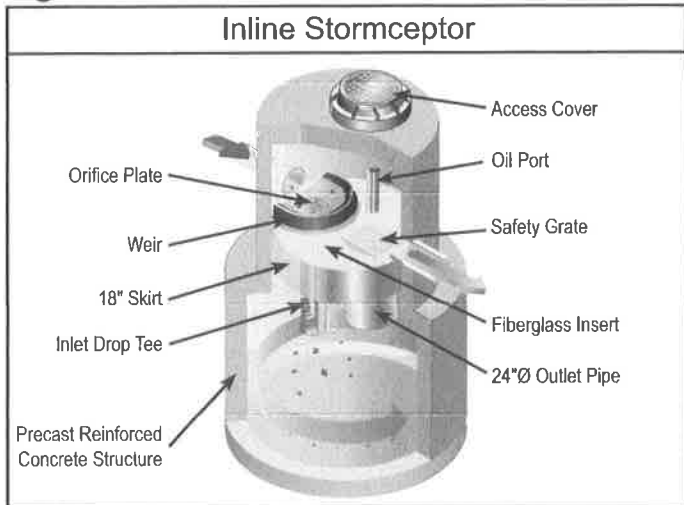


Figure 2.

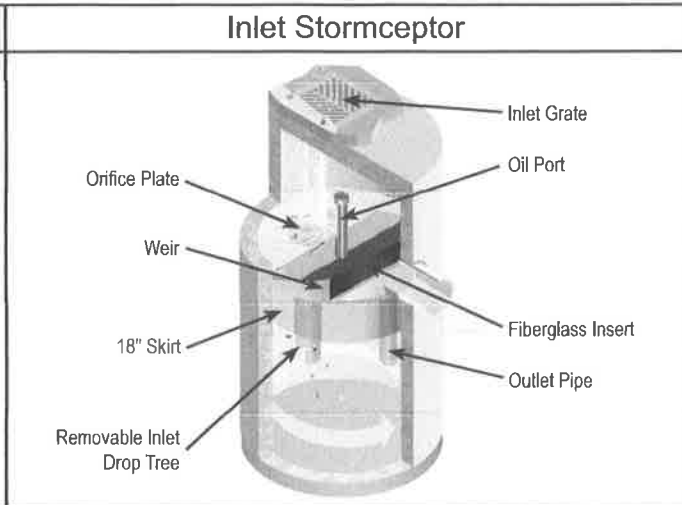

- **Manhole access cover** – provides access to the subsurface components
- **Precast reinforced concrete structure** – provides the vessel's watertight structural support
- **Fiberglass insert** – separates vessel into upper and lower chambers
- **Weir** – directs incoming stormwater and oil spills into the lower chamber
- **Orifice plate** – prevents scour of accumulated pollutants
- **Inlet drop tee** – conveys stormwater into the lower chamber
- **Fiberglass skirt** – provides double-wall containment of hydrocarbons
- **Outlet riser pipe** – conveys treated water to the upper chamber; primary vacuum line access port for sediment removal
- **Oil inspection port** – primary access for measuring oil depth and oil removal
- **Safety grate** – safety measure to cover riser pipe in the event of manned entry into vessel

3 – Stormceptor Identification

Stormceptor is available in both precast concrete and fiberglass vessels, with precast concrete often being the dominant material of construction.

In the Stormceptor, a patented, engineered fiberglass insert separates the structure into an upper chamber and lower chamber. The lower chamber will remain full of water, as this is where the pollutants are sequestered for later removal. Multiple Stormceptor model (STC, OSR, EOS, MAX and STF) configurations exist, each to be inspected and maintained in a similar fashion.

Each unit is easily identifiable as a Stormceptor by the trade name "Stormceptor" embossed on each access cover at the surface. To determine the location of "inlet" Stormceptor units with horizontal catch basin inlet, look down into the grate as the Stormceptor insert will be visible. The name "Stormceptor" is not embossed on inlet models due to the variability of inlet grates used/ approved across North America.

Once the location of the Stormceptor is determined, the model number may be identified by comparing the measured depth from the fiberglass insert level at the outlet pipe's invert (water level) to the bottom of the tank using **Table 1**.

In addition, starting in 1996 a metal serial number tag containing the model number has been affixed to the inside of the unit, on the fiberglass insert. If the unit does not have a serial number, or if there is any uncertainty regarding the size of the unit using depth measurements, please contact your local Stormceptor Representative for assistance.

Sizes/Models

Typical general dimensions and capacities of the standard precast STC, EOS & OSR Stormceptor models in both USA and Canada/International (excluding South East Asia and Australia) are provided in **Tables 1 and 2**. Typical rim to invert measurements are provided later in this document. The total depth for cleaning will be the sum of the depth from outlet pipe invert (generally the water level) to rim (grade) and the depth from outlet pipe invert to the precast bottom of the unit. Note that depths and capacities may vary slightly between regions.

Table 1A. (US) Stormceptor Dimensions – Insert to Base of Structure

STC Model	Insert to Base (in.)	EOS Model	Insert to Base (in.)	OSR Model	Insert to Base (in.)	Typical STF m (in.)
450	60	4-175	60	65	60	1.5 (60)
900	55	9-365	55	140	55	1.5 (61)
1200	71	12-590	71			1.8 (73)
1800	105	18-1000	105			2.9 (115)
2400	94	24-1400	94	250	94	2.3 (89)
3600	134	36-1700	134			3.2 (127)
4800	128	48-2000	128	390	128	2.9 (113)
6000	150	60-2500	150			3.5 (138)
7200	134	72-3400	134	560	134	3.3 (128)
11000*	128	110-5000*	128	780*	128	
13000*	150	130-6000*	150			
16000*	134	160-7800*	134	1125*	134	

Notes:

1. *Depth Below Pipe Inlet Invert to the Bottom of Base Slab can vary slightly by manufacturing facility, and can be modified to accommodate specific site designs, pollutant loads or site conditions. Contact your local representative for assistance.*

**Consist of two chamber structures in series.*

Table 1B. (CA & Int'l) Stormceptor Dimensions – Insert to Base of Structure

STC Model	Insert to Base (m)	EOS Model	Insert to Base (m)	OSR Model	Insert to Base (m)	Typical STF m (in.)
300	1.5	300	1.5	300	1.7	1.5 (60)
750	1.5	750	1.5	750	1.6	1.5 (61)
1000	1.8	1000	1.8			1.8 (73)
1500	2.8					2.9 (115)
2000	2.8	2000	2.8	2000	2.6	2.3 (89)
3000	3.7	3000	3.7			3.2 (127)
4000	3.4	4000	3.4	4000	3.6	2.9 (113)
5000	4.0	5000	4.0			3.5 (138)
6000	3.7	6000	3.7	6000	3.7	3.3 (128)
9000*	3.4	9000*	3.4	9000*	3.6	
11000*	4.0	10000*	4.0			
14000*	3.7	14000*	3.7	14000*	3.7	

Notes:

1. Depth Below Pipe Inlet Invert to the Bottom of Base Slab can vary slightly by manufacturing facility, and can be modified to accommodate specific site designs, pollutant loads or site conditions. Contact your local representative for assistance.

*Consist of two chamber structures in series.

Table 2A. (US) Storage Capacities

STC Model	Hydrocarbon Storage Capacity gal	Sediment Capacity ft ³	EOS Model	Hydrocarbon Storage Capacity gal	OSR Model	Hydrocarbon Storage Capacity gal	Sediment Capacity ft ³
450	86	46	4-175	175	065	115	46
900	251	89	9-365	365	140	233	58
1200	251	127	12-590	591			
1800	251	207	18-1000	1198			
2400	840	205	24-1400	1457	250	792	156
3600	840	373	36-1700	1773			
4800	909	543	48-2000	2005	390	1233	465
6000	909	687	60-2500	2514			
7200	1059	839	72-3400	3418	560	1384	690
11000*	2797	1089	110-5000*	5023	780*	2430	930
13000*	2797	1374	130-6000*	6041			
16000*	3055	1677	160-7800*	7850	1125*	2689	1378

Notes:

1. Hydrocarbon & Sediment capacities can be modified to accommodate specific site design requirements, contact your local representative for assistance.

*Consist of two chamber structures in series.

Table 2B. (CA & Int'l) Storage Capacities

STC Model	Hydrocarbon Storage Capacity L	Sediment Capacity L	EOS Model	Hydrocarbon Storage Capacity L	OSR Model	Hydrocarbon Storage Capacity L	Sediment Capacity L
300	300	1450	300	662	300	300	1500
750	915	3000	750	1380	750	900	3000
1000	915	3800	1000	2235			
1500	915	6205					
2000	2890	7700	2000	5515	2000	2790	7700
3000	2890	11965	3000	6710			
4000	3360	16490	4000	7585	4000	4700	22200
5000	3360	20940	5000	9515			
6000	3930	26945	6000	12940	6000	5200	26900
9000*	10555	32980	9000*	19010	9000*	9300	33000
11000*	10555	37415	10000*	22865			
14000*	11700	53890	14000*	29715	14000*	10500	53900

Notes:

1. Hydrocarbon & Sediment capacities can be modified to accommodate specific site design requirements, contact your local representative for assistance.

*Consist of two chamber structures in series.

4 – Stormceptor Inspection & Maintenance

Regular inspection and maintenance is a proven, cost-effective way to maximize water resource protection for all stormwater pollution control practices, and is required to insure proper functioning of the Stormceptor. Both inspection and maintenance of the Stormceptor is easily performed from the surface. Stormceptor’s patented technology has no moving parts, simplifying the inspection and maintenance process.

Please refer to the following information and guidelines before conducting inspection and maintenance activities.

When is inspection needed?

- Post-construction inspection is required prior to putting the Stormceptor into service.
- Routine inspections are recommended during the first year of operation to accurately assess the sediment accumulation.
- Inspection frequency in subsequent years is based on the maintenance plan developed in the first year.
- Inspections should also be performed immediately after oil, fuel, or other chemical spills.

When is maintenance cleaning needed?

- For optimum performance, the unit should be cleaned out once the sediment depth reaches the recommended maintenance sediment depth, which is approximately 15% of the unit’s total storage capacity (see **Table 2**). The frequency should be adjusted based on historical inspection results due to variable site pollutant loading.

- Sediment removal is easier when removed on a regular basis at or prior to the recommended maintenance sediment depths, as sediment build-up can compact making removal more difficult.
- The unit should be cleaned out immediately after an oil, fuel or chemical spill.

What conditions can compromise Stormceptor performance?

- If construction sediment and debris is not removed prior to activating the Stormceptor unit, maintenance frequency may be reduced.
- If the system is not maintained regularly and fills with sediment and debris beyond the capacity as indicated in **Table 2**, pollutant removal efficiency may be reduced.
- If an oil spill(s) exceeds the oil capacity of the system, subsequent spills may not be captured.
- If debris clogs the inlet of the system, removal efficiency of sediment and hydrocarbons may be reduced.
- If a downstream blockage occurs, a backwater condition may occur for the Stormceptor and removal efficiency of sediment and hydrocarbons may be reduced.

What training is required?

The Stormceptor is to be inspected and maintained by professional vacuum cleaning service providers with experience in the maintenance of underground tanks, sewers and catch basins. For typical inspection and maintenance activities, no specific supplemental training is required for the Stormceptor. Information provided within this Manual (provided to the site owner) contains sufficient guidance to maintain the system properly.

In unusual circumstances, such as if a damaged component needs replacement or some other condition requires manned entry into the vessel, confined space entry procedures must be followed. Only professional maintenance service providers trained in these procedures should enter the vessel. Service provider companies typically have personnel who are trained and certified in confined space entry procedures according to local, state, and federal standards.

What equipment is typically required for inspection?

- Manhole access cover lifting tool
- Oil dipstick / Sediment probe with ball valve (typically 3/4-inch to 1-inch diameter)
- Flashlight
- Camera
- Data log / Inspection Report
- Safety cones and caution tape
- Hard hat, safety shoes, safety glasses, and chemical-resistant gloves


Recommended Stormceptor Inspection Procedure:

- Stormceptor is to be inspected from grade through a standard surface manhole access cover.
- Sediment and oil depth inspections are performed with a sediment probe and oil dipstick.
- Oil depth is measured through the oil inspection port, either a 4-inch (100 mm) or 6-inch (150 mm) diameter port.
- Sediment depth can be measured through the oil inspection port or the 24-inch (610 mm) diameter outlet riser pipe.
- Inspections also involve a visual inspection of the internal components of the system.

Figure 3.



Figure 4.

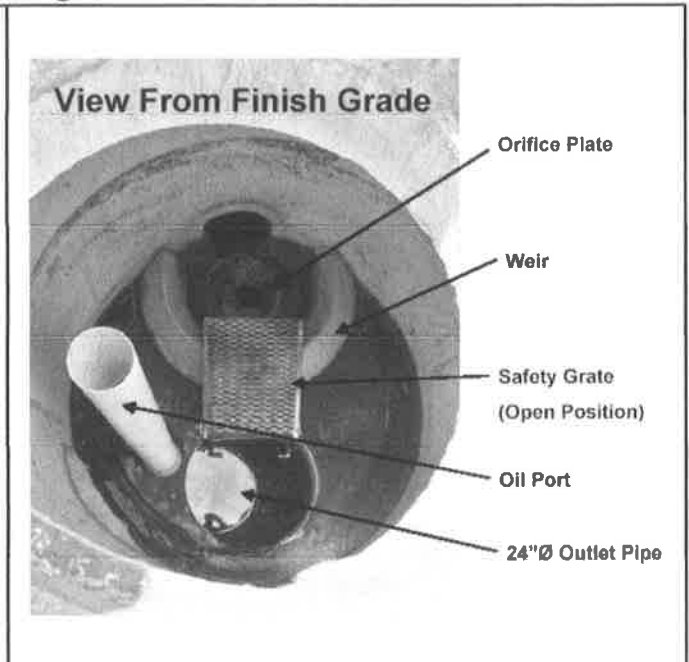

What equipment is typically required for maintenance?

- Vacuum truck equipped with water hose and jet nozzle
- Small pump and tubing for oil removal
- Manhole access cover lifting tool
- Oil dipstick / Sediment probe with ball valve (typically ¾-inch to 1-inch diameter)
- Flashlight
- Camera
- Data log / Inspection Report
- Safety cones
- Hard hats, safety shoes, safety glasses, chemical-resistant gloves, and hearing protection for service providers
- Gas analyzer, respiratory gear, and safety harness for specially trained personnel if confined space entry is required

Recommended Stormceptor Maintenance Procedure

Maintenance of Stormceptor is performed using a vacuum truck.

No entry into the unit is required for maintenance. **DO NOT ENTER THE STORMCEPTOR CHAMBER** unless you have the proper personal safety equipment, have been trained and are qualified to enter a confined space, as identified by local Occupational Safety and Health Regulations (e.g. 29 CFR 1910.146 or Canada Occupational Safety and Health Regulations – SOR/86-304). Without the proper equipment, training and permit, entry into confined spaces can result in serious bodily harm and potentially death. Consult local, provincial, and/or state regulations to determine the requirements for confined space entry. Be aware, and take precaution that the Stormceptor fiberglass insert may be slippery. In addition, be aware that some units do not have a safety grate to cover the outlet riser pipe that leads to the submerged, lower chamber.

- Ideally maintenance should be conducted during dry weather conditions when no flow is entering the unit.
- Stormceptor is to be maintained through a standard surface manhole access cover.
- Insert the oil dipstick into the oil inspection port. If oil is present, pump off the oil layer into separate containment using a small pump and tubing.
- Maintenance cleaning of accumulated sediment is performed with a vacuum truck.
 - For 6-ft (1800 mm) diameter models and larger, the vacuum hose is inserted into the lower chamber via the 24-inch (610 mm) outlet riser pipe.
 - For 4-ft (1200 mm) diameter model, the removable drop tee is lifted out, and the vacuum hose is inserted into the lower chamber via the 12-inch (305 mm) drop tee hole.

Figure 5.


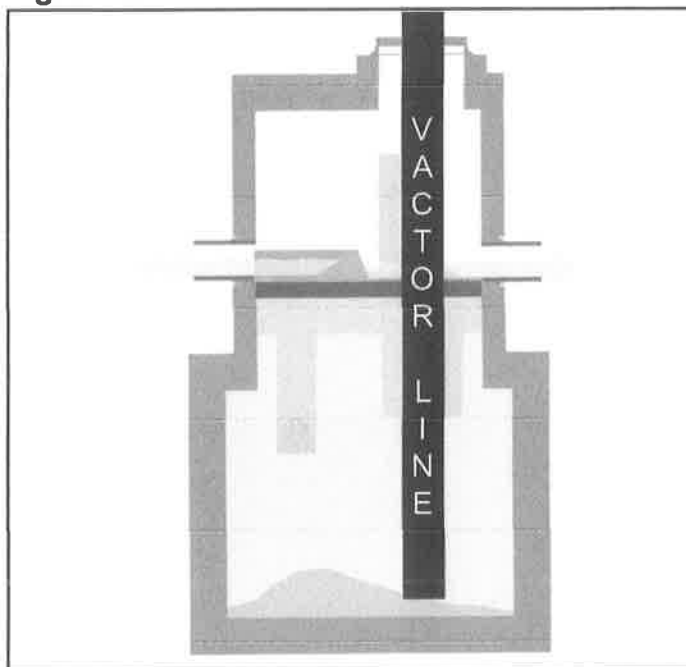


Figure 6.

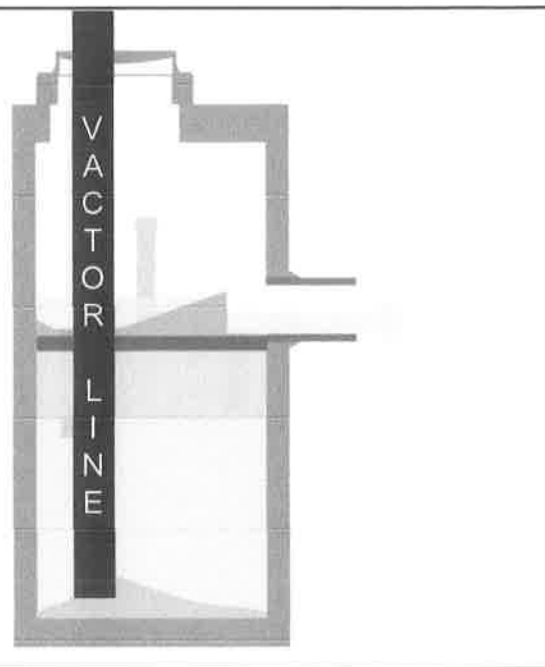


- Using the vacuum hose, decant the water from the lower chamber into a separate containment tank or to the sanitary sewer, if permitted by the local regulating authority.
- Remove the sediment sludge from the bottom of the unit using the vacuum hose. For large Stormceptor units, a flexible hose is often connected to the primary vacuum line for ease of movement in the lower chamber.
- Units that have not been maintained regularly, have surpassed the maximum recommended sediment capacity, or contain damaged components may require manned entry by trained personnel using safe and proper confined space entry procedures.

Figure 7.



Figure 8.

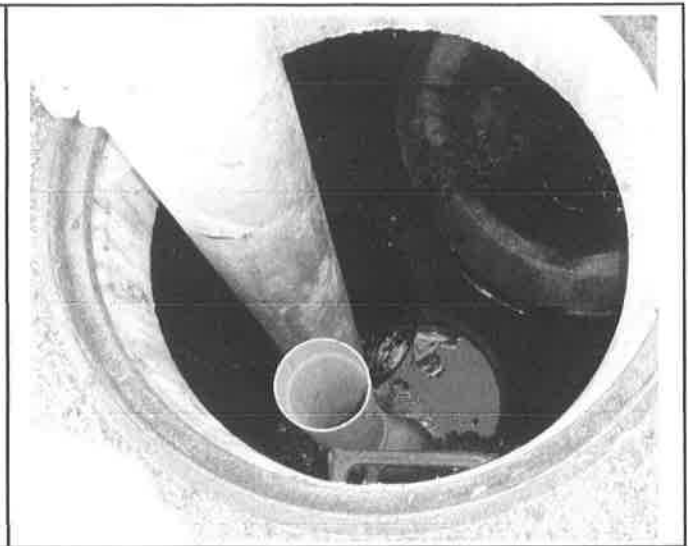

A maintenance worker stationed at the above ground surface uses a vacuum hose to evacuate water, sediment, and debris from the system.

What is required for proper disposal?

The requirements for the disposal of material removed from Stormceptor units are similar to that of any other stormwater treatment Best Management Practices (BMP). Local guidelines should be consulted prior to disposal of the separator contents. In most areas the sediment, once dewatered, can be disposed of in a sanitary landfill. It is not anticipated that the sediment would be classified as hazardous waste. This could be site and pollutant dependent. In some cases, approval from the disposal facility operator/agency may be required.

What about oil spills?

Stormceptor is often implemented in areas where there is high potential for oil, fuel or other hydrocarbon or chemical spills. Stormceptor units should be cleaned immediately after a spill occurs by a licensed liquid waste hauler. You should also notify the appropriate regulatory agencies as required in the event of a spill.

What if I see an oil rainbow or sheen at the Stormceptor outlet?

With a steady influx of water with high concentrations of oil, a sheen may be noticeable at the Stormceptor outlet. This may occur because a hydrocarbon rainbow or sheen can be seen at

very small oil concentrations (< 10 ppm). Stormceptor is effective at removing 95% of free oil, and the appearance of a sheen at the outlet with high influent oil concentrations does not mean that the unit is not working to this level of removal. In addition, if the influent oil is emulsified, the Stormceptor will not be able to remove it. The Stormceptor is designed for free oil removal and not emulsified or dissolved oil conditions.

What factors affect the costs involved with inspection/maintenance?

The Vacuum Service Industry for stormwater drainage and sewer systems is a well-established sector of the service industry that cleans underground tanks, sewers and catch basins. Costs to clean Stormceptor units will vary. Inspection and maintenance costs are most often based on unit size, the number of units on a site, sediment/oil/hazardous material loads, transportation distances, tipping fees, disposal requirements and other local regulations.

What factors predict maintenance frequency?

Maintenance frequency will vary with the amount of pollution on your site (number of hydrocarbon spills, amount of sediment, site activity and use, etc.). It is recommended that the frequency of maintenance be increased or reduced based on local conditions. If the sediment load is high from an unstable site or sediment loads transported from upstream catchments, maintenance may be required semi-annually. Conversely once a site has stabilized, maintenance may be required less frequently (for example: two to seven year, site and situation dependent). Maintenance should be performed immediately after an oil spill or once the sediment depth in Stormceptor reaches the value specified in **Table 3** based on the unit size.

Table 3A. (US) Recommended Sediment Depths Indicating Maintenance

STC Model	Maintenance Sediment depth (in)	EOS Model	Maintenance Sediment depth (in)	Oil Storage Depth (in)	OSR Model	Maintenance Sediment depth (in)
450	8	4-175	9	24	065	8
900	8	9-365	9	24	140	8
1200	10	12-590	11	39		
1800	15					
2400	12	24-1400	14	68	250	12
3600	17	36-1700	19	79		
4800	15	48-2000	16	68	390	17
6000	18	60-2500	20	79		
7200	15	72-3400	17	79	560	17
11000*	17	110-5000*	16	68	780*	17
13000*	20	130-6000*	20	79		
16000*	17	160-7800*	17	79	1125*	17

Note:

1. The values above are for typical standard units.

*Per structure.

Table 3B. (CA & Int'l) Recommended Sediment Depths Indicating Maintenance

STC Model	Maintenance Sediment depth (mm)	EOS Model	Maintenance Sediment depth (mm)	Oil Storage Depth (mm)	OSR Model	Maintenance Sediment depth (mm)
300	225	300	225	610	300	200
750	230	750	230	610	750	200
1000	275	1000	275	990		
1500	400					
2000	350	2000	350	1727	2000	300
3000	475	3000	475	2006		
4000	400	4000	400	1727	4000	375
5000	500	5000	500	2006		
6000	425	6000	425	2006	6000	375
9000*	400	9000*	400	1727	9000*	425
11000*	500	10000*	500	2006		
14000*	425	14000*	425	2006	14000*	425

Note:

1. The values above are for typical standard units.

**Per structure.*

Replacement parts

Since there are no moving parts during operation in a Stormceptor, broken, damaged, or worn parts are not typically encountered. Therefore, inspection and maintenance activities are generally focused on pollutant removal. However, if replacements parts are necessary, they may be purchased by contacting your local Stormceptor Representative, or Imbrium Systems.

The benefits of regular inspection and maintenance are many – from ensuring maximum operation efficiency, to keeping maintenance costs low, to the continued protection of natural waterways – and provide the key to Stormceptor’s long and effective service life.

Stormceptor Inspection and Maintenance Log

Stormceptor Model No: _____

Allowable Sediment Depth: _____

Serial Number: _____

Installation Date: _____

Location Description of Unit: _____

Other Comments: _____

Contact Information

Questions regarding the Stormceptor can be addressed by contacting your area Stormceptor Licensee, Imbrium Systems, or visit our website at www.stormceptor.com.

Stormceptor Licensees:

CANADA

Lafarge Canada Inc.
www.lafargepipe.com
403-292-9502 / 1-888-422-4022
780-468-5910
204-958-6348

Calgary, AB
Edmonton, AB
Winnipeg, MB, NW. ON, SK

Langley Concrete Group
www.langleyconcretigroup.com
604-502-5236

BC

Hanson Pipe & Precast Inc.
www.hansonpipeandprecast.com
519-622-7574 / 1-888-888-3222

ON

Lécuyer et Fils Ltée.
www.lecuyerbeton.com
450-454-3928 / 1-800-561-0970

QC

Strescon Limited
www.strescon.com
902-494-7400
506-633-8877

NS, NF
NB, PE

UNITED STATES

Rinker Materials
www.rinkerstormceptor.com
1-800-909-7763

AUSTRALIA & SOUTHEAST ASIA, including New Zealand & Japan

Humes Water Solutions
www.humes.com.au
+61 7 3364 2894

Imbrium Systems Inc. & Imbrium Systems LLC

Canada 1-416-960-9900 / 1-800-565-4801
United States 1-301-279-8827 / 1-888-279-8826
International +1-416-960-9900 / +1-301-279-8827
Email info@imbriumsystems.com

www.imbriumsystems.com
www.stormceptor.com

LONG TERM POLLUTION PREVENTION PLAN

The use of the property and the responsibility of the owners to implement and carry out a Long Term Pollution Prevention Plan will be subject to this document and shall include the following provisions:

- 1) Good housekeeping practices shall be implemented at all times. There shall be no debris of any kind including landscaping debris deposited within the site. Any debris found to be dumped or deposited within the site shall be immediately picked up and removed.
- 2) Storage of materials shall be done in a manner that will prevent the migration of loose soil, silt or clay or other unwanted material, in order to prevent such material from entering the storm water management system. There shall be no outdoor storage of waste products at that site at any time except as allowed by the permitting authorities for such storage.
- 3) Outdoor storage of materials shall be done in designated areas and storage bins as needed to prevent any unwanted materials from entering the storm water management system.
- 4) Routine inspections and maintenance of Storm water best management practices shall be carried out in compliance with the Operation and Maintenance plan.
- 5) Permitted lawns, gardens and other landscaped areas within the site shall be maintained by the Association.
- 6) There shall be no outdoor storage of fertilizers, herbicides, and/or pesticides at the site. Indoor storage of fertilizers, herbicides and/or pesticides shall be done in a safe and dry location. Any spill of these materials shall be cleaned up immediately. The use of fertilizers, herbicides, and pesticides at the site shall be limited to amounts allowed by regulations issued by the Walpole Zoning Board and / or other governing bodies. Pet waste deposited at the site shall be immediately picked up and removed. Pet waste to be disposed of through solid waste containers.
- 7) There shall be no on-site septic systems installed at the site unless allowed by other governing bodies.
- 8) Solid waste (trash) shall be stored in closed containers and removed by a licensed hauler at least once per week. Any solid waste not in closed containers found at that site shall be removed immediately by the Association.
- 9) Snow shall be plowed in wind rows at the edge of the paved areas and deposited in the snow storage areas. Excess snow shall be removed from the site and deposited in approved snow farms.
- 10) Road salt and sand shall be used in accordance with rules, regulations and laws in force at that time. There shall be no outdoor storage of sand or salt at the site except as may be allowed by other governing bodies.
- 11) There shall be no repairing of vehicles, construction equipment or otherwise at the site.
- 12) There shall be no illicit discharges to the storm water system.
- 13) The Owners shall become familiar with the rules and regulations and restrictions of this document.

14) In case of an emergency, the owner shall notify the following organizations

- 1) Walpole Fire Dept.
- 2) Walpole Zoning Board
- 3) Walpole Planning Board
- 4) Walpole Board of Health
- 5) Walpole Conservation Commission
- 6) Walpole Building Department
- 7) Walpole Dept. Of Public Works
- 8) Massachusetts DEP

APPENDIX I

DARWIN COMMONS, WALPOLE, MA - DRAINAGE WORKS COMPONENTS- ANNUAL INSPECTION FORM

Date: _____
Inspector Name: _____
Inspector Address: _____
Inspector Phone Number: _____
Inspector Registration Number: _____

STORMWATER MAINTENANCE

COMPONENT	DATE OF LAST INSPECTION	DATE OF LAST CLEANING	CONDITION OF STRUCTURE	SEDIMENT PRESENT	POTENTIAL FOR CLOGGING	RECOMMENDATIONS / NOTES
CB-1						
CB-2						
CB-3						
CB-4						
CB-5						
CB-6						
CB-7						
CB-8						

INDICATE: yes, no, n/a

Are outside areas kept clean and orderly? _____

Are garbage can, waste bins, or dumpsters covered? _____

Are stormwater drain paths clear? _____

Are there any hazardous wastes stored on-site? _____

Other comments: _____

Signature: _____

Inspection of all Stormwater management system components shall be conducted annually and a report provided to the Planning Board, no later than Dec. 31

DARWIN COMMONS, WALPOLE, MA - DRAINAGE WORKS COMPONENTS- ANNUAL INSPECTION FORM

Date:

Inspector Name:

Inspector Address:

Inspector Phone Number:

Inspector Registration Number:

STORMWATER MAINTENANCE

COMPONENT	DATE OF LAST INSPECTION	DATE OF LAST CLEANING	CONDITION OF STRUCTURE	SEDIMENT PRESENT	POTENTIAL FOR CLOGGING	RECOMMENDATIONS / NOTES
STORMCEPTOR- 1						
STORMCEPTOR-2						
INFIL. BASIN						
INFIL. TRENCH						
DMH 1						
DMH 2						
DMH 3						
DMH 4						
DMH 5						
DMH 6						
DMH 7						
DMH 8						

INDICATE: yes, no, n/a

COMMENTS

Are outside areas kept clean and orderly?

Are garbage can, waste bins, or dumpsters covered?

Are stormwater drain paths clear?

Are there any hazardous wastes stored on-site?

Other comments:

Signature:

Inspection of all Stormwater management system components shall be conducted annually and a report provided to the Conservation Commission, no later than Dec. 31

DARWIN COMMONS , WALPOLE, MA - DRAINAGE WORKKS COMPONENTS-ANNUAL INSPECTION FORM

Date:

Inspector Name:

Inspector Address:

Inspector Phone Number:

Inspector Registration Number:

COMPONENT	DATE OF LAST INSPECTION	DATE OF LAST CLEANING	CONDITION OF STRUCTURE	SEDIMENT PRESENT	POTENTIAL FOR CLOGGING	RECOMMENDATIONS / NOTES
DMH 9						
DMH 10						
DMH 11						
HW 1						
HW 2						
RETAIN WALL 1						
RETAIN WALL 2						
RETAIN WALL 3						
			INDICATE: yes, no, n/a			
Are outside areas kept clean and orderly?						
Are garbage can, waste bins, or dumpsters covered?						
Are stormwater drain paths clear?						
Are there any hazardous wastes stored on-site?						
Other comments:						
Signature:						

Inspection of all Stormwater management system components shall be conducted annually and a report provided to the Conservation Commission, no later than Dec. 31

**STANDARD 3
STORM WATER RECHARGE**

HYDROLOGIC GROUP A SOIL

AREA 1 (TOTAL IMPERVIOUS AREA TO INFILTRATION BASIN)

ACCESS DRIVEWAY, PARKING AREA, WALKWAYS, AND ROOFTOP DISCHARGING TO THE INFILTRATION BASIN

TOTAL IMPERVIOUS AREA OF AREA 1 = 35,405 S.F. PAVEMENT + 27,600 S.F. ROOFTOP = 63,005 S.F.

REQUIRED RECHARGE VOLUME

$63,005 \text{ S.F.} \times .60/12 = 3,150.25 \text{ C.F. REQUIRED}$

PER DRAIN CALCS, THE VOLUME OF STORED STORMWATER BELOW THE OUTLET IS .464 AC FT = 20,211.84 C.F.

$20,211.84 > 3,150.25 \text{ OK}$

AREA 2 (TOTAL IMPERVIOUS AREA TO INFILTRATION TRENCH AT REAR)

REAR PORTION OF BUILDING ROOFTOPS UNITS 13 – 22 ONLY

TOTAL IMPERVIOUS AREA OF AREA 2 = 6,000 S.F.

REQUIRED RECGARGE VOLUME = $6,000 \text{ S.F.} \times .6/12 = 300.0 \text{ C.F. REQUIRED}$

PER DRAIN CALCS, THE VOLUME OF INFILTRATION TRENCH AT REAR BELOW THE OUTLET = 1,290 C.F.

$1,290 \text{ C.F.} > 300.0 \text{ C.F. OK}$

DRAWDOWN

AREA 1

The volume in leaching basin = 20,211.84 c.f.

The bottom area of the leaching trench is 6,272 s.f.

Using an infiltration rate of 8.27 in/hr = 0.6891 ft/hr = 0.6891 cf/hr

$0.6891 \text{ cf/hr} \times 6,272 \text{ s.f.} = 4,322.45 \text{ cf/hr/leaching trench bottom}$

$20,211.84 \text{ c.f.} / 4,322.45 \text{ cf/hr} = 4.68 \text{ hrs}$ **OK**

AREA 2

The volume in the leaching trench is 1,290.00 c.f.

The bottom of the leaching trench is 880.0 s.f.

Using an infiltration rate of 8.27 in/hr = 0.6891 ft/hr = 0.6891 cf/hr

$0.6891 \text{ cf/hr} \times 880.0 \text{ s.f.} = 606.40 \text{ cf/hr/leaching trench bottom}$

$1,290.00 \text{ c.f.} / 606.40 \text{ cf/hr} = 2.13 \text{ hrs}$ **OK**

**STANDARD 3
STORM WATER RECHARGE**

HYDROLOGIC GROUP A SOIL

AREA 1 (TOTAL IMPERVIOUS AREA TO INFILTRATION BASIN)

ACCESS DRIVEWAY, PARKING AREA, WALKWAYS, AND ROOFTOP DISCHARGING TO THE INFILTRATION BASIN

TOTAL IMPERVIOUS AREA OF AREA 1 = 35,405 S.F. PAVEMENT + 27,600 S.F. ROOFTOP = 63,005 S.F.

REQUIRED RECHARGE VOLUME

$63,005 \text{ S.F.} \times .60/12 = 3,150.25 \text{ C.F. REQUIRED}$

PER DRAIN CALCS, THE VOLUME OF STORED STORMWATER BELOW THE OUTLET IS .464 AC FT = 20,211.84 C.F.

$20,211.84 > 3,150.25 \text{ OK}$

AREA 2 (TOTAL IMPERVIOUS AREA TO INFILTRATION TRENCH AT REAR)

REAR PORTION OF BUILDING ROOFTOPS UNITS 13 – 22 ONLY

TOTAL IMPERVIOUS AREA OF AREA 2 = 6,000 S.F.

REQUIRED RECHARGE VOLUME = $6,000 \text{ S.F.} \times .6/12 = 300.0 \text{ C.F. REQUIRED}$

PER DRAIN CALCS, THE VOLUME OF INFILTRATION TRENCH AT REAR BELOW THE OUTLET = 2,371 C.F.

$2,371 \text{ C.F.} > 300.0 \text{ C.F. OK}$

DRAWDOWN

AREA 1

The volume in leaching basin = 20,211.84 c.f.

The bottom area of the leaching trench is 6,272 s.f.

Using an infiltration rate of 8.27 in/hr = 0.6891 ft/hr = 0.6891 cf/hr

$0.6891 \text{ cf/hr} \times 6,272 \text{ s.f.} = 4,322.45 \text{ cf/hr/leaching trench bottom}$

$20,211.84 \text{ c.f.} / 4,322.45 \text{ cf/hr} = 4.68 \text{ hrs}$ **OK**

AREA 2

The volume in the leaching trench is 2,371.00 c.f.

The bottom of the leaching trench is 952.0 s.f.

Using an infiltration rate of 8.27 in/hr = 0.6891 ft/hr = 0.6891 cf/hr

$0.6891 \text{ cf/hr} \times 952.0 \text{ s.f.} = 656.02 \text{ cf/hr/leaching trench bottom}$

$2,371.00 \text{ c.f.} / 656.02 \text{ cf/hr} = 3.61 \text{ hrs}$ **OK**

INSTRUCTIONS:

1. In BMP Column, click on Blue Cell to Activate Drop Down Menu
2. Select BMP from Drop Down Menu
3. After BMP is selected, TSS Removal and other Columns are automatically completed.

Location: Darwin Commons, Walpole, MA

B BMP ¹	C TSS Removal Rate ¹	D Starting TSS Load*	E Amount Removed (C*D)	F Remaining Load (D-E)
Street Sweeping - 0%	0.00	1.00	0.00	1.00
Deep Sump and Hooded Catch Basin	0.25	1.00	0.25	0.75
Oil Grit Separator	0.25	0.75	0.19	0.56
Infiltration Basin	0.80	0.56	0.45	0.11
	0.00	0.11	0.00	0.11

Separate Form Needs to be Completed for Each Outlet or BMP Train

Total TSS Removal =

89%

Project: DARWIN COMMONS, WALPOLE, MA
Prepared By: John F. Glossa P.E.
Date: 8/28/2023

*Equals remaining load from previous BMP (E) which enters the BMP

DRAINAGE COMPUTATIONS

COMP. BY: _____ CHKD. BY: _____ PROJECT: DARWIN COMMON JOB NO. _____ DESIGN PERIOD: 10 YEAR
 DATE: _____ DATE: _____

LOCATION FROM TO	ROADWAY			OTHER			SUM CA	Tc (Min)	SUM Tc (Min)	I in/hr	Q xCA (cfs)	D (in)	S (ft/ft)	n	Q full (cfs)	V full (fps)	Length of Run (ft)	Total Fall (ft)
	A (Ac)	C	CA	A (Ac)	C	CA												
CB-1 CB-1	0.05	0.9	0.045	0.03	0.45	0.014	0.059	5	5	5.4	0.32	12	0.030	0.009	8.91	11.35	10	0.30
DMH-1																		
CB-2 CB-2	0.03	0.9	0.027	0.02	0.45	0.009	0.036	5	5	5.4	0.19	12	0.019	0.009	7.09	9.03	18	0.34
DMH-1																		
DMH-2							0.095	5	5	5.4	0.51	12	0.100	0.009	16.27	20.72	80	8.00
CB-3 CB-3	0.16	0.9	0.144	0.06	0.45	0.027	0.171	5	5	5.4	0.92	12	0.020	0.009	7.28	9.27	18	0.36
DMH-2							0.171	5	5	5.4	0.92	12	0.020	0.009	7.28	9.27	18	0.36
CB-4 CB-4	0.23	0.9	0.207	0.16	0.45	0.072	0.279	5	5	5.4	1.51	12	0.050	0.009	11.51	14.65	49	2.45
DMH-2							0.279	5	5	5.4	1.51	12	0.050	0.009	11.51	14.65	49	2.45
DMH-2							0.545	5	5	5.4	2.94	12	0.028	0.009	8.61	10.96	7	0.20
CB-5 CB-5	0.17	0.9	0.153	0.10	0.45	0.045	0.198	5	5	5.4	1.07	12	0.010	0.009	5.15	6.55	40	0.40
DMH-3							0.198	5	5	5.4	1.07	12	0.010	0.009	5.15	6.55	40	0.40
CB-6 CB-6	0.19	0.9	0.171	0.04	0.45	0.018	0.189	5	5	5.4	1.02	12	0.010	0.009	5.15	6.55	40	0.40
DMH-3							0.189	5	5	5.4	1.02	12	0.010	0.009	5.15	6.55	40	0.40
DMH-3							0.387	5	5	5.4	2.09	12	0.023	0.009	7.80	9.94	7	0.16



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

A. Facility Information

John Hasenjaeger

Owner Name

P.O. Box 661

Street Address

Norwood

City

MA

State

42/ 240 and 227-13

Map/Lot #

02062

Zip Code

B. Site Information

1. (Check one) New Construction Upgrade

2. Soil Survey MA GIS Source

MmC

Soil Map Unit

Terrace or Esker

Landform

Poor filter

Soil Limitations

Merrimac

Soil Series

3. Surficial Geological Report

1987

Year Published/Source

Qsg

Map Unit

Glacial outwash

Description of Geologic Map Unit:

4. Flood Rate Insurance Map

Within a regulatory floodway? Yes No

5. Within a velocity zone? Yes No

6. Within a Mapped Wetland Area? Yes No

7. Current Water Resource Conditions (USGS):

6/08/23

Month/Day/ Year

If yes, MassGIS Wetland Data Layer:

Wetland Type

Normal Above Normal Below Normal

Range: Above Normal Normal Below Normal

8. Other references reviewed:

(Zone II, IWPA, Zone A, EEA Data Portal, etc.)



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: #1 Hole # 6/8/23 Date 7:30 AM Time Cldy 55 deg Weather 42.12625 Latitude 71.24272 Longitude

1. Land Use Woodland Vegetation Hardwoods, pines Few Surface Stones (e.g., cobbles, stones, boulders, etc.) 10-12 Slope (%)

Description of Location: Vacant land at the end of Darwin Lane, a deadend street

2. Soil Parent Material: Merrimac Terrace or esker SH Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body 100+ feet Drainage Way 100+ feet Wetlands 100+ feet
Property Line 100+ feet Drinking Water Well 100+ feet Other _____ feet

4. Unsuitable Materials Present: Yes No If Yes: Disturbed Soil/Fill Material Weathered/Fractured Rock Bedrock

5. Groundwater Observed: Yes No If yes: _____ Depth to Weeping in Hole _____ Depth to Standing Water in Hole _____

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
0-10	A	SL	10YR 3/2	None	Cnc : Dpl:		5%	5%	Massive	loose	
10-29	B	LS	10yr 5/8	None	Cnc : Dpl:		5%	5%	Massive	loose	
29-120	C	S	2.5Y5/4	None	Cnc : Dpl:		40%	5%	Single grain	loose	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

Additional Notes:

C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: #2 Hole # _____ Date 6/8/23 Time 7:45 AM Weather Cldy 55 deg Latitude 42.12640 Longitude 71.24309
 1. Land Use: Woodland (e.g., woodland, agricultural field, vacant lot, etc.) Vegetation Hardwoods, Pines Surface Stones (e.g., cobbles, stones, boulders, etc.) Few Slope (%) 10-12
 Description of Location: Vacant land at the end of Darwin Lane

2. Soil Parent Material: Merrimac Terrace or esker _____ SH _____ Position on Landscape (SU, SH, BS, FS, TS, Plain) _____
 3. Distances from: Open Water Body 100+ feet Drainage Way 100+ feet Wetlands 100+ feet
Property Line 100+ feet Drinking Water Well 100+ feet Other _____ feet
 4. Unsuitable Materials Present: Yes No If Yes: Disturbed Soil/Fill Material Weathered/Fractured Rock Bedrock

5. Groundwater Observed: Yes No If yes: _____ Depth to Weeping in Hole _____ Depth Standing Water in Hole _____

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features		Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel			
0-10	A	SL	10YR 3/2	Cnc : Dpl:			5%	Massive	loose	
10-27	B	Ls	10YR5/8	Cnc : Dpl:			5%	Massive	loose	
27-132	C	S	2.5Y5/4	Cnc : Dpl:			30%	Single grain	loose	
				Cnc : Dpl:						
				Cnc : Dpl:						
				Cnc : Dpl:						
				Cnc : Dpl:						



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: #3 Hole # 6/8/23 Date 8:00 AM Time Cidy 50 deg Weather 42.12657 Latitude 71.24348 Longitude
Slope (%) 10-12

1. Land Use Woodland Hardwoods, pines Few Surface Stones (e.g., cobbles, stones, boulders, etc.)
Description of Location: Vacant land at the end of Darwin Lane, a deadend street

2. Soil Parent Material: Merrimac Terrace or esker SH
Landform Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body 100+ feet Drainage Way 100+ feet Wetlands 100+ feet
Property Line 100+ feet Drinking Water Well 100+ feet Other _____ feet

4. Unsuitable Materials Present: Yes No If Yes: Disturbed Soil/Fill Material Weathered/Fractured Rock Bedrock

5. Groundwater Observed: Yes No If yes: _____ Depth to Weeping in Hole _____ Depth to Standing Water in Hole _____

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features		Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel			
0-8	A	SL	10YR 3/2	None	Cnc : Dpl:		5%	Massive	loose	
8-27	B	LS	10yr 5/8	None	Cnc : Dpl:		5%	Massive	loose	
27-132	C	S	2.5Y5/4	None	Cnc : Dpl:		10%	Single grain	loose	
					Cnc : Dpl:					
					Cnc : Dpl:					
					Cnc : Dpl:					
					Cnc : Dpl:					



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

Additional Notes:

C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: #4 Hole # 6/8/23 Date 8:15 AM Time Cldy 50 deg Weather 42.12652 Latitude 71.24334 Longitude
 1. Land Use: Woodland (e.g., woodland, agricultural field, vacant lot, etc.) Hardwoods, Pines Vegetation Few Surface Stones (e.g., cobbles, stones, boulders, etc.) 10-12 Slope (%)

2. Soil Parent Material: Merrimac Terraced or esker Landform SH Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body 100+ feet Drainage Way 100+ feet Wetlands 100+ feet
 Property Line 100+ feet Drinking Water Well 100+ feet Other _____ feet

4. Unsuitable Materials Present: Yes No If Yes: Disturbed Soil/Fill Material Weathered/Fractured Rock Bedrock

5. Groundwater Observed: Yes No If yes: _____ Depth to Weeping in Hole _____ Depth Standing Water in Hole _____

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features		Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel			
0-10	A	SL	10YR 3/2	None	Cnc : Dpl:	0	5%	Massive	loose	
10-27	B	Ls	10YR5/8	None	Cnc : Dpl:	0	5%	Massive	loose	
27-132	C	S	2.5Y5/4	96"	Cnc : 7.5YR Dpl: 5/8	5	30%	Single grain	loose	
					Cnc : Dpl:					
					Cnc : Dpl:					
					Cnc : Dpl:					



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: #5 Hole # 11/13/23 Date 7:30 AM Time Sun 35 deg Weather 42.12625 Latitude 71.24272 Longitude
Slope (%) 10-12

1. Land Use Woodland Hardwoods, pines Few Surface Stones (e.g., cobbles, stones, boulders, etc.)
Description of Location: Vacant land at the end of Darwin Lane, a deadend street

2. Soil Parent Material: Merrimac Terrace or esker SH
Landform Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body 100+ feet Drainage Way 100+ feet Wetlands 100+ feet
Property Line 100+ feet Drinking Water Well 100+ feet Other _____ feet

4. Unsuitable Materials Present: Yes No If Yes: Disturbed Soil/Fill Material Weathered/Fractured Rock Bedrock

5. Groundwater Observed: Yes No If yes: _____ Depth to Weeping in Hole _____ Depth to Standing Water in Hole _____

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistency (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
0-8	A	SL	10YR 3/2	None	Cnc : Dpl:		5%	5%	Massive	loose	
8-24	B	SL	10yr 5/8	None	Cnc : Dpl:		5%	5%	Massive	loose	
24-185	C	S	2.5Y5/4	None	Cnc : Dpl:		30%	5%	Single grain	loose	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

Additional Notes:

C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: #6 Hole # 11/13/23 Date 8:00 AM Sun 35 deg Weather 42.12640 Latitude 71.24309 Longitude
 1. Land Use: Woodland (e.g., woodland, agricultural field, vacant lot, etc.) Hardwoods, Pines Few Surface Stones (e.g., cobbles, stones, boulders, etc.) 10-12 Slope (%)
 Description of Location: Vacant land at the end of Darwin Lane

2. Soil Parent Material: Merrimac Terrace or esker SH Position on Landscape (SU, SH, BS, FS, TS, Plain)
 Landform
 3. Distances from: Open Water Body 100+ feet Drainage Way 100+ feet Wetlands 100+ feet
 Property Line 100+ feet Drinking Water Well 100+ feet Other _____ feet
 4. Unsuitable Materials Present: Yes No If Yes: Disturbed Soil/Fill Material Weathered/Fractured Rock Bedrock
 5. Groundwater Observed: Yes No If yes: _____ Depth to Weeping in Hole _____ Depth Standing Water in Hole _____

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features		Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel			
0-11	A	SL	10YR 3/2	Cnc : Dpl:			5%	Massive	loose	
11-40	B	SL	10YR5/8	Cnc : Dpl:			5%	Massive	loose	
40-168	C	S	2.5Y5/4	Cnc : Dpl:			5%	Single grain	loose	
				Cnc : Dpl:						
				Cnc : Dpl:						
				Cnc : Dpl:						
				Cnc : Dpl:						



Form 11 - Soil Suitability Assessment for On-Site Sewage Disposal

Additional Notes:

C. On-Site Review (minimum of two holes required at every proposed primary and reserve disposal area)

Deep Observation Hole Number: #Z Hole # 11/13/23 Date 8:30 AM Time Sun 35 deg Weather 42.12640 Latitude 71.24309 Longitude
 1. Land Use: Woodland (e.g., woodland, agricultural field, vacant lot, etc.) Hardwoods, Pines Vegetation Few Surface Stones (e.g., cobbles, stones, boulders, etc.) 10-12 Slope (%)

Description of Location: Vacant land at the end of Darwin Lane

2. Soil Parent Material: Merrimac Terraced or esker Landform SH Position on Landscape (SU, SH, BS, FS, TS, Plain)

3. Distances from: Open Water Body 100+ feet Drainage Way 100+ feet Wetlands 100+ feet
 Property Line 100+ feet Drinking Water Well 100+ feet Other _____ feet

4. Unsuitable Materials Present: Yes No If Yes: Disturbed Soil/Fill Material Weathered/Fractured Rock Bedrock

5. Groundwater Observed: Yes No If yes: _____ Depth to Weeping in Hole _____ Depth Standing Water in Hole _____

Soil Log

Depth (in)	Soil Horizon /Layer	Soil Texture (USDA)	Soil Matrix: Color-Moist (Munsell)	Redoximorphic Features			Coarse Fragments % by Volume		Soil Structure	Soil Consistence (Moist)	Other
				Depth	Color	Percent	Gravel	Cobbles & Stones			
0-12	A	SL	10YR 3/2	None	Cnc : Dpl:		5%	5%	Massive	loose	
12-33	B	SL	10YR 5/8	None	Cnc : Dpl:		5%	5%	Massive	loose	
33-132	C	S	2.5Y 5/4	None	Cnc : Dpl:		5%	5%	Single grain	loose	
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						
					Cnc : Dpl:						



A product of the National Cooperative Soil Survey, a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local participants

Custom Soil Resource Report for Norfolk and Suffolk Counties, Massachusetts



Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

Preface	2
How Soil Surveys Are Made	5
Soil Map	8
Soil Map.....	9
Legend.....	10
Map Unit Legend.....	11
Map Unit Descriptions.....	11
Norfolk and Suffolk Counties, Massachusetts.....	13
253D—Hinckley loamy sand, 15 to 35 percent slopes.....	13
254B—Merrimac fine sandy loam, 3 to 8 percent slopes.....	14
254C—Merrimac fine sandy loam, 8 to 15 percent slopes.....	16
References	19

How Soil Surveys Are Made

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

Custom Soil Resource Report

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and


Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.

Soil Map

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

Custom Soil Resource Report
Soil Map

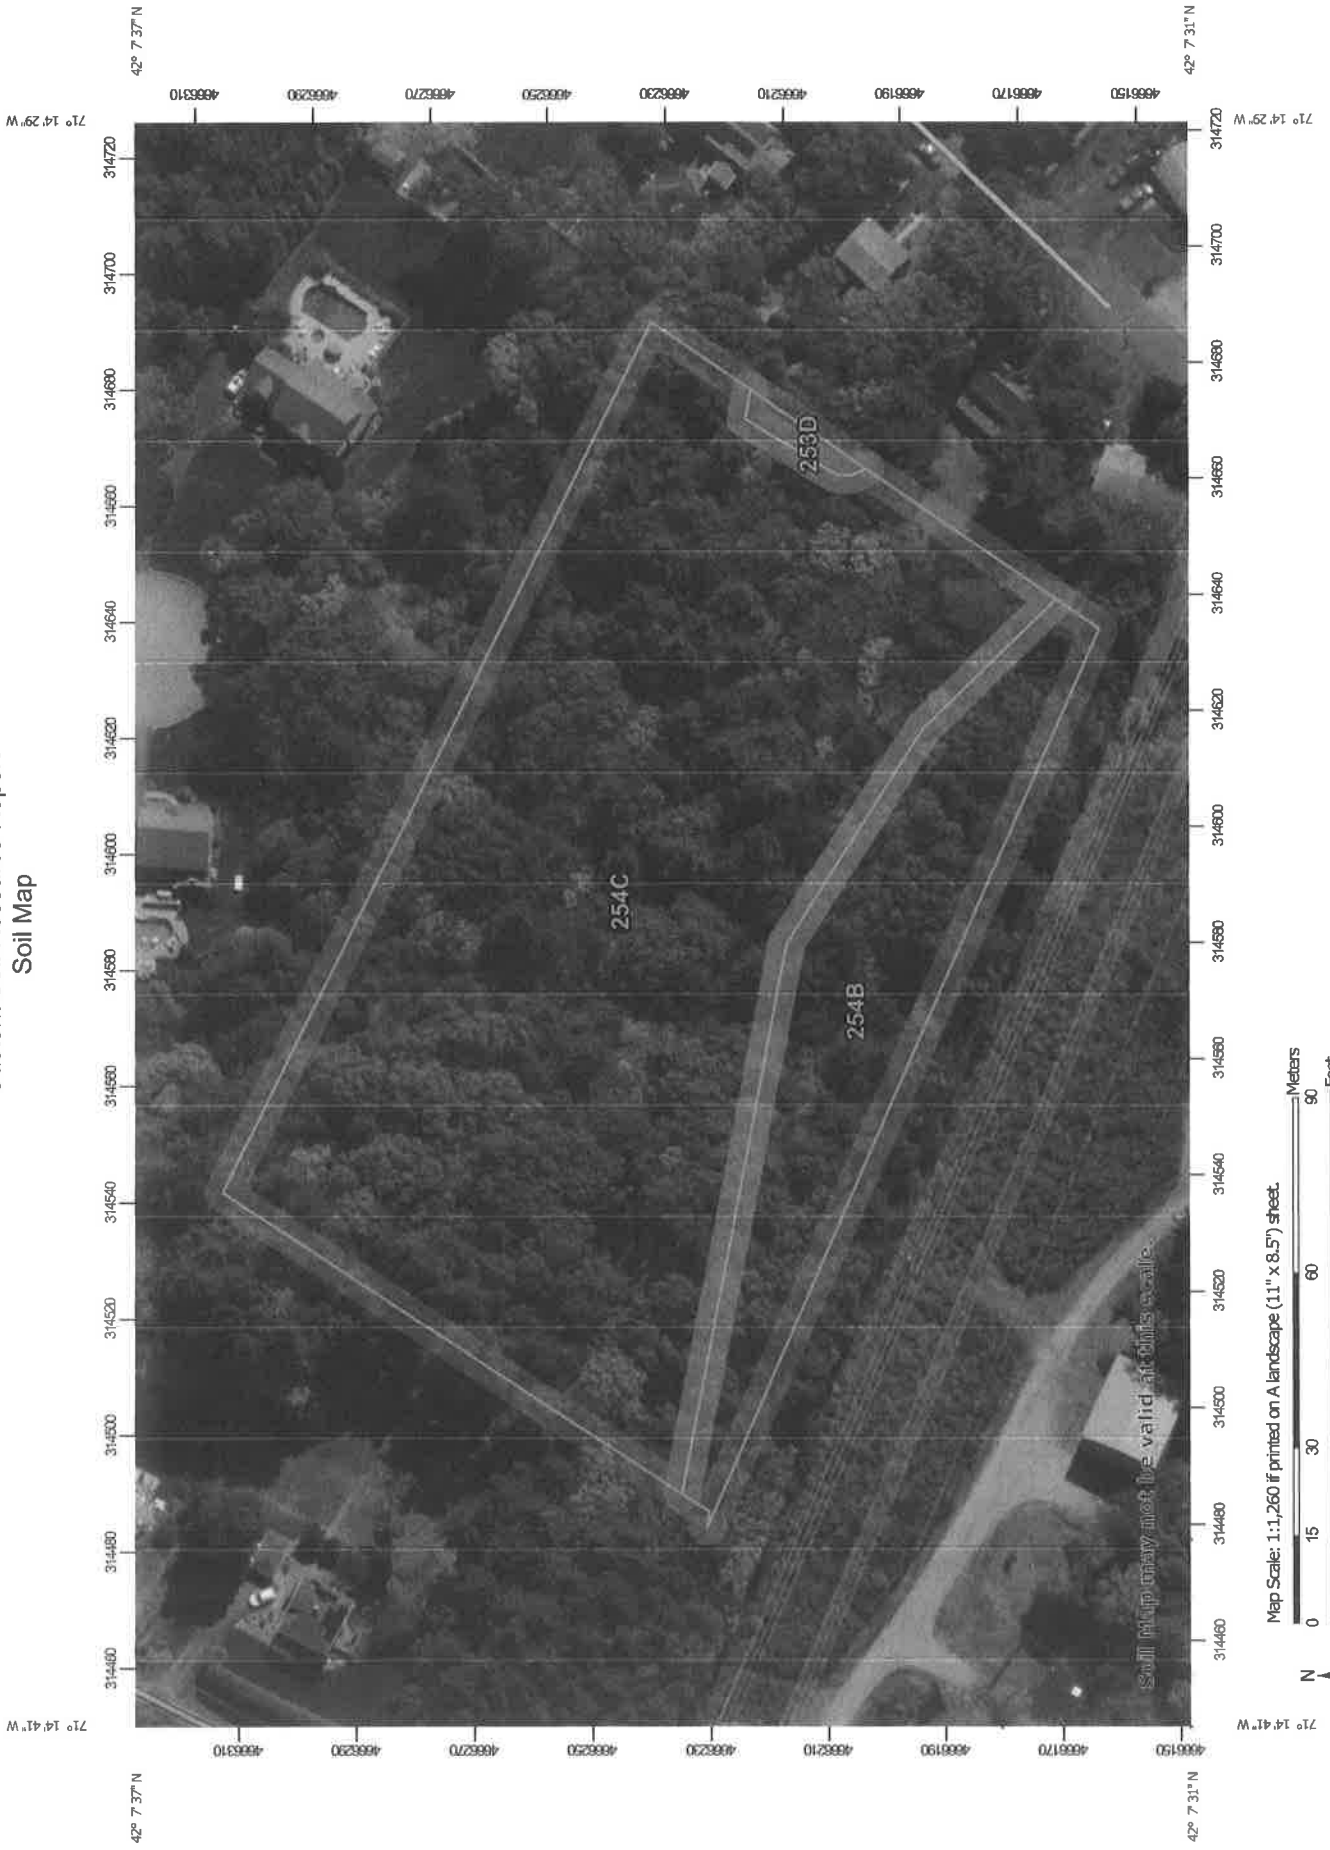

Map Scale: 1:1,260 if printed on A landscape (11" x 8.5") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 19N WGS84

MAP LEGEND

	Area of Interest (AOI)		Spoil Area
	Soils		Stony Spot
	Soil Map Unit Polygons		Very Stony Spot
	Soil Map Unit Lines		Wet Spot
	Soil Map Unit Points		Other
	Special Point Features		Special Line Features
	Blowout		Water Features
	Borrow Pit		Streams and Canals
	Clay Spot		Transportation
	Closed Depression		Rails
	Gravel Pit		Interstate Highways
	Gravelly Spot		US Routes
	Landfill		Major Roads
	Lava Flow		Local Roads
	Marsh or swamp		Background
	Mine or Quarry		Aerial Photography
	Miscellaneous Water		
	Perennial Water		
	Rock Outcrop		
	Saline Spot		
	Sandy Spot		
	Severely Eroded Spot		
	Sinkhole		
	Slide or Slip		
	Sodic Spot		

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:25,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Norfolk and Suffolk Counties, Massachusetts
 Survey Area Data: Version 18, Sep 9, 2022

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: May 22, 2022—Jun 5, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
253D	Hinckley loamy sand, 15 to 35 percent slopes	0.0	0.6%
254B	Merrimac fine sandy loam, 3 to 8 percent slopes	0.8	19.3%
254C	Merrimac fine sandy loam, 8 to 15 percent slopes	3.1	80.2%
Totals for Area of Interest		3.9	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or

Custom Soil Resource Report

landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

Norfolk and Suffolk Counties, Massachusetts

253D—Hinckley loamy sand, 15 to 35 percent slopes

Map Unit Setting

National map unit symbol: 2svmd
Elevation: 0 to 860 feet
Mean annual precipitation: 36 to 71 inches
Mean annual air temperature: 39 to 55 degrees F
Frost-free period: 140 to 240 days
Farmland classification: Not prime farmland

Map Unit Composition

Hinckley and similar soils: 85 percent
Minor components: 15 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Hinckley

Setting

Landform: Outwash deltas, outwash terraces, moraines, eskers, kames, outwash plains, kame terraces
Landform position (two-dimensional): Backslope
Landform position (three-dimensional): Head slope, nose slope, side slope, crest, riser
Down-slope shape: Concave, convex, linear
Across-slope shape: Convex, linear, concave
Parent material: Sandy and gravelly glaciofluvial deposits derived from gneiss and/or granite and/or schist

Typical profile

Oe - 0 to 1 inches: moderately decomposed plant material
A - 1 to 8 inches: loamy sand
Bw1 - 8 to 11 inches: gravelly loamy sand
Bw2 - 11 to 16 inches: gravelly loamy sand
BC - 16 to 19 inches: very gravelly loamy sand
C - 19 to 65 inches: very gravelly sand

Properties and qualities

Slope: 15 to 35 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Excessively drained
Runoff class: Very low
Capacity of the most limiting layer to transmit water (Ksat): Moderately high to very high (1.42 to 99.90 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Maximum salinity: Nonsaline (0.0 to 1.9 mmhos/cm)
Available water supply, 0 to 60 inches: Low (about 3.1 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 6e
Hydrologic Soil Group: A

Custom Soil Resource Report

Ecological site: F144AY022MA - Dry Outwash

Hydric soil rating: No

Minor Components

Windsor

Percent of map unit: 10 percent

Landform: Moraines, eskers, kames, outwash deltas, outwash terraces, outwash plains, kame terraces

Landform position (two-dimensional): Backslope

Landform position (three-dimensional): Head slope, nose slope, side slope, crest, riser

Down-slope shape: Concave, convex, linear

Across-slope shape: Convex, linear, concave

Hydric soil rating: No

Merrimac

Percent of map unit: 3 percent

Landform: Kame terraces, outwash plains, outwash terraces, moraines, eskers, kames

Landform position (two-dimensional): Backslope

Landform position (three-dimensional): Head slope, nose slope, side slope, crest, riser

Down-slope shape: Concave, convex, linear

Across-slope shape: Convex, linear, concave

Hydric soil rating: No

Sudbury

Percent of map unit: 2 percent

Landform: Outwash deltas, outwash plains, kame terraces, outwash terraces, moraines

Landform position (two-dimensional): Backslope, footslope, toeslope

Landform position (three-dimensional): Base slope, tread

Down-slope shape: Concave, linear

Across-slope shape: Concave, linear

Hydric soil rating: No

254B—Merrimac fine sandy loam, 3 to 8 percent slopes

Map Unit Setting

National map unit symbol: 2tyqs

Elevation: 0 to 1,290 feet

Mean annual precipitation: 36 to 71 inches

Mean annual air temperature: 39 to 55 degrees F

Frost-free period: 140 to 240 days

Farmland classification: All areas are prime farmland

Map Unit Composition

Merrimac and similar soils: 85 percent

Minor components: 15 percent

Custom Soil Resource Report

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Merrimac

Setting

Landform: Outwash plains, outwash terraces, moraines, eskers, kames
Landform position (two-dimensional): Summit, shoulder, backslope, footslope
Landform position (three-dimensional): Side slope, crest, riser, tread
Down-slope shape: Convex
Across-slope shape: Convex
Parent material: Loamy glaciofluvial deposits derived from granite, schist, and gneiss over sandy and gravelly glaciofluvial deposits derived from granite, schist, and gneiss

Typical profile

Ap - 0 to 10 inches: fine sandy loam
Bw1 - 10 to 22 inches: fine sandy loam
Bw2 - 22 to 26 inches: stratified gravel to gravelly loamy sand
2C - 26 to 65 inches: stratified gravel to very gravelly sand

Properties and qualities

Slope: 3 to 8 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Somewhat excessively drained
Runoff class: Very low
Capacity of the most limiting layer to transmit water (Ksat): Moderately high to very high (1.42 to 99.90 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 2 percent
Maximum salinity: Nonsaline (0.0 to 1.4 mmhos/cm)
Sodium adsorption ratio, maximum: 1.0
Available water supply, 0 to 60 inches: Low (about 4.6 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 2s
Hydrologic Soil Group: A
Ecological site: F145XY008MA - Dry Outwash
Hydric soil rating: No

Minor Components

Sudbury

Percent of map unit: 5 percent
Landform: Deltas, terraces, outwash plains
Landform position (two-dimensional): Footslope
Landform position (three-dimensional): Tread, dip
Down-slope shape: Concave
Across-slope shape: Linear
Hydric soil rating: No

Hinckley

Percent of map unit: 5 percent
Landform: Deltas, kames, eskers, outwash plains
Landform position (two-dimensional): Summit, shoulder, backslope

Custom Soil Resource Report

Landform position (three-dimensional): Head slope, nose slope, side slope, crest, rise

Down-slope shape: Convex

Across-slope shape: Convex, linear

Hydric soil rating: No

Windsor

Percent of map unit: 3 percent

Landform: Outwash plains, outwash terraces, dunes, deltas

Landform position (two-dimensional): Shoulder

Landform position (three-dimensional): Tread, riser

Down-slope shape: Linear, convex

Across-slope shape: Linear, convex

Hydric soil rating: No

Agawam

Percent of map unit: 2 percent

Landform: Outwash plains, outwash terraces, moraines, stream terraces, eskers, kames

Landform position (three-dimensional): Rise

Down-slope shape: Convex

Across-slope shape: Convex

Hydric soil rating: No

254C—Merrimac fine sandy loam, 8 to 15 percent slopes

Map Unit Setting

National map unit symbol: 2tyqt

Elevation: 0 to 1,030 feet

Mean annual precipitation: 36 to 71 inches

Mean annual air temperature: 39 to 55 degrees F

Frost-free period: 140 to 240 days

Farmland classification: Farmland of statewide importance

Map Unit Composition

Merrimac and similar soils: 85 percent

Minor components: 15 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Merrimac

Setting

Landform: Eskers, outwash plains, moraines, kames, outwash terraces

Landform position (two-dimensional): Backslope, footslope, summit, shoulder

Landform position (three-dimensional): Side slope, crest, riser, tread

Down-slope shape: Convex

Across-slope shape: Convex

Parent material: Loamy glaciofluvial deposits derived from granite, schist, and gneiss over sandy and gravelly glaciofluvial deposits derived from granite, schist, and gneiss

Custom Soil Resource Report

Typical profile

Ap - 0 to 10 inches: fine sandy loam
Bw1 - 10 to 22 inches: fine sandy loam
Bw2 - 22 to 26 inches: stratified gravel to gravelly loamy sand
2C - 26 to 65 inches: stratified gravel to very gravelly sand

Properties and qualities

Slope: 8 to 15 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Somewhat excessively drained
Runoff class: Very low
Capacity of the most limiting layer to transmit water (Ksat): Moderately high to very high (1.42 to 99.90 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 2 percent
Maximum salinity: Nonsaline (0.0 to 1.4 mmhos/cm)
Sodium adsorption ratio, maximum: 1.0
Available water supply, 0 to 60 inches: Low (about 4.6 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 2s
Hydrologic Soil Group: A
Ecological site: F145XY008MA - Dry Outwash
Hydric soil rating: No

Minor Components

Hinckley

Percent of map unit: 5 percent
Landform: Deltas, kames, eskers, outwash plains
Landform position (two-dimensional): Summit, shoulder, backslope
Landform position (three-dimensional): Head slope, nose slope, side slope, crest, rise
Down-slope shape: Convex
Across-slope shape: Convex, linear
Hydric soil rating: No

Sudbury

Percent of map unit: 5 percent
Landform: Deltas, terraces, outwash plains
Landform position (two-dimensional): Footslope
Landform position (three-dimensional): Tread, dip
Down-slope shape: Concave
Across-slope shape: Linear
Hydric soil rating: No

Windsor

Percent of map unit: 5 percent
Landform: Outwash plains, dunes, deltas, outwash terraces
Landform position (two-dimensional): Backslope
Landform position (three-dimensional): Tread, riser
Down-slope shape: Linear, convex
Across-slope shape: Linear, convex

Custom Soil Resource Report

Hydric soil rating: No

References

- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelpdb1043084>


Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242


United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf

APPENDIX II



offsite south



Routing Diagram for Existing 827
Prepared by Chessia Consulting Services LLC, Printed 12/13/2023
HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Printed 12/13/2023

Page 2

Rainfall Events Listing

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	2-yr	Type III 24-hr		Default	24.00	1	3.27	2
2	10-yr	Type III 24-hr		Default	24.00	1	4.96	2
3	25-yr	Type III 24-hr		Default	24.00	1	6.29	2
4	50-yr	Type III 24-hr		Default	24.00	1	7.54	2
5	100-yr	Type III 24-hr		Default	24.00	1	9.06	2

Existing 827

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 3

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
2.934	39	>75% Grass cover, Good, HSG A (4S)
1.636	98	Paved parking, HSG A (4S)
0.493	98	Roofs, HSG A (4S)
0.143	98	Water Surface, HSG A Basin (4S)
5.001	30	Woods, Good, HSG A (1S, 2S, 3S, 4S)
10.207	48	TOTAL AREA

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 4

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: EX-1 Runoff Area=196,713 sf 0.00% Impervious Runoff Depth=0.00"
Flow Length=682' Tc=13.7 min CN=30 Runoff=0.00 cfs 0.000 af

Subcatchment 2S: EX-2 Runoff Area=2,312 sf 0.00% Impervious Runoff Depth=0.00"
Tc=6.0 min CN=30 Runoff=0.00 cfs 0.000 af

Subcatchment 3S: EX-3 Runoff Area=3,273 sf 0.00% Impervious Runoff Depth=0.00"
Tc=6.0 min CN=30 Runoff=0.00 cfs 0.000 af

Subcatchment 4S: OS 1 Runoff Area=242,335 sf 40.85% Impervious Runoff Depth=0.55"
Flow Length=855' Tc=9.9 min CN=63 Runoff=2.27 cfs 0.255 af

Reach 7R: offsite south Inflow=0.00 cfs 0.000 af
Outflow=0.00 cfs 0.000 af

Pond 6P: Existing Basin Peak Elev=220.76' Storage=3,654 cf Inflow=2.27 cfs 0.255 af
Discarded=0.42 cfs 0.184 af Primary=0.00 cfs 0.000 af Outflow=0.42 cfs 0.184 af

Total Runoff Area = 10.207 ac Runoff Volume = 0.255 af Average Runoff Depth = 0.30"
77.73% Pervious = 7.935 ac 22.27% Impervious = 2.273 ac

Existing 827

Summary for Subcatchment 1S: EX-1

[45] Hint: Runoff=Zero

Runoff = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Depth= 0.00"
Routed to Reach 7R : offsite south


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
196,713	30	Woods, Good, HSG A
196,713		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0830	0.12		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
6.7	632	0.1000	1.58		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
13.7	682	Total			

Subcatchment 1S: EX-1

Hydrograph

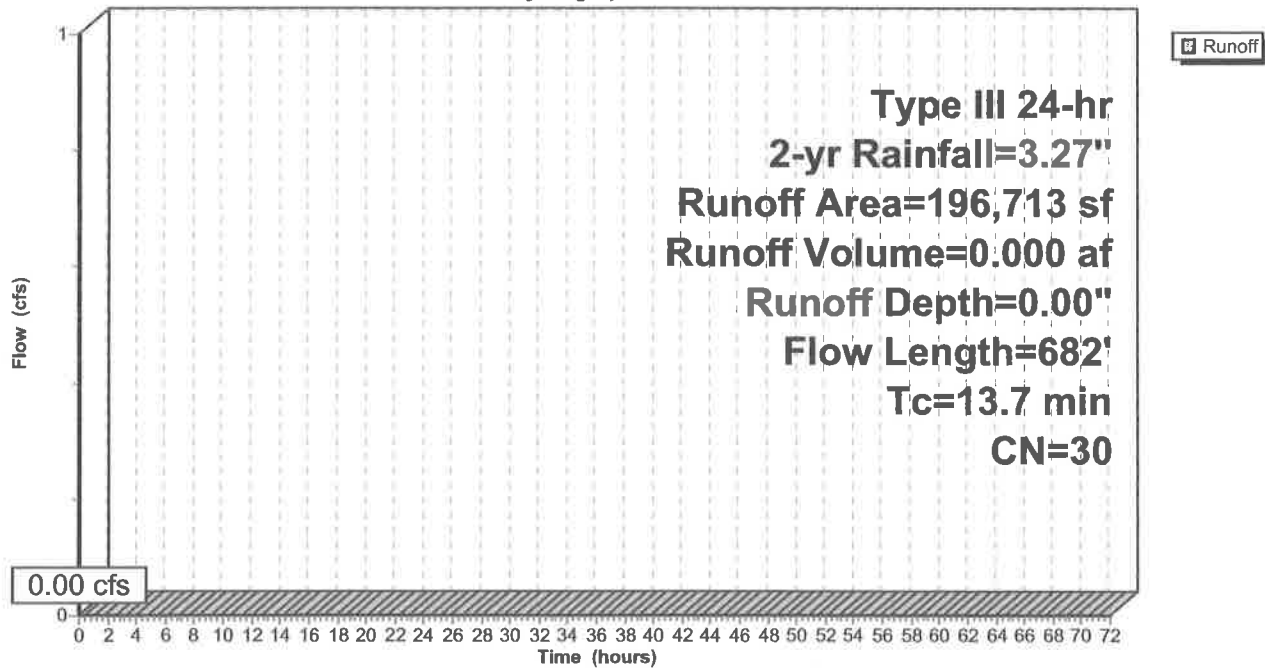

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 6

Summary for Subcatchment 2S: EX-2

[45] Hint: Runoff=Zero

Runoff = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Depth= 0.00"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
2,312	30	Woods, Good, HSG A
2,312		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 2S: EX-2

Hydrograph

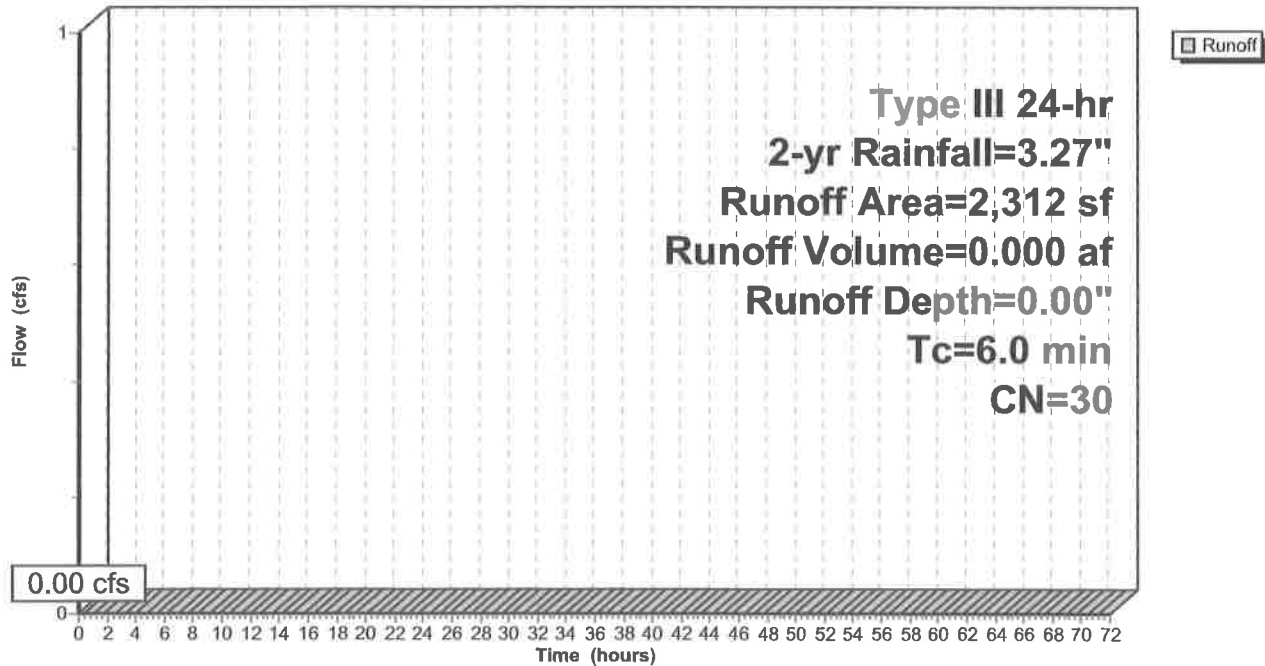

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 7

Summary for Subcatchment 3S: EX-3

[45] Hint: Runoff=Zero

Runoff = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Depth= 0.00"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
3,273	30	Woods, Good, HSG A
3,273		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 3S: EX-3

Hydrograph

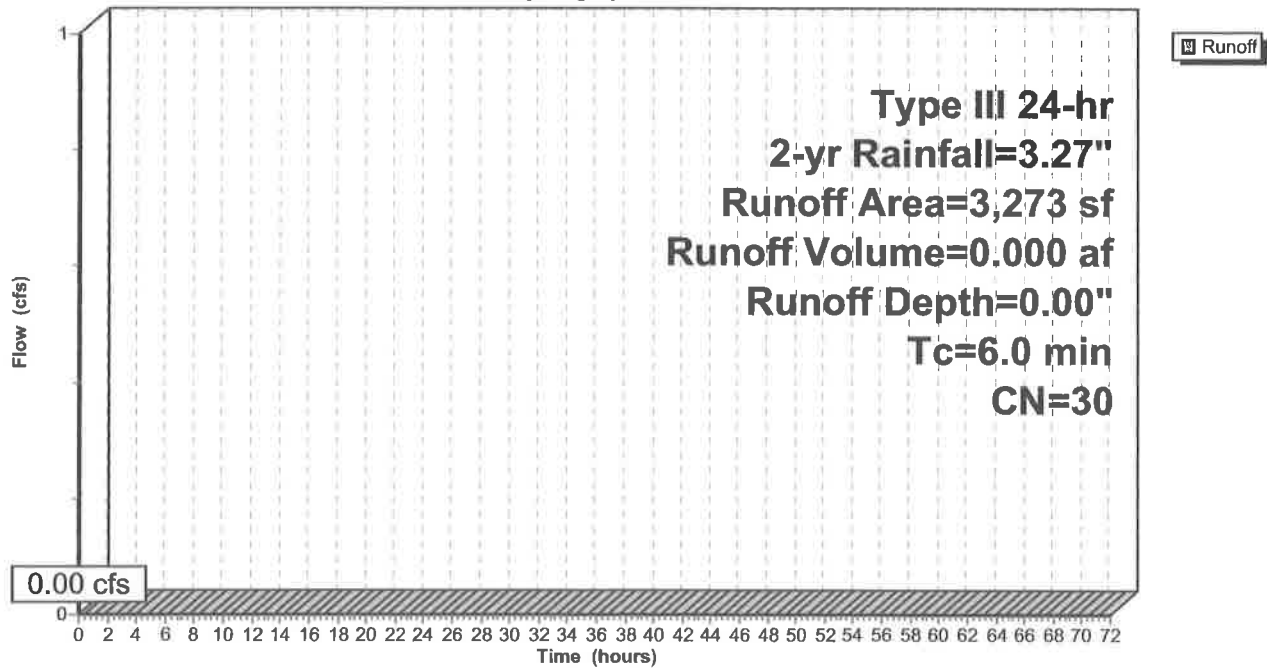

Existing 827

Prepared by Chessia Consulting Services LLC
 HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"
 Printed 12/13/2023
 Page 8

Summary for Subcatchment 4S: OS 1

Runoff = 2.27 cfs @ 12.17 hrs, Volume= 0.255 af, Depth= 0.55"
 Routed to Pond 6P : Existing Basin

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
21,486	98	Roofs, HSG A
15,524	30	Woods, Good, HSG A
127,810	39	>75% Grass cover, Good, HSG A
* 6,241	98	Water Surface, HSG A Basin
71,274	98	Paved parking, HSG A
242,335	63	Weighted Average
143,334		59.15% Pervious Area
99,001		40.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0300	0.12		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
1.1	150	0.0120	2.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	475	0.0100	5.26	6.46	Pipe Channel, RCP_Round 15" 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.013 Concrete pipe, bends & connections
0.3	180	0.0290	10.12	17.89	Pipe Channel, RCP_Round 18" 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.013 Concrete pipe, bends & connections
9.9	855	Total			

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 9

Subcatchment 4S: OS 1

Hydrograph

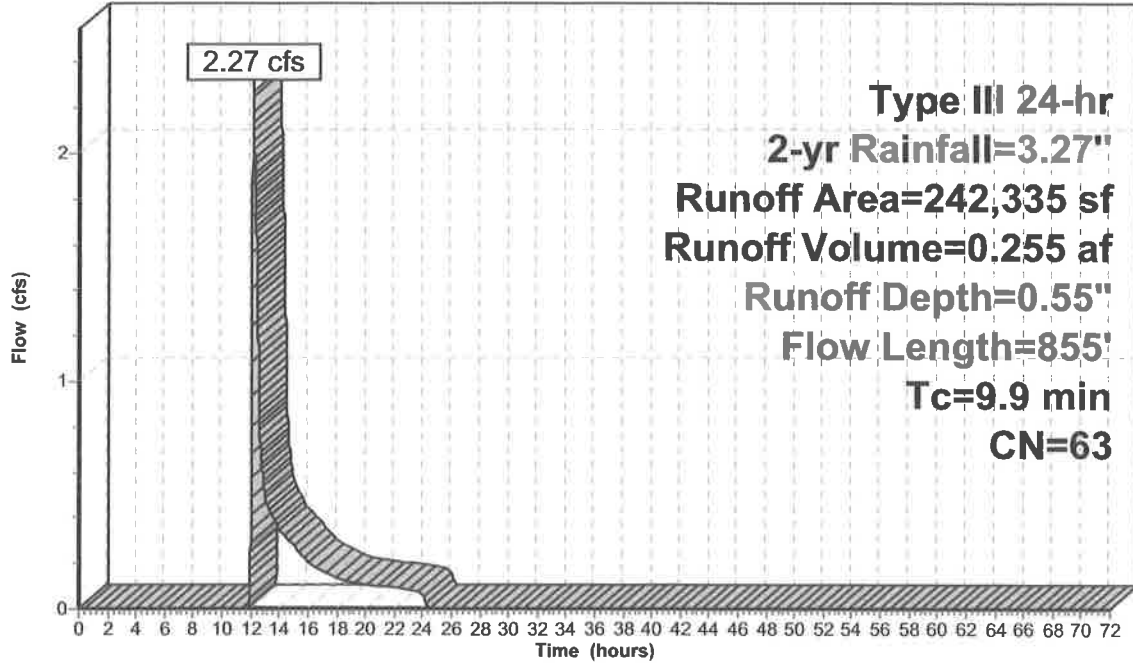

**Type III 24-hr
2-yr Rainfall=3.27"**
Runoff Area=242,335 sf
Runoff Volume=0.255 af
Runoff Depth=0.55"
Flow Length=855'
Tc=9.9 min
CN=63

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 10

Summary for Reach 7R: offsite south


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 10.079 ac, 22.55% Impervious, Inflow Depth = 0.00" for 2-yr event
Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Reach 7R: offsite south

Hydrograph

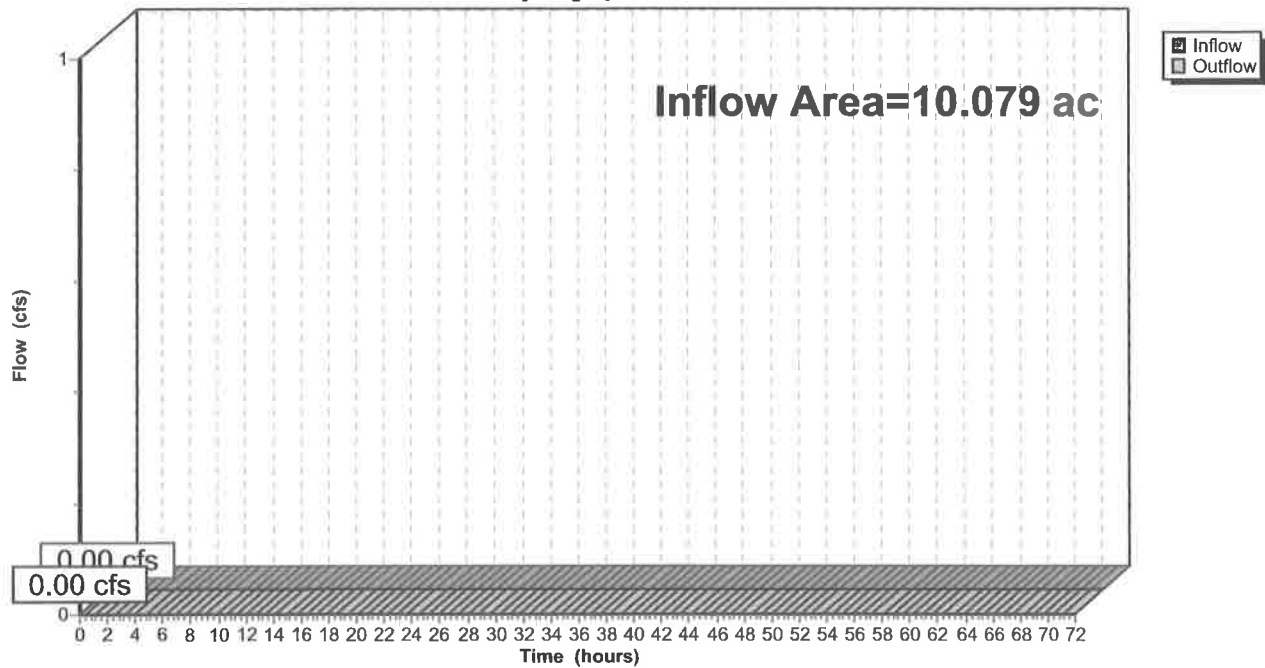

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 11

Summary for Pond 6P: Existing Basin

Inflow Area = 5.563 ac, 40.85% Impervious, Inflow Depth = 0.55" for 2-yr event
 Inflow = 2.27 cfs @ 12.17 hrs, Volume= 0.255 af
 Outflow = 0.42 cfs @ 13.31 hrs, Volume= 0.184 af, Atten= 81%, Lag= 68.5 min
 Discarded = 0.42 cfs @ 13.31 hrs, Volume= 0.184 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Routed to Reach 7R : offsite south

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs / 3
 Peak Elev= 220.76' @ 13.31 hrs Surf.Area= 2,649 sf Storage= 3,654 cf

Plug-Flow detention time= 179.8 min calculated for 0.184 af (72% of inflow)
 Center-of-Mass det. time= 73.4 min (979.1 - 905.8)

Volume	Invert	Avail.Storage	Storage Description
#1	211.00'	111 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 467 cf Embedded = 279 cf x 40.0% Voids
#2	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder Inside #1
#3	211.00'	117 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 452 cf Embedded = 294 cf x 40.0% Voids
#4	211.50'	452 cf	8.00'D x 9.00'H Vertical Cone/Cylinder Inside #3
#5	210.50'	107 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 478 cf Embedded = 269 cf x 40.0% Voids
#6	210.50'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #5
#7	210.50'	123 cf	10.00'D x 10.00'H Vertical Cone/Cylinder 785 cf Overall - 478 cf Embedded = 308 cf x 40.0% Voids
#8	210.70'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #7
#9	211.00'	298 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall x 40.0% Voids
#10	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder
#11	220.50'	23,070 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,170 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
220.50	2,038	0	0
222.00	3,006	3,783	3,783
224.00	4,743	7,749	11,532
225.00	5,659	5,201	16,733
225.50	6,241	2,975	19,708
226.00	7,205	3,362	23,070

Device	Routing	Invert	Outlet Devices
#1	Discarded	220.49'	8.270 in/hr Exfiltration over Surface area above 220.49' Excluded Surface area = 443 sf
#2	Primary	225.00'	10.0' long + 4.0 ' SideZ x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 12

Discarded OutFlow Max=0.42 cfs @ 13.31 hrs HW=220.76' (Free Discharge)


↑1=Exfiltration (Exfiltration Controls 0.42 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=210.50' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Pond 6P: Existing Basin

Hydrograph

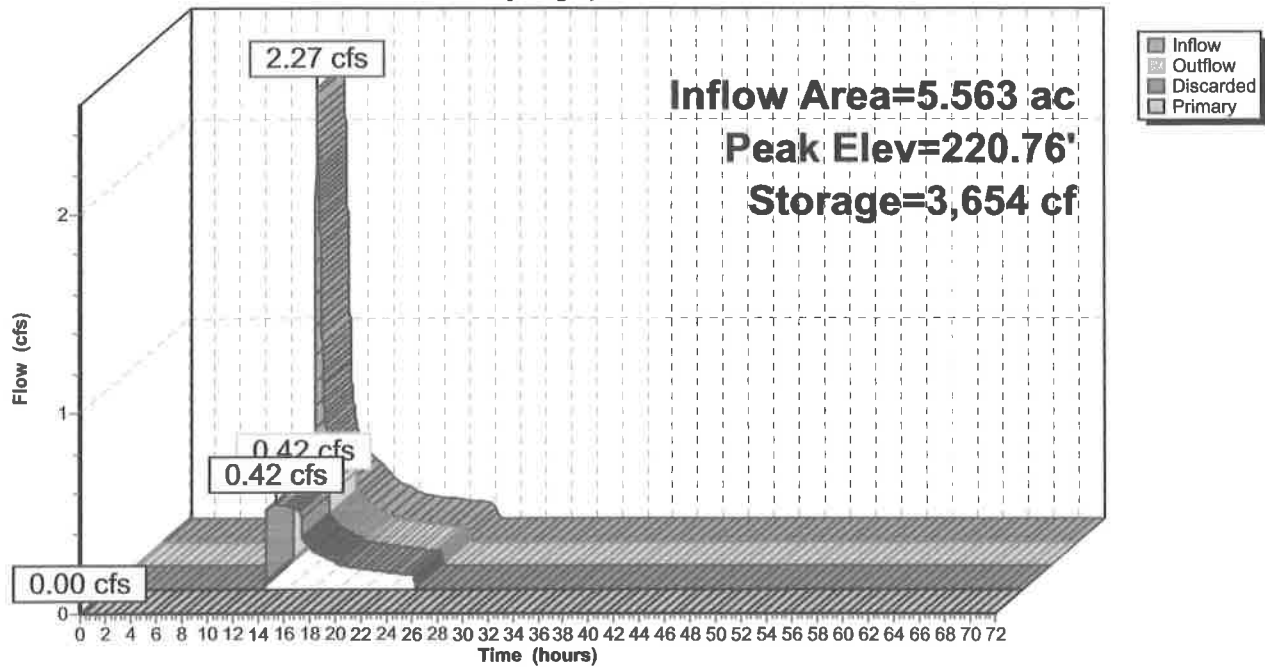

Existing 827

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 13

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: EX-1

Runoff Area=196,713 sf 0.00% Impervious Runoff Depth=0.00"
Flow Length=682' Tc=13.7 min CN=30 Runoff=0.00 cfs 0.001 af

Subcatchment 2S: EX-2

Runoff Area=2,312 sf 0.00% Impervious Runoff Depth=0.00"
Tc=6.0 min CN=30 Runoff=0.00 cfs 0.000 af

Subcatchment 3S: EX-3

Runoff Area=3,273 sf 0.00% Impervious Runoff Depth=0.00"
Tc=6.0 min CN=30 Runoff=0.00 cfs 0.000 af

Subcatchment 4S: OS 1

Runoff Area=242,335 sf 40.85% Impervious Runoff Depth=1.48"
Flow Length=855' Tc=9.9 min CN=63 Runoff=7.85 cfs 0.688 af

Reach 7R: offsite south

Inflow=0.00 cfs 0.001 af
Outflow=0.00 cfs 0.001 af

Pond 6P: Existing Basin

Peak Elev=223.63' Storage=12,947 cf Inflow=7.85 cfs 0.688 af
Discarded=0.85 cfs 0.617 af Primary=0.00 cfs 0.000 af Outflow=0.85 cfs 0.617 af

Total Runoff Area = 10.207 ac Runoff Volume = 0.689 af Average Runoff Depth = 0.81"
77.73% Pervious = 7.935 ac 22.27% Impervious = 2.273 ac

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 14

Summary for Subcatchment 1S: EX-1

Runoff = 0.00 cfs @ 24.01 hrs, Volume= 0.001 af, Depth= 0.00"
Routed to Reach 7R : offsite south


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
196,713	30	Woods, Good, HSG A
196,713		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0830	0.12		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
6.7	632	0.1000	1.58		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
13.7	682	Total			

Subcatchment 1S: EX-1

Hydrograph

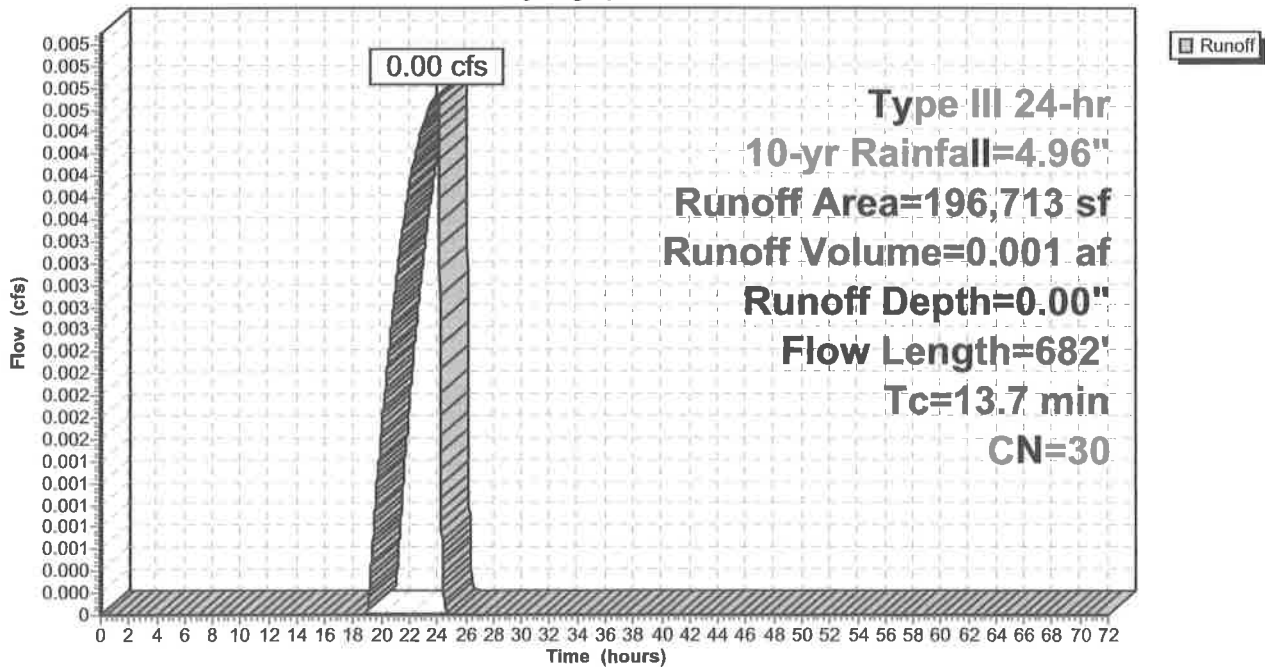

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 15

Summary for Subcatchment 2S: EX-2

Runoff = 0.00 cfs @ 24.01 hrs, Volume= 0.000 af, Depth= 0.00"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
2,312	30	Woods, Good, HSG A
2,312		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 2S: EX-2

Hydrograph

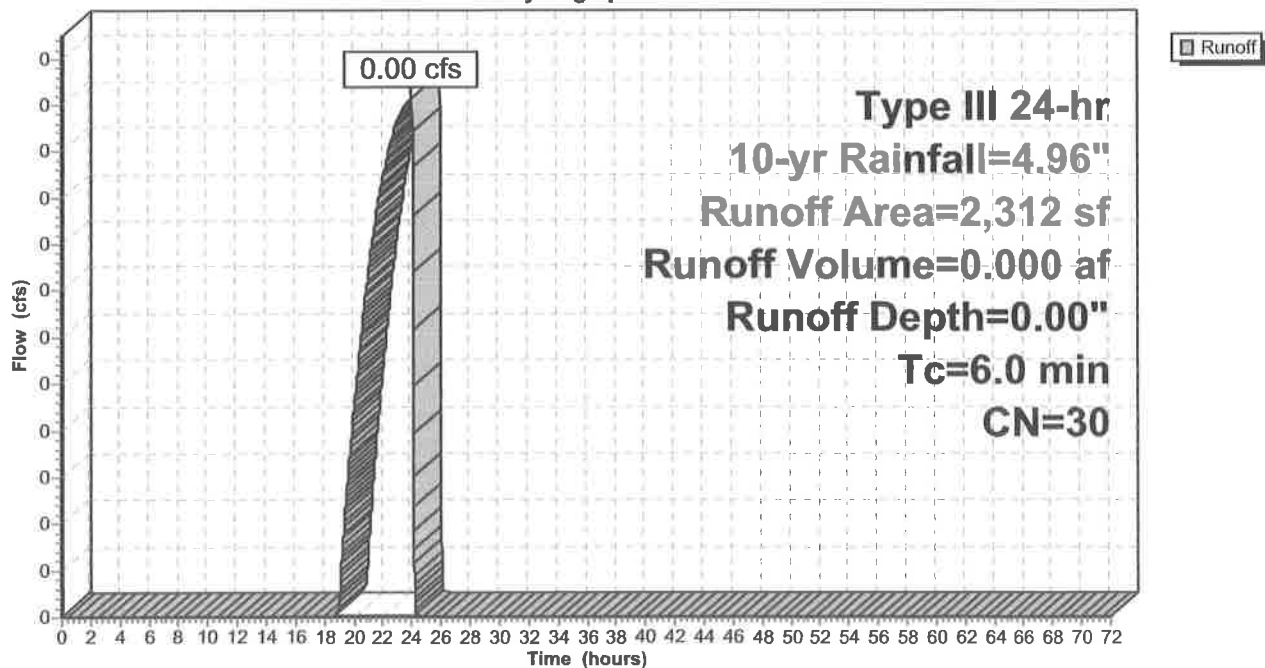

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 16

Summary for Subcatchment 3S: EX-3

Runoff = 0.00 cfs @ 24.01 hrs, Volume= 0.000 af, Depth= 0.00"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
3,273	30	Woods, Good, HSG A
3,273		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 3S: EX-3

Hydrograph

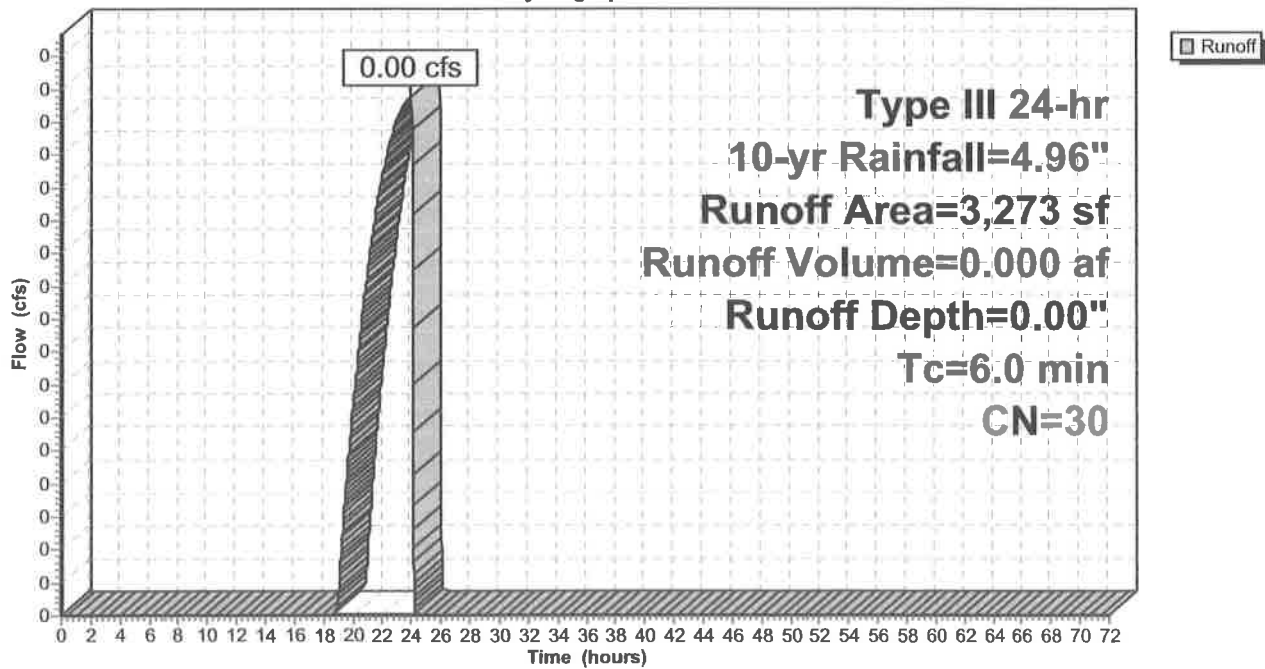

Existing 827

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 17

Summary for Subcatchment 4S: OS 1

[47] Hint: Peak is 121% of capacity of segment #3

Runoff = 7.85 cfs @ 12.15 hrs, Volume= 0.688 af, Depth= 1.48"
 Routed to Pond 6P : Existing Basin

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
21,486	98	Roofs, HSG A
15,524	30	Woods, Good, HSG A
127,810	39	>75% Grass cover, Good, HSG A
* 6,241	98	Water Surface, HSG A Basin
71,274	98	Paved parking, HSG A
242,335	63	Weighted Average
143,334		59.15% Pervious Area
99,001		40.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0300	0.12		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
1.1	150	0.0120	2.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	475	0.0100	5.26	6.46	Pipe Channel, RCP_Round 15" 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.013 Concrete pipe, bends & connections
0.3	180	0.0290	10.12	17.89	Pipe Channel, RCP_Round 18" 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.013 Concrete pipe, bends & connections
9.9	855	Total			

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 18

Subcatchment 4S: OS 1

Hydrograph

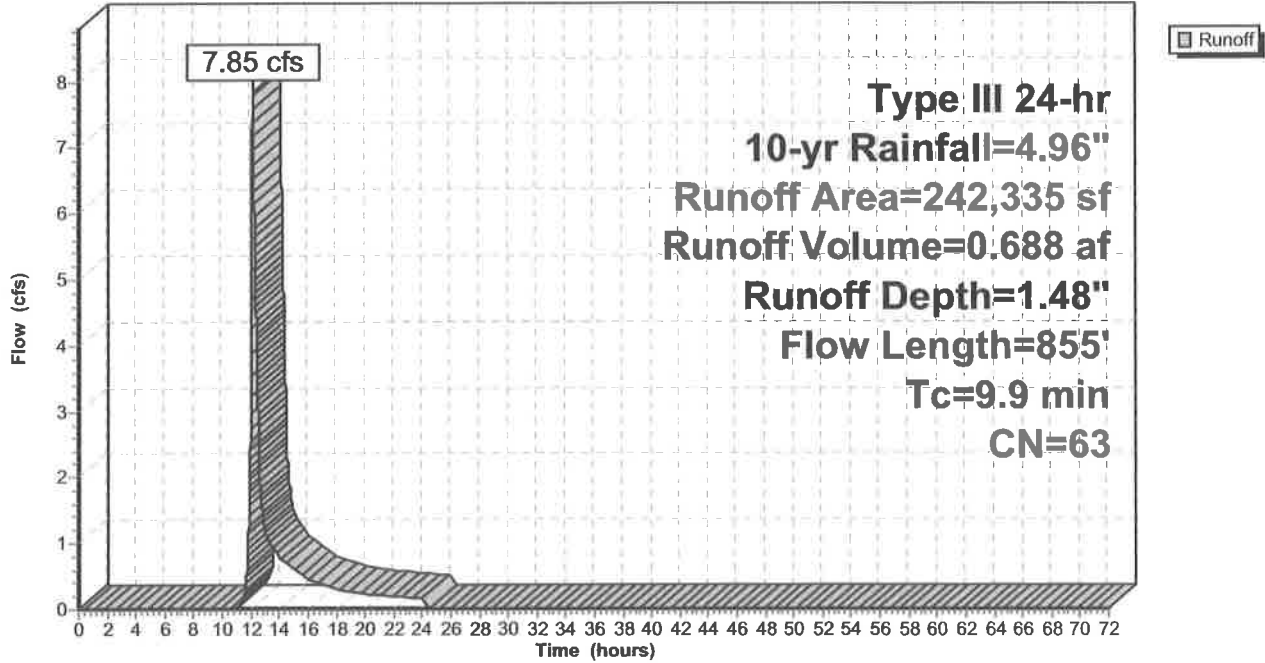

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 19

Summary for Reach 7R: offsite south


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 10.079 ac, 22.55% Impervious, Inflow Depth = 0.00" for 10-yr event
Inflow = 0.00 cfs @ 24.01 hrs, Volume= 0.001 af
Outflow = 0.00 cfs @ 24.01 hrs, Volume= 0.001 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Reach 7R: offsite south

Hydrograph

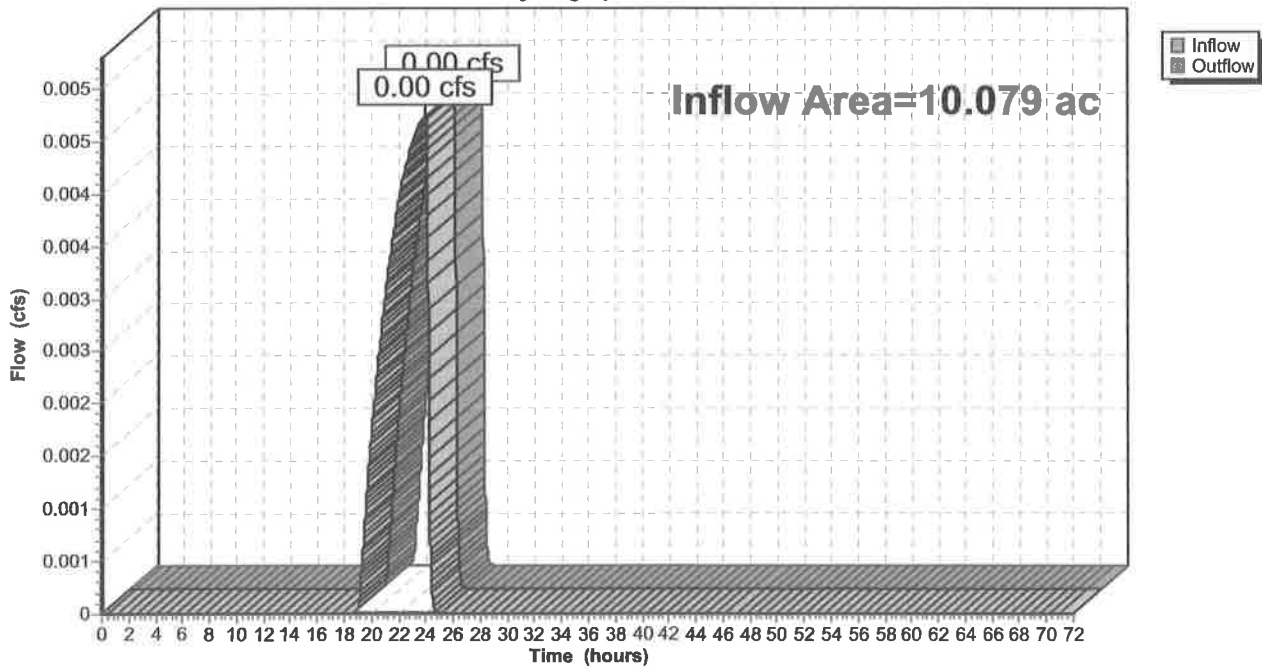

Existing 827

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 20

Summary for Pond 6P: Existing Basin

Inflow Area = 5.563 ac, 40.85% Impervious, Inflow Depth = 1.48" for 10-yr event
 Inflow = 7.85 cfs @ 12.15 hrs, Volume= 0.688 af
 Outflow = 0.85 cfs @ 13.84 hrs, Volume= 0.617 af, Atten= 89%, Lag= 101.1 min
 Discarded = 0.85 cfs @ 13.84 hrs, Volume= 0.617 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Routed to Reach 7R : offsite south

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs / 3
 Peak Elev= 223.63' @ 13.84 hrs Surf.Area= 4,867 sf Storage= 12,947 cf

Plug-Flow detention time= 206.1 min calculated for 0.617 af (90% of inflow)
 Center-of-Mass det. time= 156.1 min (1,026.7 - 870.6)

Volume	Invert	Avail.Storage	Storage Description
#1	211.00'	111 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 467 cf Embedded = 279 cf x 40.0% Voids
#2	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder Inside #1
#3	211.00'	117 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 452 cf Embedded = 294 cf x 40.0% Voids
#4	211.50'	452 cf	8.00'D x 9.00'H Vertical Cone/Cylinder Inside #3
#5	210.50'	107 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 478 cf Embedded = 269 cf x 40.0% Voids
#6	210.50'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #5
#7	210.50'	123 cf	10.00'D x 10.00'H Vertical Cone/Cylinder 785 cf Overall - 478 cf Embedded = 308 cf x 40.0% Voids
#8	210.70'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #7
#9	211.00'	298 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall x 40.0% Voids
#10	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder
#11	220.50'	23,070 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,170 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
220.50	2,038	0	0
222.00	3,006	3,783	3,783
224.00	4,743	7,749	11,532
225.00	5,659	5,201	16,733
225.50	6,241	2,975	19,708
226.00	7,205	3,362	23,070

Device	Routing	Invert	Outlet Devices
#1	Discarded	220.49'	8.270 in/hr Exfiltration over Surface area above 220.49' Excluded Surface area = 443 sf
#2	Primary	225.00'	10.0' long + 4.0 ' SideZ x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 21

Discarded OutFlow Max=0.85 cfs @ 13.84 hrs HW=223.63' (Free Discharge)


↑1=Exfiltration (Exfiltration Controls 0.85 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=210.50' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Pond 6P: Existing Basin

Hydrograph

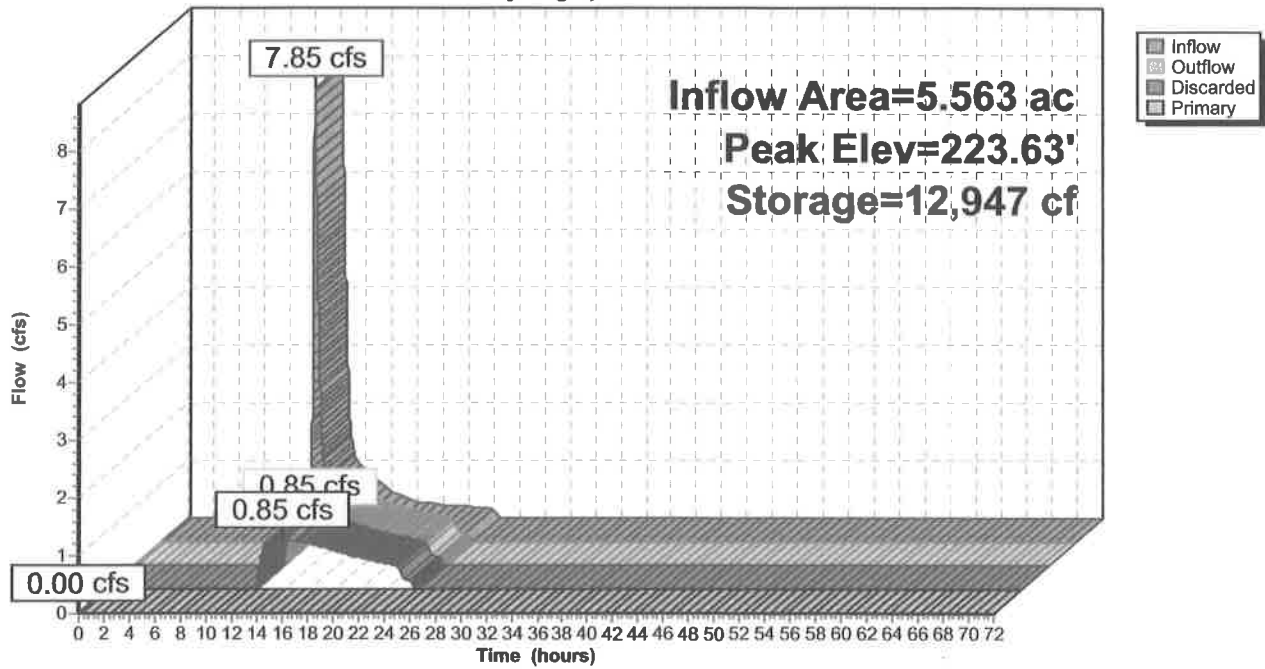

Existing 827

Type III 24-hr 25-yr Rainfall=6.29"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 22

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: EX-1

Runoff Area=196,713 sf 0.00% Impervious Runoff Depth=0.11"
Flow Length=682' Tc=13.7 min CN=30 Runoff=0.06 cfs 0.040 af

Subcatchment 2S: EX-2

Runoff Area=2,312 sf 0.00% Impervious Runoff Depth=0.11"
Tc=6.0 min CN=30 Runoff=0.00 cfs 0.000 af

Subcatchment 3S: EX-3

Runoff Area=3,273 sf 0.00% Impervious Runoff Depth=0.11"
Tc=6.0 min CN=30 Runoff=0.00 cfs 0.001 af

Subcatchment 4S: OS 1

Runoff Area=242,335 sf 40.85% Impervious Runoff Depth=2.38"
Flow Length=855' Tc=9.9 min CN=63 Runoff=13.19 cfs 1.104 af

Reach 7R: offsite south

Inflow=1.41 cfs 0.124 af
Outflow=1.41 cfs 0.124 af

Pond 6P: Existing Basin

Peak Elev=225.14' Storage=20,614 cf Inflow=13.19 cfs 1.104 af
Discarded=1.11 cfs 0.948 af Primary=1.41 cfs 0.085 af Outflow=2.52 cfs 1.033 af

Total Runoff Area = 10.207 ac Runoff Volume = 1.145 af Average Runoff Depth = 1.35"
77.73% Pervious = 7.935 ac 22.27% Impervious = 2.273 ac

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 23

Summary for Subcatchment 1S: EX-1

Runoff = 0.06 cfs @ 15.27 hrs, Volume= 0.040 af, Depth= 0.11"
Routed to Reach 7R : offsite south


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
196,713	30	Woods, Good, HSG A
196,713		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0830	0.12		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
6.7	632	0.1000	1.58		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
13.7	682	Total			

Subcatchment 1S: EX-1

Hydrograph

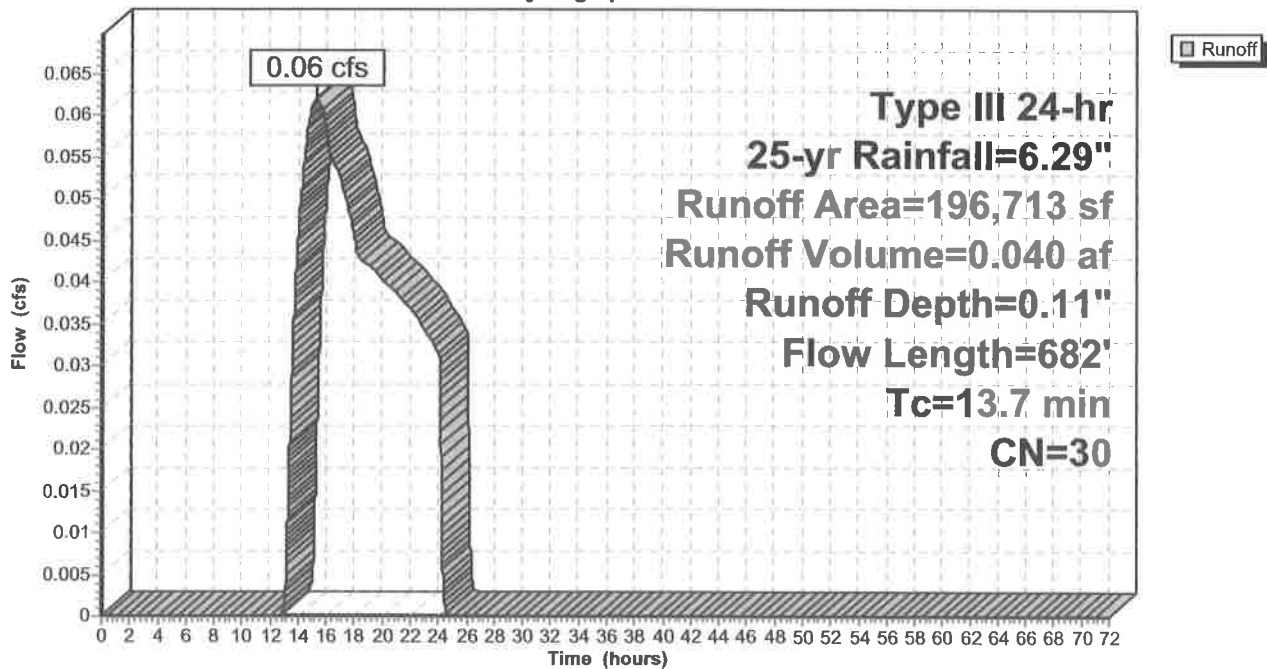

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 24

Summary for Subcatchment 2S: EX-2

Runoff = 0.00 cfs @ 15.14 hrs, Volume= 0.000 af, Depth= 0.11"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
2,312	30	Woods, Good, HSG A
2,312		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 2S: EX-2

Hydrograph

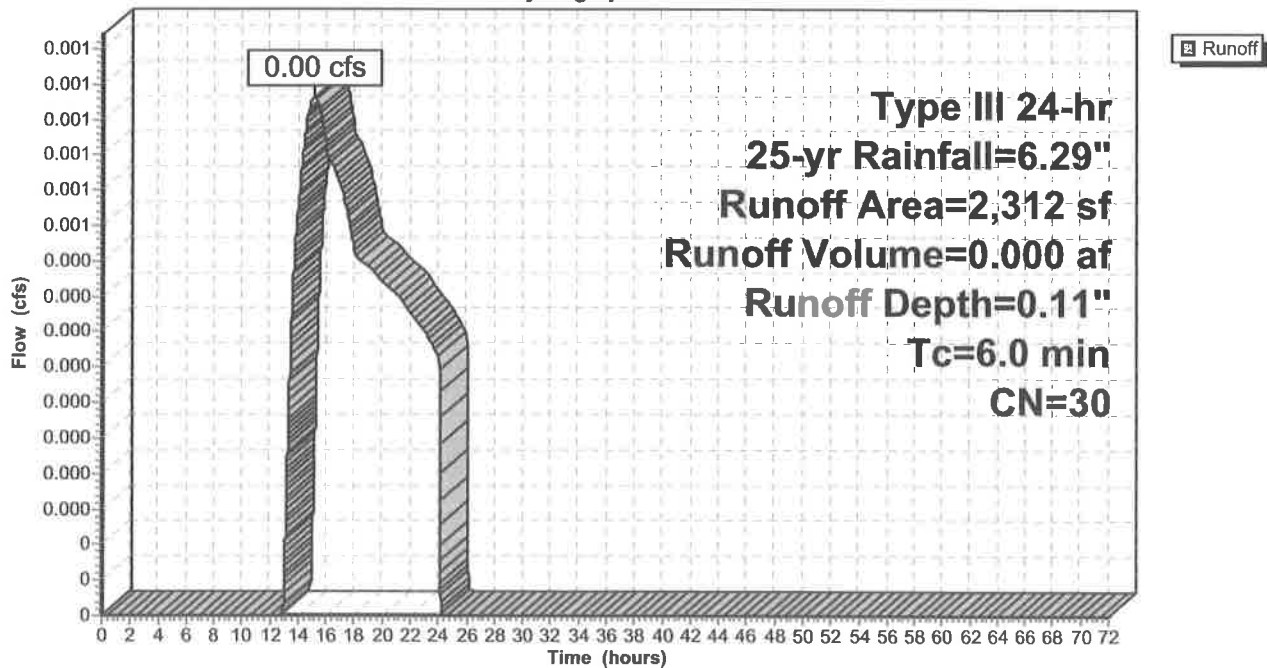

Summary for Subcatchment 3S: EX-3

Runoff = 0.00 cfs @ 15.14 hrs, Volume= 0.001 af, Depth= 0.11"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
3,273	30	Woods, Good, HSG A
3,273		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 3S: EX-3

Hydrograph

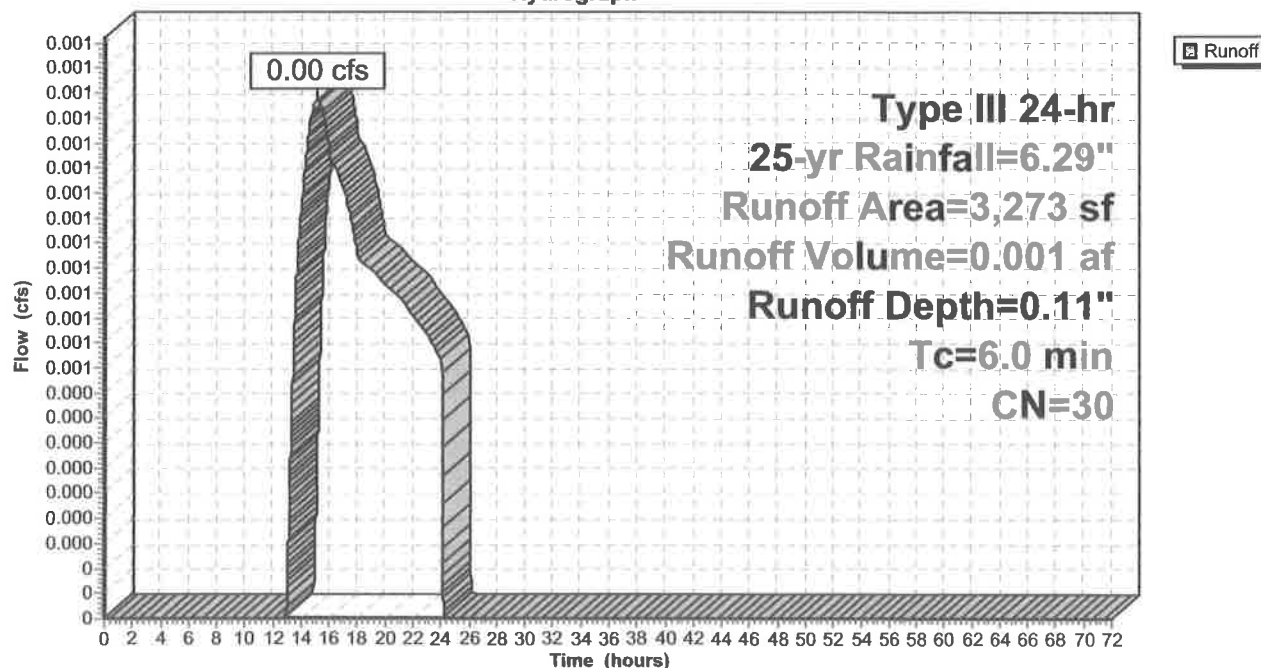

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 26

Summary for Subcatchment 4S: OS 1

[47] Hint: Peak is 204% of capacity of segment #3

Runoff = 13.19 cfs @ 12.15 hrs, Volume= 1.104 af, Depth= 2.38"
 Routed to Pond 6P : Existing Basin

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
21,486	98	Roofs, HSG A
15,524	30	Woods, Good, HSG A
127,810	39	>75% Grass cover, Good, HSG A
* 6,241	98	Water Surface, HSG A Basin
71,274	98	Paved parking, HSG A
242,335	63	Weighted Average
143,334		59.15% Pervious Area
99,001		40.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0300	0.12		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
1.1	150	0.0120	2.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	475	0.0100	5.26	6.46	Pipe Channel, RCP_Round 15" 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.013 Concrete pipe, bends & connections
0.3	180	0.0290	10.12	17.89	Pipe Channel, RCP_Round 18" 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.013 Concrete pipe, bends & connections
9.9	855	Total			

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 27

Subcatchment 4S: OS 1

Hydrograph

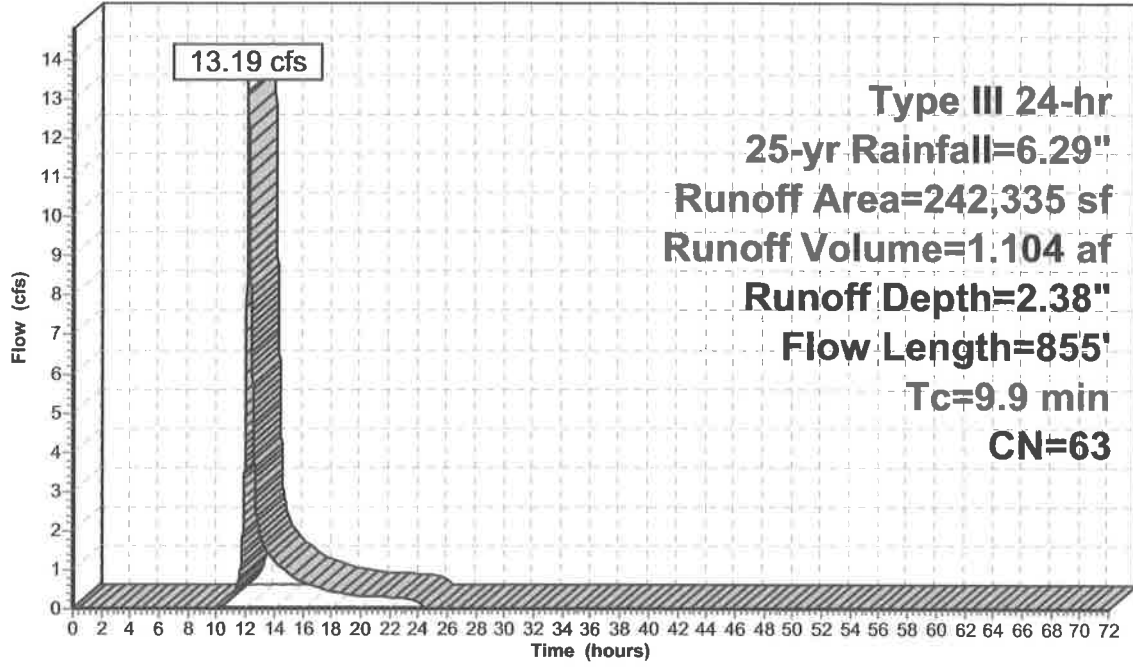

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 28

Summary for Reach 7R: offsite south


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 10.079 ac, 22.55% Impervious, Inflow Depth = 0.15" for 25-yr event
Inflow = 1.41 cfs @ 12.72 hrs, Volume= 0.124 af
Outflow = 1.41 cfs @ 12.72 hrs, Volume= 0.124 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Reach 7R: offsite south

Hydrograph

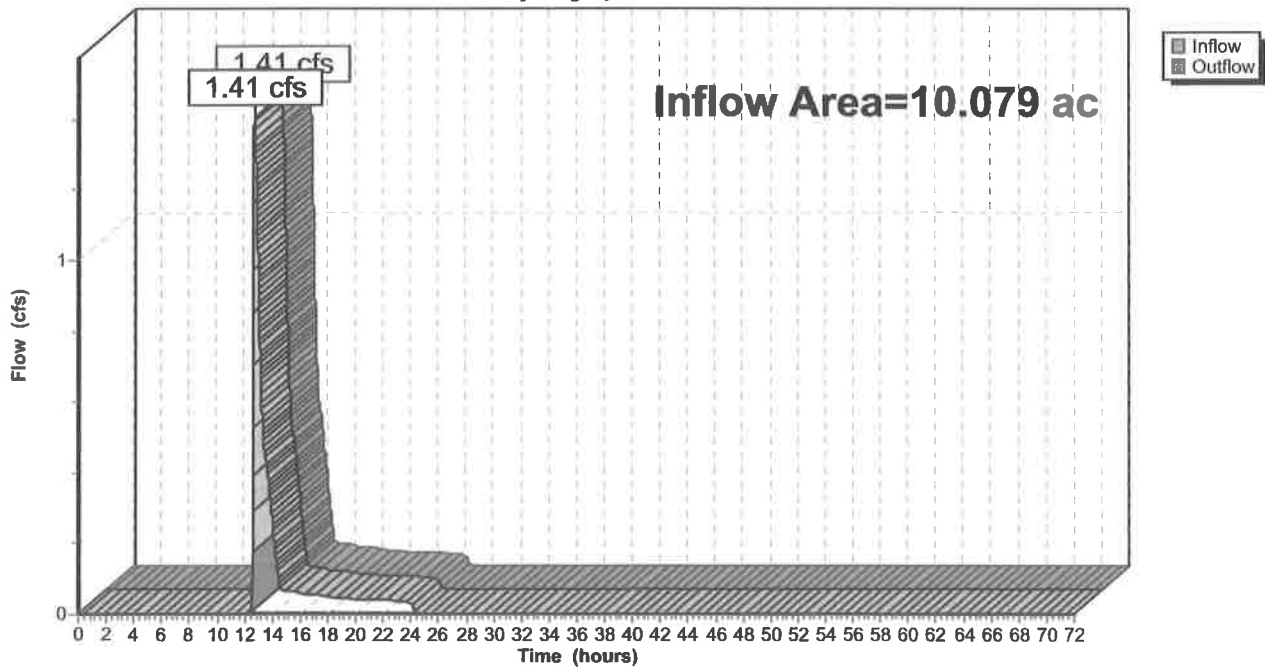

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 29

Summary for Pond 6P: Existing Basin

Inflow Area = 5.563 ac, 40.85% Impervious, Inflow Depth = 2.38" for 25-yr event
 Inflow = 13.19 cfs @ 12.15 hrs, Volume= 1.104 af
 Outflow = 2.52 cfs @ 12.72 hrs, Volume= 1.033 af, Atten= 81%, Lag= 34.2 min
 Discarded = 1.11 cfs @ 12.72 hrs, Volume= 0.948 af
 Primary = 1.41 cfs @ 12.72 hrs, Volume= 0.085 af
 Routed to Reach 7R : offsite south

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs / 3
 Peak Elev= 225.14' @ 12.72 hrs Surf.Area= 6,260 sf Storage= 20,614 cf

Plug-Flow detention time= 227.5 min calculated for 1.033 af (94% of inflow)
 Center-of-Mass det. time= 194.0 min (1,050.0 - 856.0)

Volume	Invert	Avail.Storage	Storage Description
#1	211.00'	111 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 467 cf Embedded = 279 cf x 40.0% Voids
#2	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder Inside #1
#3	211.00'	117 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 452 cf Embedded = 294 cf x 40.0% Voids
#4	211.50'	452 cf	8.00'D x 9.00'H Vertical Cone/Cylinder Inside #3
#5	210.50'	107 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 478 cf Embedded = 269 cf x 40.0% Voids
#6	210.50'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #5
#7	210.50'	123 cf	10.00'D x 10.00'H Vertical Cone/Cylinder 785 cf Overall - 478 cf Embedded = 308 cf x 40.0% Voids
#8	210.70'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #7
#9	211.00'	298 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall x 40.0% Voids
#10	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder
#11	220.50'	23,070 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,170 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
220.50	2,038	0	0
222.00	3,006	3,783	3,783
224.00	4,743	7,749	11,532
225.00	5,659	5,201	16,733
225.50	6,241	2,975	19,708
226.00	7,205	3,362	23,070

Device	Routing	Invert	Outlet Devices
#1	Discarded	220.49'	8.270 in/hr Exfiltration over Surface area above 220.49' Excluded Surface area = 443 sf
#2	Primary	225.00'	10.0' long + 4.0 ' SideZ x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 30

Discarded OutFlow Max=1.11 cfs @ 12.72 hrs HW=225.14' (Free Discharge)


↑1=Exfiltration (Exfiltration Controls 1.11 cfs)

Primary OutFlow Max=1.23 cfs @ 12.72 hrs HW=225.14' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 1.23 cfs @ 0.85 fps)

Pond 6P: Existing Basin

Hydrograph

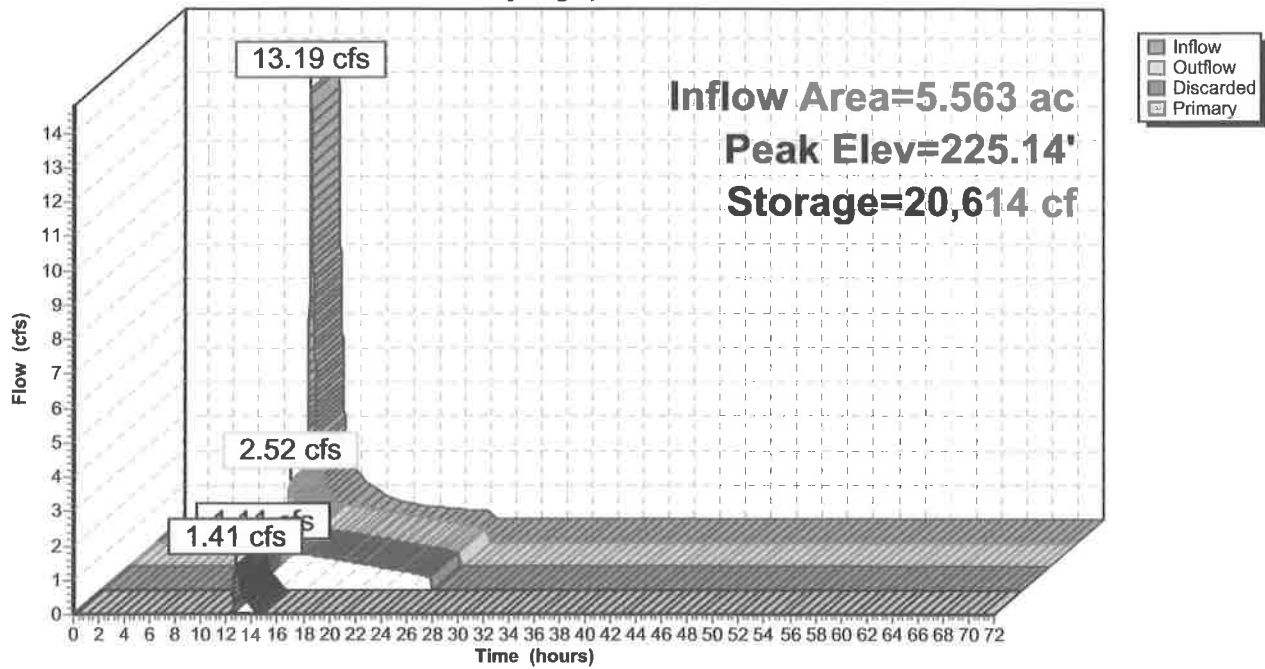

Existing 827

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 31

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: EX-1	Runoff Area=196,713 sf 0.00% Impervious Runoff Depth=0.32" Flow Length=682' Tc=13.7 min CN=30 Runoff=0.25 cfs 0.119 af
Subcatchment 2S: EX-2	Runoff Area=2,312 sf 0.00% Impervious Runoff Depth=0.32" Tc=6.0 min CN=30 Runoff=0.00 cfs 0.001 af
Subcatchment 3S: EX-3	Runoff Area=3,273 sf 0.00% Impervious Runoff Depth=0.32" Tc=6.0 min CN=30 Runoff=0.00 cfs 0.002 af
Subcatchment 4S: OS 1	Runoff Area=242,335 sf 40.85% Impervious Runoff Depth=3.31" Flow Length=855' Tc=9.9 min CN=63 Runoff=18.68 cfs 1.535 af
Reach 7R: offsite south	Inflow=8.80 cfs 0.516 af Outflow=8.80 cfs 0.516 af
Pond 6P: Existing Basin	Peak Elev=225.44' Storage=22,459 cf Inflow=18.68 cfs 1.535 af Discarded=1.18 cfs 1.066 af Primary=8.72 cfs 0.398 af Outflow=9.91 cfs 1.464 af

Total Runoff Area = 10.207 ac Runoff Volume = 1.657 af Average Runoff Depth = 1.95"
77.73% Pervious = 7.935 ac 22.27% Impervious = 2.273 ac

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 32

Summary for Subcatchment 1S: EX-1

Runoff = 0.25 cfs @ 12.59 hrs, Volume= 0.119 af, Depth= 0.32"
 Routed to Reach 7R : offsite south


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
196,713	30	Woods, Good, HSG A
196,713		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0830	0.12		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
6.7	632	0.1000	1.58		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
13.7	682	Total			

Subcatchment 1S: EX-1

Hydrograph

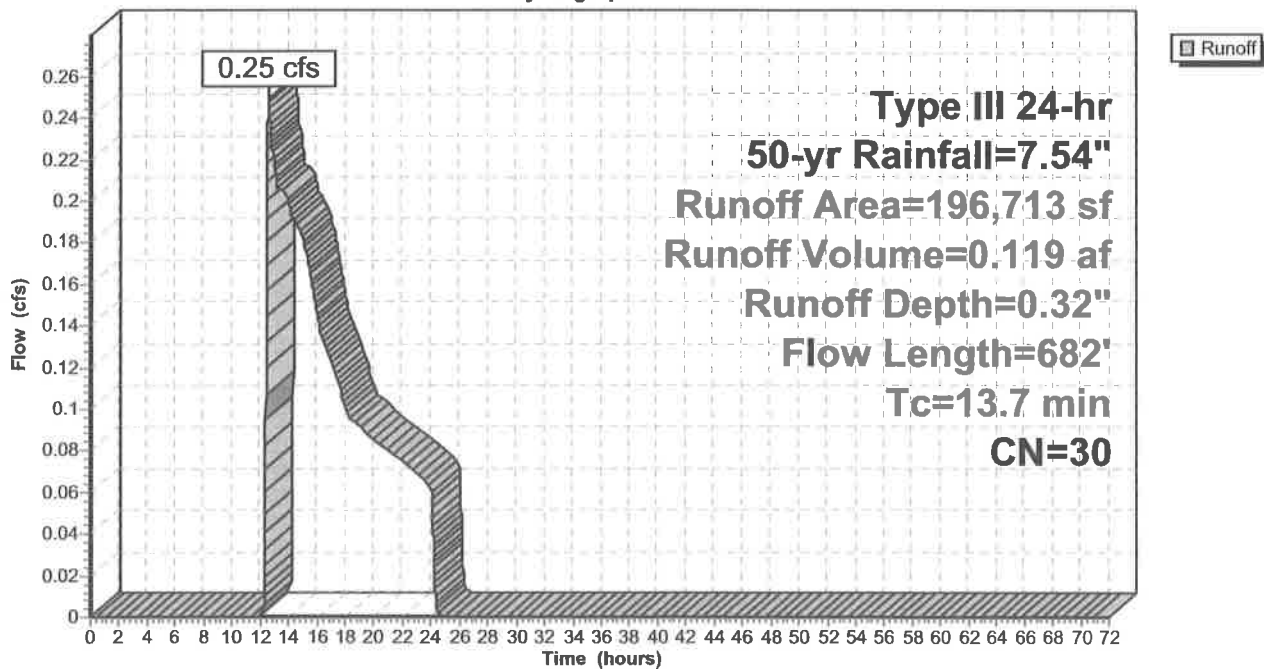

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 33

Summary for Subcatchment 2S: EX-2

Runoff = 0.00 cfs @ 12.47 hrs, Volume= 0.001 af, Depth= 0.32"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
2,312	30	Woods, Good, HSG A
2,312		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 2S: EX-2

Hydrograph

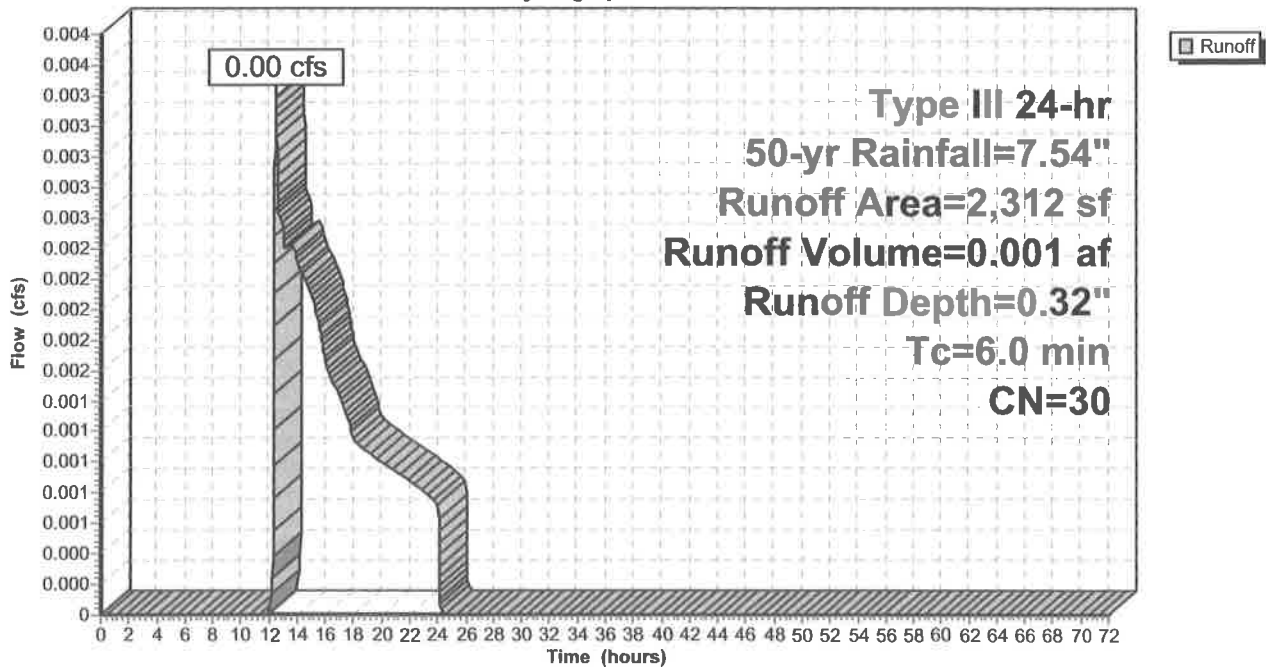

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 34

Summary for Subcatchment 3S: EX-3

Runoff = 0.00 cfs @ 12.47 hrs, Volume= 0.002 af, Depth= 0.32"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
3,273	30	Woods, Good, HSG A
3,273		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 3S: EX-3

Hydrograph

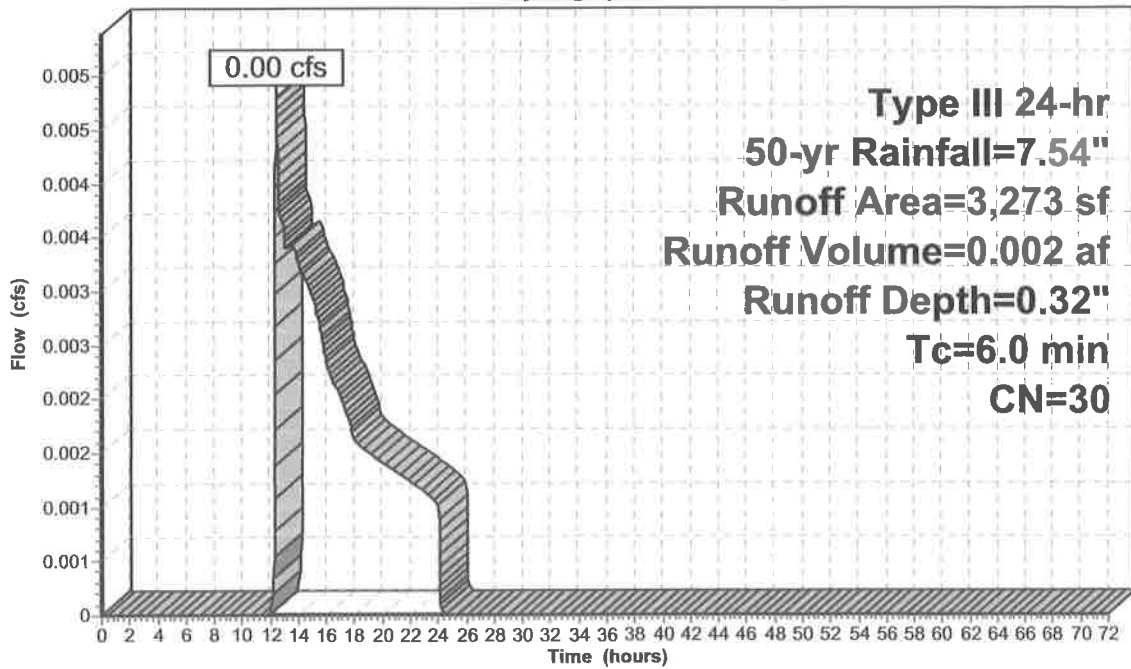

Existing 827

Prepared by Chessia Consulting Services LLC
 HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 35

Summary for Subcatchment 4S: OS 1

[47] Hint: Peak is 289% of capacity of segment #3

[47] Hint: Peak is 104% of capacity of segment #4

Runoff = 18.68 cfs @ 12.14 hrs, Volume= 1.535 af, Depth= 3.31"
 Routed to Pond 6P : Existing Basin

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
21,486	98	Roofs, HSG A
15,524	30	Woods, Good, HSG A
127,810	39	>75% Grass cover, Good, HSG A
* 6,241	98	Water Surface, HSG A Basin
71,274	98	Paved parking, HSG A
242,335	63	Weighted Average
143,334		59.15% Pervious Area
99,001		40.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0300	0.12		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
1.1	150	0.0120	2.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	475	0.0100	5.26	6.46	Pipe Channel, RCP_Round 15" 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.013 Concrete pipe, bends & connections
0.3	180	0.0290	10.12	17.89	Pipe Channel, RCP_Round 18" 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.013 Concrete pipe, bends & connections
9.9	855	Total			

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 36

Subcatchment 4S: OS 1

Hydrograph

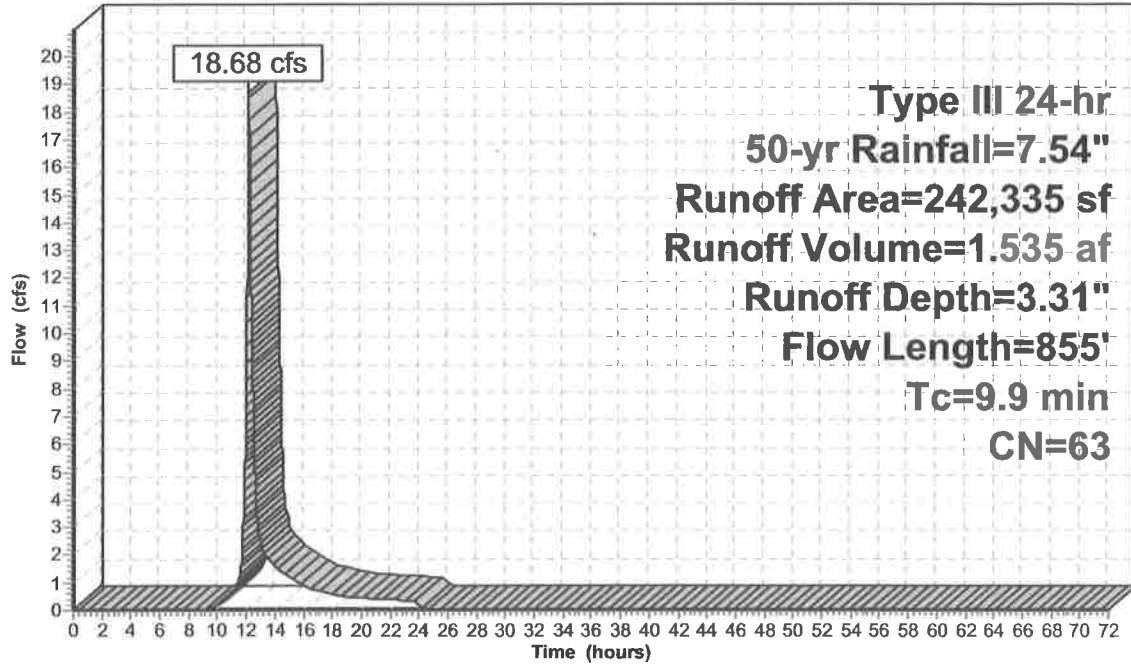

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 37

Summary for Reach 7R: offsite south


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 10.079 ac, 22.55% Impervious, Inflow Depth = 0.61" for 50-yr event
Inflow = 8.80 cfs @ 12.37 hrs, Volume= 0.516 af
Outflow = 8.80 cfs @ 12.37 hrs, Volume= 0.516 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Reach 7R: offsite south

Hydrograph

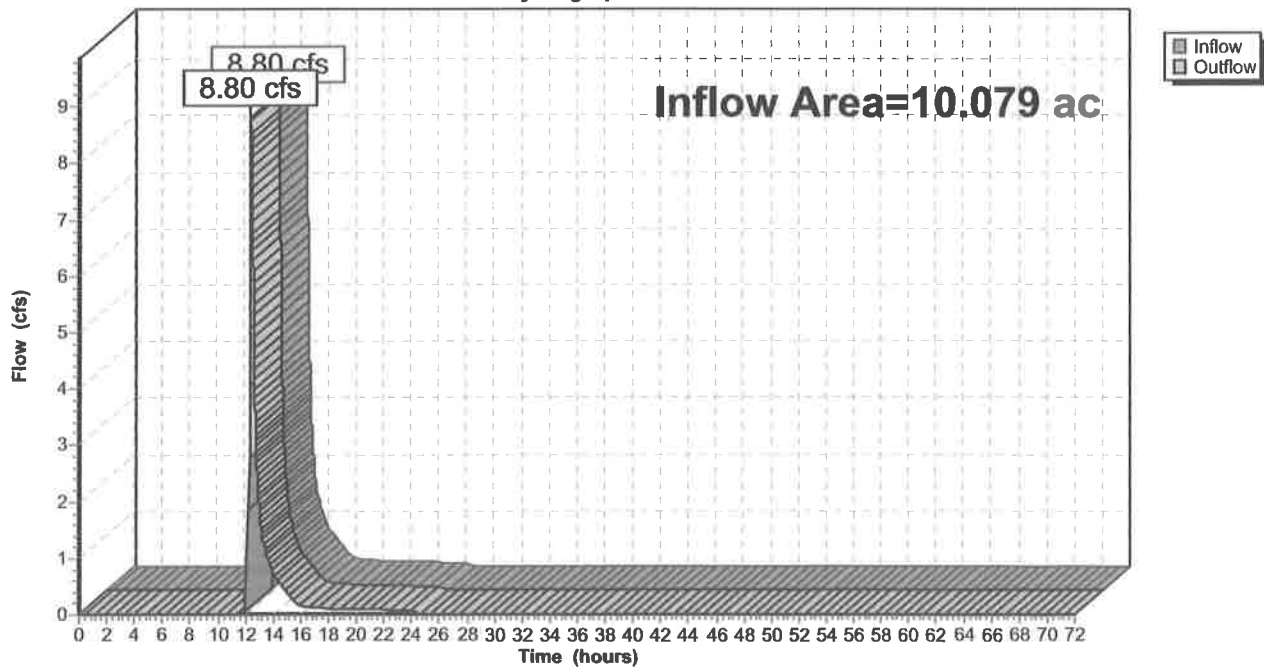

Existing 827

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 38

Summary for Pond 6P: Existing Basin

Inflow Area = 5.563 ac, 40.85% Impervious, Inflow Depth = 3.31" for 50-yr event
 Inflow = 18.68 cfs @ 12.14 hrs, Volume= 1.535 af
 Outflow = 9.91 cfs @ 12.37 hrs, Volume= 1.464 af, Atten= 47%, Lag= 13.6 min
 Discarded = 1.18 cfs @ 12.37 hrs, Volume= 1.066 af
 Primary = 8.72 cfs @ 12.37 hrs, Volume= 0.398 af
 Routed to Reach 7R : offsite south

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs / 3
 Peak Elev= 225.44' @ 12.37 hrs Surf.Area= 6,618 sf Storage= 22,459 cf

Plug-Flow detention time= 184.9 min calculated for 1.464 af (95% of inflow)
 Center-of-Mass det. time= 159.7 min (1,005.9 - 846.2)

Volume	Invert	Avail.Storage	Storage Description
#1	211.00'	111 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 467 cf Embedded = 279 cf x 40.0% Voids
#2	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder Inside #1
#3	211.00'	117 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 452 cf Embedded = 294 cf x 40.0% Voids
#4	211.50'	452 cf	8.00'D x 9.00'H Vertical Cone/Cylinder Inside #3
#5	210.50'	107 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 478 cf Embedded = 269 cf x 40.0% Voids
#6	210.50'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #5
#7	210.50'	123 cf	10.00'D x 10.00'H Vertical Cone/Cylinder 785 cf Overall - 478 cf Embedded = 308 cf x 40.0% Voids
#8	210.70'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #7
#9	211.00'	298 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall x 40.0% Voids
#10	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder
#11	220.50'	23,070 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,170 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
220.50	2,038	0	0
222.00	3,006	3,783	3,783
224.00	4,743	7,749	11,532
225.00	5,659	5,201	16,733
225.50	6,241	2,975	19,708
226.00	7,205	3,362	23,070

Device	Routing	Invert	Outlet Devices
#1	Discarded	220.49'	8.270 in/hr Exfiltration over Surface area above 220.49' Excluded Surface area = 443 sf
#2	Primary	225.00'	10.0' long + 4.0 ' SideZ x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 39

Discarded OutFlow Max=1.18 cfs @ 12.37 hrs HW=225.44' (Free Discharge)


↑1=Exfiltration (Exfiltration Controls 1.18 cfs)

Primary OutFlow Max=8.59 cfs @ 12.37 hrs HW=225.44' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 8.59 cfs @ 1.64 fps)

Pond 6P: Existing Basin

Hydrograph

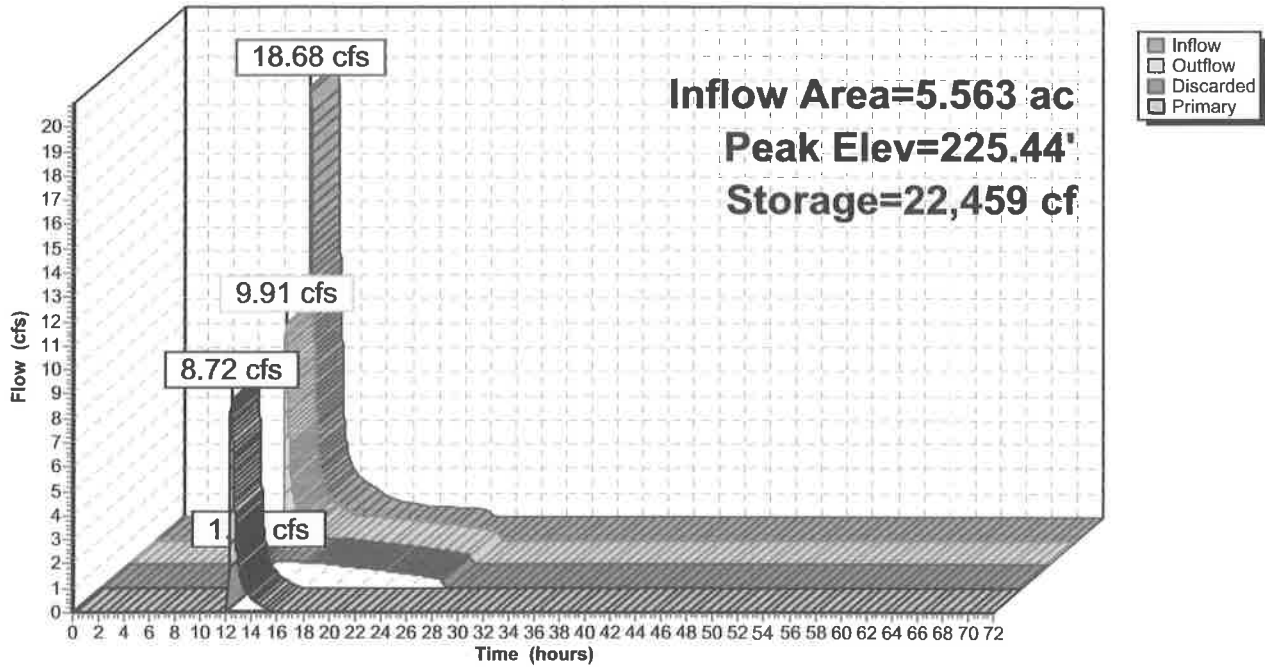

Existing 827

Type III 24-hr 100-yr Rainfall=9.06"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 40

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: EX-1

Runoff Area=196,713 sf 0.00% Impervious Runoff Depth=0.70"
Flow Length=682' Tc=13.7 min CN=30 Runoff=1.18 cfs 0.262 af

Subcatchment 2S: EX-2

Runoff Area=2,312 sf 0.00% Impervious Runoff Depth=0.70"
Tc=6.0 min CN=30 Runoff=0.02 cfs 0.003 af

Subcatchment 3S: EX-3

Runoff Area=3,273 sf 0.00% Impervious Runoff Depth=0.70"
Tc=6.0 min CN=30 Runoff=0.02 cfs 0.004 af

Subcatchment 4S: OS 1

Runoff Area=242,335 sf 40.85% Impervious Runoff Depth=4.52"
Flow Length=855' Tc=9.9 min CN=63 Runoff=25.75 cfs 2.095 af

Reach 7R: offsite south

Inflow=19.72 cfs 1.094 af
Outflow=19.72 cfs 1.094 af

Pond 6P: Existing Basin

Peak Elev=225.70' Storage=24,073 cf Inflow=25.75 cfs 2.095 af
Discarded=1.27 cfs 1.193 af Primary=19.15 cfs 0.832 af Outflow=20.42 cfs 2.024 af

Total Runoff Area = 10.207 ac Runoff Volume = 2.365 af Average Runoff Depth = 2.78"
77.73% Pervious = 7.935 ac 22.27% Impervious = 2.273 ac

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 41

Summary for Subcatchment 1S: EX-1

Runoff = 1.18 cfs @ 12.46 hrs, Volume= 0.262 af, Depth= 0.70"
Routed to Reach 7R : offsite south


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
196,713	30	Woods, Good, HSG A
196,713		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0830	0.12		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
6.7	632	0.1000	1.58		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
13.7	682	Total			

Subcatchment 1S: EX-1

Hydrograph

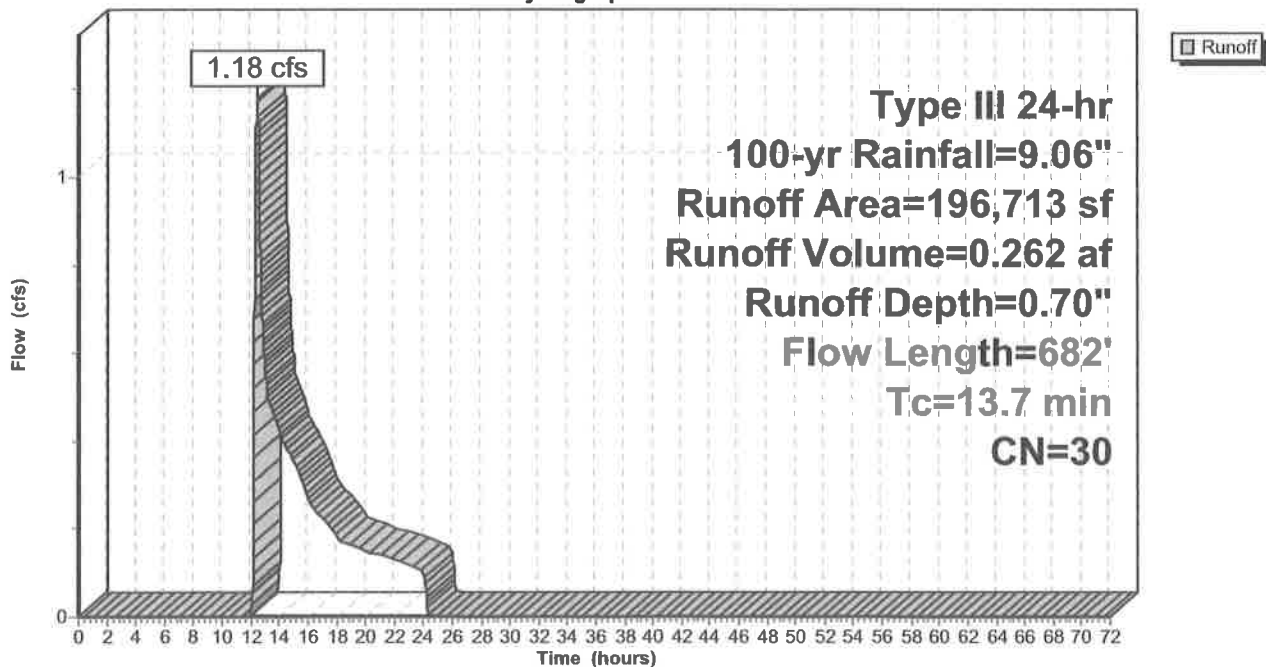

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 42

Summary for Subcatchment 2S: EX-2

Runoff = 0.02 cfs @ 12.34 hrs, Volume= 0.003 af, Depth= 0.70"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
2,312	30	Woods, Good, HSG A
2,312		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 2S: EX-2

Hydrograph

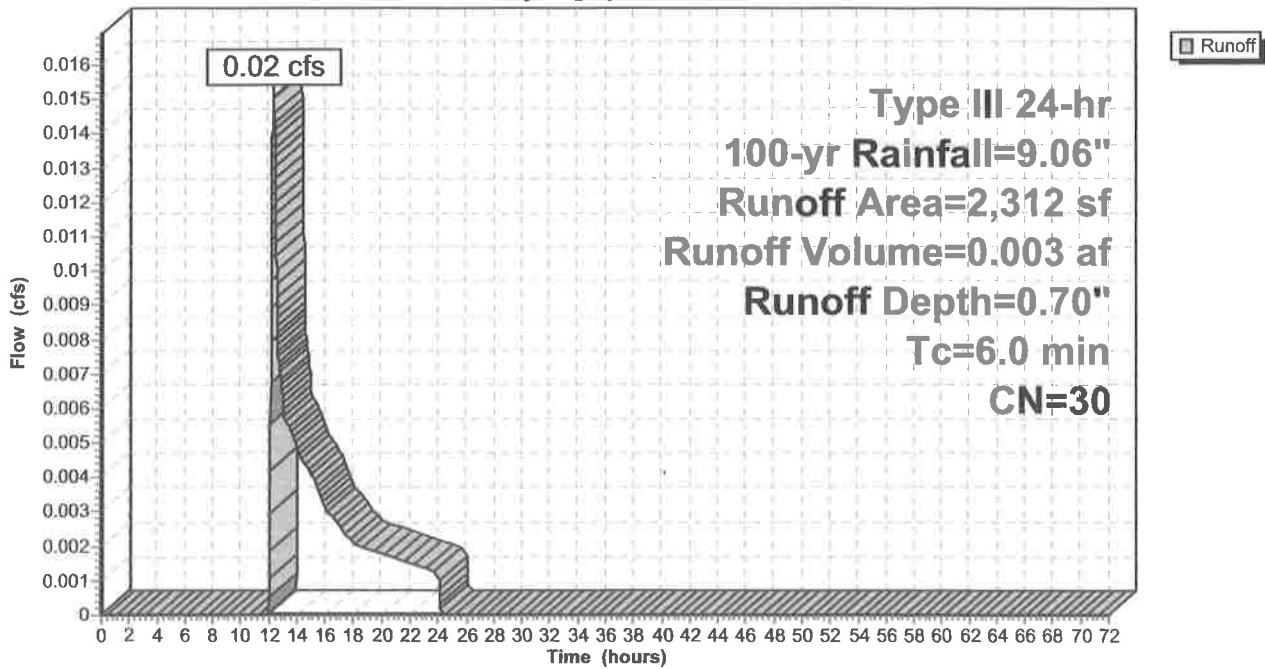

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 43

Summary for Subcatchment 3S: EX-3

Runoff = 0.02 cfs @ 12.34 hrs, Volume= 0.004 af, Depth= 0.70"


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
3,273	30	Woods, Good, HSG A
3,273		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 3S: EX-3

Hydrograph

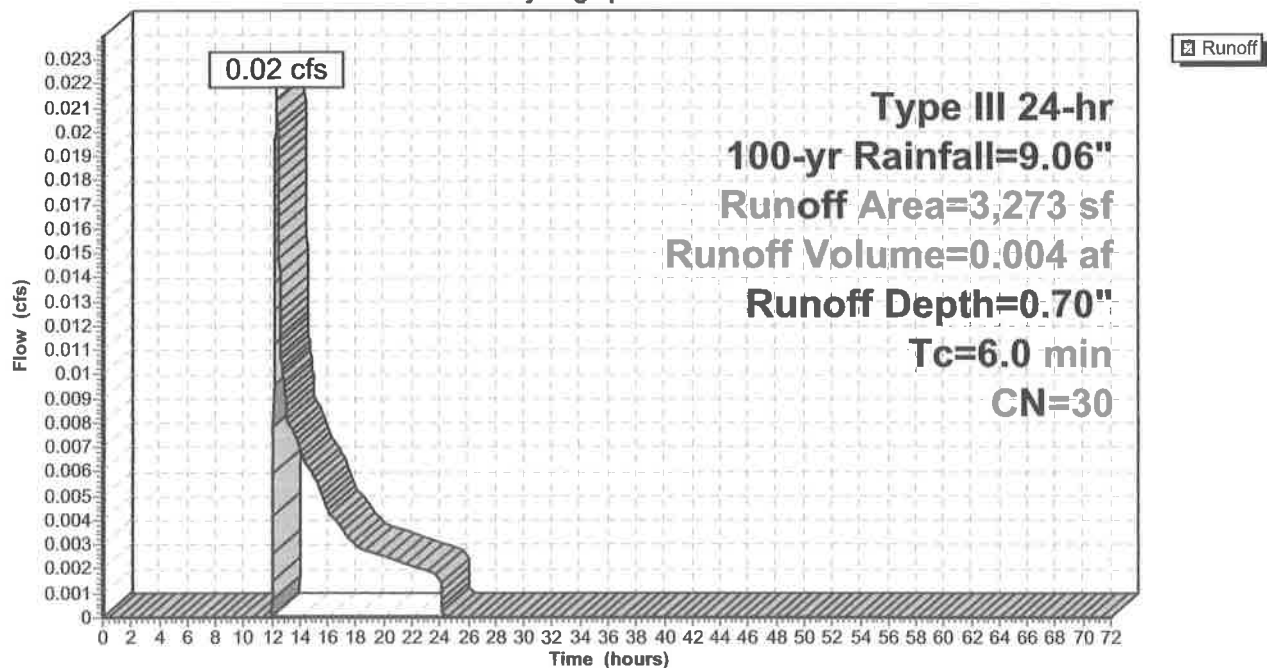

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 44

Summary for Subcatchment 4S: OS 1

[47] Hint: Peak is 399% of capacity of segment #3

[47] Hint: Peak is 144% of capacity of segment #4

Runoff = 25.75 cfs @ 12.14 hrs, Volume= 2.095 af, Depth= 4.52"
 Routed to Pond 6P : Existing Basin

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
21,486	98	Roofs, HSG A
15,524	30	Woods, Good, HSG A
127,810	39	>75% Grass cover, Good, HSG A
* 6,241	98	Water Surface, HSG A Basin
71,274	98	Paved parking, HSG A
242,335	63	Weighted Average
143,334		59.15% Pervious Area
99,001		40.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0300	0.12		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
1.1	150	0.0120	2.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	475	0.0100	5.26	6.46	Pipe Channel, RCP_Round 15" 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.013 Concrete pipe, bends & connections
0.3	180	0.0290	10.12	17.89	Pipe Channel, RCP_Round 18" 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.013 Concrete pipe, bends & connections
9.9	855	Total			

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 45

Subcatchment 4S: OS 1

Hydrograph

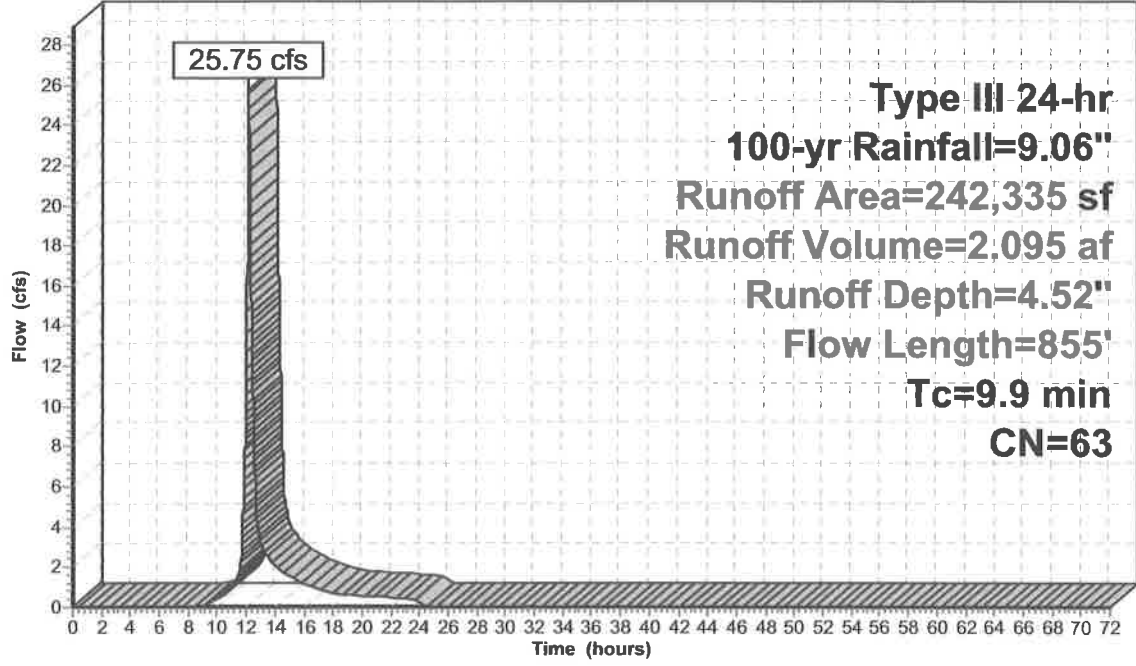

Runoff

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 46

Summary for Reach 7R: offsite south


[40] Hint: Not Described (Outflow=Inflow)

Inflow Area = 10.079 ac, 22.55% Impervious, Inflow Depth = 1.30" for 100-yr event
Inflow = 19.72 cfs @ 12.23 hrs, Volume= 1.094 af
Outflow = 19.72 cfs @ 12.23 hrs, Volume= 1.094 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Reach 7R: offsite south

Hydrograph

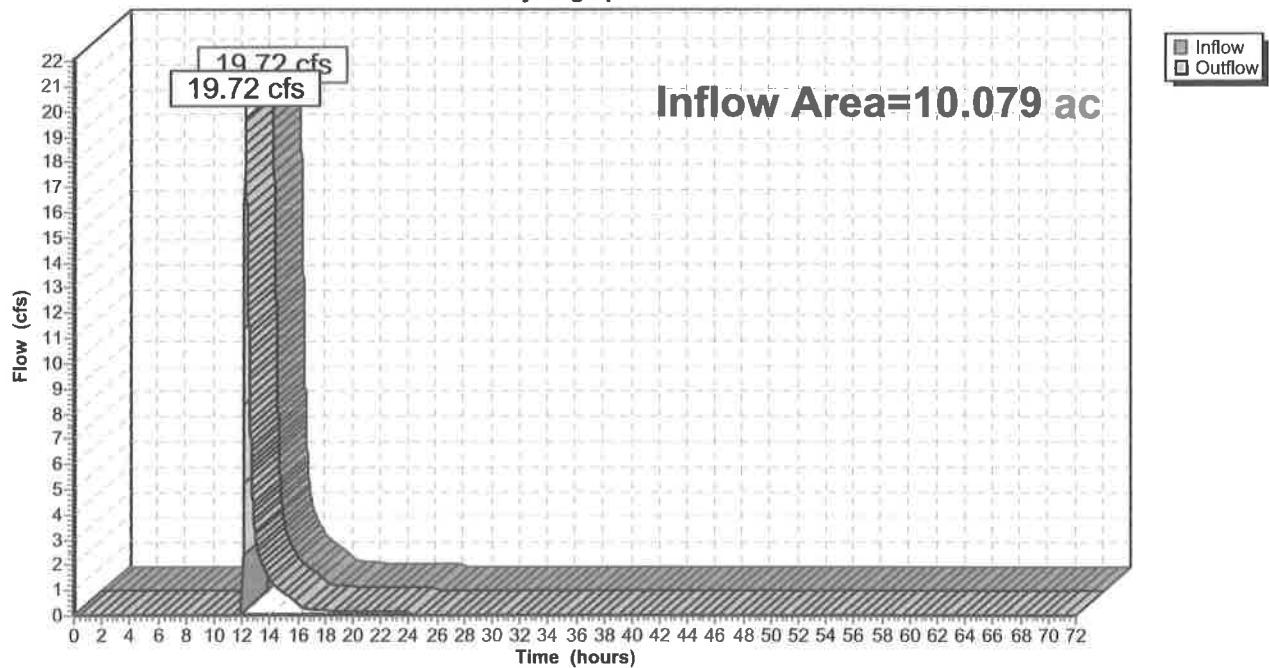

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 47

Summary for Pond 6P: Existing Basin

Inflow Area = 5.563 ac, 40.85% Impervious, Inflow Depth = 4.52" for 100-yr event
 Inflow = 25.75 cfs @ 12.14 hrs, Volume= 2.095 af
 Outflow = 20.42 cfs @ 12.23 hrs, Volume= 2.024 af, Atten= 21%, Lag= 5.2 min
 Discarded = 1.27 cfs @ 12.23 hrs, Volume= 1.193 af
 Primary = 19.15 cfs @ 12.23 hrs, Volume= 0.832 af
 Routed to Reach 7R : offsite south

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs / 3
 Peak Elev= 225.70' @ 12.23 hrs Surf.Area= 7,063 sf Storage= 24,073 cf

Plug-Flow detention time= 151.6 min calculated for 2.024 af (97% of inflow)
 Center-of-Mass det. time= 132.5 min (969.6 - 837.2)

Volume	Invert	Avail.Storage	Storage Description
#1	211.00'	111 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 467 cf Embedded = 279 cf x 40.0% Voids
#2	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder Inside #1
#3	211.00'	117 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 452 cf Embedded = 294 cf x 40.0% Voids
#4	211.50'	452 cf	8.00'D x 9.00'H Vertical Cone/Cylinder Inside #3
#5	210.50'	107 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 478 cf Embedded = 269 cf x 40.0% Voids
#6	210.50'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #5
#7	210.50'	123 cf	10.00'D x 10.00'H Vertical Cone/Cylinder 785 cf Overall - 478 cf Embedded = 308 cf x 40.0% Voids
#8	210.70'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #7
#9	211.00'	298 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall x 40.0% Voids
#10	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder
#11	220.50'	23,070 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,170 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
220.50	2,038	0	0
222.00	3,006	3,783	3,783
224.00	4,743	7,749	11,532
225.00	5,659	5,201	16,733
225.50	6,241	2,975	19,708
226.00	7,205	3,362	23,070

Device	Routing	Invert	Outlet Devices
#1	Discarded	220.49'	8.270 in/hr Exfiltration over Surface area above 220.49' Excluded Surface area = 443 sf
#2	Primary	225.00'	10.0' long + 4.0 ' SideZ x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

Existing 827

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 48

Discarded OutFlow Max=1.27 cfs @ 12.23 hrs HW=225.70' (Free Discharge)


↑1=Exfiltration (Exfiltration Controls 1.27 cfs)

Primary OutFlow Max=19.11 cfs @ 12.23 hrs HW=225.70' (Free Discharge)



↑2=Broad-Crested Rectangular Weir (Weir Controls 19.11 cfs @ 2.15 fps)

Pond 6P: Existing Basin

Hydrograph

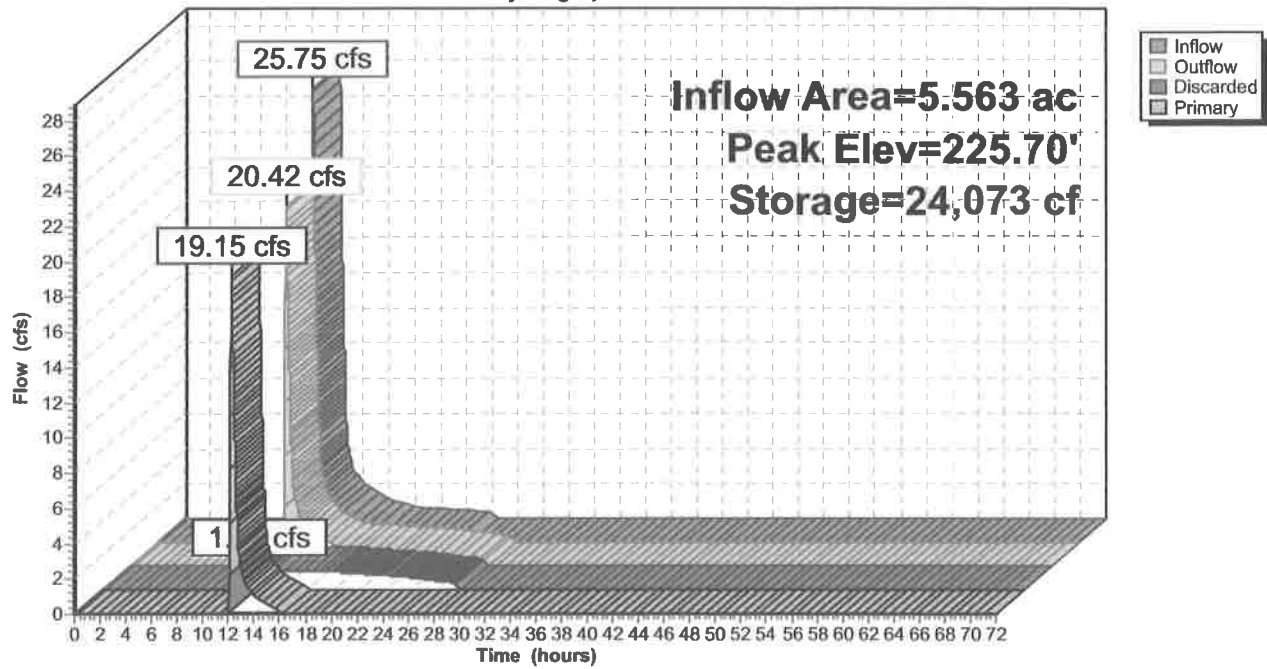

APPENDIX III

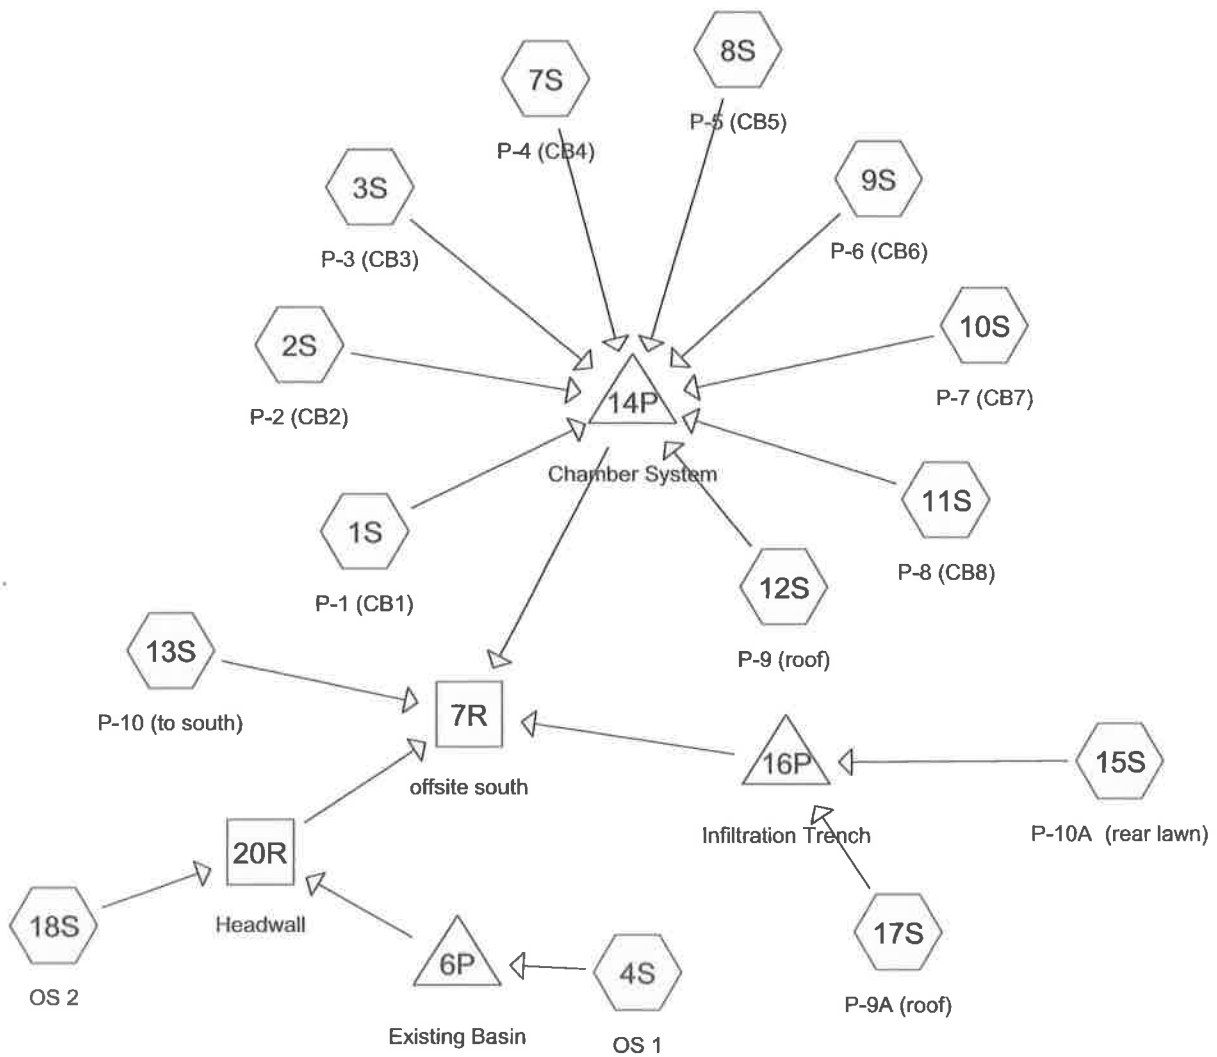

Routing Diagram for proposed 12-8-23
 Prepared by Chessia Consulting Services LLC, Printed 12/13/2023
 HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Printed 12/13/2023

Page 2

Rainfall Events Listing

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	2-yr	Type III 24-hr		Default	24.00	1	3.27	2
2	10-yr	Type III 24-hr		Default	24.00	1	4.96	2
3	25-yr	Type III 24-hr		Default	24.00	1	6.29	2
4	50-yr	Type III 24-hr		Default	24.00	1	7.54	2
5	100-yr	Type III 24-hr		Default	24.00	1	9.06	2

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
4.515	39	>75% Grass cover, Good, HSG A (1S, 2S, 3S, 4S, 7S, 8S, 9S, 10S, 11S, 13S, 15S)
0.165	30	Meadow, non-grazed, HSG A (15S)
2.421	98	Paved parking, HSG A (1S, 2S, 3S, 4S, 7S, 8S, 9S)
1.265	98	Roofs, HSG A (4S, 12S, 17S)
0.022	98	Water Surface, HSG A (15S)
0.143	98	Water Surface, HSG A Basin (4S)
1.677	30	Woods, Good, HSG A (4S, 10S, 13S, 18S)
10.207	60	TOTAL AREA

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 4

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: P-1 (CB1)	Runoff Area=3,398 sf 66.27% Impervious Runoff Depth=1.32" Tc=6.0 min CN=78 Runoff=0.12 cfs 0.009 af
Subcatchment 2S: P-2 (CB2)	Runoff Area=1,896 sf 84.86% Impervious Runoff Depth=2.15" Tc=6.0 min CN=89 Runoff=0.11 cfs 0.008 af
Subcatchment 3S: P-3 (CB3)	Runoff Area=9,124 sf 89.35% Impervious Runoff Depth=2.42" Tc=6.0 min CN=92 Runoff=0.58 cfs 0.042 af
Subcatchment 4S: OS 1	Runoff Area=242,335 sf 40.85% Impervious Runoff Depth=0.55" Flow Length=855' Tc=9.9 min CN=63 Runoff=2.27 cfs 0.255 af
Subcatchment 7S: P-4 (CB4)	Runoff Area=17,772 sf 65.10% Impervious Runoff Depth=1.26" Tc=6.0 min CN=77 Runoff=0.59 cfs 0.043 af
Subcatchment 8S: P-5 (CB5)	Runoff Area=5,781 sf 64.57% Impervious Runoff Depth=1.26" Tc=6.0 min CN=77 Runoff=0.19 cfs 0.014 af
Subcatchment 9S: P-6 (CB6)	Runoff Area=11,883 sf 57.73% Impervious Runoff Depth=1.03" Tc=6.0 min CN=73 Runoff=0.31 cfs 0.023 af
Subcatchment 10S: P-7 (CB7)	Runoff Area=13,474 sf 0.00% Impervious Runoff Depth=0.00" Tc=6.0 min CN=36 Runoff=0.00 cfs 0.000 af
Subcatchment 11S: P-8 (CB8)	Runoff Area=22,491 sf 0.00% Impervious Runoff Depth=0.00" Tc=6.0 min CN=39 Runoff=0.00 cfs 0.000 af
Subcatchment 12S: P-9 (roof)	Runoff Area=27,632 sf 100.00% Impervious Runoff Depth=3.04" Tc=6.0 min CN=98 Runoff=2.01 cfs 0.161 af
Subcatchment 13S: P-10 (to south)	Runoff Area=15,401 sf 0.00% Impervious Runoff Depth=0.00" Flow Length=145' Tc=8.4 min CN=35 Runoff=0.00 cfs 0.000 af
Subcatchment 15S: P-10A (rear lawn)	Runoff Area=21,516 sf 4.43% Impervious Runoff Depth=0.00" Tc=6.0 min CN=39 Runoff=0.00 cfs 0.000 af
Subcatchment 17S: P-9A (roof)	Runoff Area=6,000 sf 100.00% Impervious Runoff Depth=3.04" Tc=6.0 min CN=98 Runoff=0.44 cfs 0.035 af
Subcatchment 18S: OS 2	Runoff Area=45,929 sf 0.00% Impervious Runoff Depth=0.00" Flow Length=333' Slope=0.0700 '/' Tc=11.1 min CN=30 Runoff=0.00 cfs 0.000 af
Reach 7R: offsite south	Inflow=0.00 cfs 0.000 af Outflow=0.00 cfs 0.000 af
Reach 20R: Headwall	Avg. Flow Depth=0.00' Max Vel=0.00 fps Inflow=0.00 cfs 0.000 af 24.0" Round Pipe n=0.012 L=311.0' S=0.0450 '/' Capacity=52.00 cfs Outflow=0.00 cfs 0.000 af

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 5

Pond 6P: Existing Basin

Peak Elev=220.76' Storage=3,654 cf Inflow=2.27 cfs 0.255 af
Discarded=0.42 cfs 0.184 af Primary=0.00 cfs 0.000 af Outflow=0.42 cfs 0.184 af

Pond 14P: Chamber System

Peak Elev=209.69' Storage=0.049 af Inflow=3.91 cfs 0.299 af
Discarded=1.21 cfs 0.299 af Primary=0.00 cfs 0.000 af Outflow=1.21 cfs 0.299 af

Pond 16P: Infiltration Trench

Peak Elev=195.43' Storage=162 cf Inflow=0.44 cfs 0.035 af
Outflow=0.18 cfs 0.035 af

Total Runoff Area = 10.207 ac Runoff Volume = 0.590 af Average Runoff Depth = 0.69"
62.27% Pervious = 6.356 ac 37.73% Impervious = 3.851 ac

proposed 12-8-23

Type III 24-hr 2-yr Rainfall=3.27"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 6

Summary for Subcatchment 1S: P-1 (CB1)

Runoff = 0.12 cfs @ 12.09 hrs, Volume= 0.009 af, Depth= 1.32"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
2,252	98	Paved parking, HSG A
1,146	39	>75% Grass cover, Good, HSG A
3,398	78	Weighted Average
1,146		33.73% Pervious Area
2,252		66.27% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 1S: P-1 (CB1)

Hydrograph

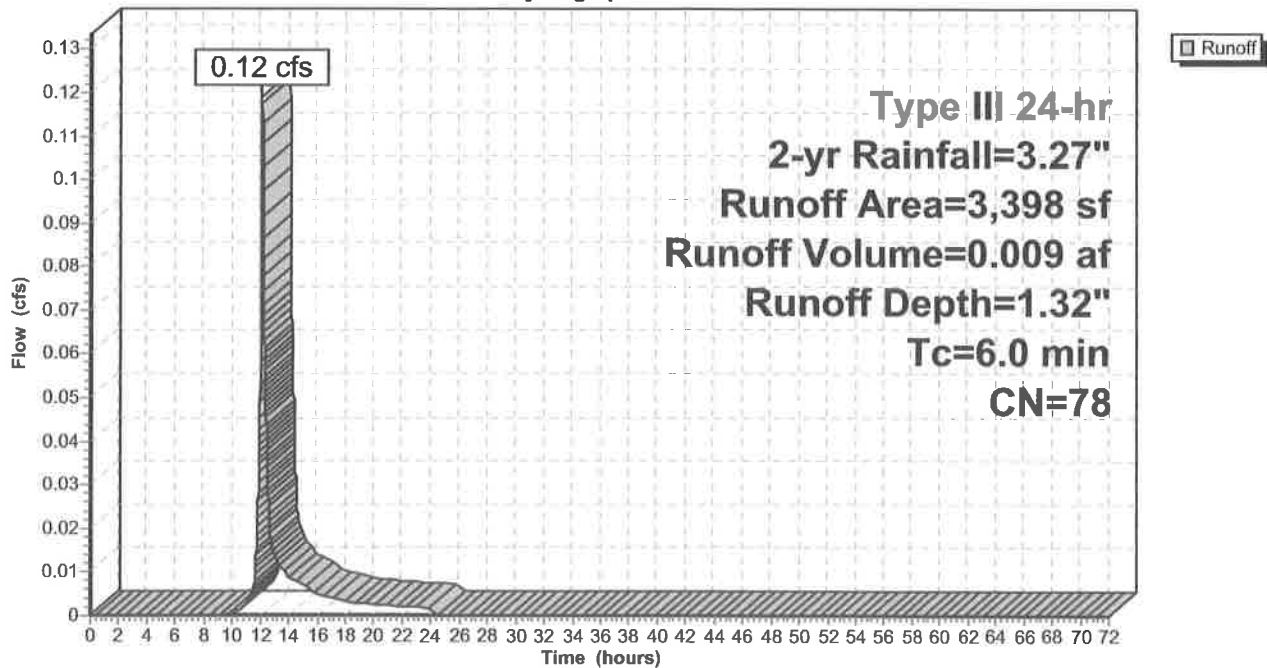

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 7

Summary for Subcatchment 2S: P-2 (CB2)

Runoff = 0.11 cfs @ 12.09 hrs, Volume= 0.008 af, Depth= 2.15"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
1,609	98	Paved parking, HSG A
287	39	>75% Grass cover, Good, HSG A
1,896	89	Weighted Average
287		15.14% Pervious Area
1,609		84.86% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 2S: P-2 (CB2)

Hydrograph

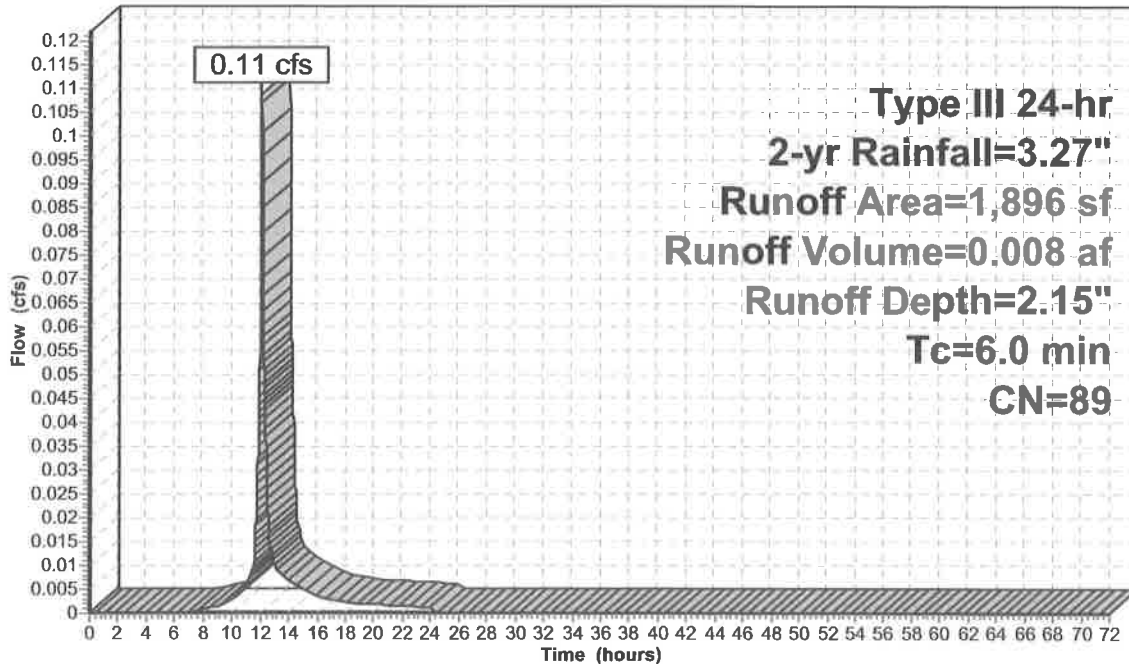

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 8

Summary for Subcatchment 3S: P-3 (CB3)

Runoff = 0.58 cfs @ 12.09 hrs, Volume= 0.042 af, Depth= 2.42"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
8,152	98	Paved parking, HSG A
972	39	>75% Grass cover, Good, HSG A
9,124	92	Weighted Average
972		10.65% Pervious Area
8,152		89.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 3S: P-3 (CB3)

Hydrograph

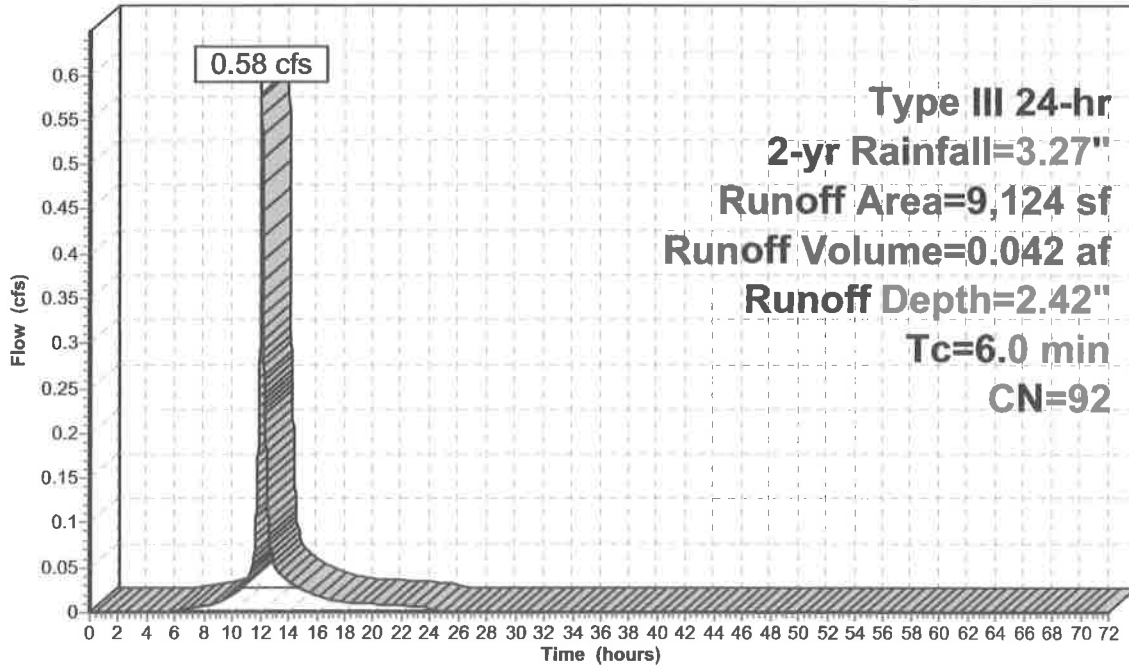

Runoff

proposed 12-8-23

Type III 24-hr 2-yr Rainfall=3.27"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 9

Summary for Subcatchment 4S: OS 1

Runoff = 2.27 cfs @ 12.17 hrs, Volume= 0.255 af, Depth= 0.55"
Routed to Pond 6P : Existing Basin

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
21,486	98	Roofs, HSG A
15,524	30	Woods, Good, HSG A
127,810	39	>75% Grass cover, Good, HSG A
* 6,241	98	Water Surface, HSG A Basin
71,274	98	Paved parking, HSG A
242,335	63	Weighted Average
143,334		59.15% Pervious Area
99,001		40.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0300	0.12		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
1.1	150	0.0120	2.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	475	0.0100	5.26	6.46	Pipe Channel, RCP_Round 15" 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.013 Concrete pipe, bends & connections
0.3	180	0.0280	9.95	17.58	Pipe Channel, RCP_Round 18" 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.013
9.9	855	Total			

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 10

Subcatchment 4S: OS 1

Hydrograph

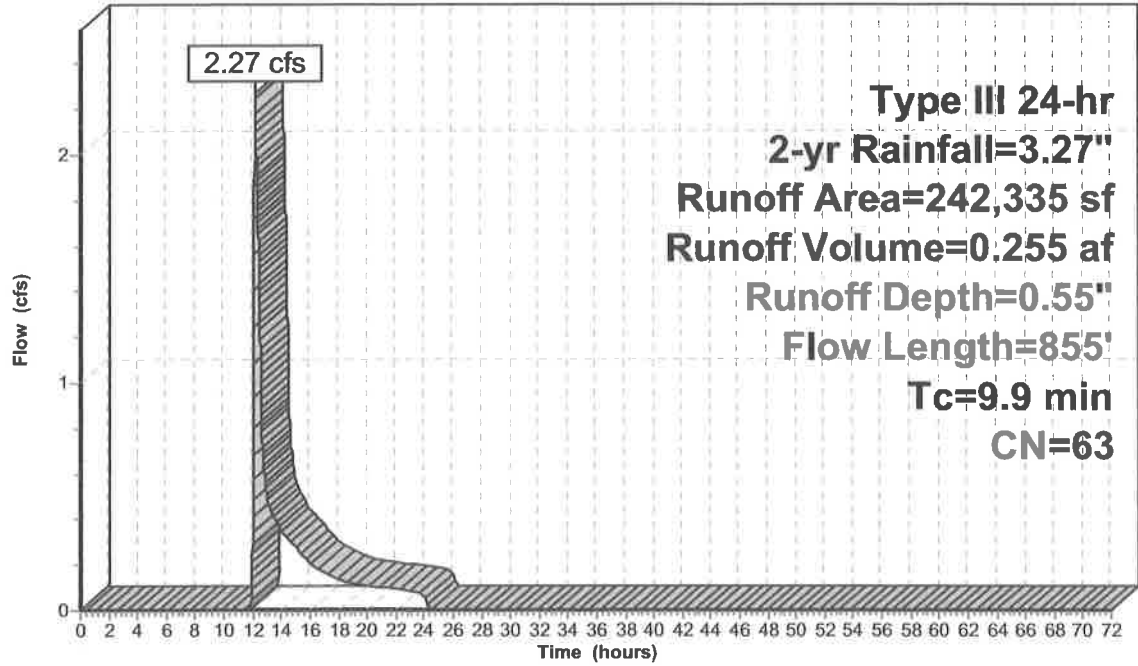

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 11

Summary for Subcatchment 7S: P-4 (CB4)

Runoff = 0.59 cfs @ 12.09 hrs, Volume= 0.043 af, Depth= 1.26"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
11,570	98	Paved parking, HSG A
6,202	39	>75% Grass cover, Good, HSG A
17,772	77	Weighted Average
6,202		34.90% Pervious Area
11,570		65.10% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 7S: P-4 (CB4)

Hydrograph

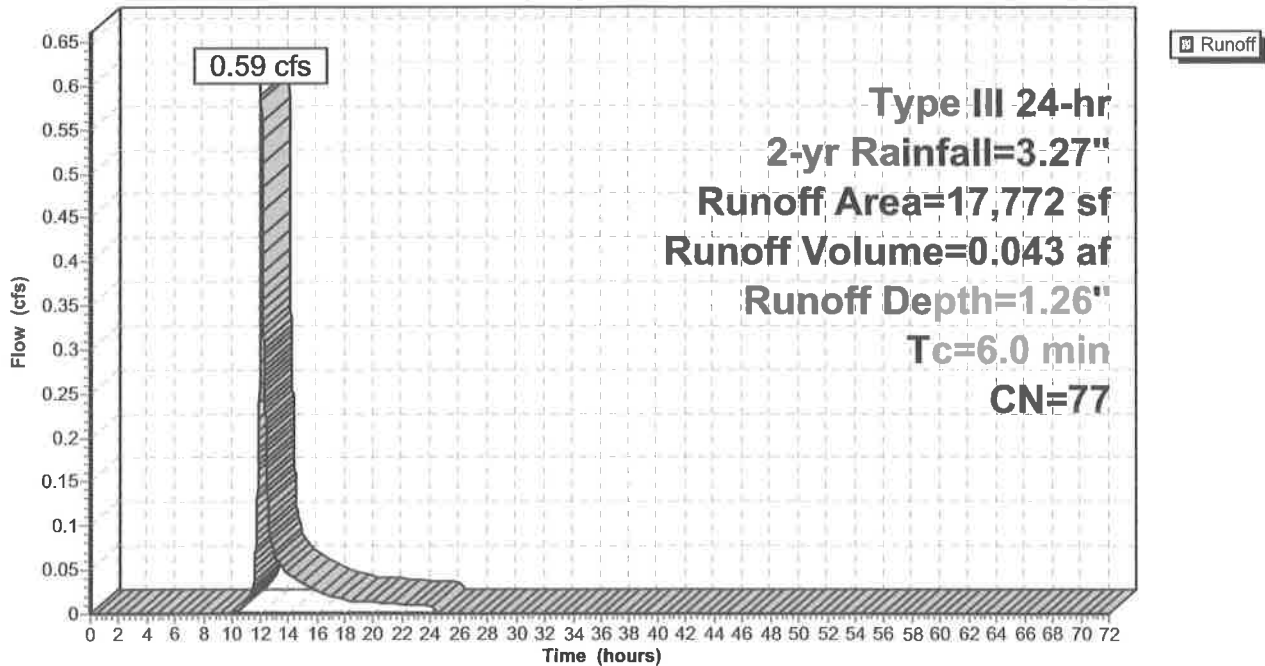

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 12

Summary for Subcatchment 8S: P-5 (CB5)

Runoff = 0.19 cfs @ 12.09 hrs, Volume= 0.014 af, Depth= 1.26"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
3,733	98	Paved parking, HSG A
2,048	39	>75% Grass cover, Good, HSG A
5,781	77	Weighted Average
2,048		35.43% Pervious Area
3,733		64.57% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 8S: P-5 (CB5)

Hydrograph

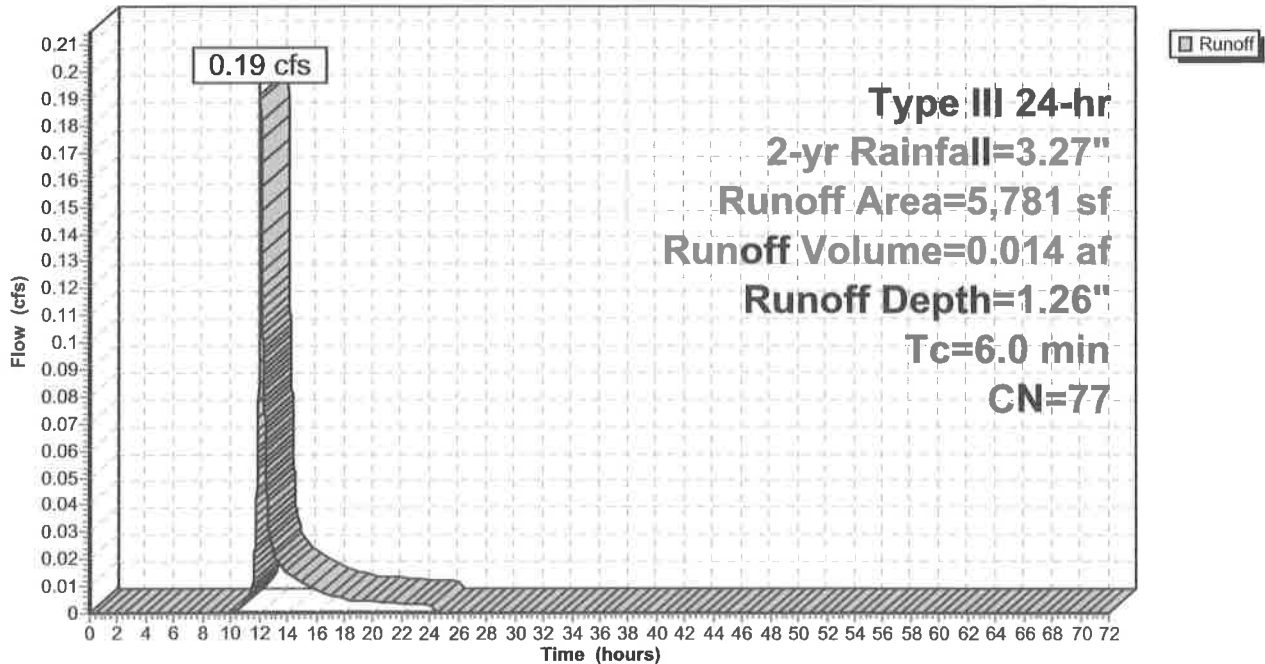

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 13

Summary for Subcatchment 9S: P-6 (CB6)

Runoff = 0.31 cfs @ 12.10 hrs, Volume= 0.023 af, Depth= 1.03"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
6,860	98	Paved parking, HSG A
5,023	39	>75% Grass cover, Good, HSG A
11,883	73	Weighted Average
5,023		42.27% Pervious Area
6,860		57.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 9S: P-6 (CB6)

Hydrograph

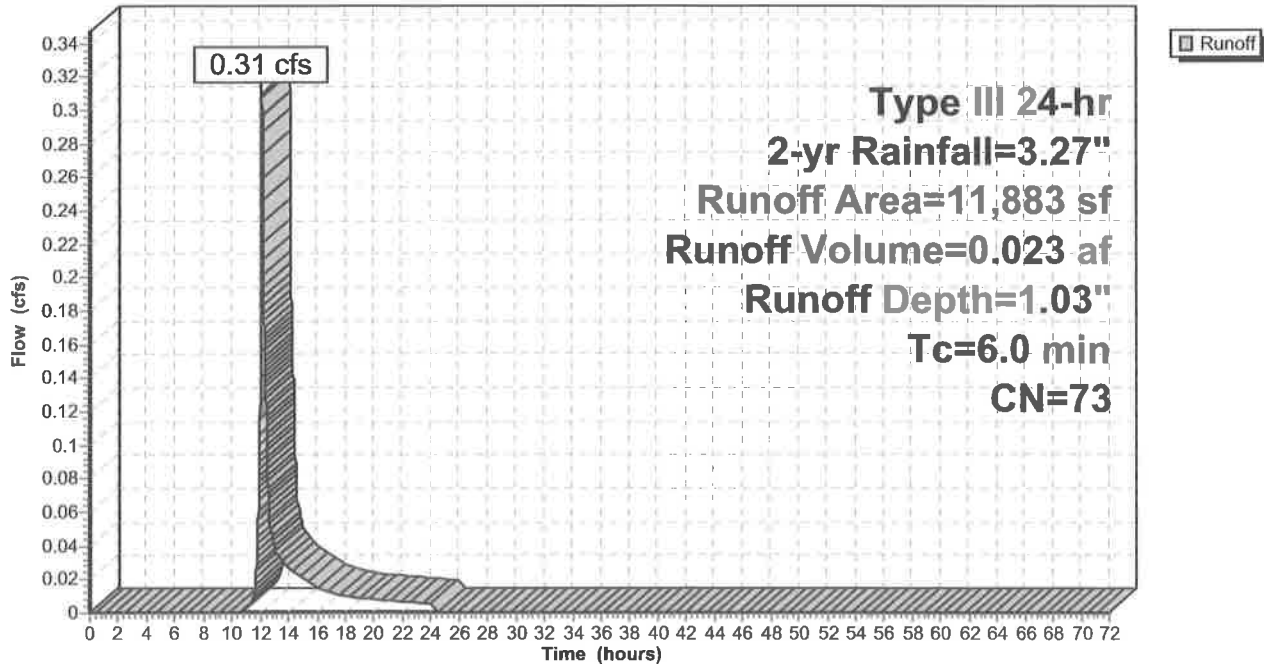

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 14

Summary for Subcatchment 10S: P-7 (CB7)

Runoff = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Depth= 0.00"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
8,914	39	>75% Grass cover, Good, HSG A
4,560	30	Woods, Good, HSG A
13,474	36	Weighted Average
13,474		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 10S: P-7 (CB7)

Hydrograph

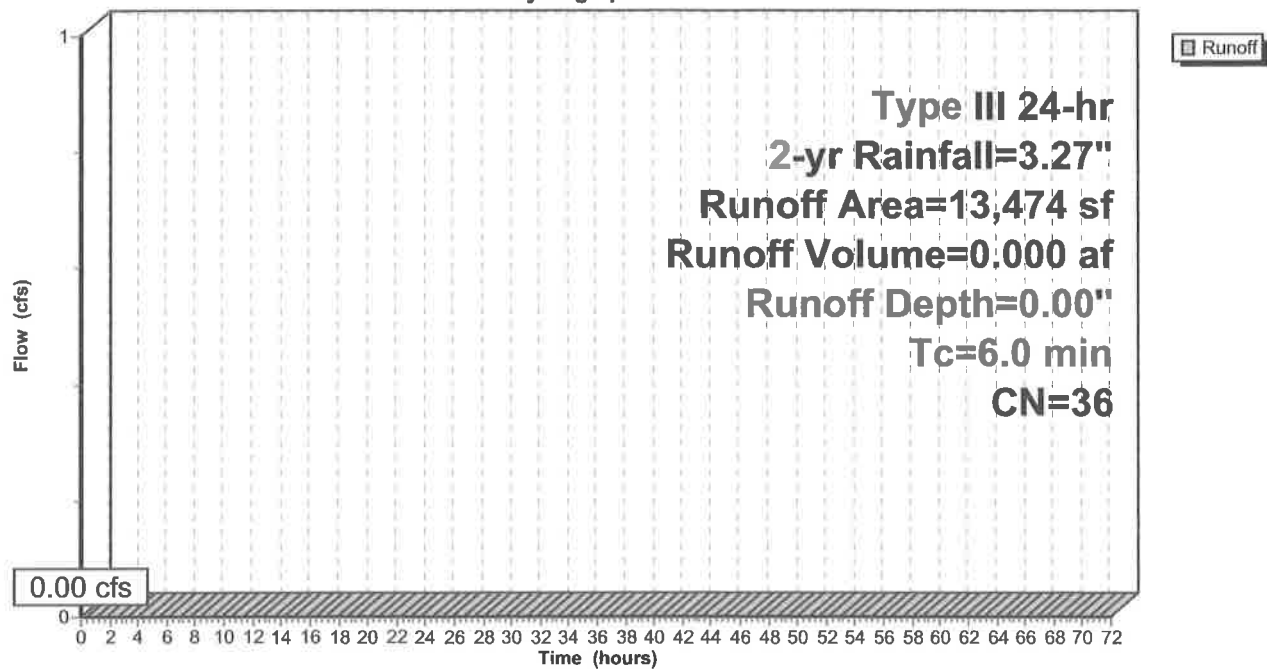

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 15

Summary for Subcatchment 11S: P-8 (CB8)

Runoff = 0.00 cfs @ 24.01 hrs, Volume= 0.000 af, Depth= 0.00"
 Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
22,491	39	>75% Grass cover, Good, HSG A
22,491		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 11S: P-8 (CB8)

Hydrograph

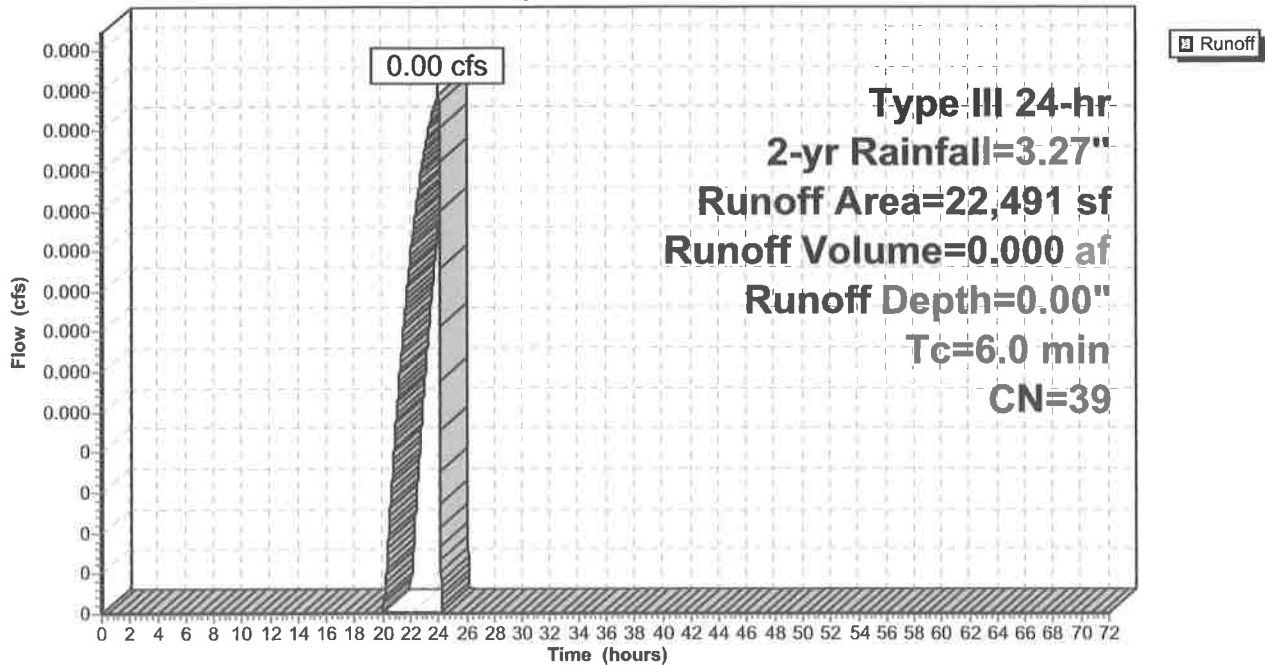

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 16

Summary for Subcatchment 12S: P-9 (roof)

Runoff = 2.01 cfs @ 12.08 hrs, Volume= 0.161 af, Depth= 3.04"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
27,632	98	Roofs, HSG A
27,632		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 12S: P-9 (roof)

Hydrograph

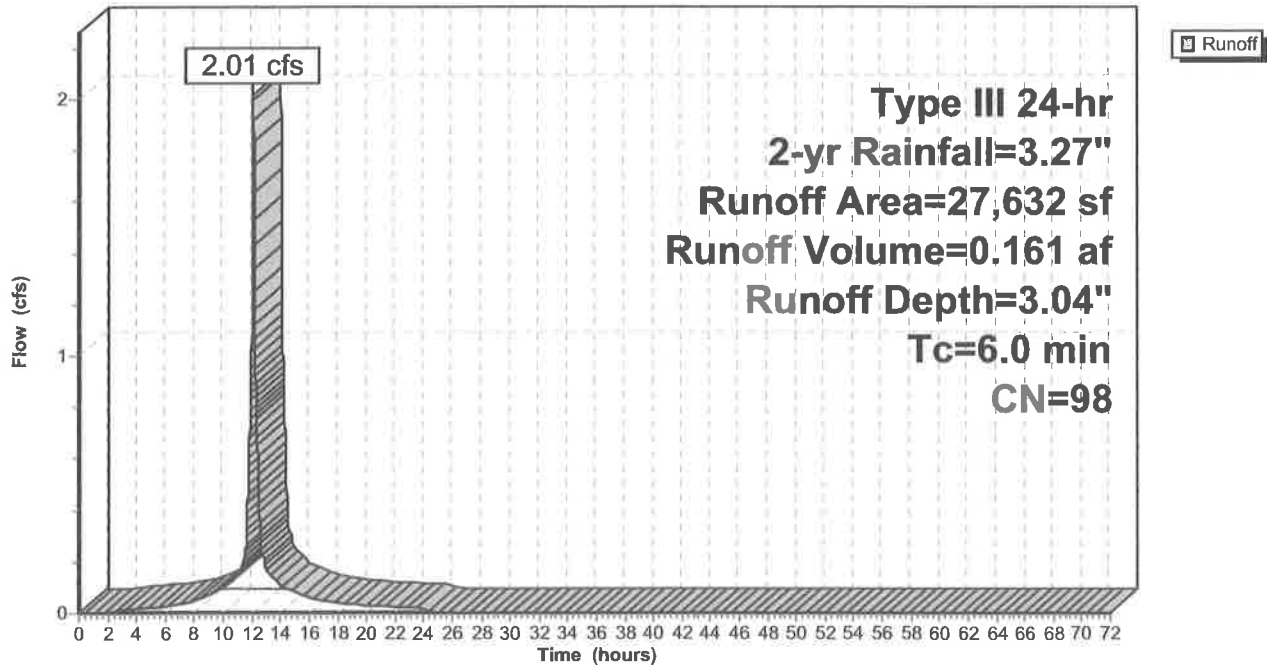

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 17

Summary for Subcatchment 13S: P-10 (to south)

Runoff = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Depth= 0.00"
Routed to Reach 7R : offsite south


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
8,371	39	>75% Grass cover, Good, HSG A
7,030	30	Woods, Good, HSG A
15,401	35	Weighted Average
15,401		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
0.2	95	0.1900	6.54		Shallow Concentrated Flow, Grassed Waterway Kv= 15.0 fps
8.4	145	Total			

Subcatchment 13S: P-10 (to south)

Hydrograph

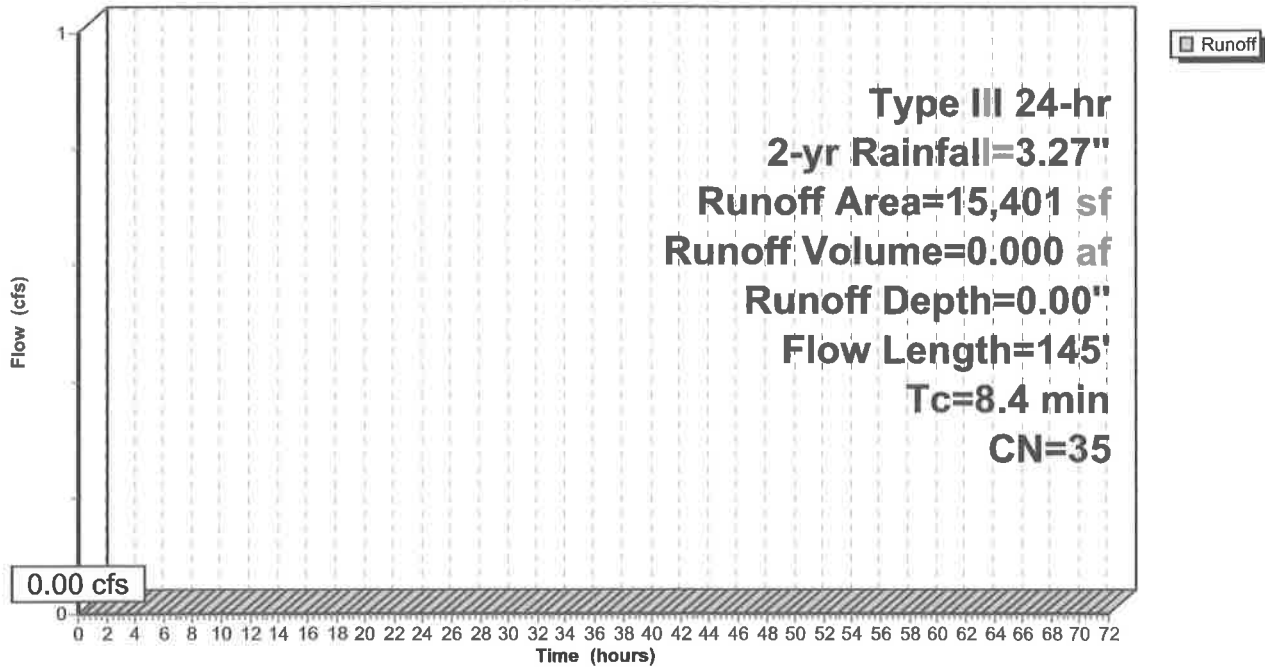

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 18

Summary for Subcatchment 15S: P-10A (rear lawn)

Runoff = 0.00 cfs @ 24.01 hrs, Volume= 0.000 af, Depth= 0.00"
 Routed to Pond 16P : Infiltration Trench


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
13,389	39	>75% Grass cover, Good, HSG A
953	98	Water Surface, HSG A
7,174	30	Meadow, non-grazed, HSG A
21,516	39	Weighted Average
20,563		95.57% Pervious Area
953		4.43% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 15S: P-10A (rear lawn)

Hydrograph

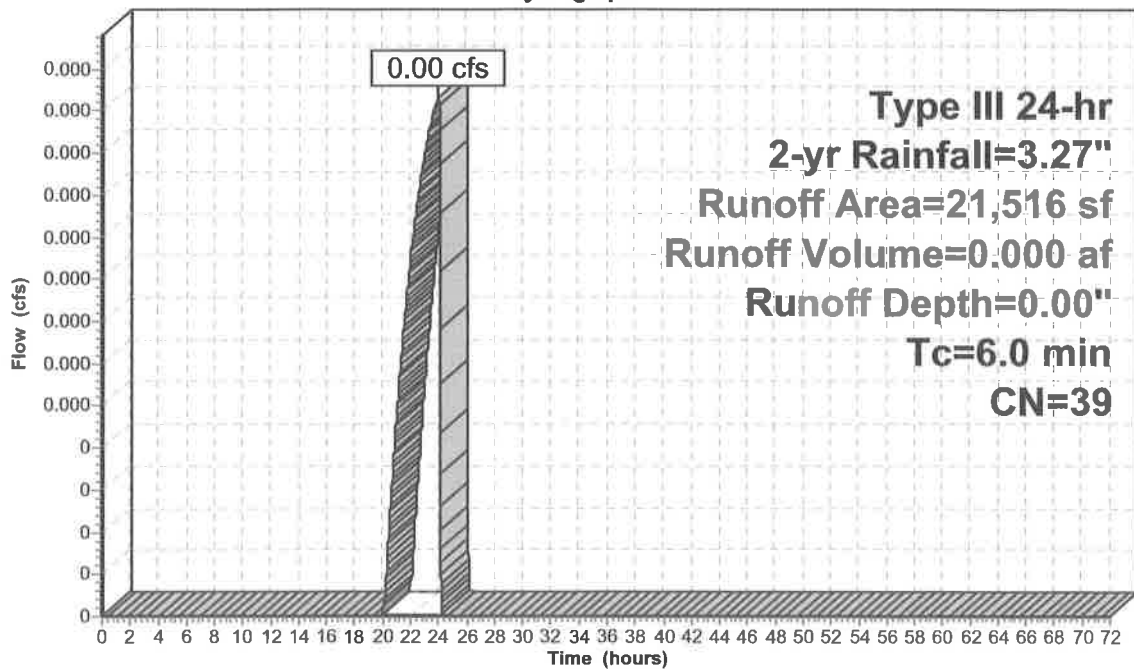

Runoff

Type III 24-hr
 2-yr Rainfall=3.27"
 Runoff Area=21,516 sf
 Runoff Volume=0.000 af
 Runoff Depth=0.00"
 Tc=6.0 min
 CN=39

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 19

Summary for Subcatchment 17S: P-9A (roof)

Runoff = 0.44 cfs @ 12.08 hrs, Volume= 0.035 af, Depth= 3.04"
Routed to Pond 16P : Infiltration Trench


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
6,000	98	Roofs, HSG A
6,000		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 17S: P-9A (roof)

Hydrograph

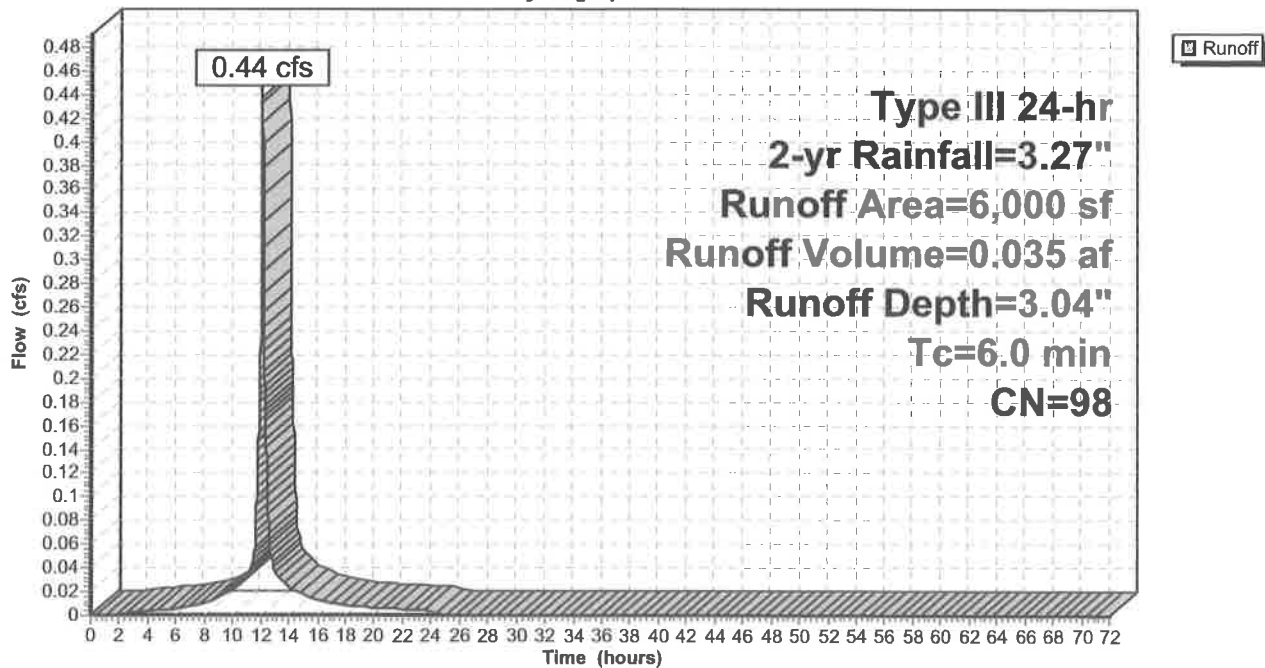

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 20

Summary for Subcatchment 18S: OS 2

Runoff = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Depth= 0.00"
Routed to Reach 20R : Headwall


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 2-yr Rainfall=3.27"

Area (sf)	CN	Description
45,929	30	Woods, Good, HSG A
45,929		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0700	0.11		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
3.6	283	0.0700	1.32		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
11.1	333	Total			

Subcatchment 18S: OS 2

Hydrograph

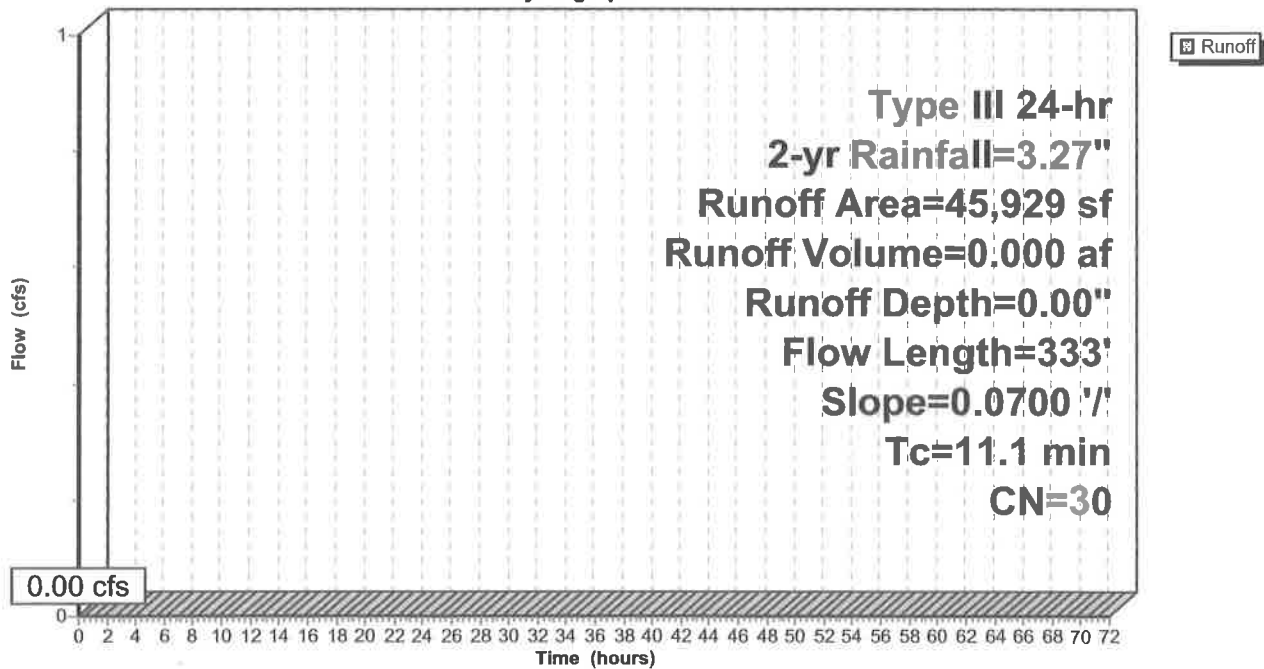

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 21


Summary for Reach 7R: offsite south

Inflow Area = 10.207 ac, 37.73% Impervious, Inflow Depth = 0.00" for 2-yr event
Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Reach 7R: offsite south

Hydrograph

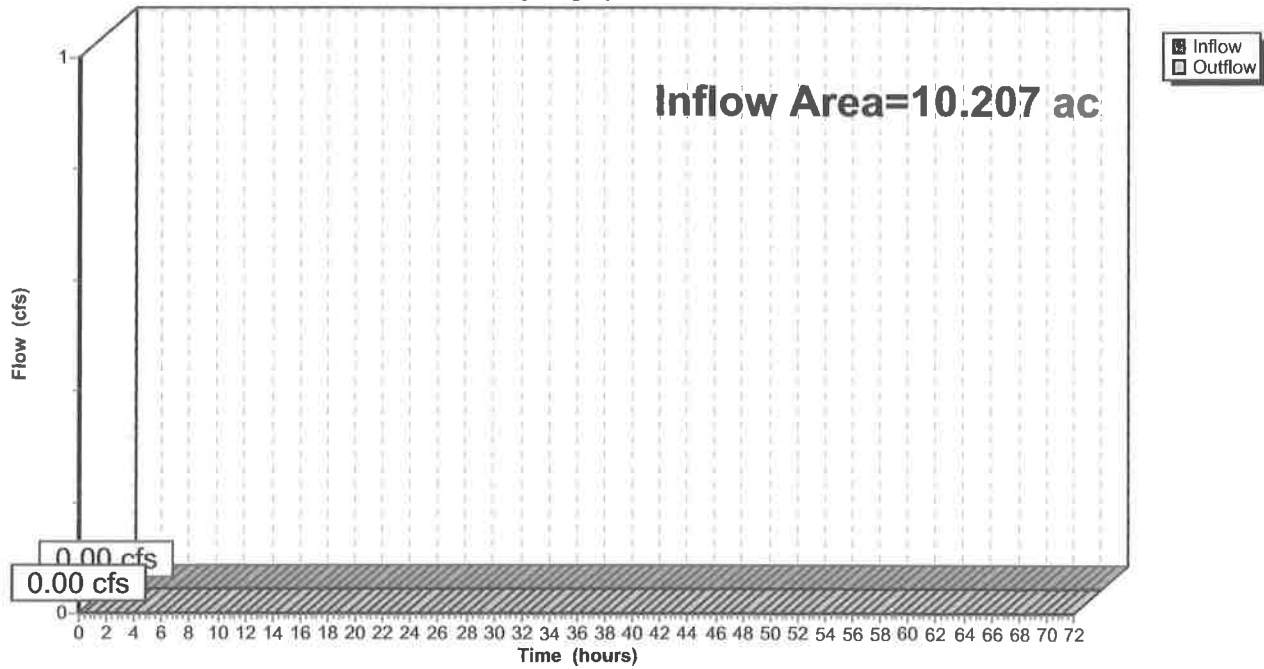

proposed 12-8-23

Type III 24-hr 2-yr Rainfall=3.27"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 22


Summary for Reach 20R: Headwall

Inflow Area = 6.618 ac, 34.34% Impervious, Inflow Depth = 0.00" for 2-yr event
 Inflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Outflow = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Atten= 0%, Lag= 0.0 min
 Routed to Reach 7R : offsite south

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Max. Velocity= 0.00 fps, Min. Travel Time= 0.0 min
 Avg. Velocity = 0.00 fps, Avg. Travel Time= 0.0 min


Peak Storage= 0 cf @ 0.00 hrs
 Average Depth at Peak Storage= 0.00'
 Bank-Full Depth= 2.00' Flow Area= 3.1 sf, Capacity= 52.00 cfs

24.0" Round Pipe
 n= 0.012
 Length= 311.0' Slope= 0.0450 '/'
 Inlet Invert= 214.00', Outlet Invert= 200.00'



Reach 20R: Headwall

Hydrograph

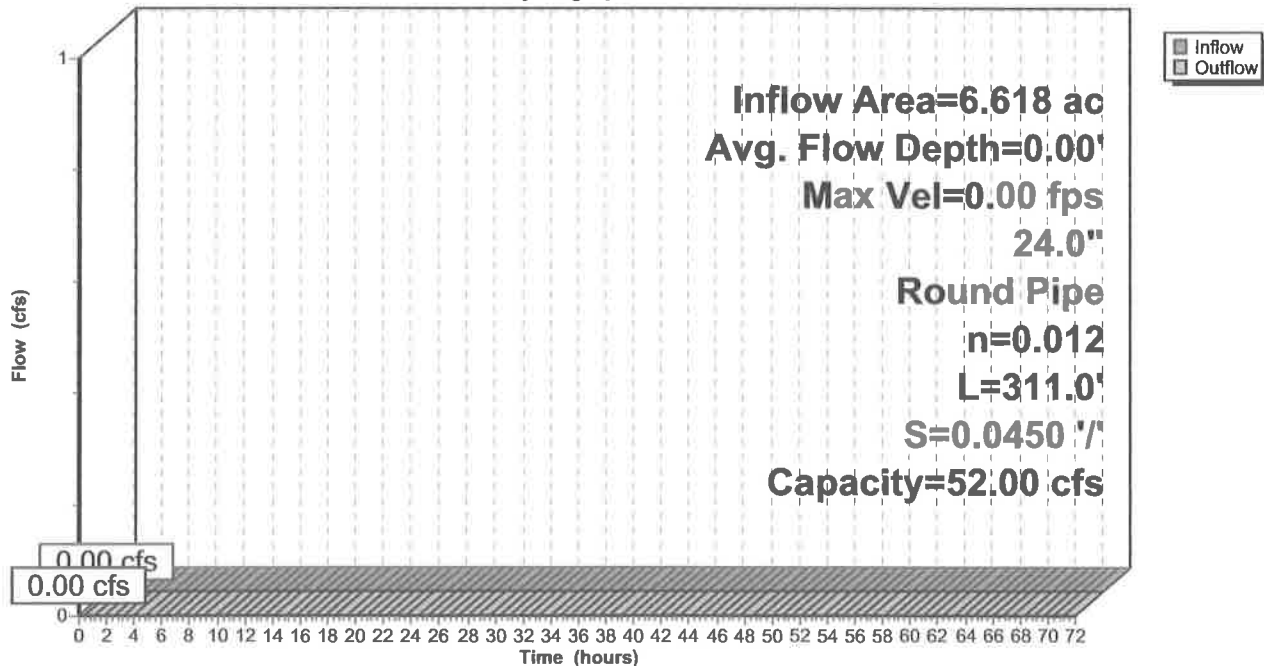

Summary for Pond 6P: Existing Basin

Inflow Area = 5.563 ac, 40.85% Impervious, Inflow Depth = 0.55" for 2-yr event
 Inflow = 2.27 cfs @ 12.17 hrs, Volume= 0.255 af
 Outflow = 0.42 cfs @ 13.31 hrs, Volume= 0.184 af, Atten= 81%, Lag= 68.5 min
 Discarded = 0.42 cfs @ 13.31 hrs, Volume= 0.184 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Routed to Reach 20R : Headwall

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs / 3
 Peak Elev= 220.76' @ 13.31 hrs Surf.Area= 2,649 sf Storage= 3,654 cf

Plug-Flow detention time= 179.8 min calculated for 0.184 af (72% of inflow)
 Center-of-Mass det. time= 73.4 min (979.1 - 905.8)

Volume	Invert	Avail.Storage	Storage Description
#1	211.00'	111 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 467 cf Embedded = 279 cf x 40.0% Voids
#2	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder Inside #1
#3	211.00'	117 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 452 cf Embedded = 294 cf x 40.0% Voids
#4	211.50'	452 cf	8.00'D x 9.00'H Vertical Cone/Cylinder Inside #3
#5	210.50'	107 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 478 cf Embedded = 269 cf x 40.0% Voids
#6	210.50'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #5
#7	210.50'	123 cf	10.00'D x 10.00'H Vertical Cone/Cylinder 785 cf Overall - 478 cf Embedded = 308 cf x 40.0% Voids
#8	210.70'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #7
#9	211.00'	298 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall x 40.0% Voids
#10	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder
#11	220.50'	23,070 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,170 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
220.50	2,038	0	0
222.00	3,006	3,783	3,783
224.00	4,743	7,749	11,532
225.00	5,659	5,201	16,733
225.50	6,241	2,975	19,708
226.00	7,205	3,362	23,070

Device	Routing	Invert	Outlet Devices
#1	Discarded	220.49'	8.270 in/hr Exfiltration over Surface area above 220.49' Excluded Surface area = 443 sf
#2	Primary	225.00'	10.0' long + 4.0 ' SideZ x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 24


Discarded OutFlow Max=0.42 cfs @ 13.31 hrs HW=220.76' (Free Discharge)

↑1=Exfiltration (Exfiltration Controls 0.42 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=210.50' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Pond 6P: Existing Basin

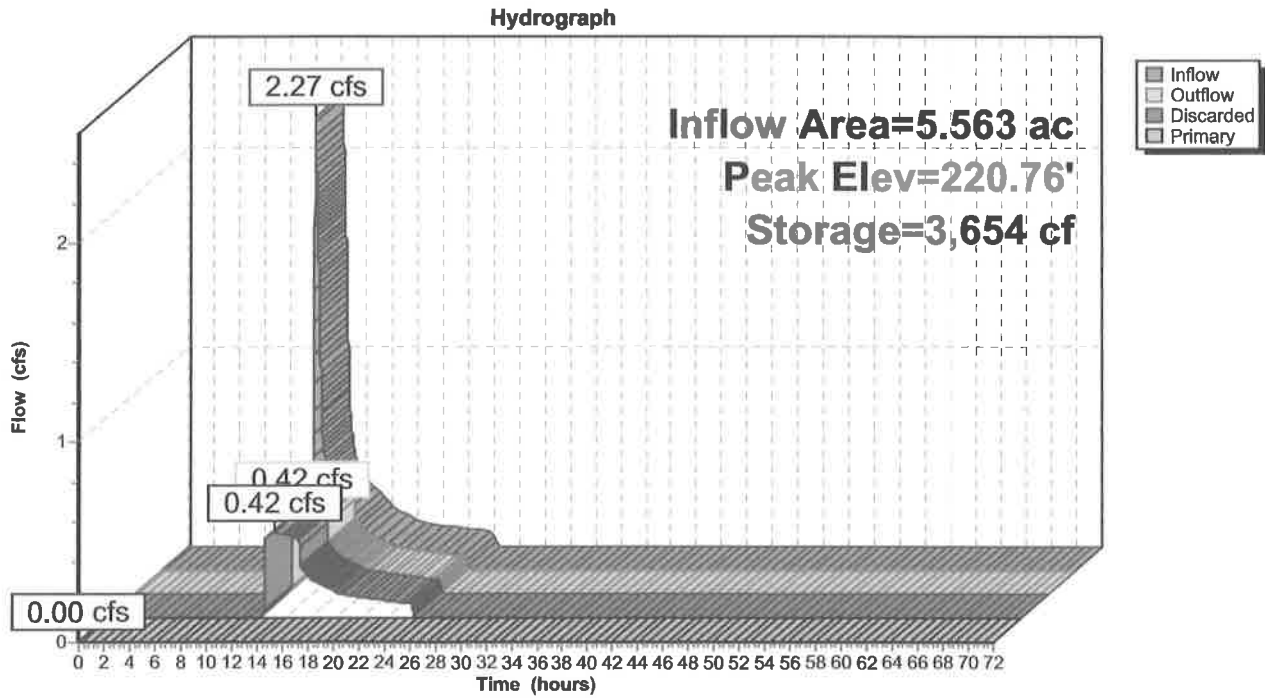

proposed 12-8-23

Type III 24-hr 2-yr Rainfall=3.27"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 25

Summary for Pond 14P: Chamber System

Inflow Area = 2.604 ac, 54.48% Impervious, Inflow Depth = 1.38" for 2-yr event
 Inflow = 3.91 cfs @ 12.09 hrs, Volume= 0.299 af
 Outflow = 1.21 cfs @ 11.89 hrs, Volume= 0.299 af, Atten= 69%, Lag= 0.0 min
 Discarded = 1.21 cfs @ 11.89 hrs, Volume= 0.299 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Routed to Reach 7R : offsite south

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Peak Elev= 209.69' @ 12.42 hrs Surf.Area= 0.145 ac Storage= 0.049 af

Plug-Flow detention time= 9.2 min calculated for 0.299 af (100% of inflow)
 Center-of-Mass det. time= 9.2 min (801.6 - 792.4)

Volume	Invert	Avail.Storage	Storage Description
#1A	209.00'	0.146 af	19.60'W x 322.00'L x 5.50'H Field A 0.797 af Overall - 0.433 af Embedded = 0.364 af x 40.0% Voids
#2A	209.50'	0.326 af	Galley 4x4x4 x 320 Inside #1 Inside= 42.0"W x 43.0"H => 12.67 sf x 3.50'L = 44.3 cf Outside= 52.8"W x 48.0"H => 14.72 sf x 4.00'L = 58.9 cf 320 Chambers in 4 Rows
		0.472 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	209.00'	8.270 in/hr Exfiltration over Surface area
#2	Primary	214.00'	15.0" Round Culvert L= 157.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 214.00' / 206.60' S= 0.0471 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 1.23 sf

Discarded OutFlow Max=1.21 cfs @ 11.89 hrs HW=209.06' (Free Discharge)
 ↗1=Exfiltration (Exfiltration Controls 1.21 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=209.00' (Free Discharge)
 ↗2=Culvert (Controls 0.00 cfs)

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 26

Pond 14P: Chamber System - Chamber Wizard Field A

Chamber Model = Galley 4x4x4 (Concrete Galley, UCPI 4x4x4 Galley or equivalent)

Inside= 42.0"W x 43.0"H => 12.67 sf x 3.50'L = 44.3 cf

Outside= 52.8"W x 48.0"H => 14.72 sf x 4.00'L = 58.9 cf

80 Chambers/Row x 4.00' Long = 320.00' Row Length +12.0" End Stone x 2 = 322.00' Base Length

4 Rows x 52.8" Wide + 12.0" Side Stone x 2 = 19.60' Base Width

6.0" Stone Base + 48.0" Chamber Height + 12.0" Stone Cover = 5.50' Field Height

320 Chambers x 44.3 cf = 14,190.3 cf Chamber Storage

320 Chambers x 58.9 cf = 18,840.4 cf Displacement

34,711.6 cf Field - 18,840.4 cf Chambers = 15,871.2 cf Stone x 40.0% Voids = 6,348.5 cf Stone Storage

Chamber Storage + Stone Storage = 20,538.8 cf = 0.472 af

Overall Storage Efficiency = 59.2%

Overall System Size = 322.00' x 19.60' x 5.50'

320 Chambers

1,285.6 cy Field

587.8 cy Stone



0.0000

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 2-yr Rainfall=3.27"

Printed 12/13/2023

Page 27

Pond 14P: Chamber System

Hydrograph

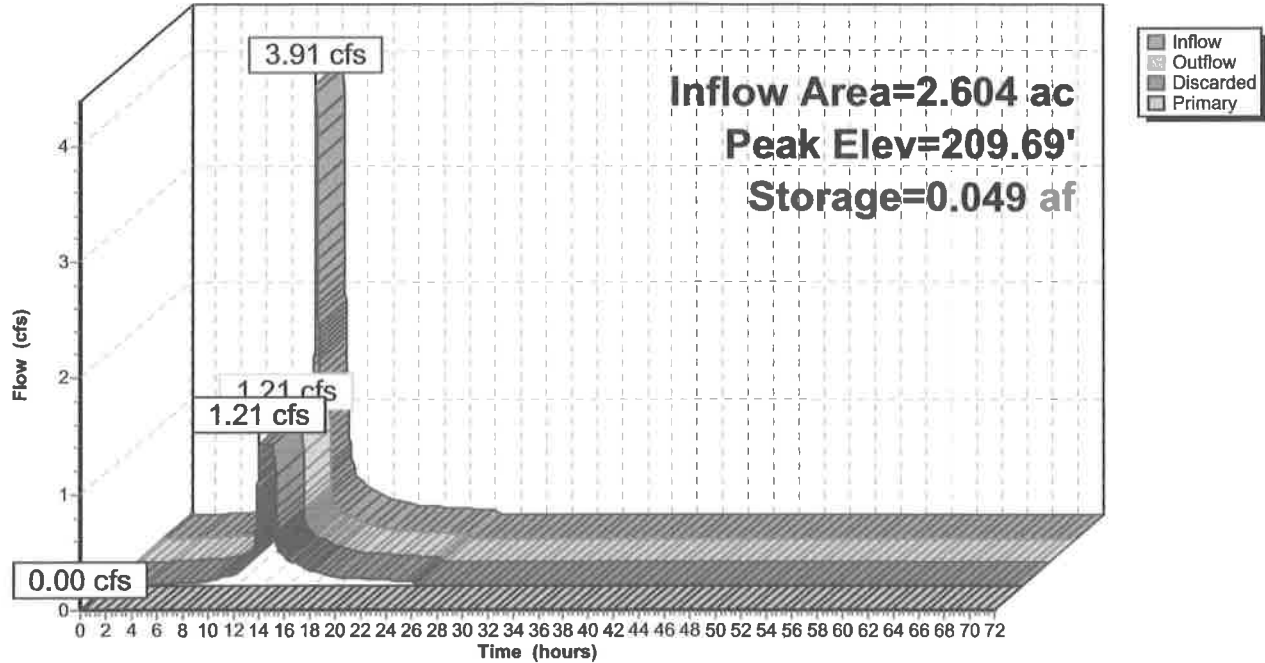

proposed 12-8-23

Type III 24-hr 2-yr Rainfall=3.27"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 28

Summary for Pond 16P: Infiltration Trench

Inflow Area = 0.632 ac, 25.27% Impervious, Inflow Depth = 0.66" for 2-yr event
 Inflow = 0.44 cfs @ 12.08 hrs, Volume= 0.035 af
 Outflow = 0.18 cfs @ 11.95 hrs, Volume= 0.035 af, Atten= 58%, Lag= 0.0 min
 Discarded = 0.18 cfs @ 11.95 hrs, Volume= 0.035 af

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Peak Elev= 195.43' @ 12.28 hrs Surf.Area= 952 sf Storage= 162 cf

Plug-Flow detention time= 4.5 min calculated for 0.035 af (100% of inflow)
 Center-of-Mass det. time= 4.5 min (761.3 - 756.8)


Volume	Invert	Avail.Storage	Storage Description
#1	195.00'	1,593 cf	8.50'W x 112.00'L x 5.00'H Prismatic 4,760 cf Overall - 778 cf Embedded = 3,982 cf x 40.0% Voids
#2	196.25'	778 cf	18.0" Round CMP_Round 18" x 4 Inside #1 L= 110.0'
		2,371 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Discarded	195.00'	8.270 in/hr Exfiltration over Horizontal area

Discarded OutFlow Max=0.18 cfs @ 11.95 hrs HW=195.05' (Free Discharge)
 1=Exfiltration (Exfiltration Controls 0.18 cfs)

Pond 16P: Infiltration Trench

Hydrograph

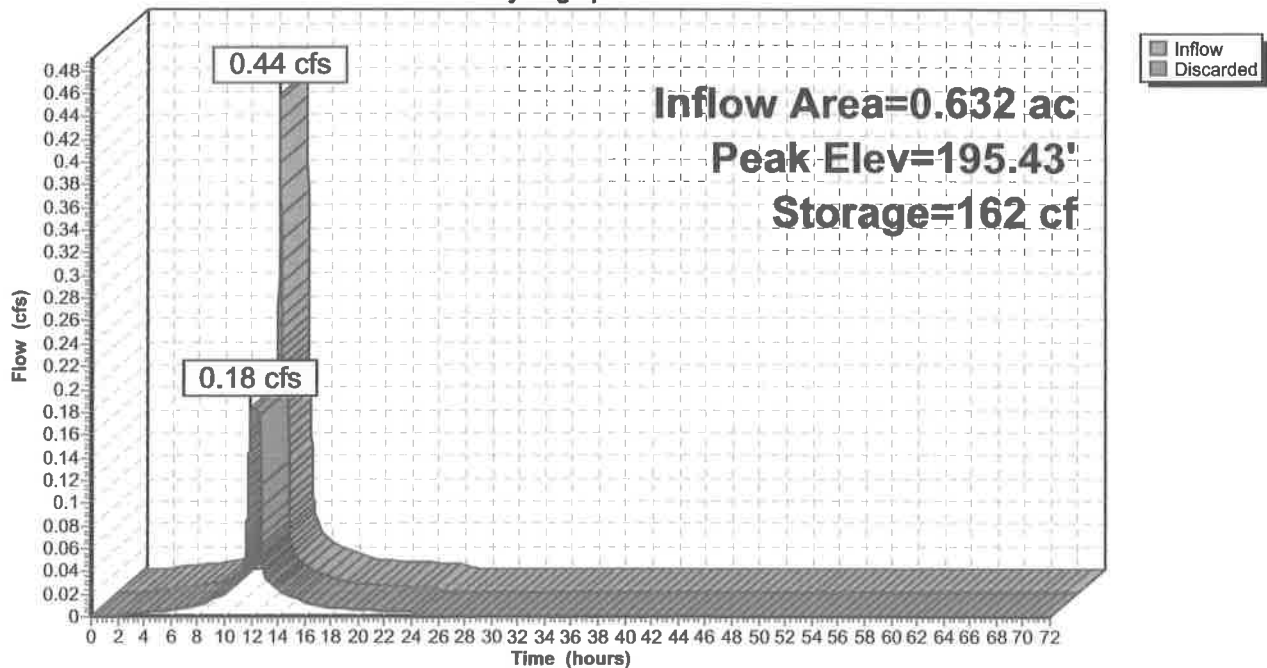

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: P-1 (CB1)	Runoff Area=3,398 sf 66.27% Impervious Runoff Depth=2.68" Tc=6.0 min CN=78 Runoff=0.25 cfs 0.017 af
Subcatchment 2S: P-2 (CB2)	Runoff Area=1,896 sf 84.86% Impervious Runoff Depth=3.73" Tc=6.0 min CN=89 Runoff=0.19 cfs 0.014 af
Subcatchment 3S: P-3 (CB3)	Runoff Area=9,124 sf 89.35% Impervious Runoff Depth=4.05" Tc=6.0 min CN=92 Runoff=0.94 cfs 0.071 af
Subcatchment 4S: OS 1	Runoff Area=242,335 sf 40.85% Impervious Runoff Depth=1.48" Flow Length=855' Tc=9.9 min CN=63 Runoff=7.85 cfs 0.688 af
Subcatchment 7S: P-4 (CB4)	Runoff Area=17,772 sf 65.10% Impervious Runoff Depth=2.59" Tc=6.0 min CN=77 Runoff=1.24 cfs 0.088 af
Subcatchment 8S: P-5 (CB5)	Runoff Area=5,781 sf 64.57% Impervious Runoff Depth=2.59" Tc=6.0 min CN=77 Runoff=0.40 cfs 0.029 af
Subcatchment 9S: P-6 (CB6)	Runoff Area=11,883 sf 57.73% Impervious Runoff Depth=2.25" Tc=6.0 min CN=73 Runoff=0.71 cfs 0.051 af
Subcatchment 10S: P-7 (CB7)	Runoff Area=13,474 sf 0.00% Impervious Runoff Depth=0.10" Tc=6.0 min CN=36 Runoff=0.00 cfs 0.003 af
Subcatchment 11S: P-8 (CB8)	Runoff Area=22,491 sf 0.00% Impervious Runoff Depth=0.19" Tc=6.0 min CN=39 Runoff=0.02 cfs 0.008 af
Subcatchment 12S: P-9 (roof)	Runoff Area=27,632 sf 100.00% Impervious Runoff Depth=4.72" Tc=6.0 min CN=98 Runoff=3.08 cfs 0.250 af
Subcatchment 13S: P-10 (to south)	Runoff Area=15,401 sf 0.00% Impervious Runoff Depth=0.08" Flow Length=145' Tc=8.4 min CN=35 Runoff=0.00 cfs 0.002 af
Subcatchment 15S: P-10A (rear lawn)	Runoff Area=21,516 sf 4.43% Impervious Runoff Depth=0.19" Tc=6.0 min CN=39 Runoff=0.02 cfs 0.008 af
Subcatchment 17S: P-9A (roof)	Runoff Area=6,000 sf 100.00% Impervious Runoff Depth=4.72" Tc=6.0 min CN=98 Runoff=0.67 cfs 0.054 af
Subcatchment 18S: OS 2	Runoff Area=45,929 sf 0.00% Impervious Runoff Depth=0.00" Flow Length=333' Slope=0.0700 '/' Tc=11.1 min CN=30 Runoff=0.00 cfs 0.000 af
Reach 7R: offsite south	Inflow=0.00 cfs 0.003 af Outflow=0.00 cfs 0.003 af
Reach 20R: Headwall	Avg. Flow Depth=0.00' Max Vel=1.47 fps Inflow=0.00 cfs 0.000 af 24.0" Round Pipe n=0.012 L=311.0' S=0.0450 '/' Capacity=52.00 cfs Outflow=0.00 cfs 0.000 af

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 30

Pond 6P: Existing Basin

Peak Elev=223.63' Storage=12,947 cf Inflow=7.85 cfs 0.688 af
Discarded=0.85 cfs 0.617 af Primary=0.00 cfs 0.000 af Outflow=0.85 cfs 0.617 af

Pond 14P: Chamber System

Peak Elev=210.51' Storage=0.136 af Inflow=6.80 cfs 0.530 af
Discarded=1.21 cfs 0.530 af Primary=0.00 cfs 0.000 af Outflow=1.21 cfs 0.530 af

Pond 16P: Infiltration Trench

Peak Elev=196.10' Storage=419 cf Inflow=0.67 cfs 0.062 af
Outflow=0.18 cfs 0.062 af

Total Runoff Area = 10.207 ac Runoff Volume = 1.283 af Average Runoff Depth = 1.51"
62.27% Pervious = 6.356 ac 37.73% Impervious = 3.851 ac

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 31

Summary for Subcatchment 1S: P-1 (CB1)

Runoff = 0.25 cfs @ 12.09 hrs, Volume= 0.017 af, Depth= 2.68"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
2,252	98	Paved parking, HSG A
1,146	39	>75% Grass cover, Good, HSG A
3,398	78	Weighted Average
1,146		33.73% Pervious Area
2,252		66.27% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 1S: P-1 (CB1)

Hydrograph

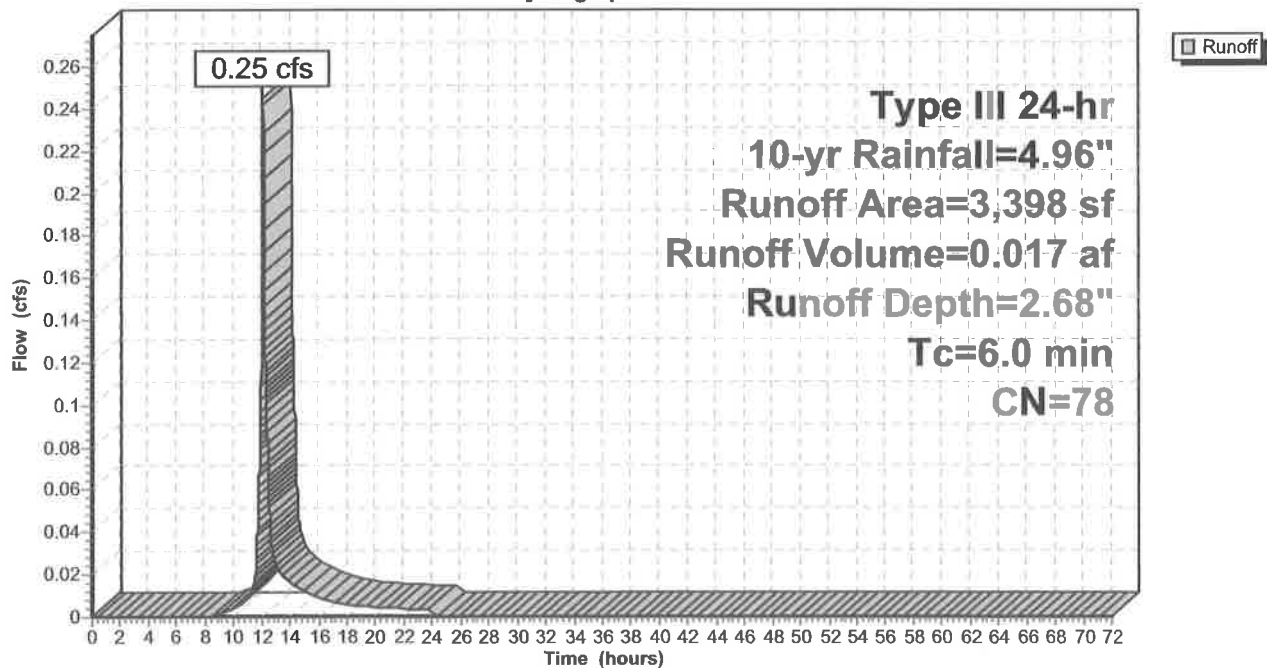

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 32

Summary for Subcatchment 2S: P-2 (CB2)

Runoff = 0.19 cfs @ 12.09 hrs, Volume= 0.014 af, Depth= 3.73"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
1,609	98	Paved parking, HSG A
287	39	>75% Grass cover, Good, HSG A
1,896	89	Weighted Average
287		15.14% Pervious Area
1,609		84.86% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 2S: P-2 (CB2)

Hydrograph

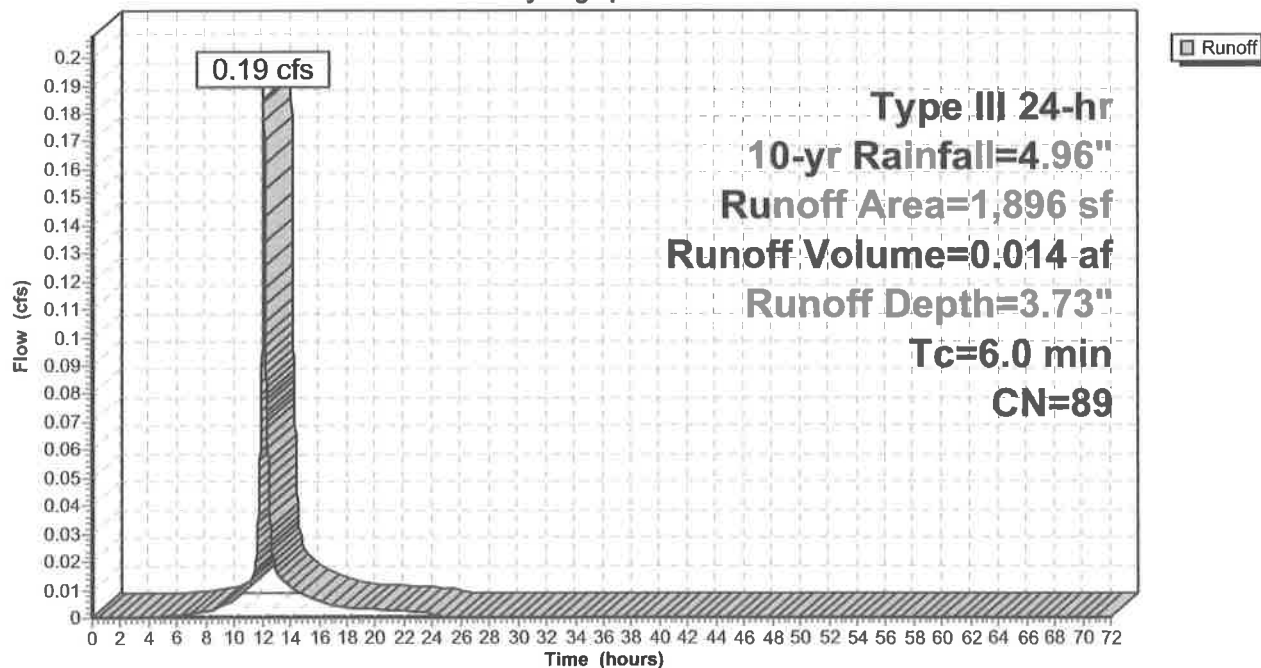

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 33

Summary for Subcatchment 3S: P-3 (CB3)

Runoff = 0.94 cfs @ 12.08 hrs, Volume= 0.071 af, Depth= 4.05"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
8,152	98	Paved parking, HSG A
972	39	>75% Grass cover, Good, HSG A
9,124	92	Weighted Average
972		10.65% Pervious Area
8,152		89.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 3S: P-3 (CB3)

Hydrograph

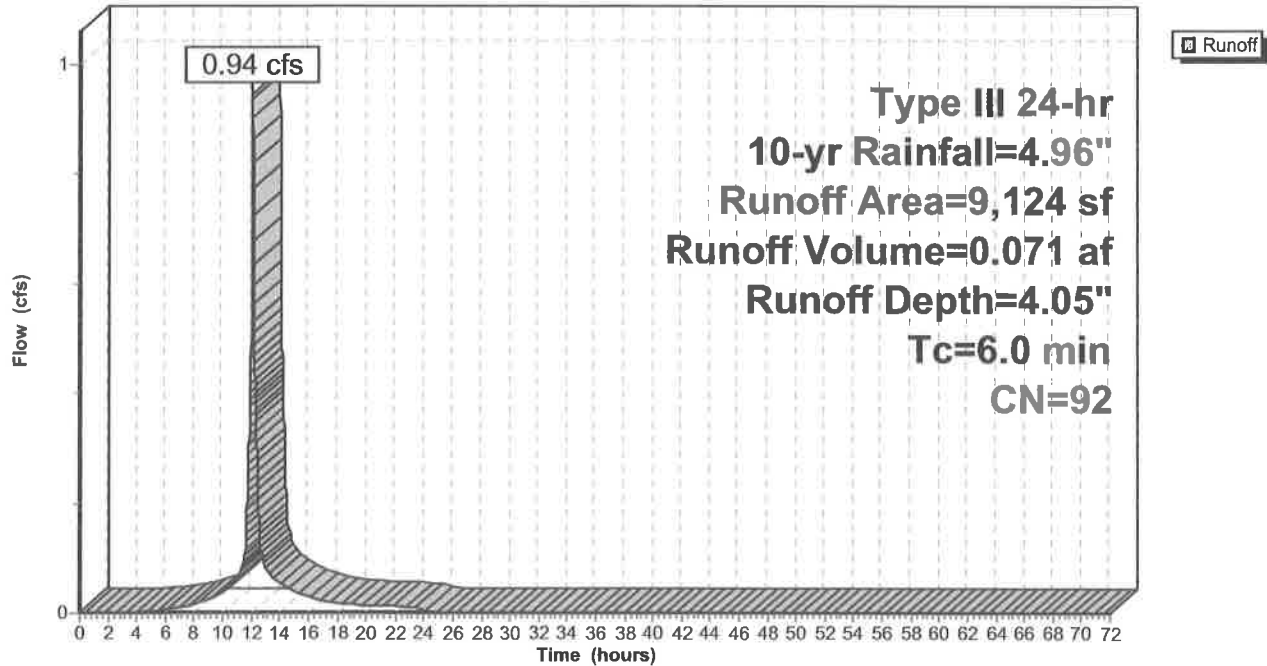

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 34

Summary for Subcatchment 4S: OS 1

Runoff = 7.85 cfs @ 12.15 hrs, Volume= 0.688 af, Depth= 1.48"
Routed to Pond 6P : Existing Basin

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
21,486	98	Roofs, HSG A
15,524	30	Woods, Good, HSG A
127,810	39	>75% Grass cover, Good, HSG A
* 6,241	98	Water Surface, HSG A Basin
71,274	98	Paved parking, HSG A
242,335	63	Weighted Average
143,334		59.15% Pervious Area
99,001		40.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0300	0.12		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
1.1	150	0.0120	2.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	475	0.0100	5.26	6.46	Pipe Channel, RCP_Round 15" 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.013 Concrete pipe, bends & connections
0.3	180	0.0280	9.95	17.58	Pipe Channel, RCP_Round 18" 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.013
9.9	855	Total			

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 35

Subcatchment 4S: OS 1

Hydrograph

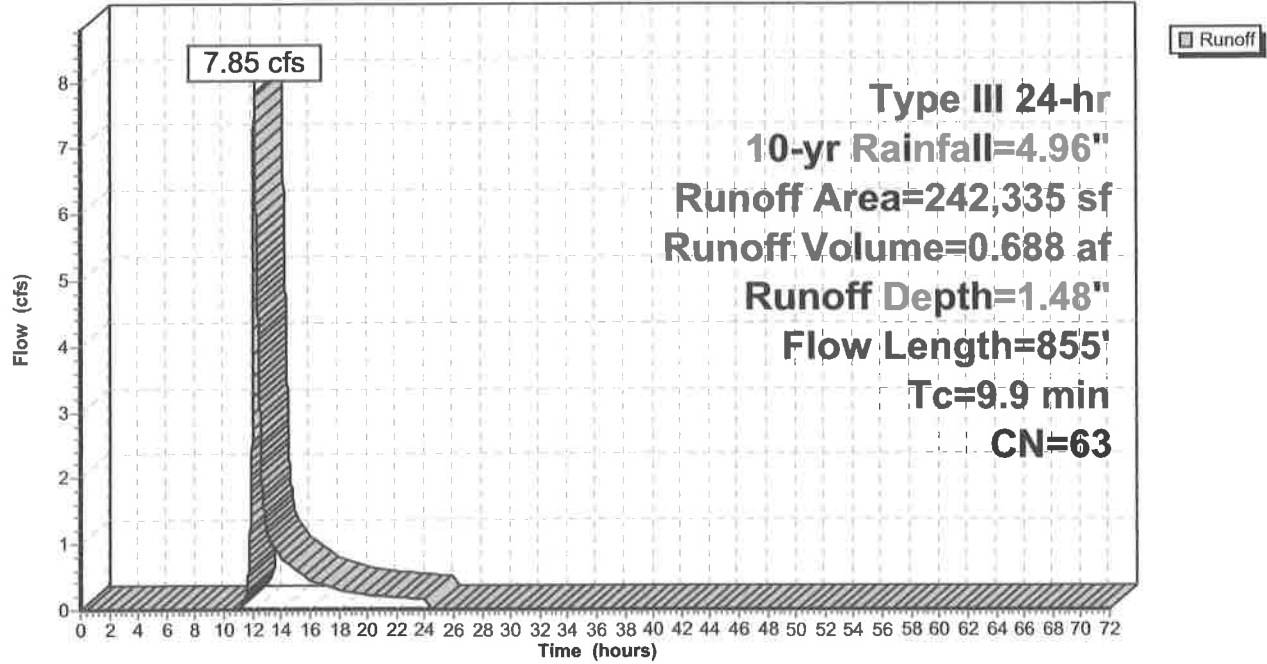

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 36

Summary for Subcatchment 7S: P-4 (CB4)

Runoff = 1.24 cfs @ 12.09 hrs, Volume= 0.088 af, Depth= 2.59"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
11,570	98	Paved parking, HSG A
6,202	39	>75% Grass cover, Good, HSG A
17,772	77	Weighted Average
6,202		34.90% Pervious Area
11,570		65.10% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 7S: P-4 (CB4)

Hydrograph

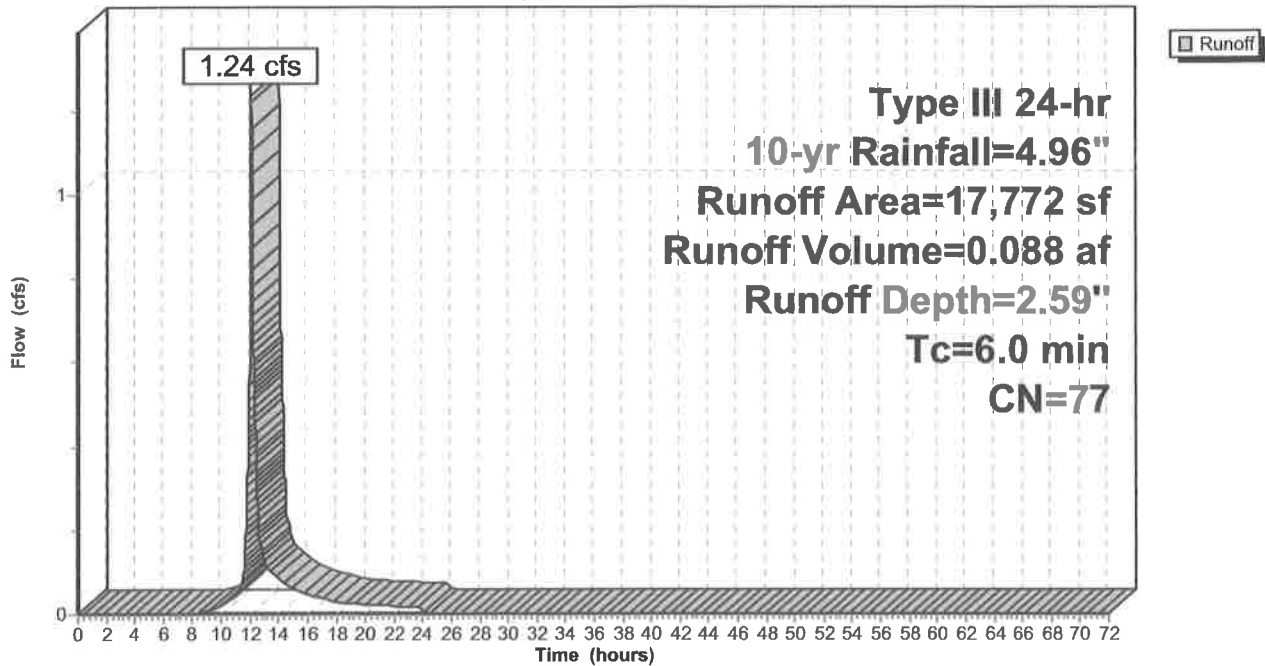

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 37

Summary for Subcatchment 8S: P-5 (CB5)

Runoff = 0.40 cfs @ 12.09 hrs, Volume= 0.029 af, Depth= 2.59"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
3,733	98	Paved parking, HSG A
2,048	39	>75% Grass cover, Good, HSG A
5,781	77	Weighted Average
2,048		35.43% Pervious Area
3,733		64.57% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 8S: P-5 (CB5)

Hydrograph

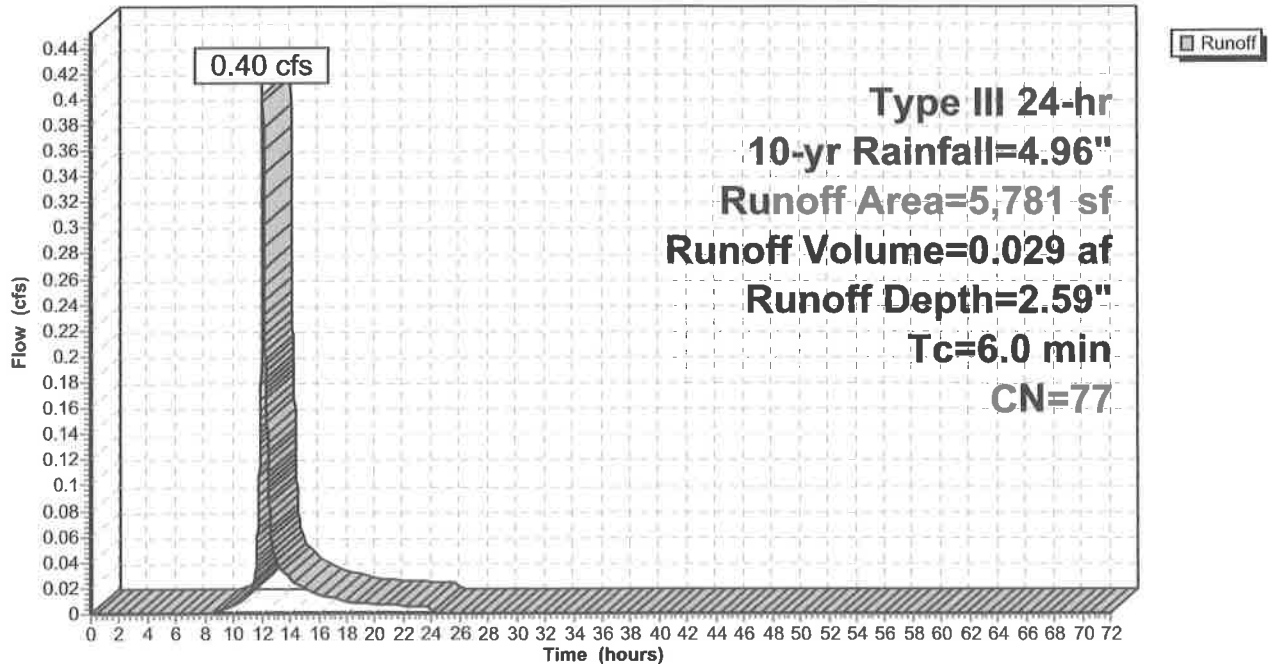

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 38

Summary for Subcatchment 9S: P-6 (CB6)

Runoff = 0.71 cfs @ 12.09 hrs, Volume= 0.051 af, Depth= 2.25"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
6,860	98	Paved parking, HSG A
5,023	39	>75% Grass cover, Good, HSG A
11,883	73	Weighted Average
5,023		42.27% Pervious Area
6,860		57.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 9S: P-6 (CB6)

Hydrograph

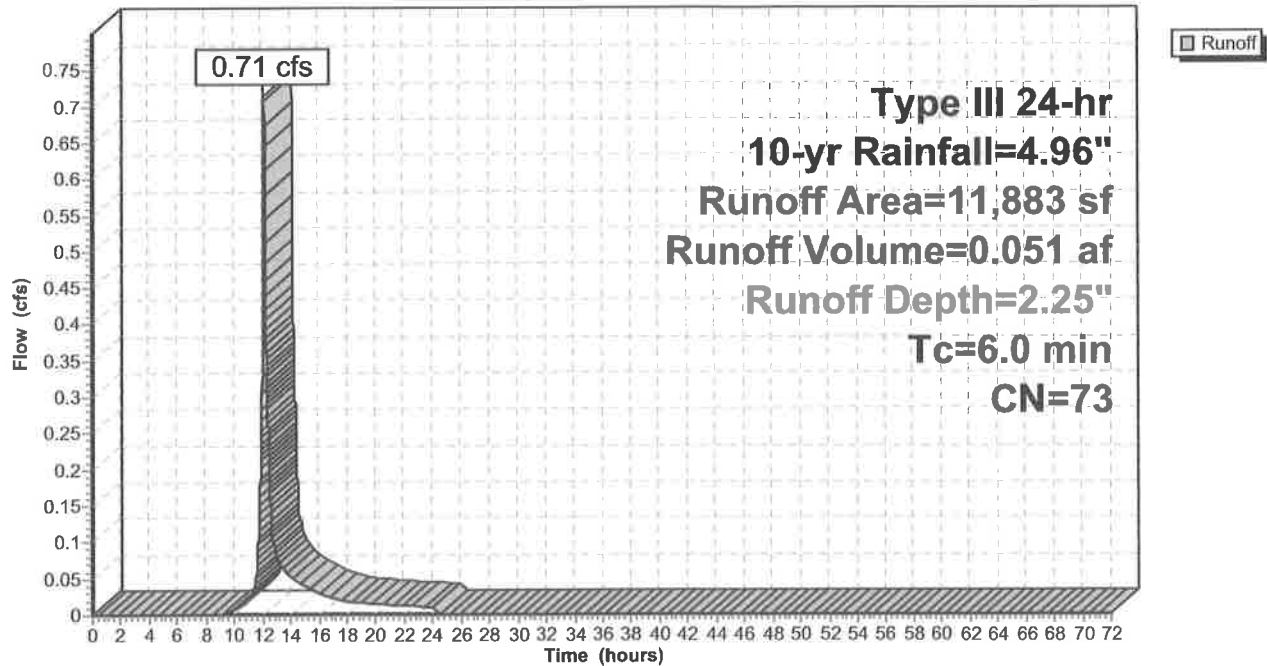

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 39

Summary for Subcatchment 10S: P-7 (CB7)

Runoff = 0.00 cfs @ 14.90 hrs, Volume= 0.003 af, Depth= 0.10"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
8,914	39	>75% Grass cover, Good, HSG A
4,560	30	Woods, Good, HSG A
13,474	36	Weighted Average
13,474		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 10S: P-7 (CB7)

Hydrograph

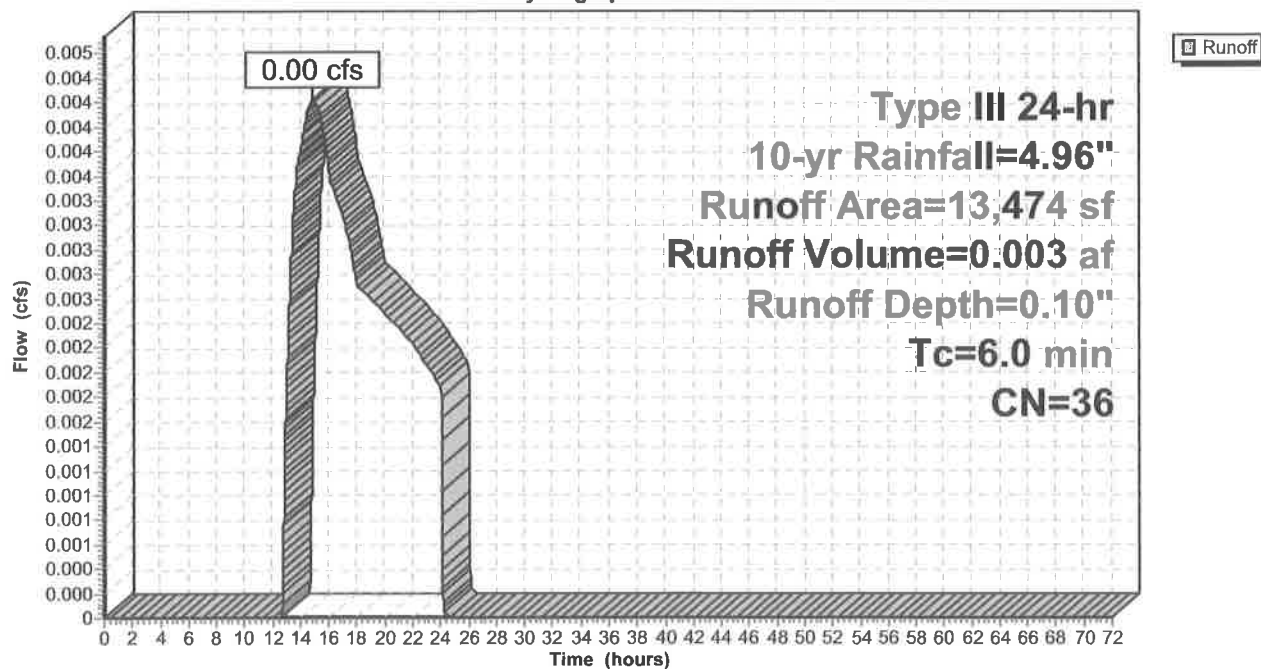

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 40

Summary for Subcatchment 11S: P-8 (CB8)

Runoff = 0.02 cfs @ 12.48 hrs, Volume= 0.008 af, Depth= 0.19"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
22,491	39	>75% Grass cover, Good, HSG A
22,491		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 11S: P-8 (CB8)

Hydrograph

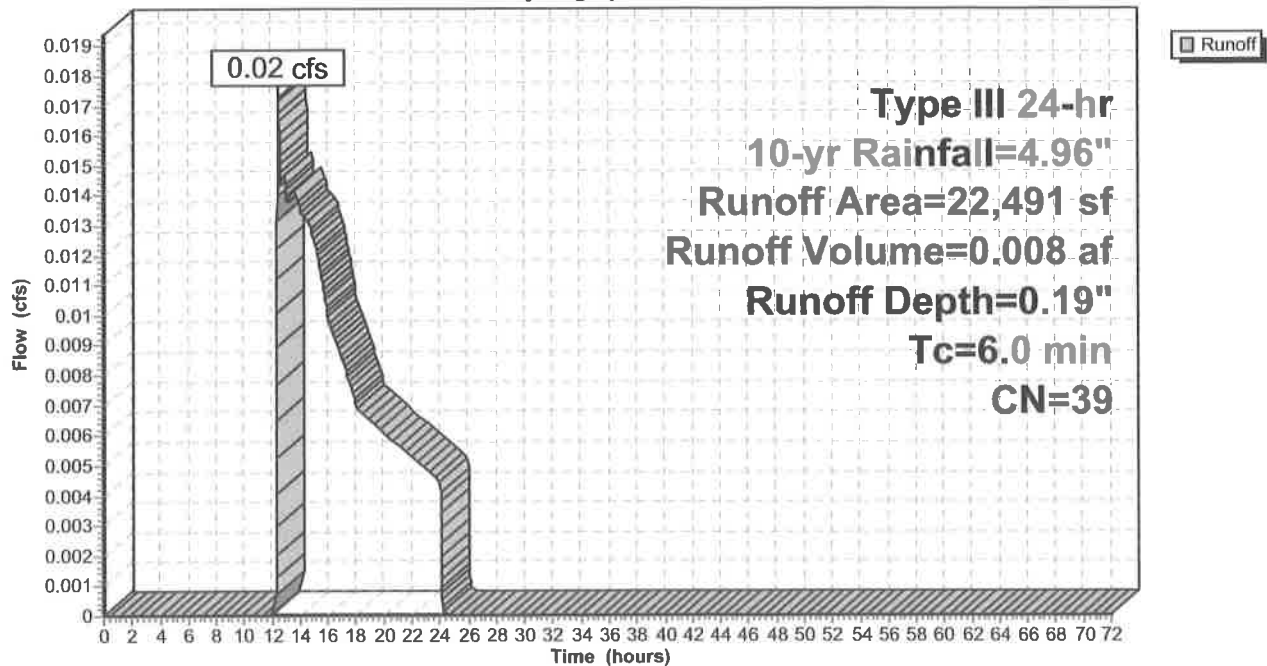

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 41

Summary for Subcatchment 12S: P-9 (roof)

Runoff = 3.08 cfs @ 12.08 hrs, Volume= 0.250 af, Depth= 4.72"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
27,632	98	Roofs, HSG A
27,632		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 12S: P-9 (roof)

Hydrograph

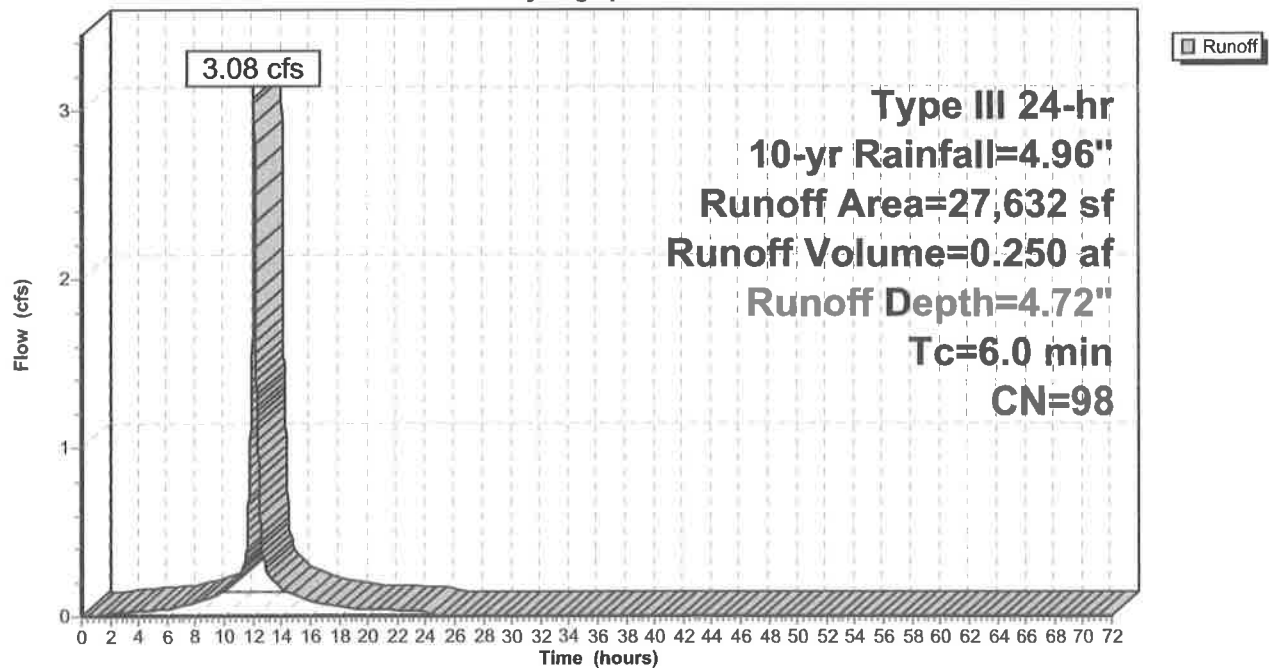

Summary for Subcatchment 13S: P-10 (to south)

Runoff = 0.00 cfs @ 15.24 hrs, Volume= 0.002 af, Depth= 0.08"
Routed to Reach 7R : offsite south


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
8,371	39	>75% Grass cover, Good, HSG A
7,030	30	Woods, Good, HSG A
15,401	35	Weighted Average
15,401		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
0.2	95	0.1900	6.54		Shallow Concentrated Flow, Grassed Waterway Kv= 15.0 fps
8.4	145	Total			

Subcatchment 13S: P-10 (to south)

Hydrograph

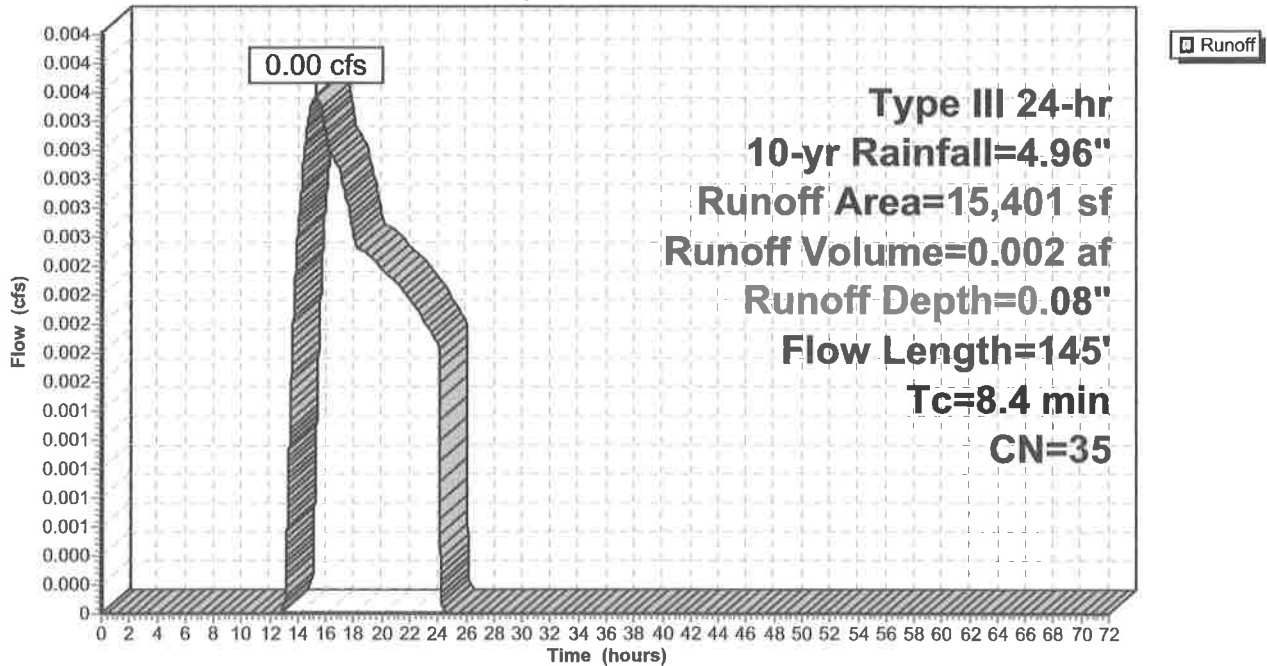

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 43

Summary for Subcatchment 15S: P-10A (rear lawn)

Runoff = 0.02 cfs @ 12.48 hrs, Volume= 0.008 af, Depth= 0.19"
Routed to Pond 16P : Infiltration Trench


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
13,389	39	>75% Grass cover, Good, HSG A
953	98	Water Surface, HSG A
7,174	30	Meadow, non-grazed, HSG A
21,516	39	Weighted Average
20,563		95.57% Pervious Area
953		4.43% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 15S: P-10A (rear lawn)

Hydrograph

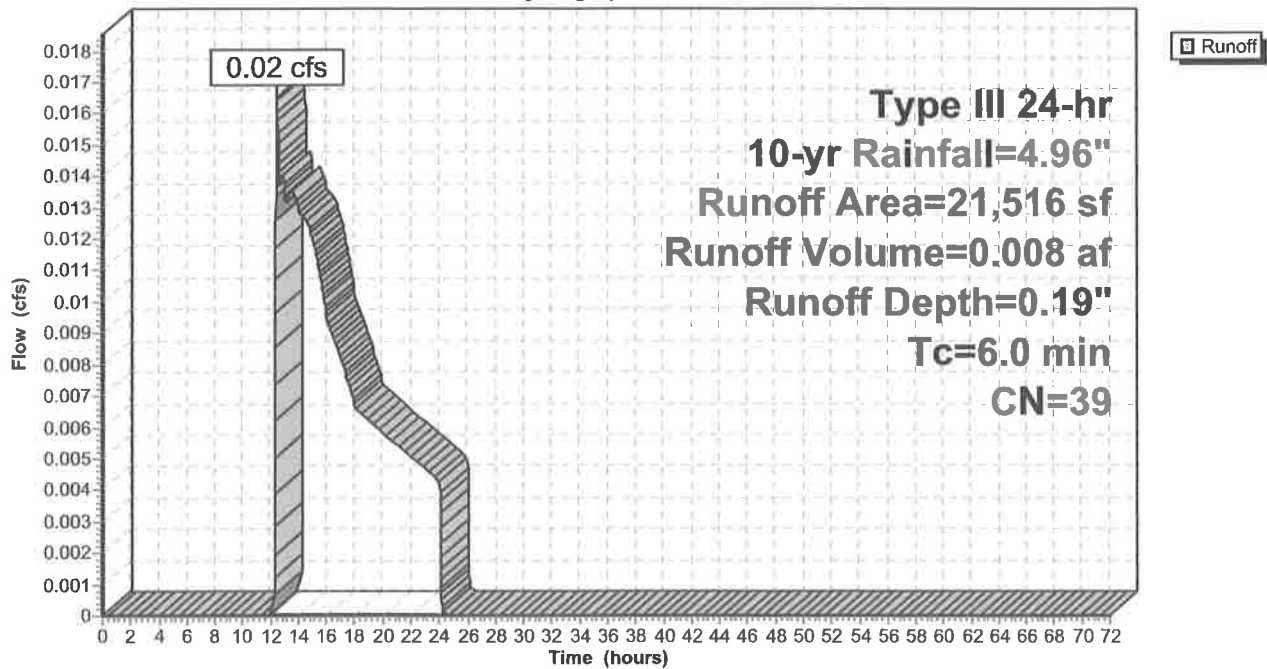

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 44

Summary for Subcatchment 17S: P-9A (roof)

Runoff = 0.67 cfs @ 12.08 hrs, Volume= 0.054 af, Depth= 4.72"
Routed to Pond 16P : Infiltration Trench


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
6,000	98	Roofs, HSG A
6,000		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 17S: P-9A (roof)

Hydrograph

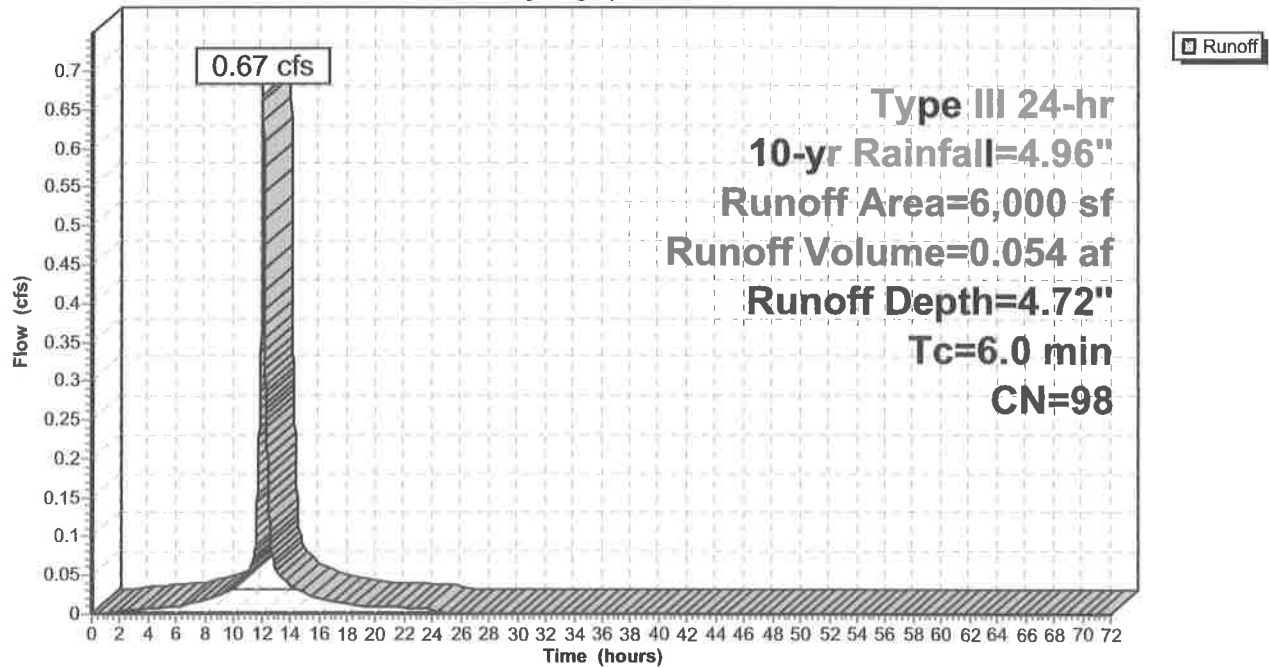

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 45

Summary for Subcatchment 18S: OS 2

Runoff = 0.00 cfs @ 24.01 hrs, Volume= 0.000 af, Depth= 0.00"
Routed to Reach 20R : Headwall


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 10-yr Rainfall=4.96"

Area (sf)	CN	Description
45,929	30	Woods, Good, HSG A
45,929		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0700	0.11		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
3.6	283	0.0700	1.32		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
11.1	333	Total			

Subcatchment 18S: OS 2

Hydrograph

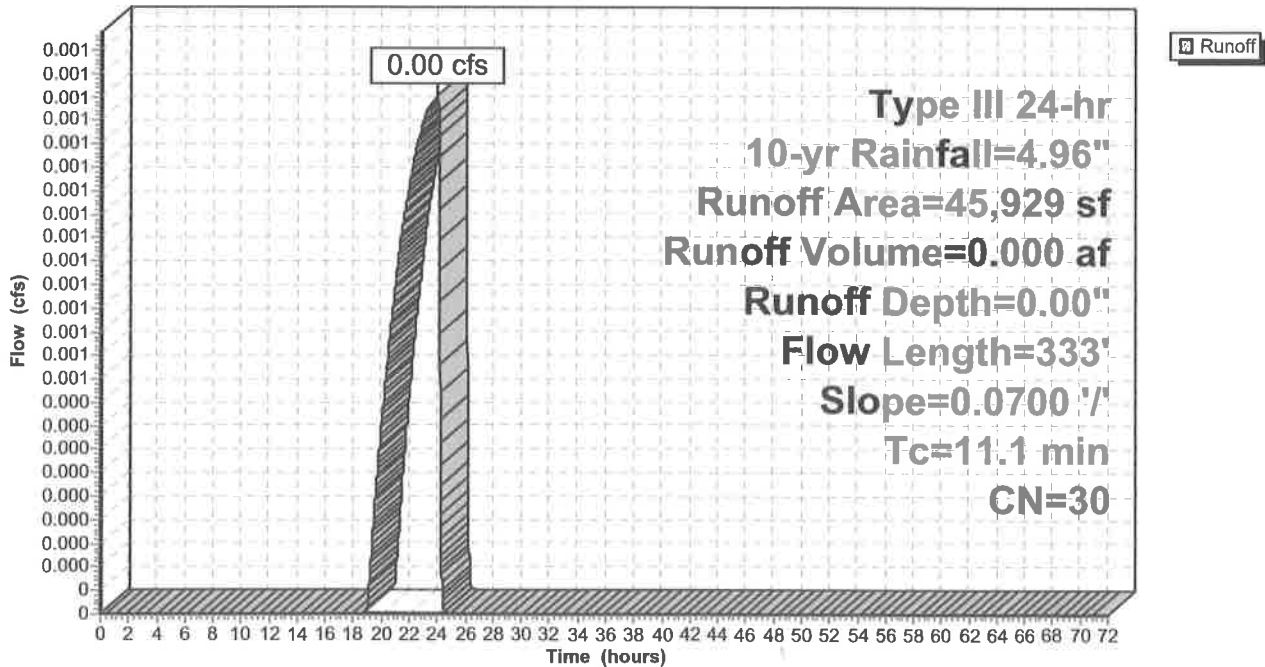

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 46


Summary for Reach 7R: offsite south

Inflow Area = 10.207 ac, 37.73% Impervious, Inflow Depth = 0.00" for 10-yr event
Inflow = 0.00 cfs @ 15.24 hrs, Volume= 0.003 af
Outflow = 0.00 cfs @ 15.24 hrs, Volume= 0.003 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Reach 7R: offsite south

Hydrograph

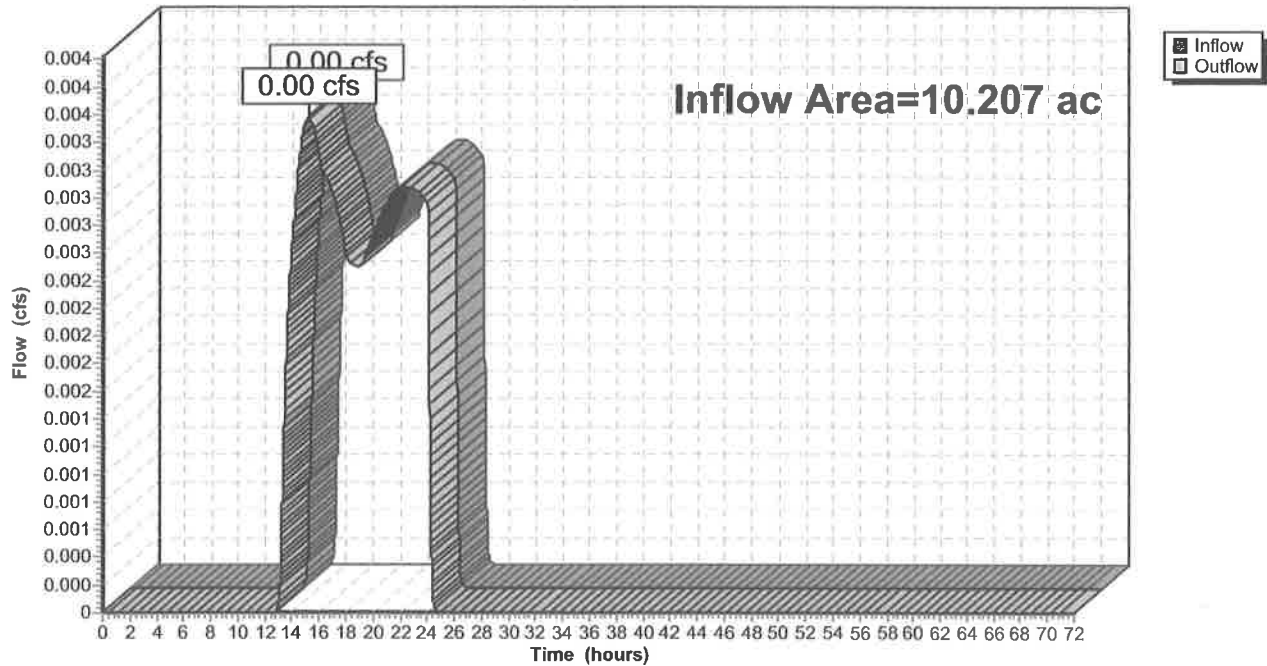

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 47


Summary for Reach 20R: Headwall

Inflow Area = 6.618 ac, 34.34% Impervious, Inflow Depth = 0.00" for 10-yr event
 Inflow = 0.00 cfs @ 24.01 hrs, Volume= 0.000 af
 Outflow = 0.00 cfs @ 24.08 hrs, Volume= 0.000 af, Atten= 0%, Lag= 4.2 min
 Routed to Reach 7R : offsite south

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Max. Velocity= 1.47 fps, Min. Travel Time= 3.5 min
 Avg. Velocity = 1.47 fps, Avg. Travel Time= 3.5 min


Peak Storage= 0 cf @ 24.02 hrs
 Average Depth at Peak Storage= 0.00' , Surface Width= 0.15'
 Bank-Full Depth= 2.00' Flow Area= 3.1 sf, Capacity= 52.00 cfs

24.0" Round Pipe
 n= 0.012
 Length= 311.0' Slope= 0.0450 '/'
 Inlet Invert= 214.00', Outlet Invert= 200.00'



Reach 20R: Headwall

Hydrograph

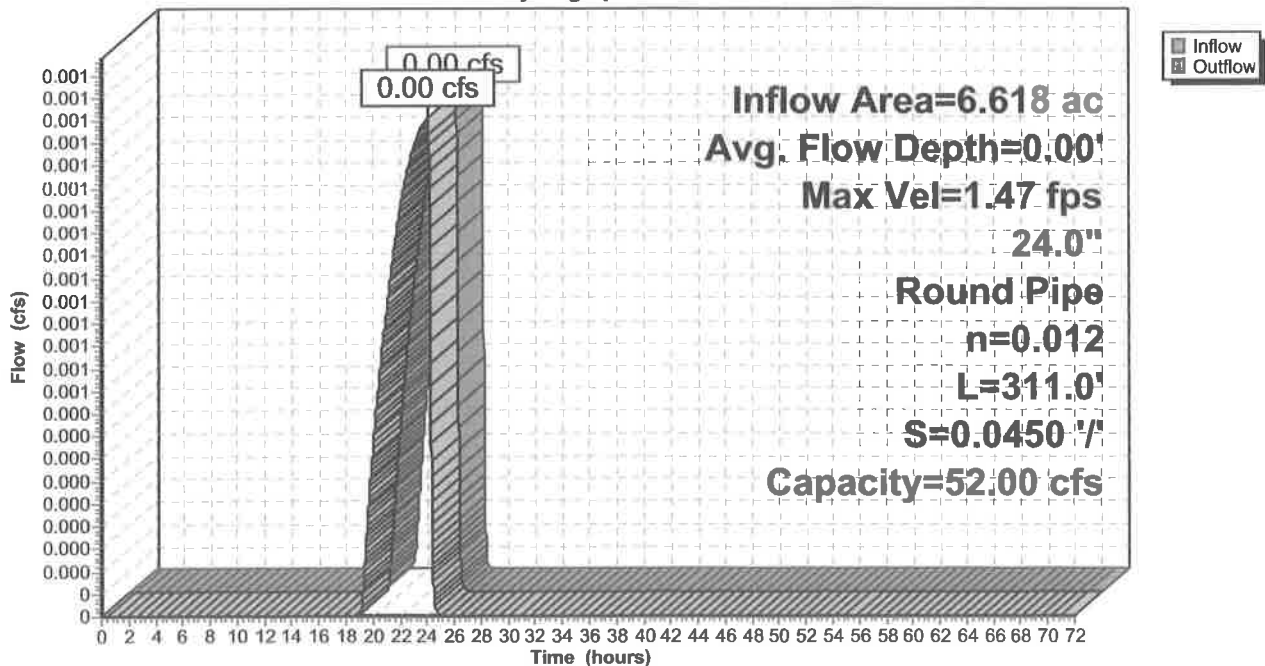

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 48

Summary for Pond 6P: Existing Basin

Inflow Area = 5.563 ac, 40.85% Impervious, Inflow Depth = 1.48" for 10-yr event
 Inflow = 7.85 cfs @ 12.15 hrs, Volume= 0.688 af
 Outflow = 0.85 cfs @ 13.84 hrs, Volume= 0.617 af, Atten= 89%, Lag= 101.1 min
 Discarded = 0.85 cfs @ 13.84 hrs, Volume= 0.617 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Routed to Reach 20R : Headwall

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs / 3
 Peak Elev= 223.63' @ 13.84 hrs Surf.Area= 4,867 sf Storage= 12,947 cf

Plug-Flow detention time= 206.1 min calculated for 0.617 af (90% of inflow)
 Center-of-Mass det. time= 156.1 min (1,026.7 - 870.6)

Volume	Invert	Avail.Storage	Storage Description
#1	211.00'	111 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 467 cf Embedded = 279 cf x 40.0% Voids
#2	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder Inside #1
#3	211.00'	117 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 452 cf Embedded = 294 cf x 40.0% Voids
#4	211.50'	452 cf	8.00'D x 9.00'H Vertical Cone/Cylinder Inside #3
#5	210.50'	107 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 478 cf Embedded = 269 cf x 40.0% Voids
#6	210.50'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #5
#7	210.50'	123 cf	10.00'D x 10.00'H Vertical Cone/Cylinder 785 cf Overall - 478 cf Embedded = 308 cf x 40.0% Voids
#8	210.70'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #7
#9	211.00'	298 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall x 40.0% Voids
#10	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder
#11	220.50'	23,070 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,170 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
220.50	2,038	0	0
222.00	3,006	3,783	3,783
224.00	4,743	7,749	11,532
225.00	5,659	5,201	16,733
225.50	6,241	2,975	19,708
226.00	7,205	3,362	23,070

Device	Routing	Invert	Outlet Devices
#1	Discarded	220.49'	8.270 in/hr Exfiltration over Surface area above 220.49' Excluded Surface area = 443 sf
#2	Primary	225.00'	10.0' long + 4.0 'l' SideZ x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 49

Discarded OutFlow Max=0.85 cfs @ 13.84 hrs HW=223.63' (Free Discharge)


↑1=Exfiltration (Exfiltration Controls 0.85 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=210.50' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Controls 0.00 cfs)

Pond 6P: Existing Basin

Hydrograph

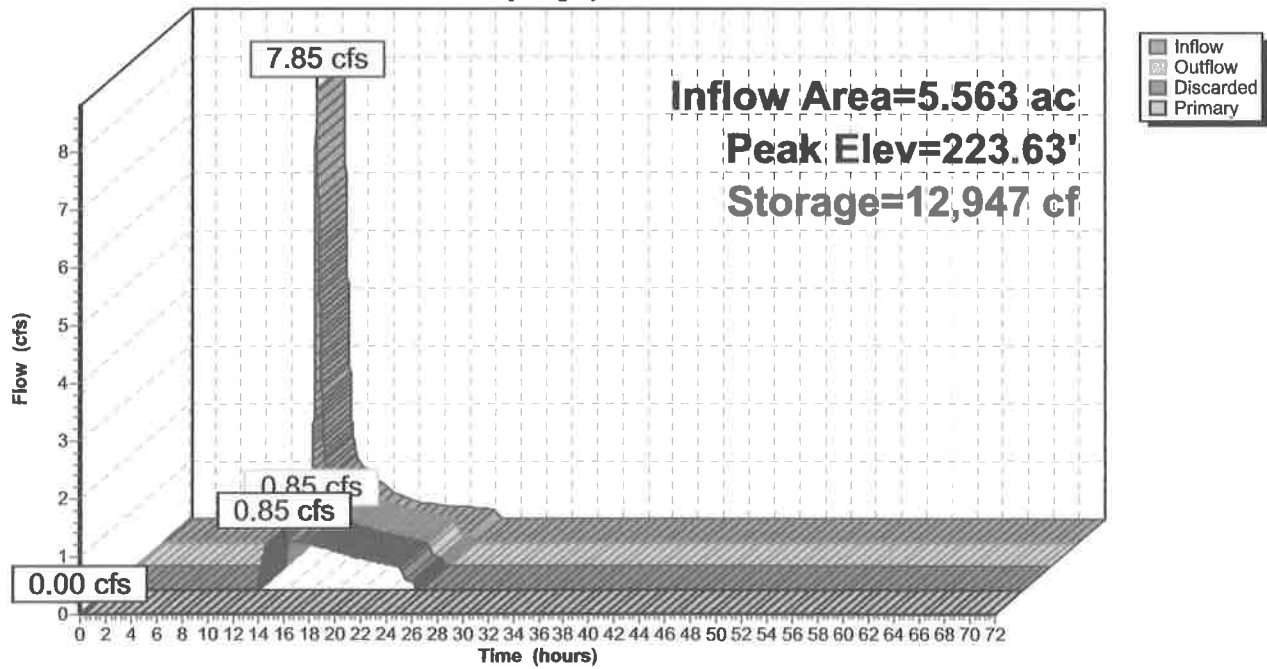

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 50

Summary for Pond 14P: Chamber System

Inflow Area = 2.604 ac, 54.48% Impervious, Inflow Depth = 2.44" for 10-yr event
 Inflow = 6.80 cfs @ 12.09 hrs, Volume= 0.530 af
 Outflow = 1.21 cfs @ 11.73 hrs, Volume= 0.530 af, Atten= 82%, Lag= 0.0 min
 Discarded = 1.21 cfs @ 11.73 hrs, Volume= 0.530 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Routed to Reach 7R : offsite south

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Peak Elev= 210.51' @ 12.55 hrs Surf.Area= 0.145 ac Storage= 0.136 af

Plug-Flow detention time= 28.3 min calculated for 0.530 af (100% of inflow)
 Center-of-Mass det. time= 28.3 min (817.5 - 789.3)

Volume	Invert	Avail.Storage	Storage Description
#1A	209.00'	0.146 af	19.60'W x 322.00'L x 5.50'H Field A 0.797 af Overall - 0.433 af Embedded = 0.364 af x 40.0% Voids
#2A	209.50'	0.326 af	Galley 4x4x4 x 320 Inside #1 Inside= 42.0"W x 43.0"H => 12.67 sf x 3.50'L = 44.3 cf Outside= 52.8"W x 48.0"H => 14.72 sf x 4.00'L = 58.9 cf 320 Chambers in 4 Rows
		0.472 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	209.00'	8.270 in/hr Exfiltration over Surface area
#2	Primary	214.00'	15.0" Round Culvert L= 157.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 214.00' / 206.60' S= 0.0471 ' /' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 1.23 sf

Discarded OutFlow Max=1.21 cfs @ 11.73 hrs HW=209.07' (Free Discharge)
 ↑1=Exfiltration (Exfiltration Controls 1.21 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=209.00' (Free Discharge)
 ↑2=Culvert (Controls 0.00 cfs)

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 51

Pond 14P: Chamber System - Chamber Wizard Field A

Chamber Model = Galley 4x4x4 (Concrete Galley, UCPI 4x4x4 Galley or equivalent)

Inside= 42.0"W x 43.0"H => 12.67 sf x 3.50'L = 44.3 cf

Outside= 52.8"W x 48.0"H => 14.72 sf x 4.00'L = 58.9 cf

80 Chambers/Row x 4.00' Long = 320.00' Row Length +12.0" End Stone x 2 = 322.00' Base Length

4 Rows x 52.8" Wide + 12.0" Side Stone x 2 = 19.60' Base Width

6.0" Stone Base + 48.0" Chamber Height + 12.0" Stone Cover = 5.50' Field Height

320 Chambers x 44.3 cf = 14,190.3 cf Chamber Storage

320 Chambers x 58.9 cf = 18,840.4 cf Displacement

34,711.6 cf Field - 18,840.4 cf Chambers = 15,871.2 cf Stone x 40.0% Voids = 6,348.5 cf Stone Storage

Chamber Storage + Stone Storage = 20,538.8 cf = 0.472 af


Overall Storage Efficiency = 59.2%

Overall System Size = 322.00' x 19.60' x 5.50'

320 Chambers

1,285.6 cy Field

587.8 cy Stone



10000

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 10-yr Rainfall=4.96"

Printed 12/13/2023

Page 52

Pond 14P: Chamber System

Hydrograph

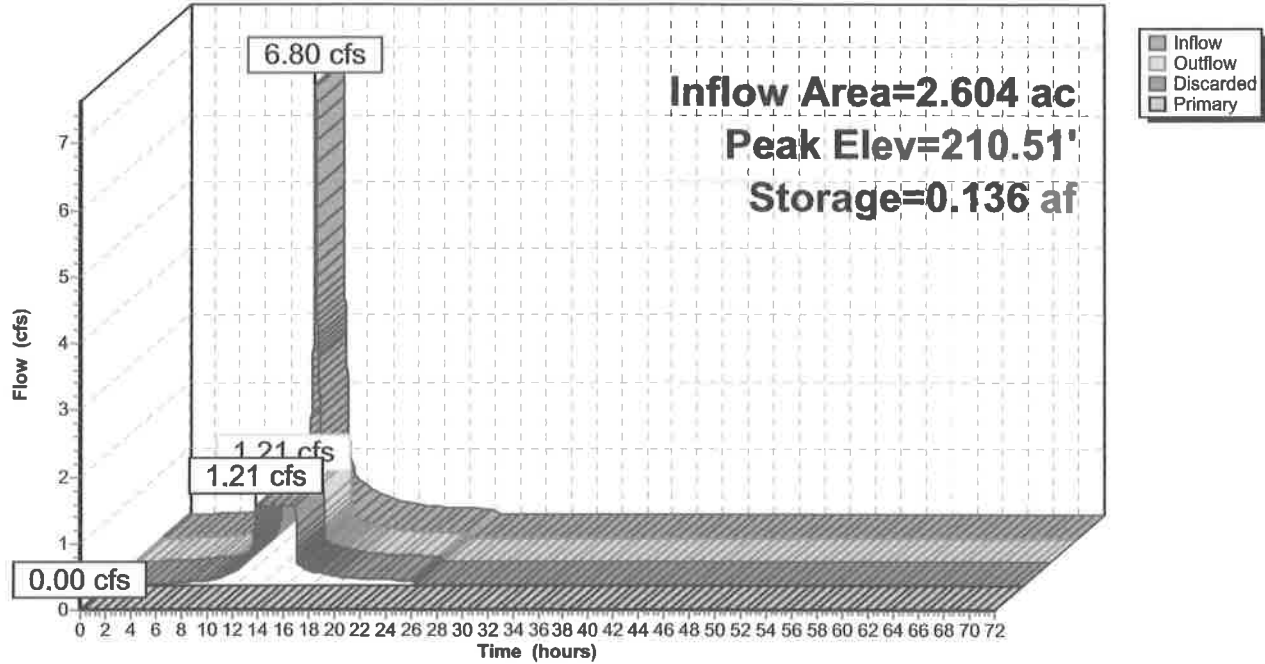

proposed 12-8-23

Type III 24-hr 10-yr Rainfall=4.96"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 53

Summary for Pond 16P: Infiltration Trench

Inflow Area = 0.632 ac, 25.27% Impervious, Inflow Depth = 1.18" for 10-yr event
 Inflow = 0.67 cfs @ 12.08 hrs, Volume= 0.062 af
 Outflow = 0.18 cfs @ 11.80 hrs, Volume= 0.062 af, Atten= 73%, Lag= 0.0 min
 Discarded = 0.18 cfs @ 11.80 hrs, Volume= 0.062 af

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Peak Elev= 196.10' @ 12.45 hrs Surf.Area= 952 sf Storage= 419 cf

Plug-Flow detention time= 10.3 min calculated for 0.062 af (100% of inflow)
 Center-of-Mass det. time= 10.3 min (792.2 - 781.9)


Volume	Invert	Avail.Storage	Storage Description
#1	195.00'	1,593 cf	8.50'W x 112.00'L x 5.00'H Prismaoid 4,760 cf Overall - 778 cf Embedded = 3,982 cf x 40.0% Voids
#2	196.25'	778 cf	18.0" Round CMP_Round 18" x 4 Inside #1 L= 110.0'
		2,371 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Discarded	195.00'	8.270 in/hr Exfiltration over Horizontal area

Discarded OutFlow Max=0.18 cfs @ 11.80 hrs HW=195.05' (Free Discharge)
 ↑=Exfiltration (Exfiltration Controls 0.18 cfs)

Pond 16P: Infiltration Trench

Hydrograph

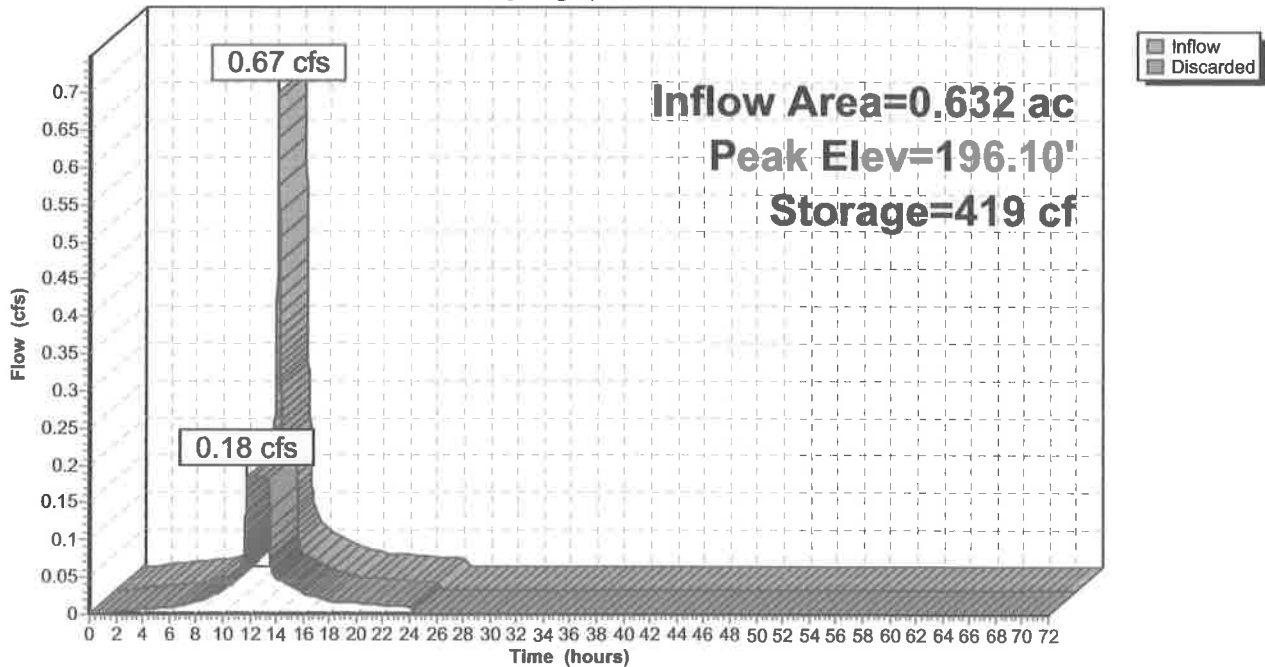

proposed 12-8-23

Type III 24-hr 25-yr Rainfall=6.29"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 54

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: P-1 (CB1)	Runoff Area=3,398 sf 66.27% Impervious Runoff Depth=3.84" Tc=6.0 min CN=78 Runoff=0.35 cfs 0.025 af
Subcatchment 2S: P-2 (CB2)	Runoff Area=1,896 sf 84.86% Impervious Runoff Depth=5.02" Tc=6.0 min CN=89 Runoff=0.24 cfs 0.018 af
Subcatchment 3S: P-3 (CB3)	Runoff Area=9,124 sf 89.35% Impervious Runoff Depth=5.35" Tc=6.0 min CN=92 Runoff=1.23 cfs 0.093 af
Subcatchment 4S: OS 1	Runoff Area=242,335 sf 40.85% Impervious Runoff Depth=2.38" Flow Length=855' Tc=9.9 min CN=63 Runoff=13.19 cfs 1.104 af
Subcatchment 7S: P-4 (CB4)	Runoff Area=17,772 sf 65.10% Impervious Runoff Depth=3.73" Tc=6.0 min CN=77 Runoff=1.78 cfs 0.127 af
Subcatchment 8S: P-5 (CB5)	Runoff Area=5,781 sf 64.57% Impervious Runoff Depth=3.73" Tc=6.0 min CN=77 Runoff=0.58 cfs 0.041 af
Subcatchment 9S: P-6 (CB6)	Runoff Area=11,883 sf 57.73% Impervious Runoff Depth=3.33" Tc=6.0 min CN=73 Runoff=1.07 cfs 0.076 af
Subcatchment 10S: P-7 (CB7)	Runoff Area=13,474 sf 0.00% Impervious Runoff Depth=0.36" Tc=6.0 min CN=36 Runoff=0.04 cfs 0.009 af
Subcatchment 11S: P-8 (CB8)	Runoff Area=22,491 sf 0.00% Impervious Runoff Depth=0.53" Tc=6.0 min CN=39 Runoff=0.12 cfs 0.023 af
Subcatchment 12S: P-9 (roof)	Runoff Area=27,632 sf 100.00% Impervious Runoff Depth=6.05" Tc=6.0 min CN=98 Runoff=3.91 cfs 0.320 af
Subcatchment 13S: P-10 (to south)	Runoff Area=15,401 sf 0.00% Impervious Runoff Depth=0.31" Flow Length=145' Tc=8.4 min CN=35 Runoff=0.03 cfs 0.009 af
Subcatchment 15S: P-10A (rear lawn)	Runoff Area=21,516 sf 4.43% Impervious Runoff Depth=0.53" Tc=6.0 min CN=39 Runoff=0.11 cfs 0.022 af
Subcatchment 17S: P-9A (roof)	Runoff Area=6,000 sf 100.00% Impervious Runoff Depth=6.05" Tc=6.0 min CN=98 Runoff=0.85 cfs 0.069 af
Subcatchment 18S: OS 2	Runoff Area=45,929 sf 0.00% Impervious Runoff Depth=0.11" Flow Length=333' Slope=0.0700 '/' Tc=11.1 min CN=30 Runoff=0.01 cfs 0.009 af
Reach 7R: offsite south	Inflow=1.42 cfs 0.103 af Outflow=1.42 cfs 0.103 af
Reach 20R: Headwall	Avg. Flow Depth=0.23' Max Vel=7.18 fps Inflow=1.41 cfs 0.094 af 24.0" Round Pipe n=0.012 L=311.0' S=0.0450 '/' Capacity=52.00 cfs Outflow=1.40 cfs 0.094 af

proposed 12-8-23

Type III 24-hr 25-yr Rainfall=6.29"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 55

Pond 6P: Existing Basin Peak Elev=225.14' Storage=20,614 cf Inflow=13.19 cfs 1.104 af
Discarded=1.11 cfs 0.948 af Primary=1.41 cfs 0.085 af Outflow=2.52 cfs 1.033 af

Pond 14P: Chamber System Peak Elev=211.29' Storage=0.219 af Inflow=9.20 cfs 0.733 af
Discarded=1.21 cfs 0.733 af Primary=0.00 cfs 0.000 af Outflow=1.21 cfs 0.733 af

Pond 16P: Infiltration Trench Peak Elev=196.76' Storage=812 cf Inflow=0.89 cfs 0.091 af
Outflow=0.18 cfs 0.091 af

Total Runoff Area = 10.207 ac Runoff Volume = 1.947 af Average Runoff Depth = 2.29"
62.27% Pervious = 6.356 ac 37.73% Impervious = 3.851 ac

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 56

Summary for Subcatchment 1S: P-1 (CB1)

Runoff = 0.35 cfs @ 12.09 hrs, Volume= 0.025 af, Depth= 3.84"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
2,252	98	Paved parking, HSG A
1,146	39	>75% Grass cover, Good, HSG A
3,398	78	Weighted Average
1,146		33.73% Pervious Area
2,252		66.27% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 1S: P-1 (CB1)

Hydrograph

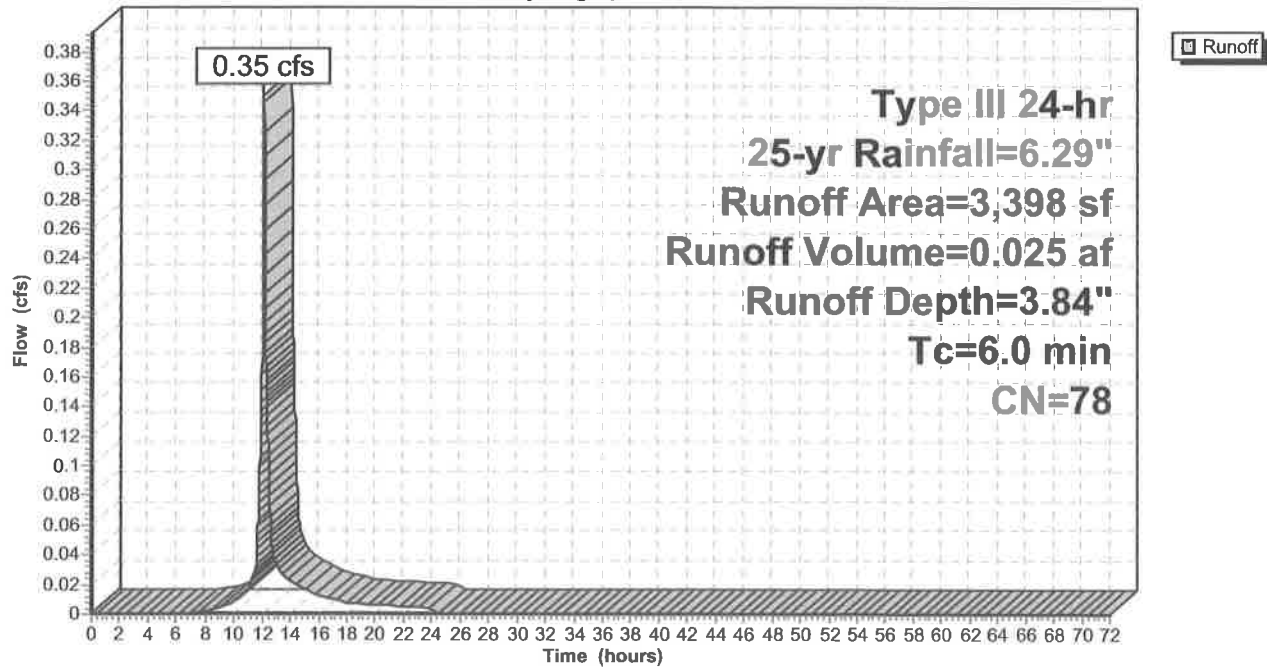

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 57

Summary for Subcatchment 2S: P-2 (CB2)

Runoff = 0.24 cfs @ 12.08 hrs, Volume= 0.018 af, Depth= 5.02"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
1,609	98	Paved parking, HSG A
287	39	>75% Grass cover, Good, HSG A
1,896	89	Weighted Average
287		15.14% Pervious Area
1,609		84.86% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 2S: P-2 (CB2)

Hydrograph

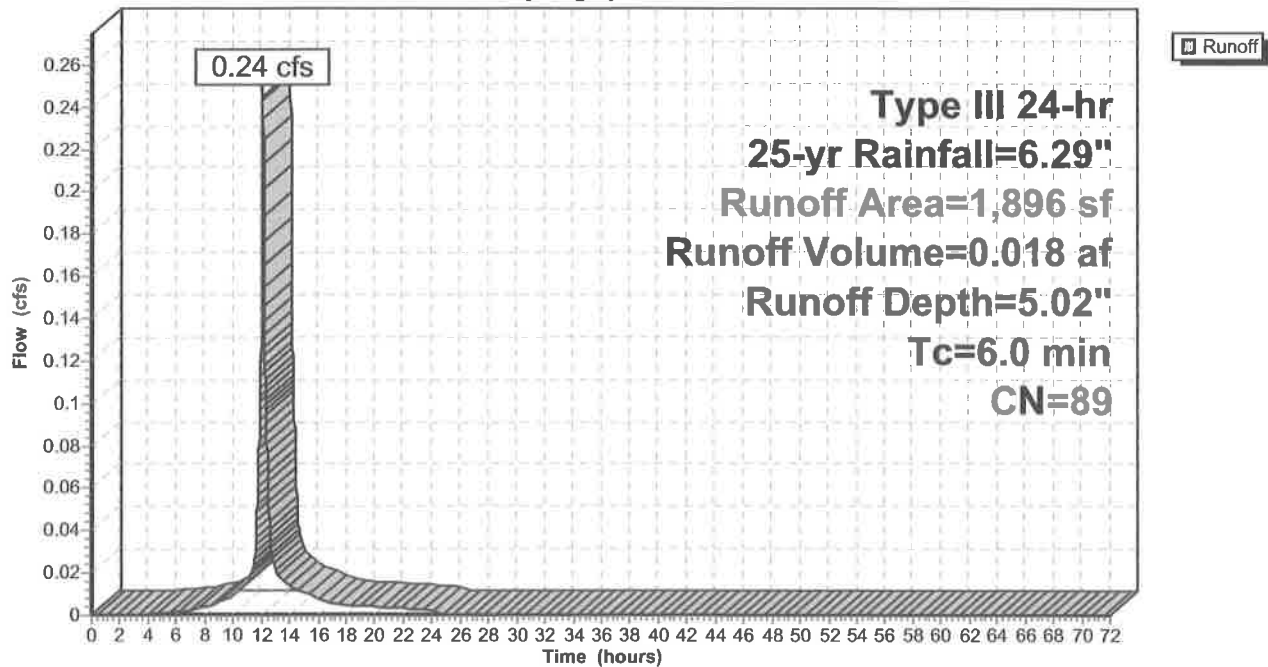

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 58

Summary for Subcatchment 3S: P-3 (CB3)

Runoff = 1.23 cfs @ 12.08 hrs, Volume= 0.093 af, Depth= 5.35"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
8,152	98	Paved parking, HSG A
972	39	>75% Grass cover, Good, HSG A
9,124	92	Weighted Average
972		10.65% Pervious Area
8,152		89.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 3S: P-3 (CB3)

Hydrograph

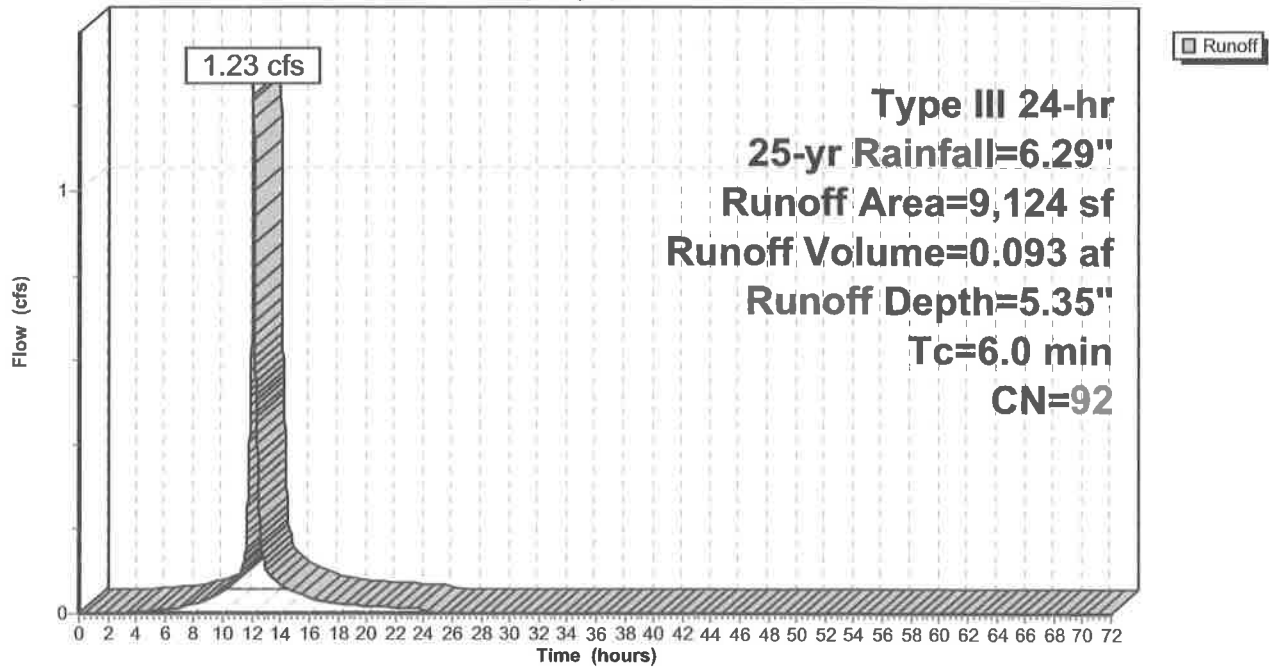

proposed 12-8-23

Type III 24-hr 25-yr Rainfall=6.29"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 59

Summary for Subcatchment 4S: OS 1

Runoff = 13.19 cfs @ 12.15 hrs, Volume= 1.104 af, Depth= 2.38"
Routed to Pond 6P : Existing Basin

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
21,486	98	Roofs, HSG A
15,524	30	Woods, Good, HSG A
127,810	39	>75% Grass cover, Good, HSG A
* 6,241	98	Water Surface, HSG A Basin
71,274	98	Paved parking, HSG A
242,335	63	Weighted Average
143,334		59.15% Pervious Area
99,001		40.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0300	0.12		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
1.1	150	0.0120	2.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	475	0.0100	5.26	6.46	Pipe Channel, RCP_Round 15" 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.013 Concrete pipe, bends & connections
0.3	180	0.0280	9.95	17.58	Pipe Channel, RCP_Round 18" 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.013
9.9	855	Total			

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 60

Subcatchment 4S: OS 1

Hydrograph

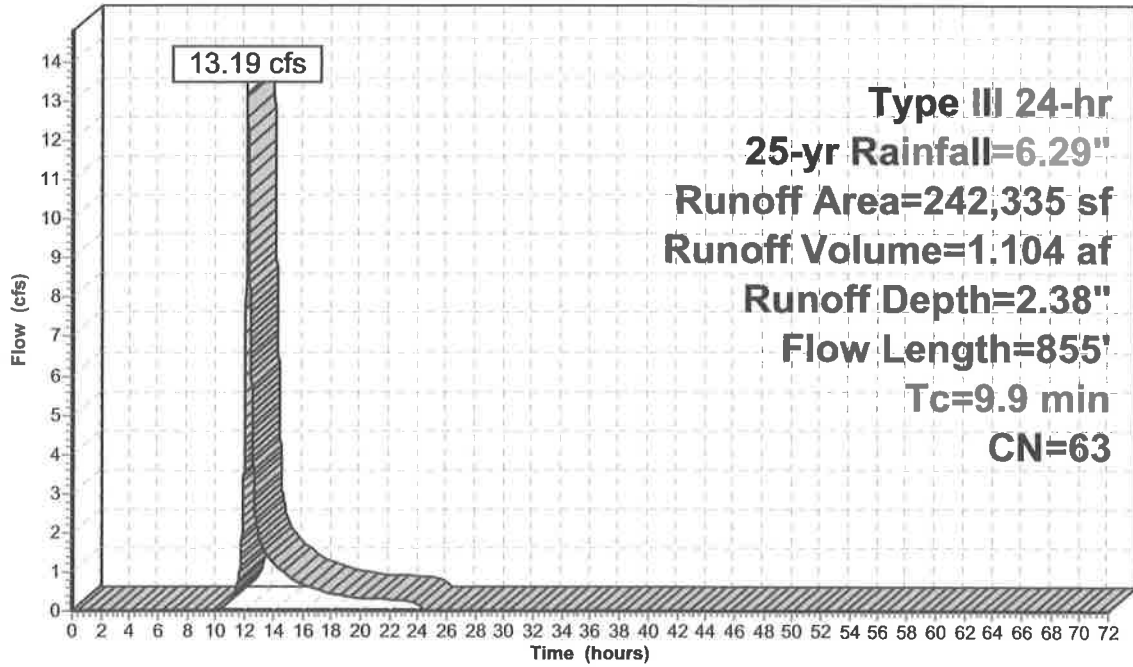

Runoff

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 61

Summary for Subcatchment 7S: P-4 (CB4)

Runoff = 1.78 cfs @ 12.09 hrs, Volume= 0.127 af, Depth= 3.73"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
11,570	98	Paved parking, HSG A
6,202	39	>75% Grass cover, Good, HSG A
17,772	77	Weighted Average
6,202		34.90% Pervious Area
11,570		65.10% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 7S: P-4 (CB4)

Hydrograph

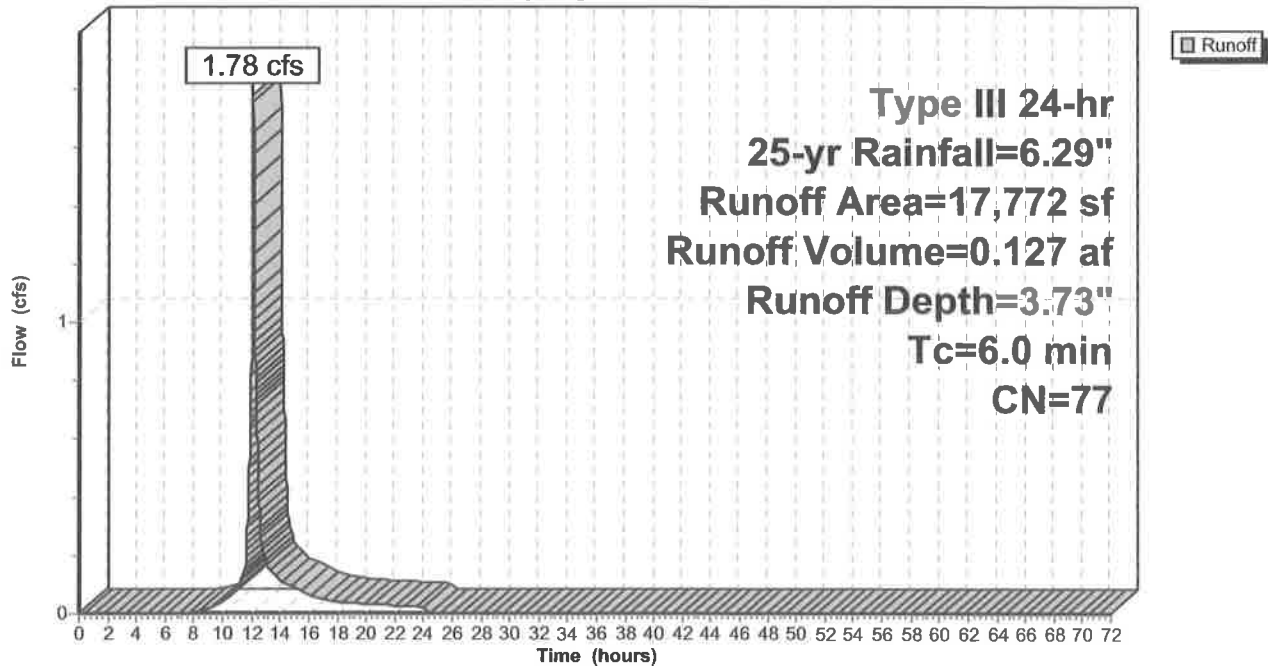

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 62

Summary for Subcatchment 8S: P-5 (CB5)

Runoff = 0.58 cfs @ 12.09 hrs, Volume= 0.041 af, Depth= 3.73"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
3,733	98	Paved parking, HSG A
2,048	39	>75% Grass cover, Good, HSG A
5,781	77	Weighted Average
2,048		35.43% Pervious Area
3,733		64.57% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 8S: P-5 (CB5)

Hydrograph

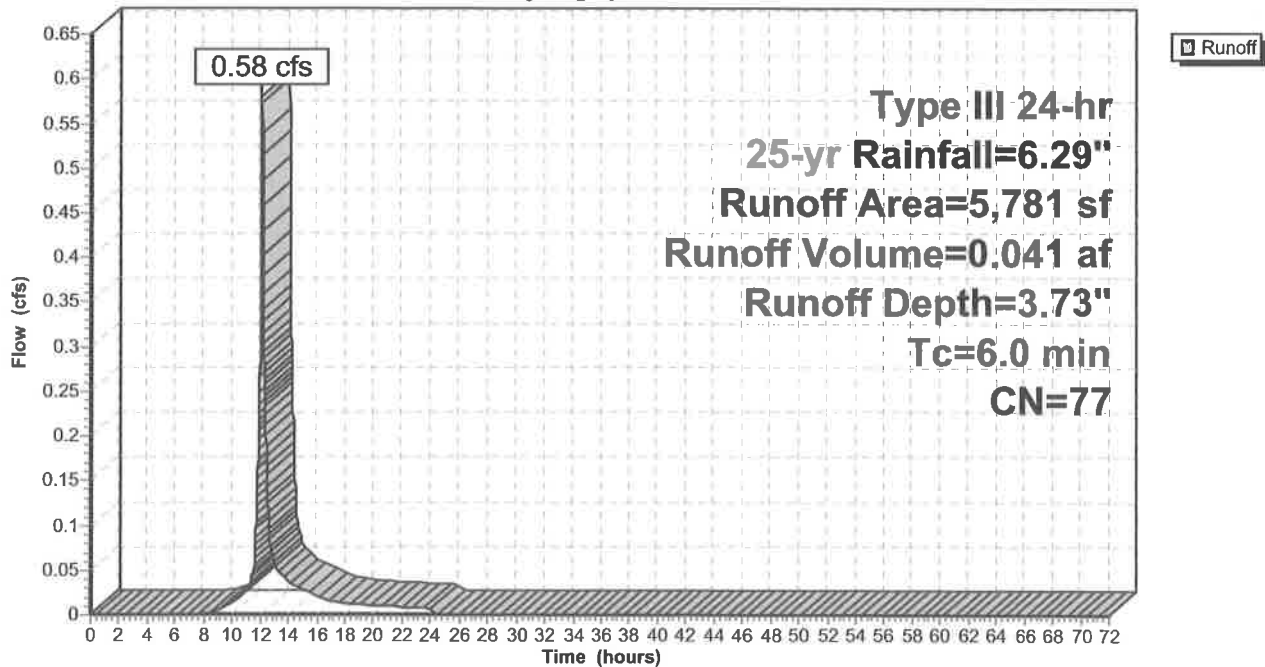

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 63

Summary for Subcatchment 9S: P-6 (CB6)

Runoff = 1.07 cfs @ 12.09 hrs, Volume= 0.076 af, Depth= 3.33"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
6,860	98	Paved parking, HSG A
5,023	39	>75% Grass cover, Good, HSG A
11,883	73	Weighted Average
5,023		42.27% Pervious Area
6,860		57.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 9S: P-6 (CB6)

Hydrograph

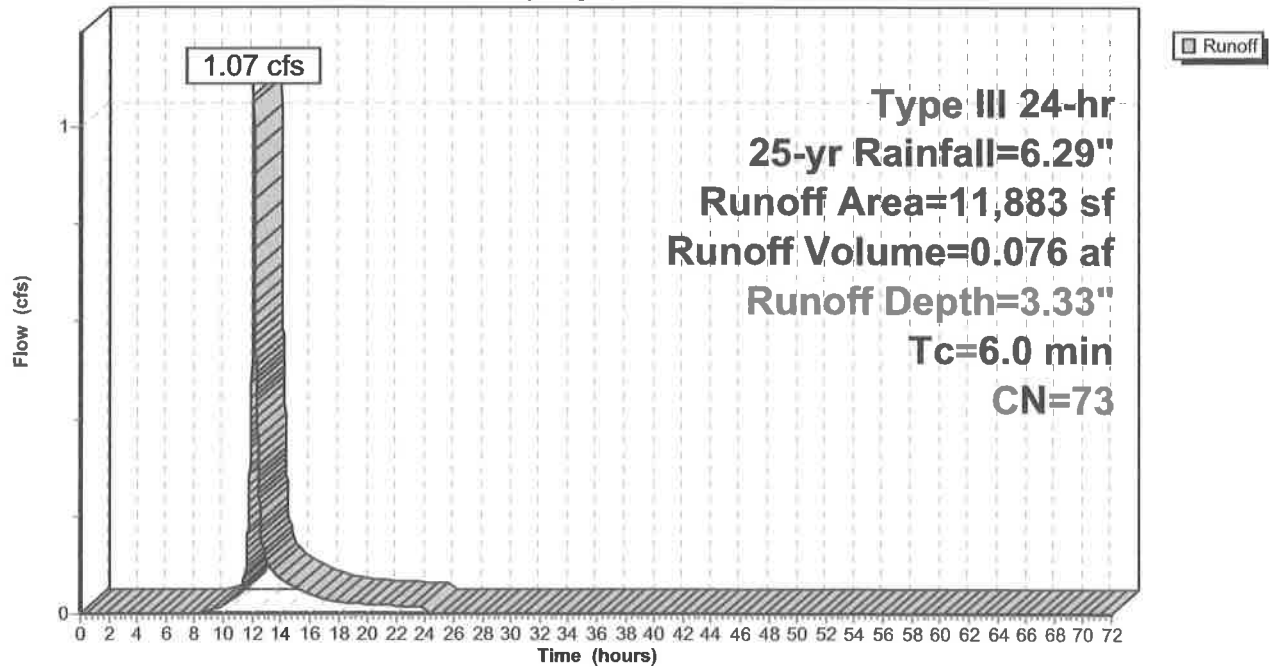

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 64

Summary for Subcatchment 10S: P-7 (CB7)

Runoff = 0.04 cfs @ 12.39 hrs, Volume= 0.009 af, Depth= 0.36"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
8,914	39	>75% Grass cover, Good, HSG A
4,560	30	Woods, Good, HSG A
13,474	36	Weighted Average
13,474		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 10S: P-7 (CB7)

Hydrograph

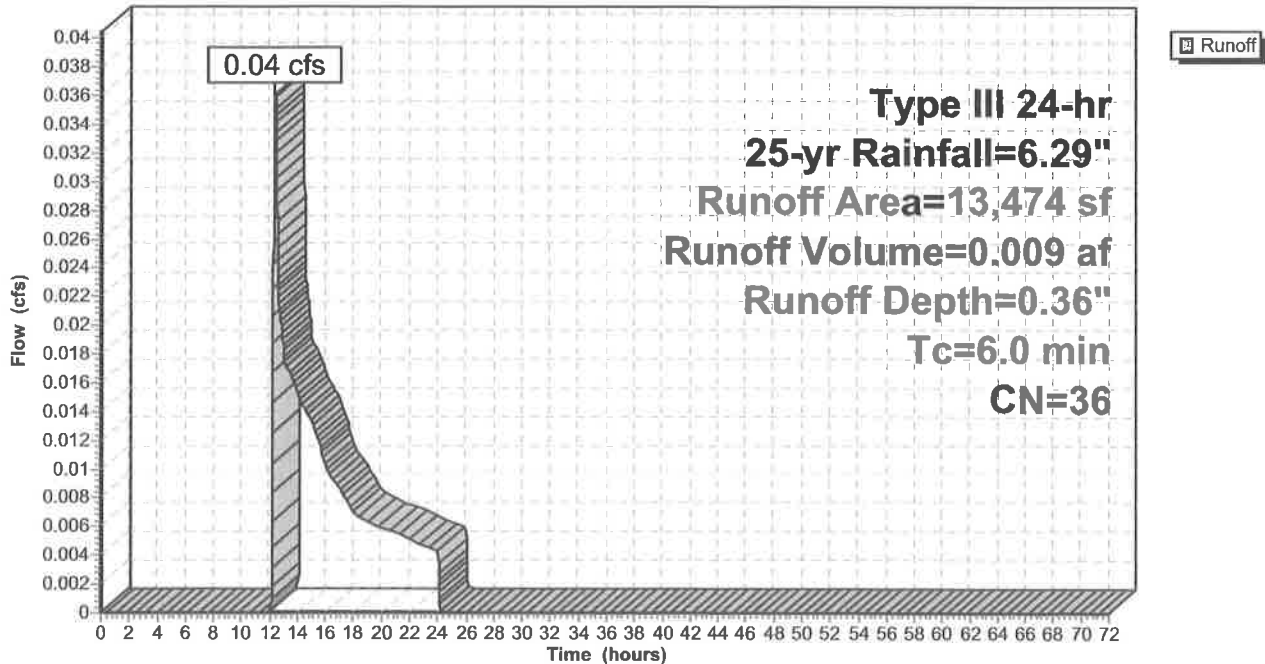

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 65

Summary for Subcatchment 11S: P-8 (CB8)

Runoff = 0.12 cfs @ 12.31 hrs, Volume= 0.023 af, Depth= 0.53"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
22,491	39	>75% Grass cover, Good, HSG A
22,491		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 11S: P-8 (CB8)

Hydrograph

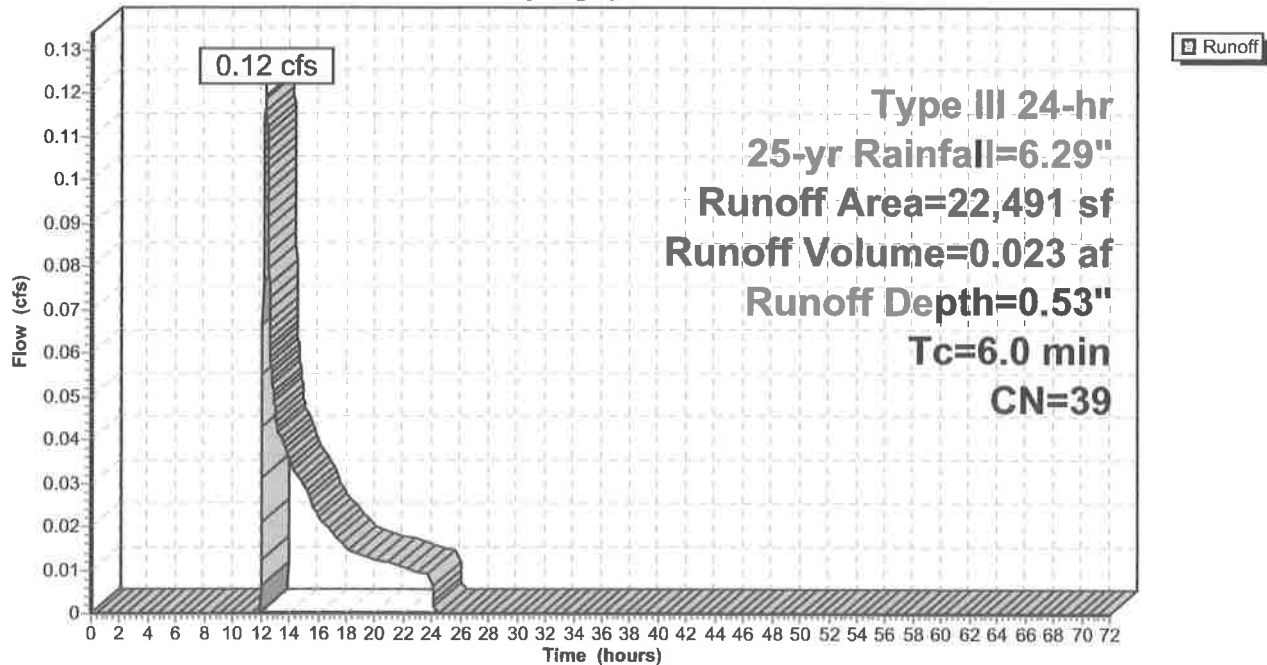

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 66

Summary for Subcatchment 12S: P-9 (roof)

Runoff = 3.91 cfs @ 12.08 hrs, Volume= 0.320 af, Depth= 6.05"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
27,632	98	Roofs, HSG A
27,632		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 12S: P-9 (roof)

Hydrograph

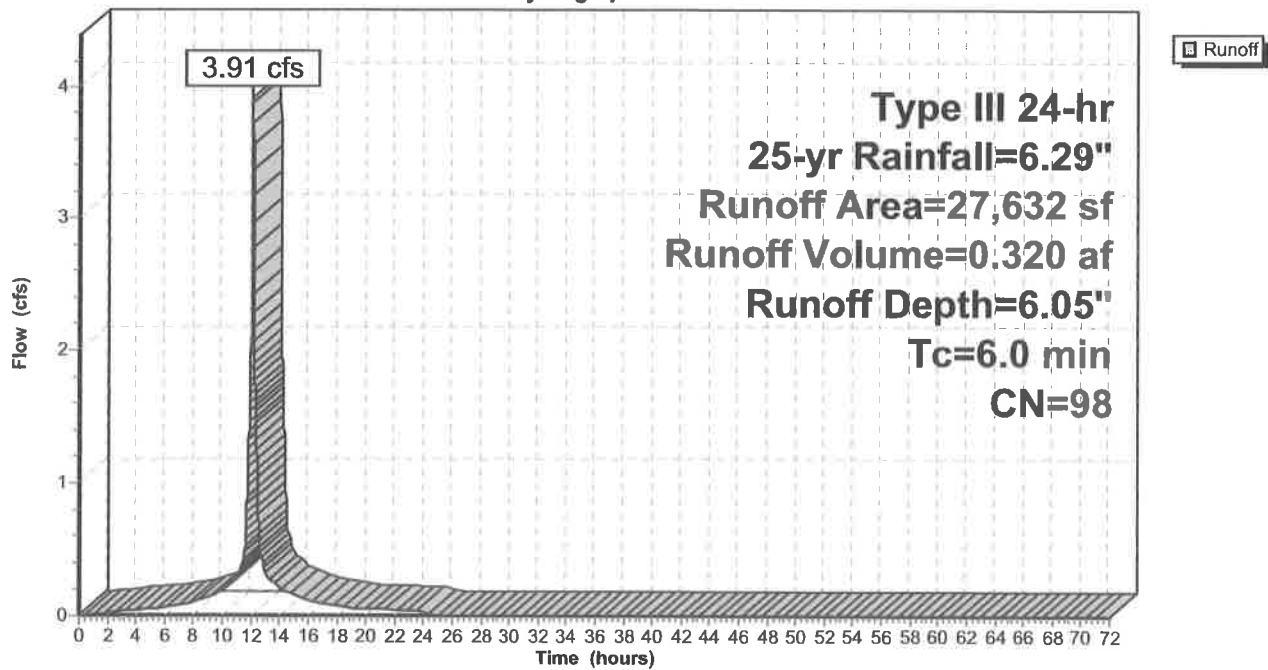

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 67

Summary for Subcatchment 13S: P-10 (to south)

Runoff = 0.03 cfs @ 12.46 hrs, Volume= 0.009 af, Depth= 0.31"
Routed to Reach 7R : offsite south


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
8,371	39	>75% Grass cover, Good, HSG A
7,030	30	Woods, Good, HSG A
15,401	35	Weighted Average
15,401		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
0.2	95	0.1900	6.54		Shallow Concentrated Flow, Grassed Waterway Kv= 15.0 fps
8.4	145	Total			

Subcatchment 13S: P-10 (to south)

Hydrograph

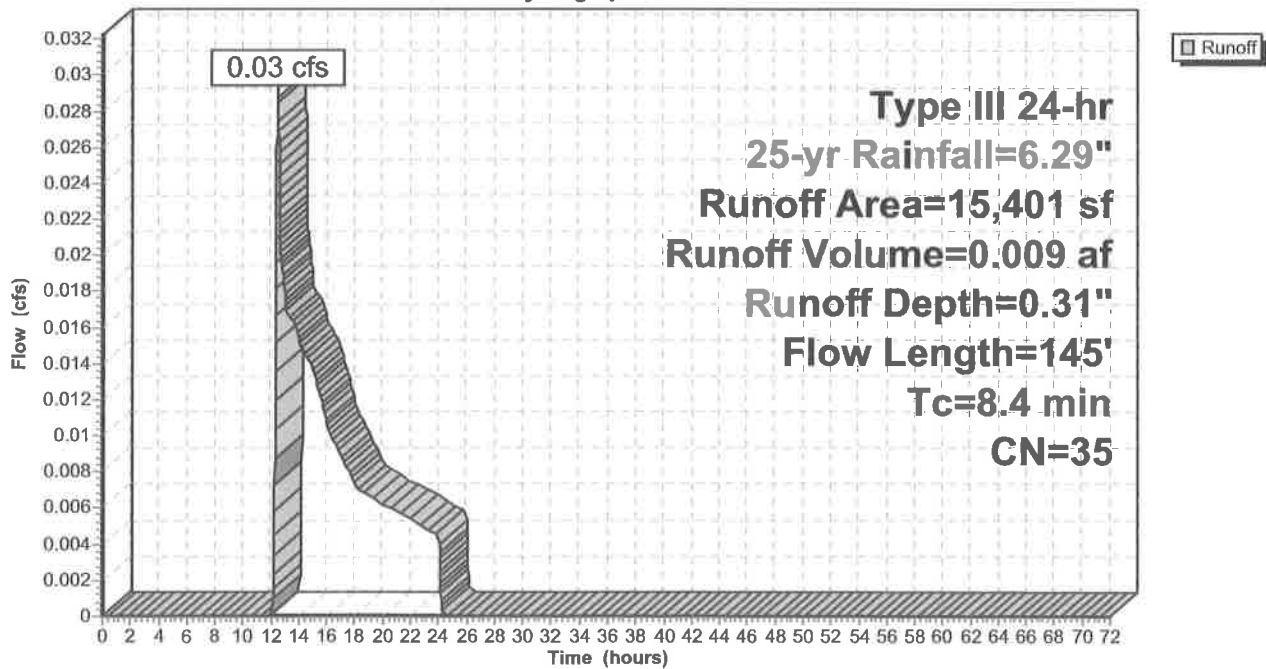

proposed 12-8-23

Type III 24-hr 25-yr Rainfall=6.29"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 68

Summary for Subcatchment 15S: P-10A (rear lawn)

Runoff = 0.11 cfs @ 12.31 hrs, Volume= 0.022 af, Depth= 0.53"
Routed to Pond 16P : Infiltration Trench


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
13,389	39	>75% Grass cover, Good, HSG A
953	98	Water Surface, HSG A
7,174	30	Meadow, non-grazed, HSG A
21,516	39	Weighted Average
20,563		95.57% Pervious Area
953		4.43% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 15S: P-10A (rear lawn)

Hydrograph

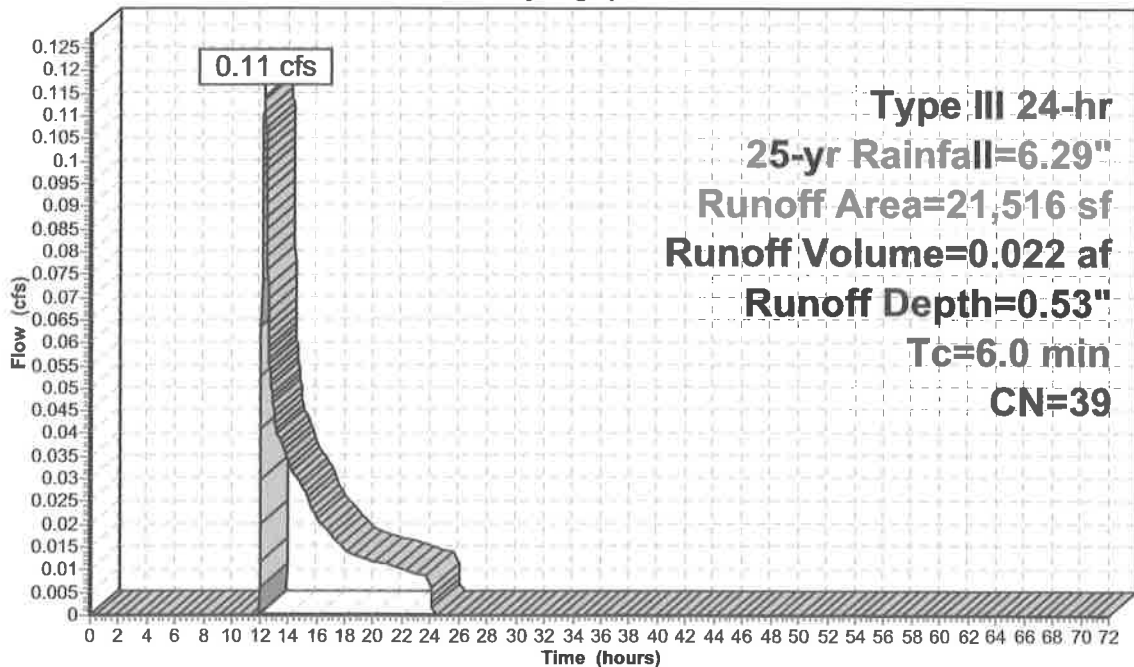

Runoff

Type III 24-hr
25-yr Rainfall=6.29"
Runoff Area=21,516 sf
Runoff Volume=0.022 af
Runoff Depth=0.53"
Tc=6.0 min
CN=39

proposed 12-8-23

Type III 24-hr 25-yr Rainfall=6.29"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 69

Summary for Subcatchment 17S: P-9A (roof)

Runoff = 0.85 cfs @ 12.08 hrs, Volume= 0.069 af, Depth= 6.05"
Routed to Pond 16P : Infiltration Trench


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
6,000	98	Roofs, HSG A
6,000		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 17S: P-9A (roof)

Hydrograph

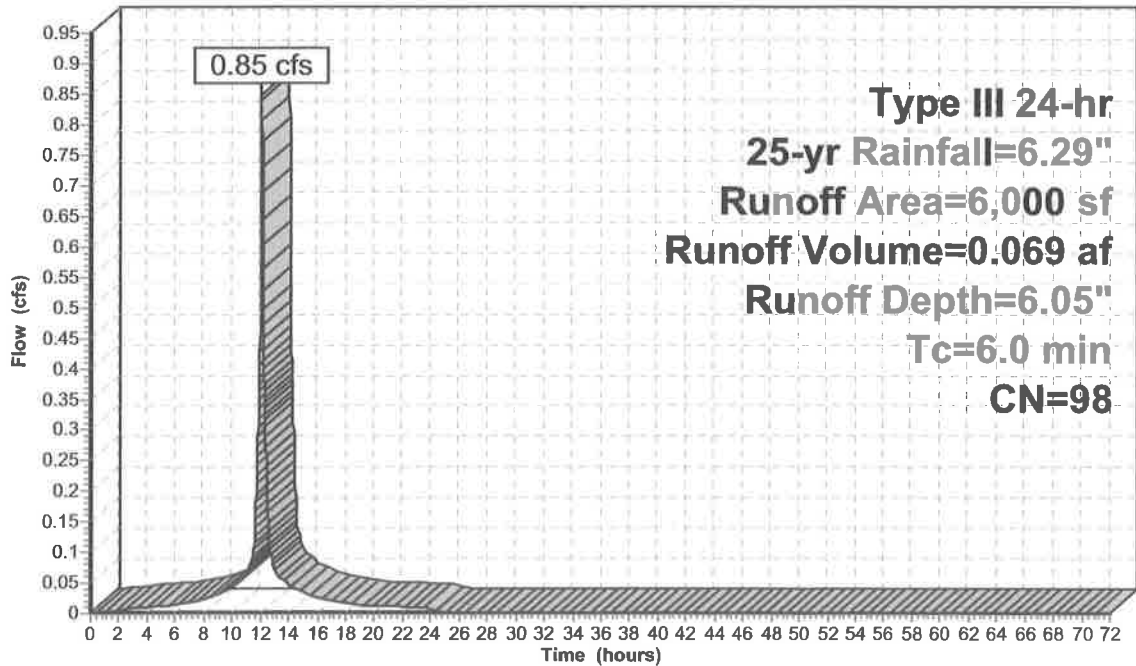

**Type III 24-hr
25-yr Rainfall=6.29"
Runoff Area=6,000 sf
Runoff Volume=0.069 af
Runoff Depth=6.05"
Tc=6.0 min
CN=98**

proposed 12-8-23

Type III 24-hr 25-yr Rainfall=6.29"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 70

Summary for Subcatchment 18S: OS 2

Runoff = 0.01 cfs @ 15.23 hrs, Volume= 0.009 af, Depth= 0.11"
Routed to Reach 20R : Headwall


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 25-yr Rainfall=6.29"

Area (sf)	CN	Description
45,929	30	Woods, Good, HSG A
45,929		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0700	0.11		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
3.6	283	0.0700	1.32		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
11.1	333	Total			

Subcatchment 18S: OS 2

Hydrograph

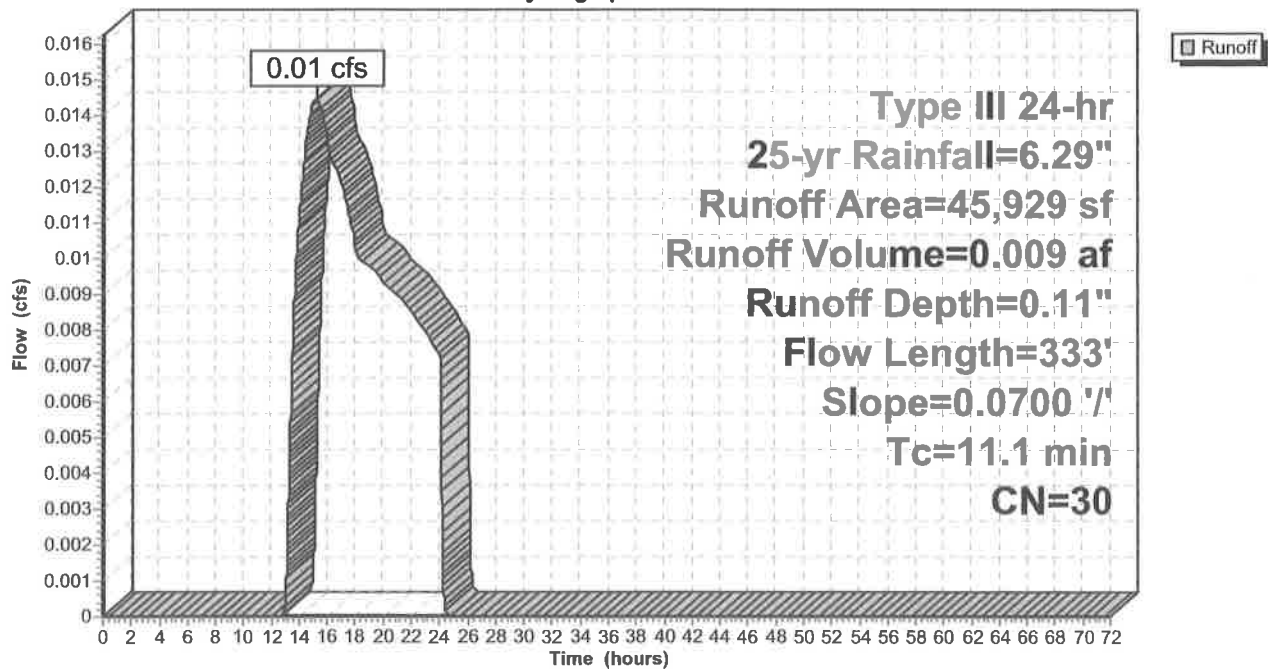

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023


Page 71

Summary for Reach 7R: offsite south

Inflow Area = 10.207 ac, 37.73% Impervious, Inflow Depth = 0.12" for 25-yr event
Inflow = 1.42 cfs @ 12.74 hrs, Volume= 0.103 af
Outflow = 1.42 cfs @ 12.74 hrs, Volume= 0.103 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Reach 7R: offsite south

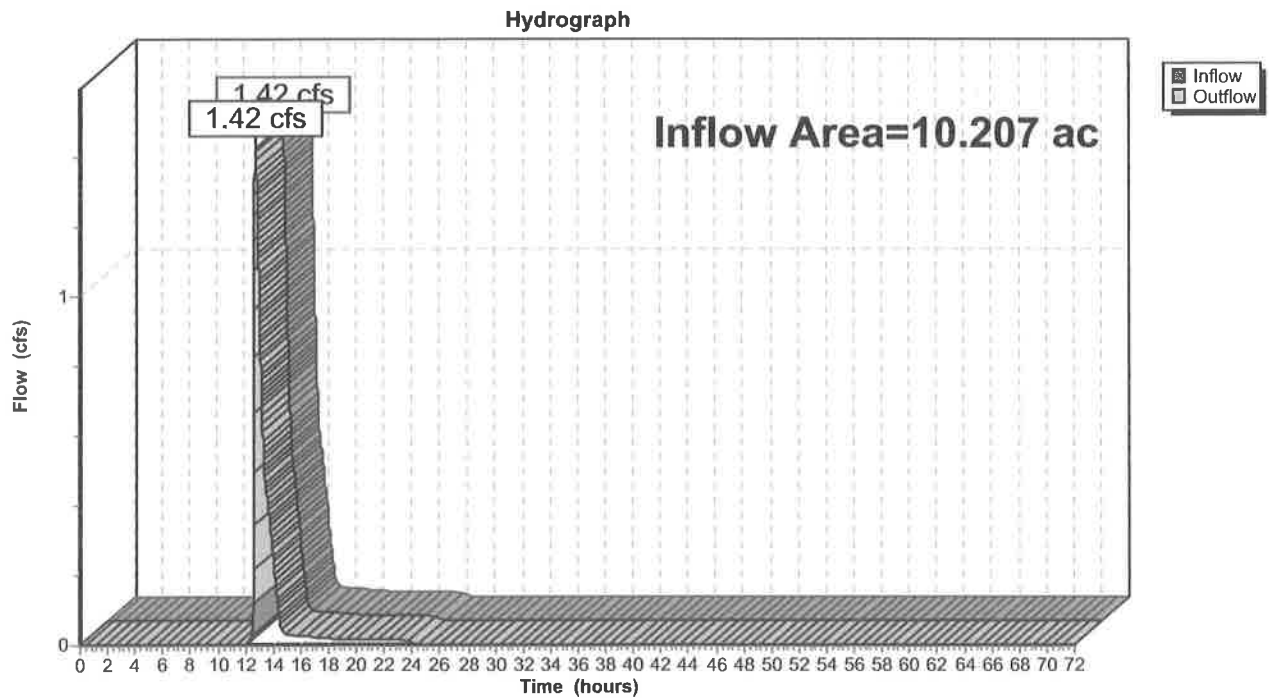

Summary for Reach 20R: Headwall

Inflow Area = 6.618 ac, 34.34% Impervious, Inflow Depth = 0.17" for 25-yr event
 Inflow = 1.41 cfs @ 12.72 hrs, Volume= 0.094 af
 Outflow = 1.40 cfs @ 12.74 hrs, Volume= 0.094 af, Atten= 0%, Lag= 1.3 min
 Routed to Reach 7R : offsite south

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Max. Velocity= 7.18 fps, Min. Travel Time= 0.7 min
 Avg. Velocity = 2.19 fps, Avg. Travel Time= 2.4 min


Peak Storage= 61 cf @ 12.72 hrs
 Average Depth at Peak Storage= 0.23', Surface Width= 1.27'
 Bank-Full Depth= 2.00' Flow Area= 3.1 sf, Capacity= 52.00 cfs

24.0" Round Pipe
 n= 0.012
 Length= 311.0' Slope= 0.0450 '/'
 Inlet Invert= 214.00', Outlet Invert= 200.00'



Reach 20R: Headwall

Hydrograph

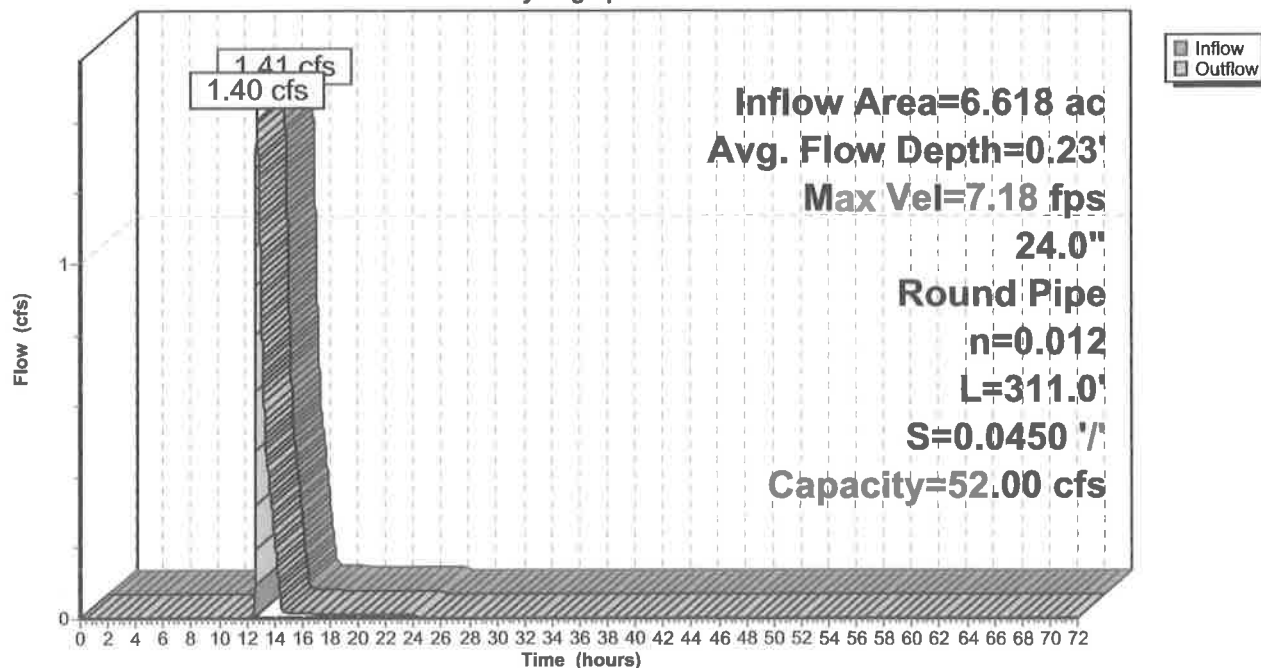

Summary for Pond 6P: Existing Basin

Inflow Area = 5.563 ac, 40.85% Impervious, Inflow Depth = 2.38" for 25-yr event
 Inflow = 13.19 cfs @ 12.15 hrs, Volume= 1.104 af
 Outflow = 2.52 cfs @ 12.72 hrs, Volume= 1.033 af, Atten= 81%, Lag= 34.2 min
 Discarded = 1.11 cfs @ 12.72 hrs, Volume= 0.948 af
 Primary = 1.41 cfs @ 12.72 hrs, Volume= 0.085 af
 Routed to Reach 20R : Headwall

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs / 3
 Peak Elev= 225.14' @ 12.72 hrs Surf.Area= 6,260 sf Storage= 20,614 cf

Plug-Flow detention time= 227.5 min calculated for 1.033 af (94% of inflow)
 Center-of-Mass det. time= 194.0 min (1,050.0 - 856.0)

Volume	Invert	Avail.Storage	Storage Description
#1	211.00'	111 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 467 cf Embedded = 279 cf x 40.0% Voids
#2	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder Inside #1
#3	211.00'	117 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 452 cf Embedded = 294 cf x 40.0% Voids
#4	211.50'	452 cf	8.00'D x 9.00'H Vertical Cone/Cylinder Inside #3
#5	210.50'	107 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 478 cf Embedded = 269 cf x 40.0% Voids
#6	210.50'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #5
#7	210.50'	123 cf	10.00'D x 10.00'H Vertical Cone/Cylinder 785 cf Overall - 478 cf Embedded = 308 cf x 40.0% Voids
#8	210.70'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #7
#9	211.00'	298 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall x 40.0% Voids
#10	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder
#11	220.50'	23,070 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,170 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
220.50	2,038	0	0
222.00	3,006	3,783	3,783
224.00	4,743	7,749	11,532
225.00	5,659	5,201	16,733
225.50	6,241	2,975	19,708
226.00	7,205	3,362	23,070

Device	Routing	Invert	Outlet Devices
#1	Discarded	220.49'	8.270 in/hr Exfiltration over Surface area above 220.49' Excluded Surface area = 443 sf
#2	Primary	225.00'	10.0' long + 4.0 ' SideZ x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 74

Discarded OutFlow Max=1.11 cfs @ 12.72 hrs HW=225.14' (Free Discharge)


↑1=Exfiltration (Exfiltration Controls 1.11 cfs)

Primary OutFlow Max=1.23 cfs @ 12.72 hrs HW=225.14' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 1.23 cfs @ 0.85 fps)

Pond 6P: Existing Basin

Hydrograph

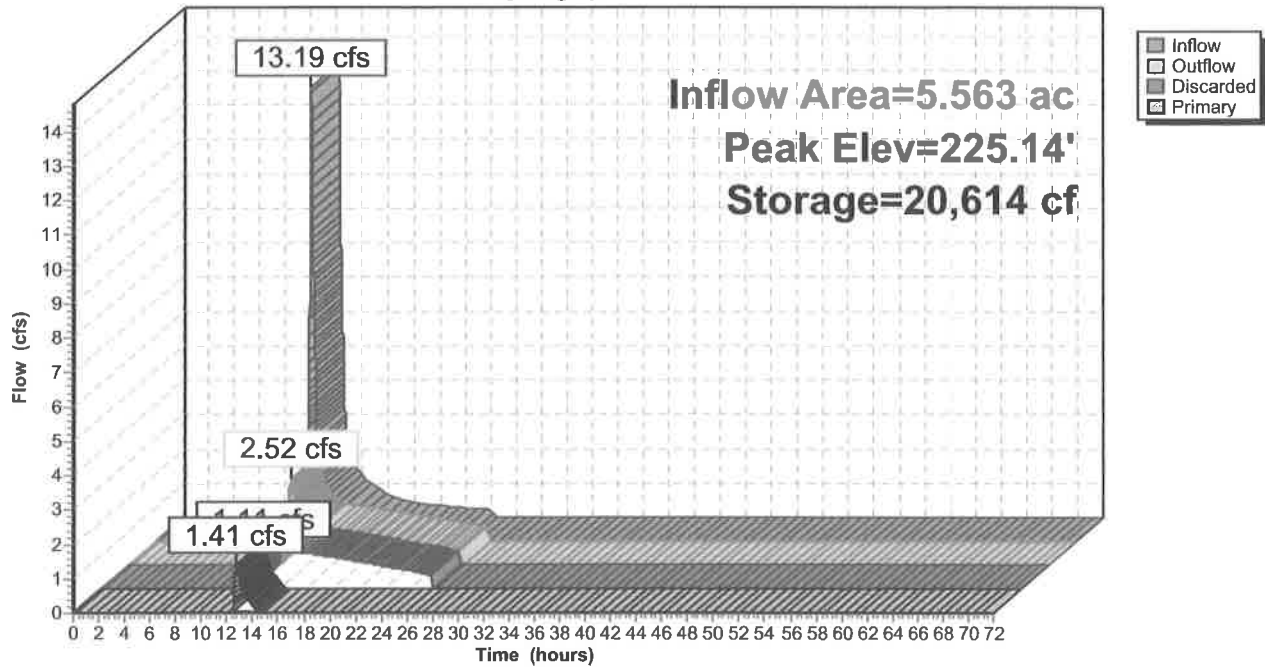

proposed 12-8-23

Type III 24-hr 25-yr Rainfall=6.29"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 75

Summary for Pond 14P: Chamber System

Inflow Area = 2.604 ac, 54.48% Impervious, Inflow Depth = 3.38" for 25-yr event
 Inflow = 9.20 cfs @ 12.09 hrs, Volume= 0.733 af
 Outflow = 1.21 cfs @ 11.65 hrs, Volume= 0.733 af, Atten= 87%, Lag= 0.0 min
 Discarded = 1.21 cfs @ 11.65 hrs, Volume= 0.733 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Routed to Reach 7R : offsite south

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Peak Elev= 211.29' @ 12.68 hrs Surf.Area= 0.145 ac Storage= 0.219 af

Plug-Flow detention time= 52.4 min calculated for 0.733 af (100% of inflow)
 Center-of-Mass det. time= 52.4 min (839.8 - 787.4)

Volume	Invert	Avail.Storage	Storage Description
#1A	209.00'	0.146 af	19.60"W x 322.00'L x 5.50'H Field A 0.797 af Overall - 0.433 af Embedded = 0.364 af x 40.0% Voids
#2A	209.50'	0.326 af	Galley 4x4x4 x 320 Inside #1 Inside= 42.0"W x 43.0"H => 12.67 sf x 3.50'L = 44.3 cf Outside= 52.8"W x 48.0"H => 14.72 sf x 4.00'L = 58.9 cf 320 Chambers in 4 Rows
		0.472 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	209.00'	8.270 in/hr Exfiltration over Surface area
#2	Primary	214.00'	15.0" Round Culvert L= 157.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 214.00' / 206.60' S= 0.0471 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 1.23 sf

Discarded OutFlow Max=1.21 cfs @ 11.65 hrs HW=209.06' (Free Discharge)
 ↑1=Exfiltration (Exfiltration Controls 1.21 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=209.00' (Free Discharge)
 ↑2=Culvert (Controls 0.00 cfs)

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 76

Pond 14P: Chamber System - Chamber Wizard Field A

Chamber Model = Galley 4x4x4 (Concrete Galley, UCPI 4x4x4 Galley or equivalent)

Inside= 42.0"W x 43.0"H => 12.67 sf x 3.50'L = 44.3 cf

Outside= 52.8"W x 48.0"H => 14.72 sf x 4.00'L = 58.9 cf

80 Chambers/Row x 4.00' Long = 320.00' Row Length +12.0" End Stone x 2 = 322.00' Base Length

4 Rows x 52.8" Wide + 12.0" Side Stone x 2 = 19.60' Base Width

6.0" Stone Base + 48.0" Chamber Height + 12.0" Stone Cover = 5.50' Field Height

320 Chambers x 44.3 cf = 14,190.3 cf Chamber Storage

320 Chambers x 58.9 cf = 18,840.4 cf Displacement

34,711.6 cf Field - 18,840.4 cf Chambers = 15,871.2 cf Stone x 40.0% Voids = 6,348.5 cf Stone Storage

Chamber Storage + Stone Storage = 20,538.8 cf = 0.472 af

Overall Storage Efficiency = 59.2%

Overall System Size = 322.00' x 19.60' x 5.50'

320 Chambers

1,285.6 cy Field

587.8 cy Stone



proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 25-yr Rainfall=6.29"

Printed 12/13/2023

Page 77

Pond 14P: Chamber System

Hydrograph

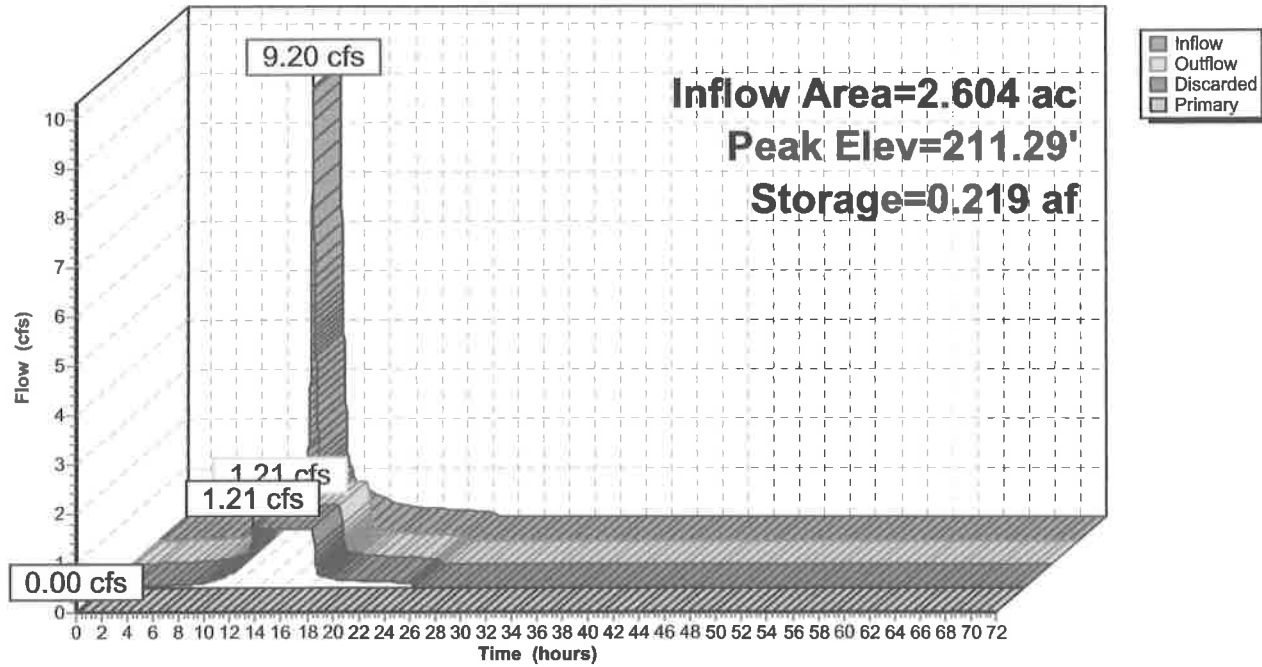

proposed 12-8-23

Type III 24-hr 25-yr Rainfall=6.29"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 78

Summary for Pond 16P: Infiltration Trench

Inflow Area = 0.632 ac, 25.27% Impervious, Inflow Depth = 1.74" for 25-yr event
 Inflow = 0.89 cfs @ 12.09 hrs, Volume= 0.091 af
 Outflow = 0.18 cfs @ 11.73 hrs, Volume= 0.091 af, Atten= 79%, Lag= 0.0 min
 Discarded = 0.18 cfs @ 11.73 hrs, Volume= 0.091 af

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Peak Elev= 196.76' @ 12.58 hrs Surf.Area= 952 sf Storage= 812 cf

Plug-Flow detention time= 23.8 min calculated for 0.091 af (100% of inflow)
 Center-of-Mass det. time= 23.8 min (817.4 - 793.6)


Volume	Invert	Avail.Storage	Storage Description
#1	195.00'	1,593 cf	8.50'W x 112.00'L x 5.00'H Prismaoid 4,760 cf Overall - 778 cf Embedded = 3,982 cf x 40.0% Voids
#2	196.25'	778 cf	18.0" Round CMP_Round 18" x 4 Inside #1 L= 110.0'
		2,371 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Discarded	195.00'	8.270 in/hr Exfiltration over Horizontal area

Discarded OutFlow Max=0.18 cfs @ 11.73 hrs HW=195.05' (Free Discharge)
 ↑=Exfiltration (Exfiltration Controls 0.18 cfs)

Pond 16P: Infiltration Trench

Hydrograph

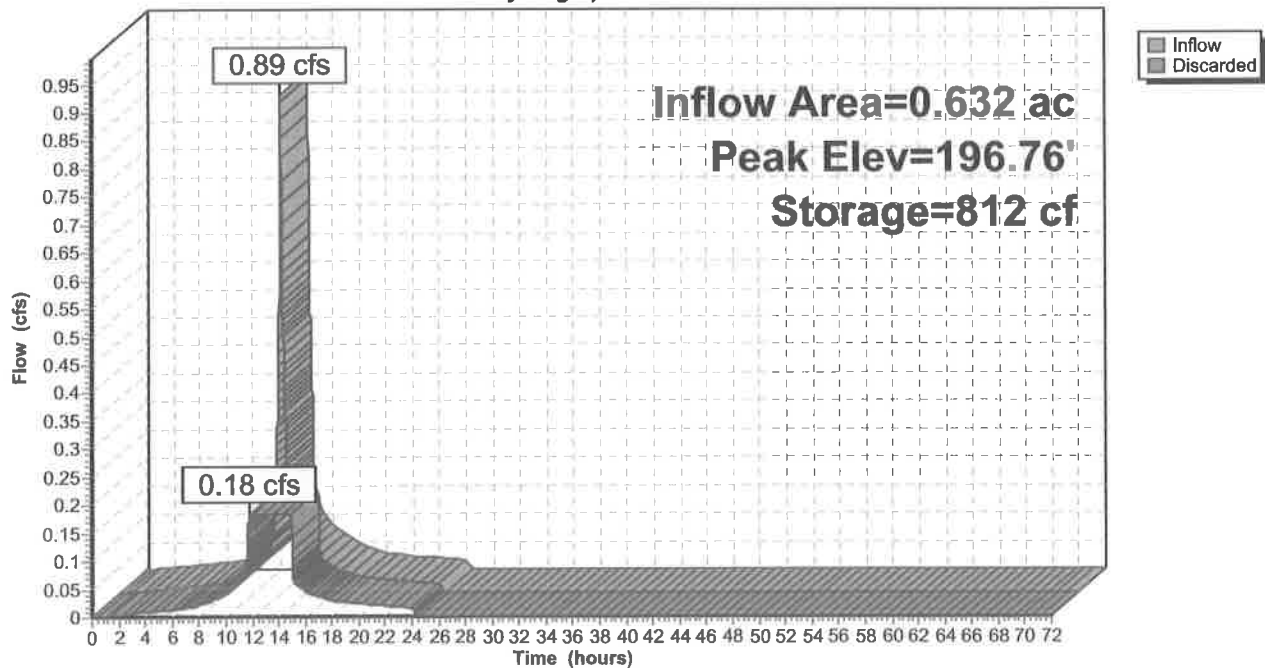

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 79

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: P-1 (CB1)	Runoff Area=3,398 sf 66.27% Impervious Runoff Depth=4.97" Tc=6.0 min CN=78 Runoff=0.45 cfs 0.032 af
Subcatchment 2S: P-2 (CB2)	Runoff Area=1,896 sf 84.86% Impervious Runoff Depth=6.24" Tc=6.0 min CN=89 Runoff=0.30 cfs 0.023 af
Subcatchment 3S: P-3 (CB3)	Runoff Area=9,124 sf 89.35% Impervious Runoff Depth=6.59" Tc=6.0 min CN=92 Runoff=1.49 cfs 0.115 af
Subcatchment 4S: OS 1	Runoff Area=242,335 sf 40.85% Impervious Runoff Depth=3.31" Flow Length=855' Tc=9.9 min CN=63 Runoff=18.68 cfs 1.535 af
Subcatchment 7S: P-4 (CB4)	Runoff Area=17,772 sf 65.10% Impervious Runoff Depth=4.85" Tc=6.0 min CN=77 Runoff=2.31 cfs 0.165 af
Subcatchment 8S: P-5 (CB5)	Runoff Area=5,781 sf 64.57% Impervious Runoff Depth=4.85" Tc=6.0 min CN=77 Runoff=0.75 cfs 0.054 af
Subcatchment 9S: P-6 (CB6)	Runoff Area=11,883 sf 57.73% Impervious Runoff Depth=4.40" Tc=6.0 min CN=73 Runoff=1.41 cfs 0.100 af
Subcatchment 10S: P-7 (CB7)	Runoff Area=13,474 sf 0.00% Impervious Runoff Depth=0.73" Tc=6.0 min CN=36 Runoff=0.11 cfs 0.019 af
Subcatchment 11S: P-8 (CB8)	Runoff Area=22,491 sf 0.00% Impervious Runoff Depth=0.97" Tc=6.0 min CN=39 Runoff=0.34 cfs 0.042 af
Subcatchment 12S: P-9 (roof)	Runoff Area=27,632 sf 100.00% Impervious Runoff Depth=7.30" Tc=6.0 min CN=98 Runoff=4.69 cfs 0.386 af
Subcatchment 13S: P-10 (to south)	Runoff Area=15,401 sf 0.00% Impervious Runoff Depth=0.65" Flow Length=145' Tc=8.4 min CN=35 Runoff=0.10 cfs 0.019 af
Subcatchment 15S: P-10A (rear lawn)	Runoff Area=21,516 sf 4.43% Impervious Runoff Depth=0.97" Tc=6.0 min CN=39 Runoff=0.33 cfs 0.040 af
Subcatchment 17S: P-9A (roof)	Runoff Area=6,000 sf 100.00% Impervious Runoff Depth=7.30" Tc=6.0 min CN=98 Runoff=1.02 cfs 0.084 af
Subcatchment 18S: OS 2	Runoff Area=45,929 sf 0.00% Impervious Runoff Depth=0.32" Flow Length=333' Slope=0.0700 '/' Tc=11.1 min CN=30 Runoff=0.06 cfs 0.028 af
Reach 7R: offsite south	Inflow=8.84 cfs 0.445 af Outflow=8.84 cfs 0.445 af
Reach 20R: Headwall	Avg. Flow Depth=0.55' Max Vel=12.30 fps Inflow=8.75 cfs 0.425 af 24.0" Round Pipe n=0.012 L=311.0' S=0.0450 '/' Capacity=52.00 cfs Outflow=8.74 cfs 0.425 af

proposed 12-8-23

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 80

Pond 6P: Existing Basin

Peak Elev=225.44' Storage=22,459 cf Inflow=18.68 cfs 1.535 af
Discarded=1.18 cfs 1.066 af Primary=8.72 cfs 0.398 af Outflow=9.91 cfs 1.464 af

Pond 14P: Chamber System

Peak Elev=212.17' Storage=0.312 af Inflow=11.76 cfs 0.935 af
Discarded=1.21 cfs 0.935 af Primary=0.00 cfs 0.000 af Outflow=1.21 cfs 0.935 af

Pond 16P: Infiltration Trench

Peak Elev=197.52' Storage=1,379 cf Inflow=1.31 cfs 0.124 af
Outflow=0.18 cfs 0.124 af

Total Runoff Area = 10.207 ac Runoff Volume = 2.641 af Average Runoff Depth = 3.10"
62.27% Pervious = 6.356 ac 37.73% Impervious = 3.851 ac

proposed 12-8-23

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 81

Summary for Subcatchment 1S: P-1 (CB1)

Runoff = 0.45 cfs @ 12.09 hrs, Volume= 0.032 af, Depth= 4.97"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
2,252	98	Paved parking, HSG A
1,146	39	>75% Grass cover, Good, HSG A
3,398	78	Weighted Average
1,146		33.73% Pervious Area
2,252		66.27% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 1S: P-1 (CB1)

Hydrograph

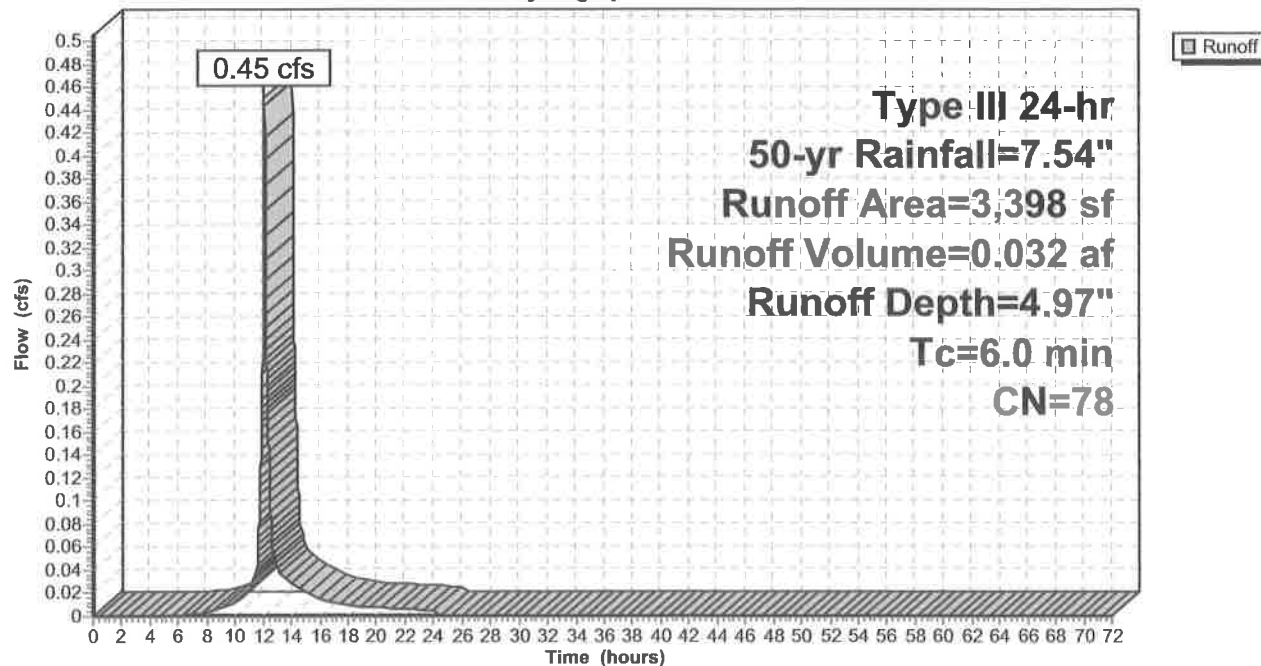

proposed 12-8-23

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 82

Summary for Subcatchment 2S: P-2 (CB2)

Runoff = 0.30 cfs @ 12.08 hrs, Volume= 0.023 af, Depth= 6.24"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
1,609	98	Paved parking, HSG A
287	39	>75% Grass cover, Good, HSG A
1,896	89	Weighted Average
287		15.14% Pervious Area
1,609		84.86% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 2S: P-2 (CB2)

Hydrograph

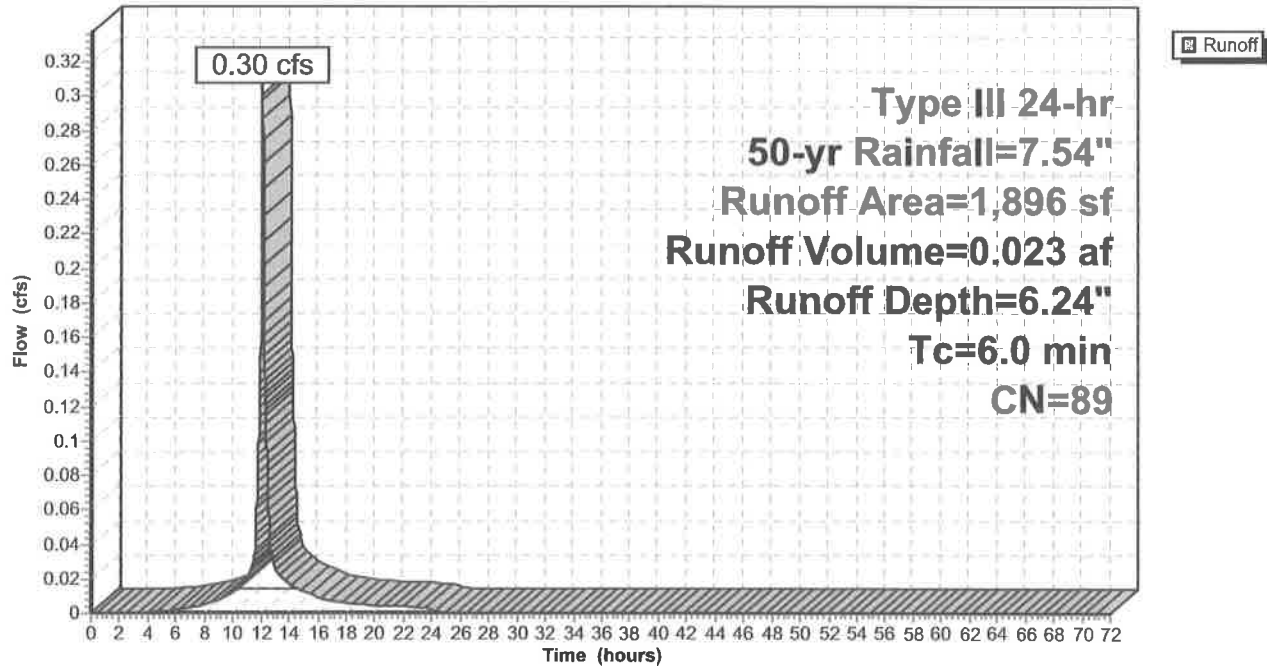

proposed 12-8-23

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 83

Summary for Subcatchment 3S: P-3 (CB3)

Runoff = 1.49 cfs @ 12.08 hrs, Volume= 0.115 af, Depth= 6.59"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
8,152	98	Paved parking, HSG A
972	39	>75% Grass cover, Good, HSG A
9,124	92	Weighted Average
972		10.65% Pervious Area
8,152		89.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 3S: P-3 (CB3)

Hydrograph

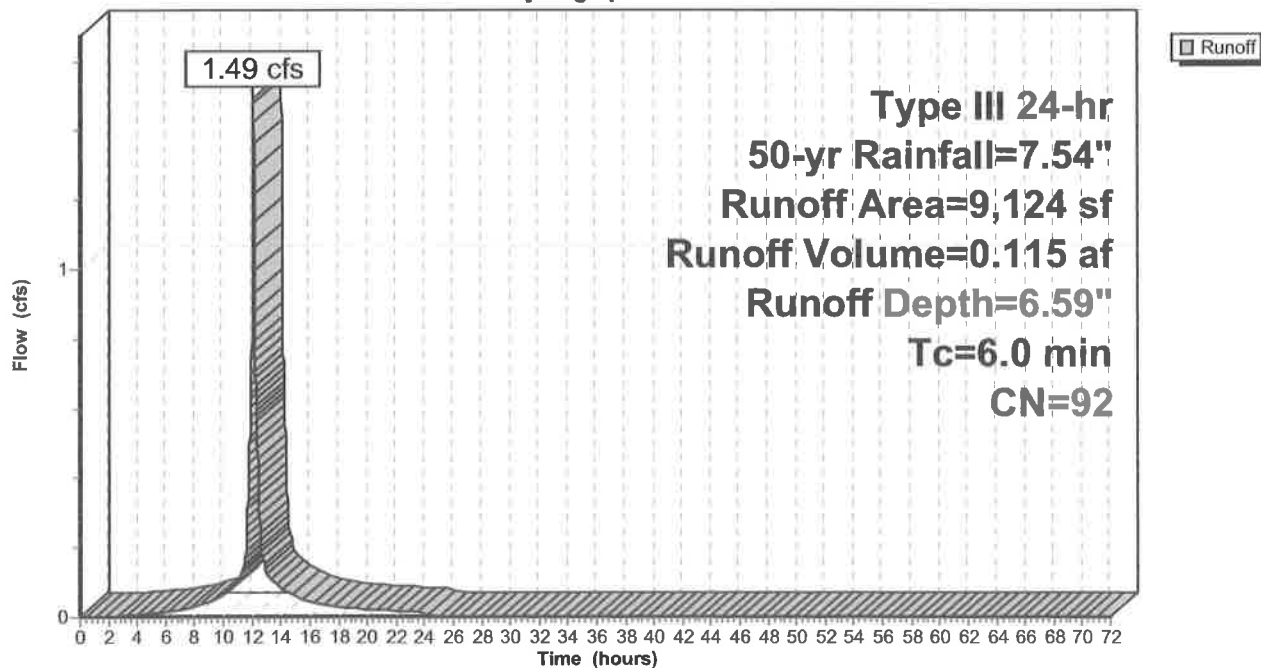

proposed 12-8-23

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 84

Summary for Subcatchment 4S: OS 1

Runoff = 18.68 cfs @ 12.14 hrs, Volume= 1.535 af, Depth= 3.31"
 Routed to Pond 6P : Existing Basin

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
21,486	98	Roofs, HSG A
15,524	30	Woods, Good, HSG A
127,810	39	>75% Grass cover, Good, HSG A
* 6,241	98	Water Surface, HSG A Basin
71,274	98	Paved parking, HSG A
242,335	63	Weighted Average
143,334		59.15% Pervious Area
99,001		40.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0300	0.12		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
1.1	150	0.0120	2.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	475	0.0100	5.26	6.46	Pipe Channel, RCP_Round 15" 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.013 Concrete pipe, bends & connections
0.3	180	0.0280	9.95	17.58	Pipe Channel, RCP_Round 18" 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.013
9.9	855	Total			

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 85

Subcatchment 4S: OS 1

Hydrograph

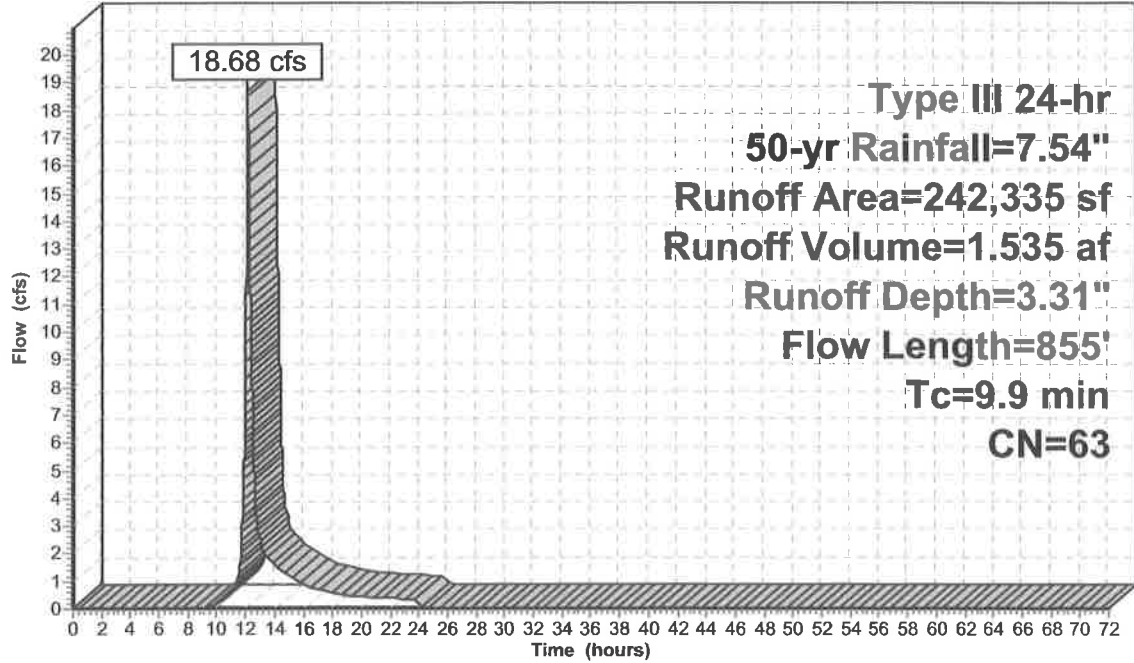

Runoff

Type III 24-hr
50-yr Rainfall=7.54"
Runoff Area=242,335 sf
Runoff Volume=1.535 af
Runoff Depth=3.31"
Flow Length=855'
Tc=9.9 min
CN=63

proposed 12-8-23

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 86

Summary for Subcatchment 7S: P-4 (CB4)

Runoff = 2.31 cfs @ 12.09 hrs, Volume= 0.165 af, Depth= 4.85"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
11,570	98	Paved parking, HSG A
6,202	39	>75% Grass cover, Good, HSG A
17,772	77	Weighted Average
6,202		34.90% Pervious Area
11,570		65.10% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 7S: P-4 (CB4)

Hydrograph

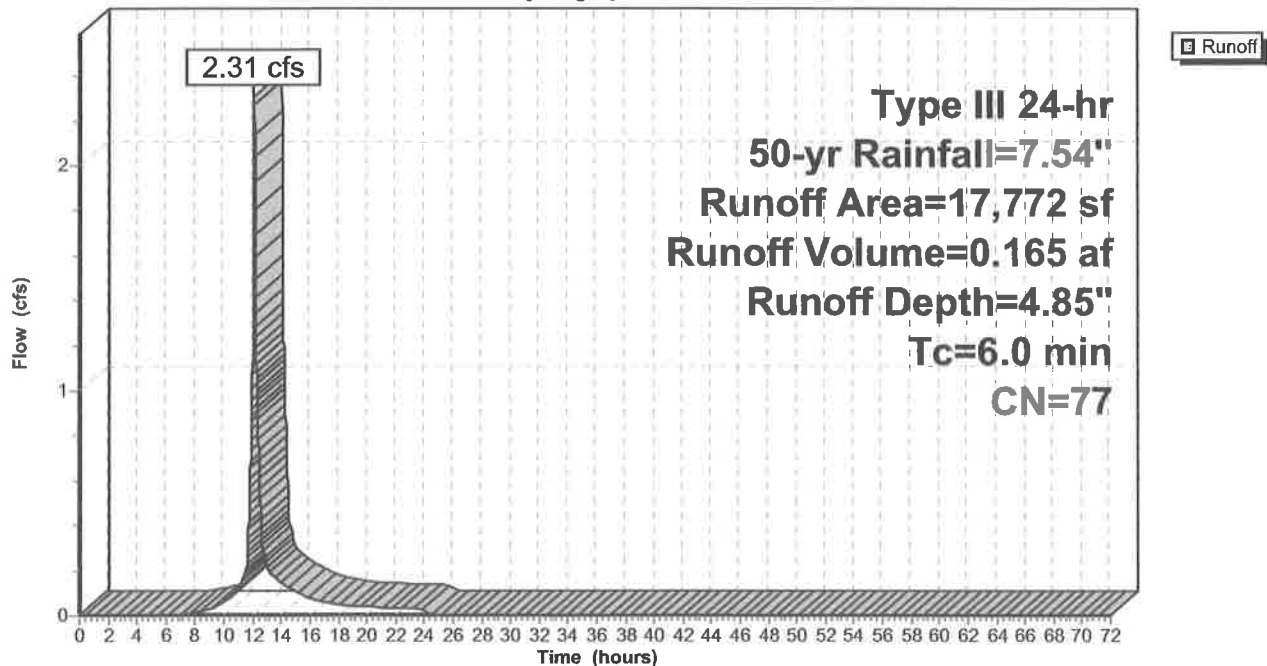

proposed 12-8-23

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 87

Summary for Subcatchment 8S: P-5 (CB5)

Runoff = 0.75 cfs @ 12.09 hrs, Volume= 0.054 af, Depth= 4.85"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
3,733	98	Paved parking, HSG A
2,048	39	>75% Grass cover, Good, HSG A
5,781	77	Weighted Average
2,048		35.43% Pervious Area
3,733		64.57% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 8S: P-5 (CB5)

Hydrograph

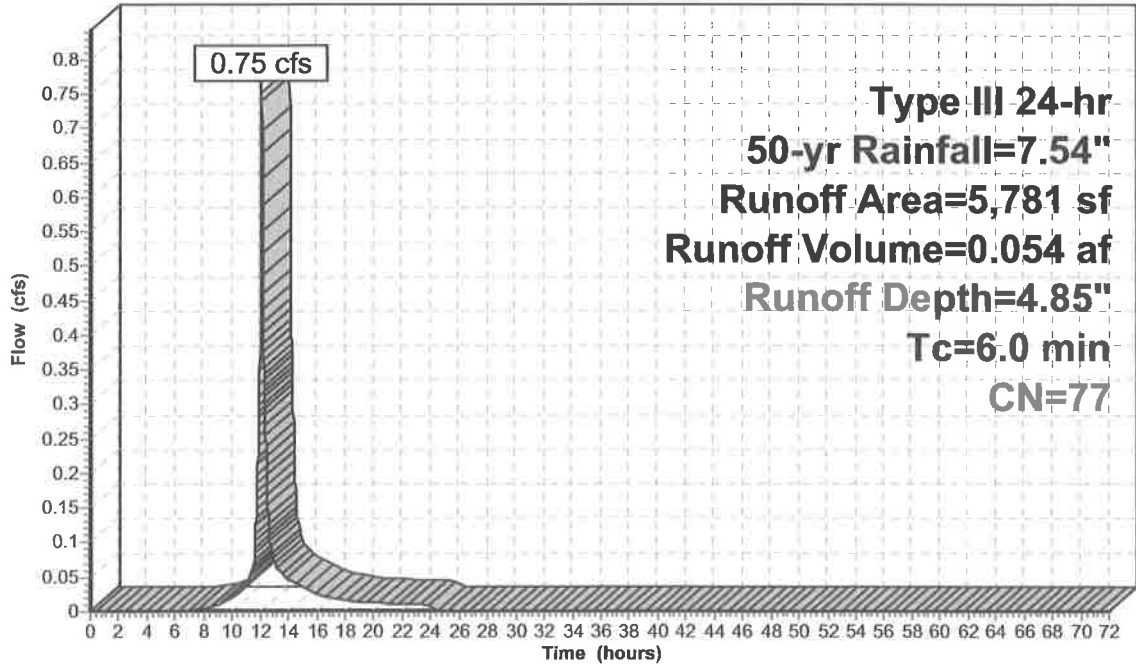

Runoff

proposed 12-8-23

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 88

Summary for Subcatchment 9S: P-6 (CB6)

Runoff = 1.41 cfs @ 12.09 hrs, Volume= 0.100 af, Depth= 4.40"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
6,860	98	Paved parking, HSG A
5,023	39	>75% Grass cover, Good, HSG A
11,883	73	Weighted Average
5,023		42.27% Pervious Area
6,860		57.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 9S: P-6 (CB6)

Hydrograph

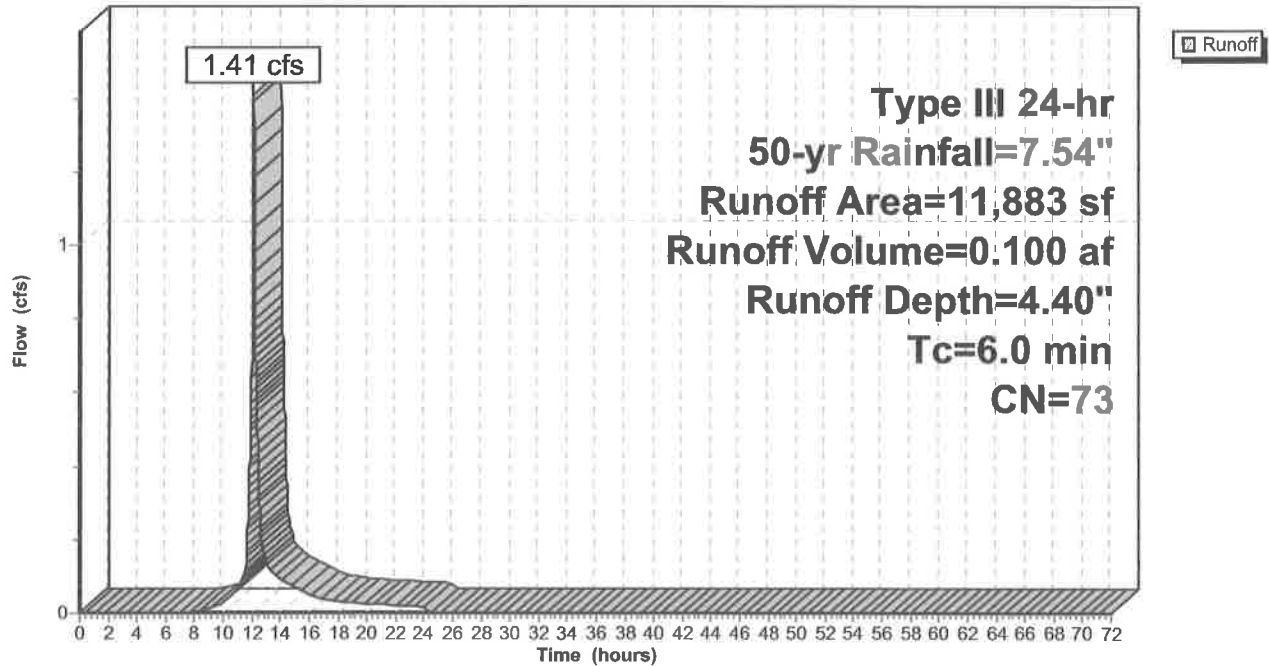

proposed 12-8-23

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 89

Summary for Subcatchment 10S: P-7 (CB7)

Runoff = 0.11 cfs @ 12.28 hrs, Volume= 0.019 af, Depth= 0.73"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
8,914	39	>75% Grass cover, Good, HSG A
4,560	30	Woods, Good, HSG A
13,474	36	Weighted Average
13,474		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 10S: P-7 (CB7)

Hydrograph

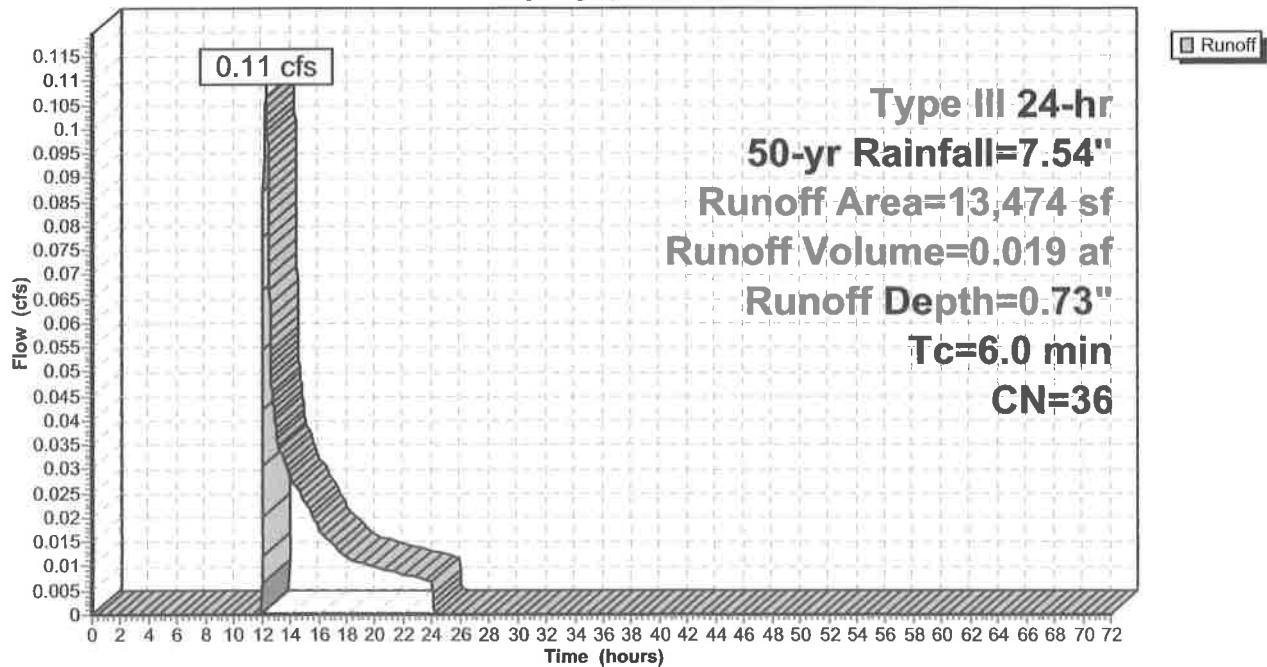

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 90

Summary for Subcatchment 11S: P-8 (CB8)

Runoff = 0.34 cfs @ 12.13 hrs, Volume= 0.042 af, Depth= 0.97"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
22,491	39	>75% Grass cover, Good, HSG A
22,491		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 11S: P-8 (CB8)

Hydrograph

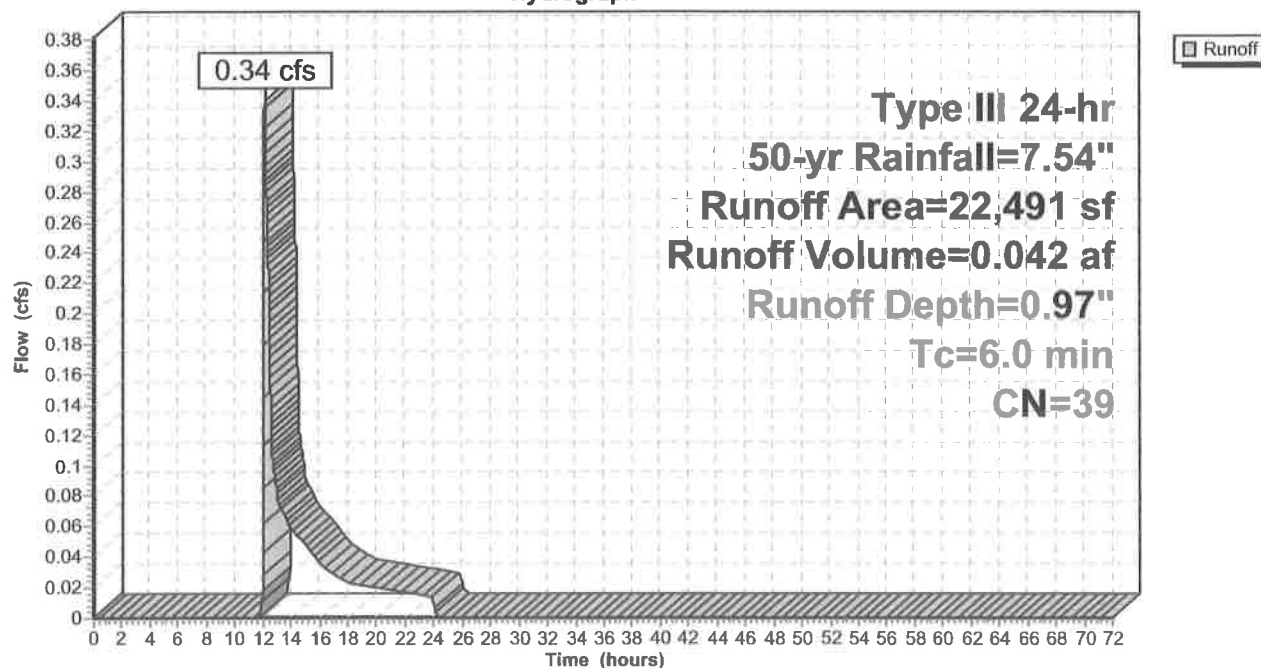

proposed 12-8-23

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 91

Summary for Subcatchment 12S: P-9 (roof)

Runoff = 4.69 cfs @ 12.08 hrs, Volume= 0.386 af, Depth= 7.30"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
27,632	98	Roofs, HSG A
27,632		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 12S: P-9 (roof)

Hydrograph

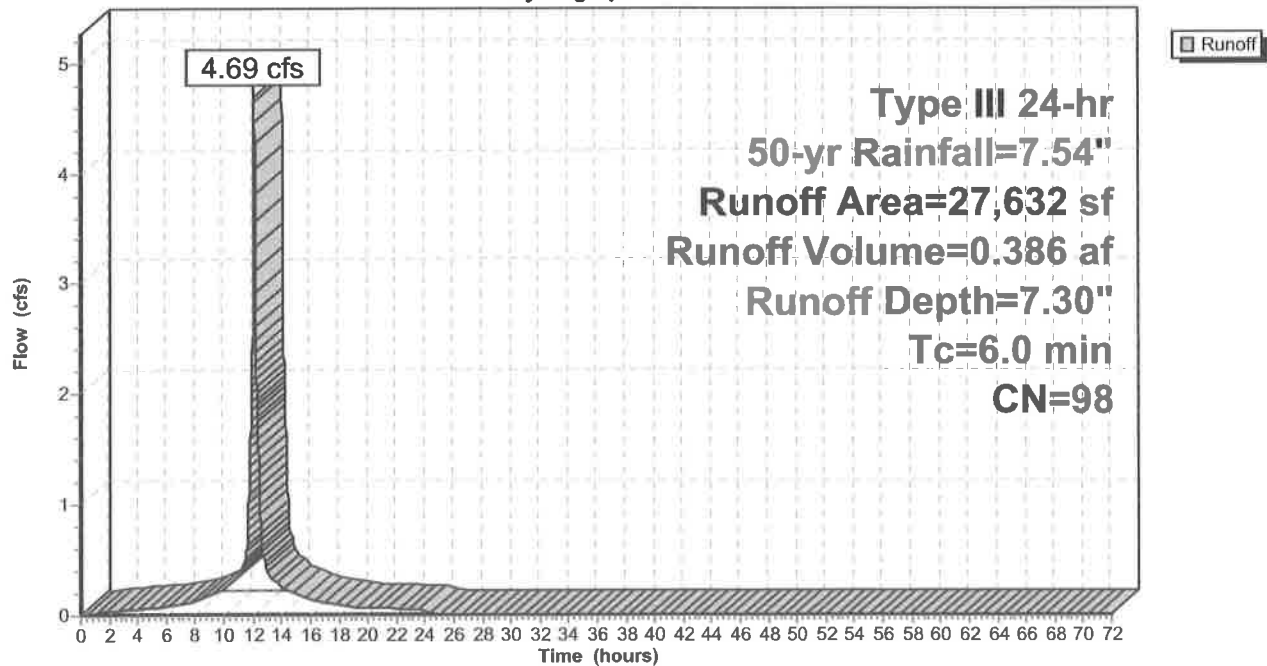

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 92

Summary for Subcatchment 13S: P-10 (to south)

Runoff = 0.10 cfs @ 12.35 hrs, Volume= 0.019 af, Depth= 0.65"
 Routed to Reach 7R : offsite south


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
8,371	39	>75% Grass cover, Good, HSG A
7,030	30	Woods, Good, HSG A
15,401	35	Weighted Average
15,401		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
0.2	95	0.1900	6.54		Shallow Concentrated Flow, Grassed Waterway Kv= 15.0 fps
8.4	145	Total			

Subcatchment 13S: P-10 (to south)

Hydrograph

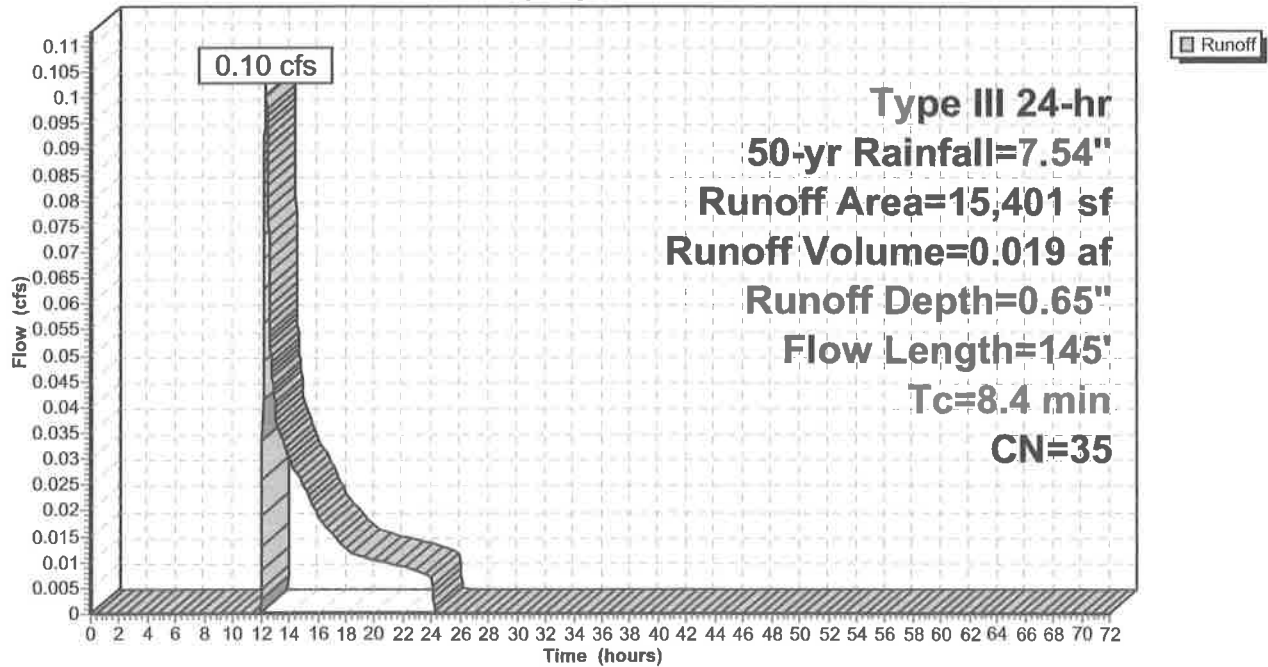

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 93

Summary for Subcatchment 15S: P-10A (rear lawn)

Runoff = 0.33 cfs @ 12.13 hrs, Volume= 0.040 af, Depth= 0.97"
Routed to Pond 16P : Infiltration Trench


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
13,389	39	>75% Grass cover, Good, HSG A
953	98	Water Surface, HSG A
7,174	30	Meadow, non-grazed, HSG A
21,516	39	Weighted Average
20,563		95.57% Pervious Area
953		4.43% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 15S: P-10A (rear lawn)

Hydrograph

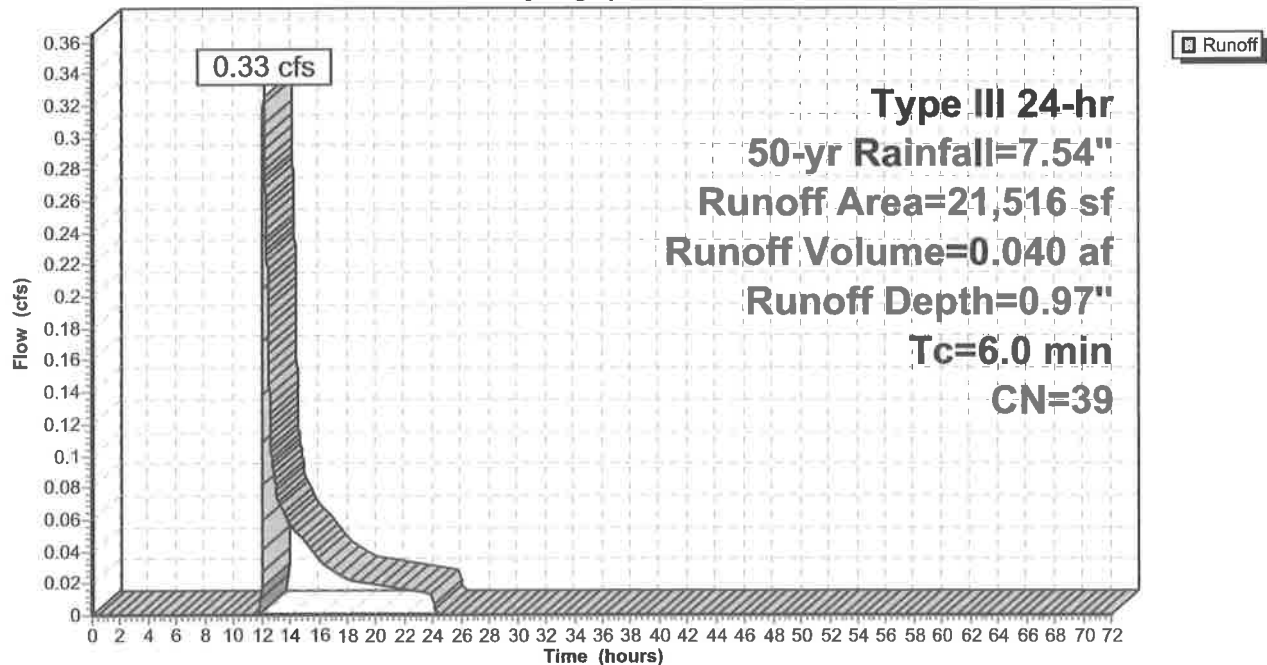

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 94

Summary for Subcatchment 17S: P-9A (roof)

Runoff = 1.02 cfs @ 12.08 hrs, Volume= 0.084 af, Depth= 7.30"
Routed to Pond 16P : Infiltration Trench


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
6,000	98	Roofs, HSG A
6,000		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 17S: P-9A (roof)

Hydrograph

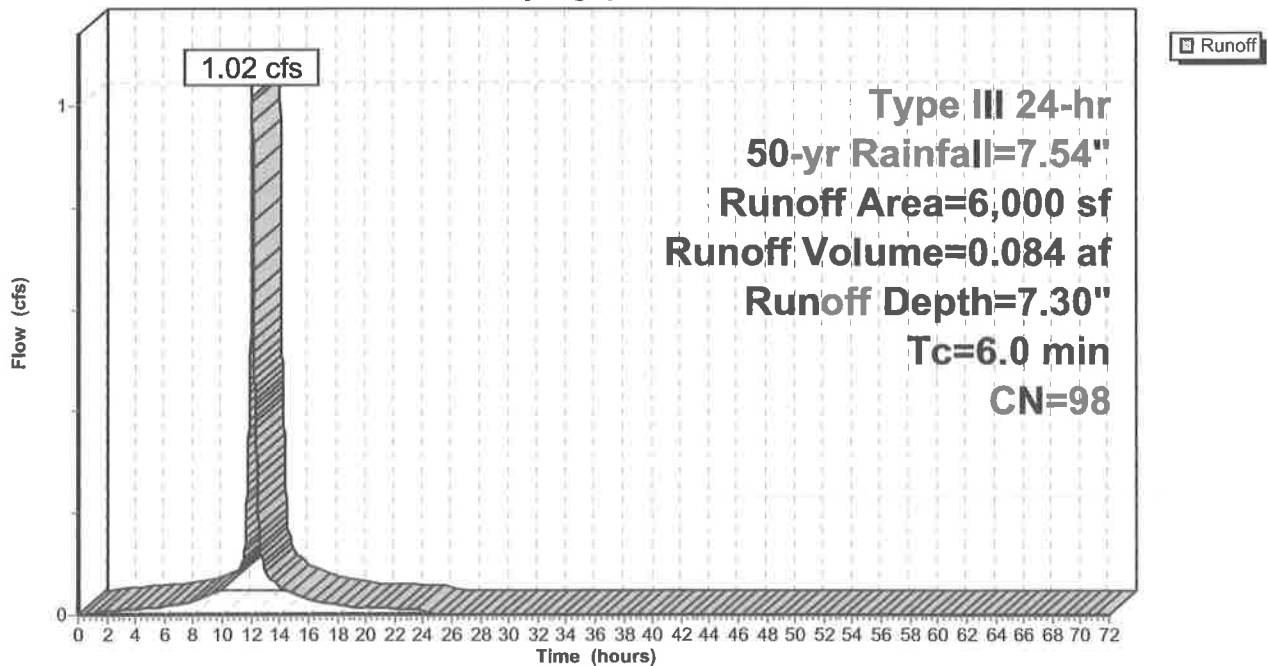

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 95

Summary for Subcatchment 18S: OS 2

Runoff = 0.06 cfs @ 12.54 hrs, Volume= 0.028 af, Depth= 0.32"
Routed to Reach 20R : Headwall


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 50-yr Rainfall=7.54"

Area (sf)	CN	Description
45,929	30	Woods, Good, HSG A
45,929		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0700	0.11		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
3.6	283	0.0700	1.32		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
11.1	333	Total			

Subcatchment 18S: OS 2

Hydrograph

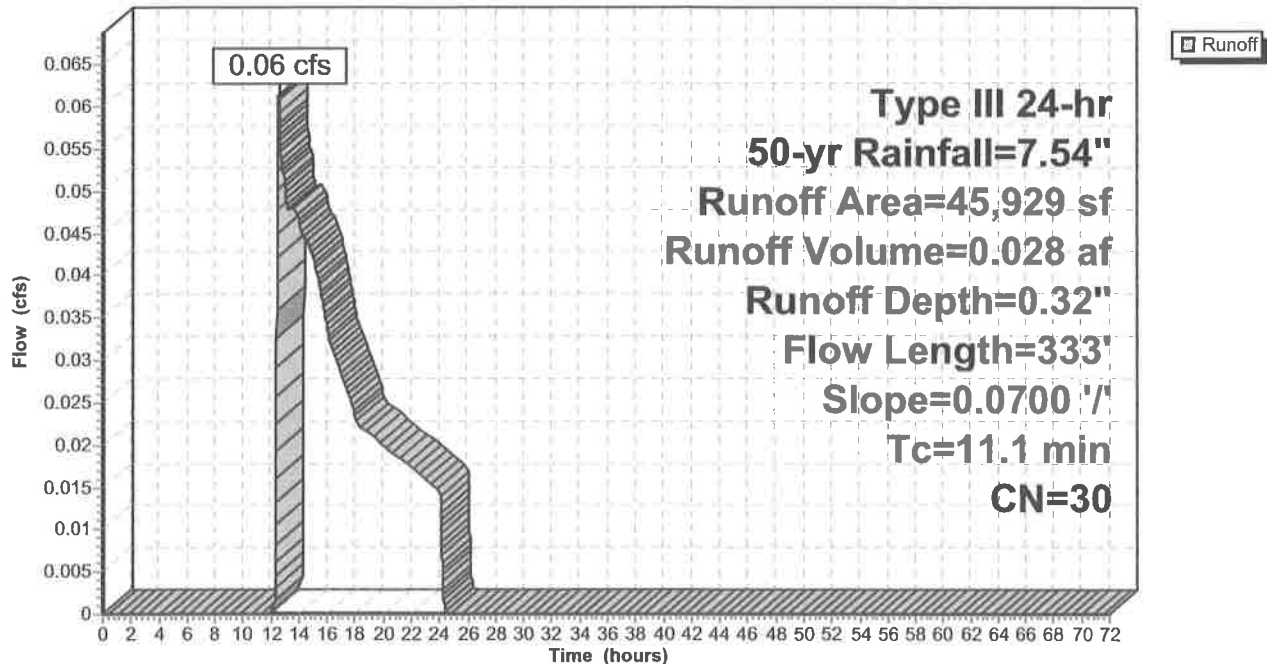

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023


Page 96

Summary for Reach 7R: offsite south

Inflow Area = 10.207 ac, 37.73% Impervious, Inflow Depth = 0.52" for 50-yr event
Inflow = 8.84 cfs @ 12.38 hrs, Volume= 0.445 af
Outflow = 8.84 cfs @ 12.38 hrs, Volume= 0.445 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Reach 7R: offsite south

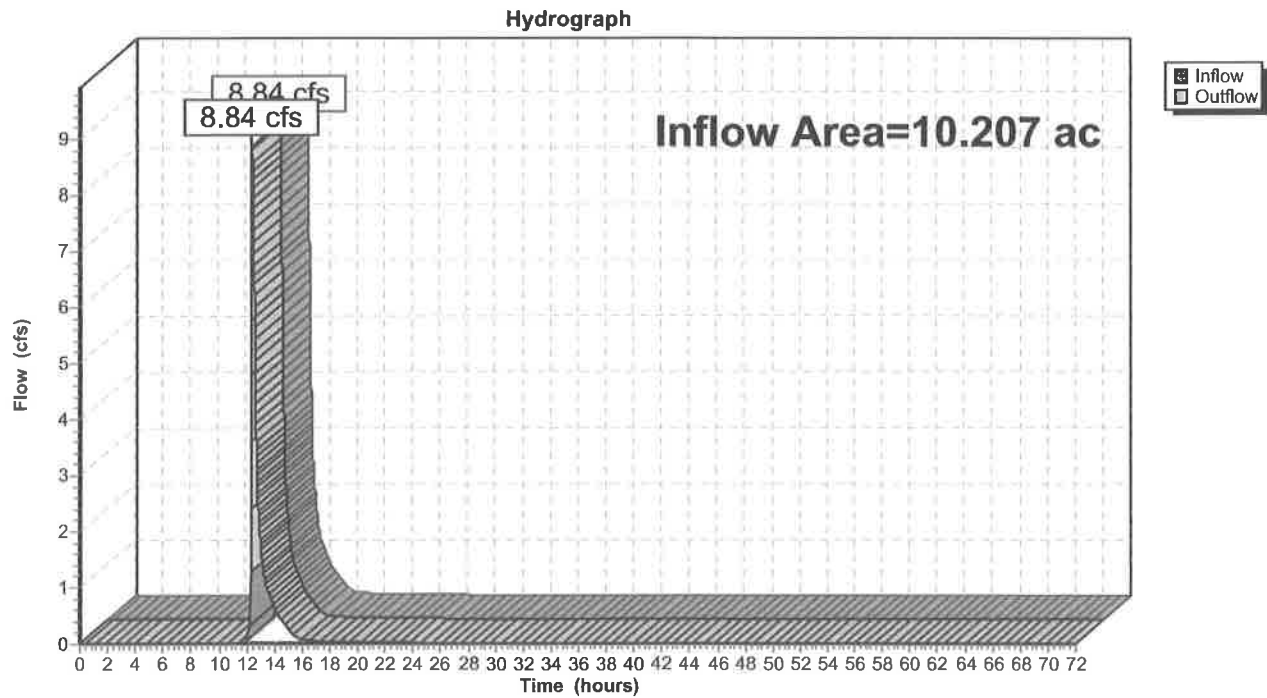

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 97

Summary for Reach 20R: Headwall

Inflow Area = 6.618 ac, 34.34% Impervious, Inflow Depth = 0.77" for 50-yr event
 Inflow = 8.75 cfs @ 12.37 hrs, Volume= 0.425 af
 Outflow = 8.74 cfs @ 12.38 hrs, Volume= 0.425 af, Atten= 0%, Lag= 0.8 min
 Routed to Reach 7R : offsite south

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Max. Velocity= 12.30 fps, Min. Travel Time= 0.4 min
 Avg. Velocity = 3.19 fps, Avg. Travel Time= 1.6 min


Peak Storage= 221 cf @ 12.38 hrs
 Average Depth at Peak Storage= 0.55' , Surface Width= 1.79'
 Bank-Full Depth= 2.00' Flow Area= 3.1 sf, Capacity= 52.00 cfs

24.0" Round Pipe
 n= 0.012
 Length= 311.0' Slope= 0.0450 '/'
 Inlet Invert= 214.00', Outlet Invert= 200.00'



Reach 20R: Headwall

Hydrograph

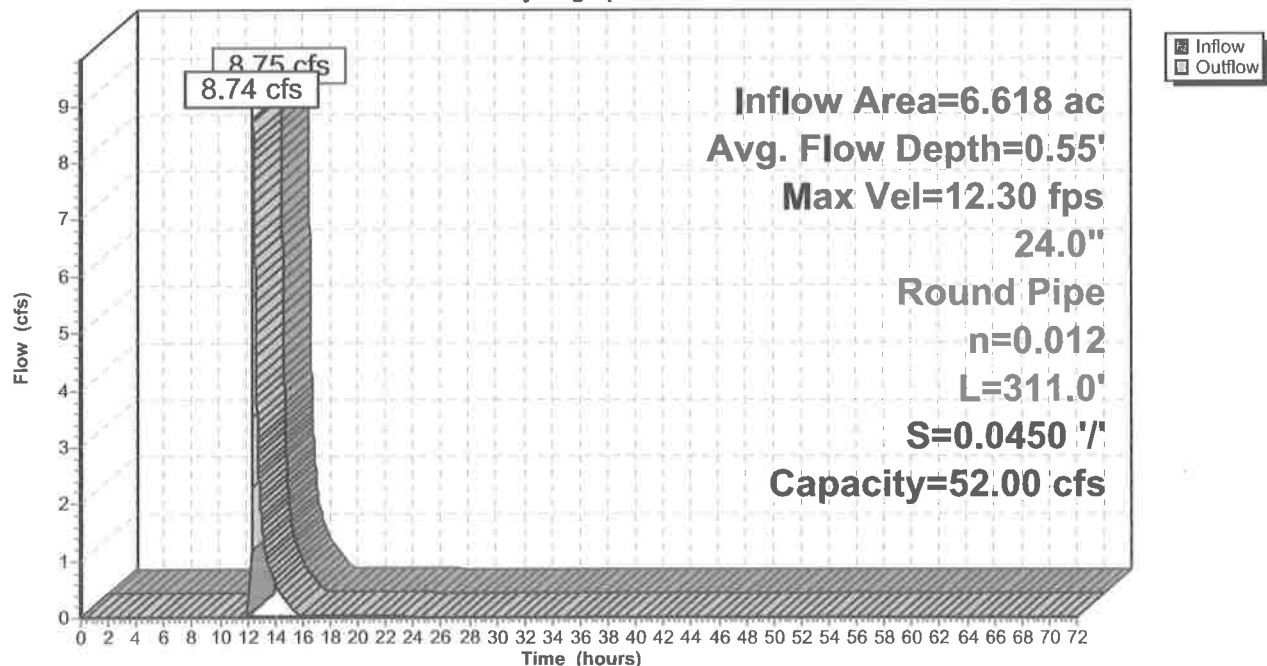

Summary for Pond 6P: Existing Basin

Inflow Area = 5.563 ac, 40.85% Impervious, Inflow Depth = 3.31" for 50-yr event
 Inflow = 18.68 cfs @ 12.14 hrs, Volume= 1.535 af
 Outflow = 9.91 cfs @ 12.37 hrs, Volume= 1.464 af, Atten= 47%, Lag= 13.6 min
 Discarded = 1.18 cfs @ 12.37 hrs, Volume= 1.066 af
 Primary = 8.72 cfs @ 12.37 hrs, Volume= 0.398 af
 Routed to Reach 20R : Headwall

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs / 3
 Peak Elev= 225.44' @ 12.37 hrs Surf.Area= 6,618 sf Storage= 22,459 cf

Plug-Flow detention time= 184.9 min calculated for 1.464 af (95% of inflow)
 Center-of-Mass det. time= 159.7 min (1,005.9 - 846.2)

Volume	Invert	Avail.Storage	Storage Description
#1	211.00'	111 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 467 cf Embedded = 279 cf x 40.0% Voids
#2	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder Inside #1
#3	211.00'	117 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 452 cf Embedded = 294 cf x 40.0% Voids
#4	211.50'	452 cf	8.00'D x 9.00'H Vertical Cone/Cylinder Inside #3
#5	210.50'	107 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 478 cf Embedded = 269 cf x 40.0% Voids
#6	210.50'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #5
#7	210.50'	123 cf	10.00'D x 10.00'H Vertical Cone/Cylinder 785 cf Overall - 478 cf Embedded = 308 cf x 40.0% Voids
#8	210.70'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #7
#9	211.00'	298 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall x 40.0% Voids
#10	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder
#11	220.50'	23,070 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,170 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
220.50	2,038	0	0
222.00	3,006	3,783	3,783
224.00	4,743	7,749	11,532
225.00	5,659	5,201	16,733
225.50	6,241	2,975	19,708
226.00	7,205	3,362	23,070

Device	Routing	Invert	Outlet Devices
#1	Discarded	220.49'	8.270 in/hr Exfiltration over Surface area above 220.49' Excluded Surface area = 443 sf
#2	Primary	225.00'	10.0' long + 4.0 'l' SideZ x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023


Page 99

Discarded OutFlow Max=1.18 cfs @ 12.37 hrs HW=225.44' (Free Discharge)
↑1=Exfiltration (Exfiltration Controls 1.18 cfs)

Primary OutFlow Max=8.59 cfs @ 12.37 hrs HW=225.44' (Free Discharge)
↑2=Broad-Crested Rectangular Weir (Weir Controls 8.59 cfs @ 1.64 fps)

Pond 6P: Existing Basin

Hydrograph

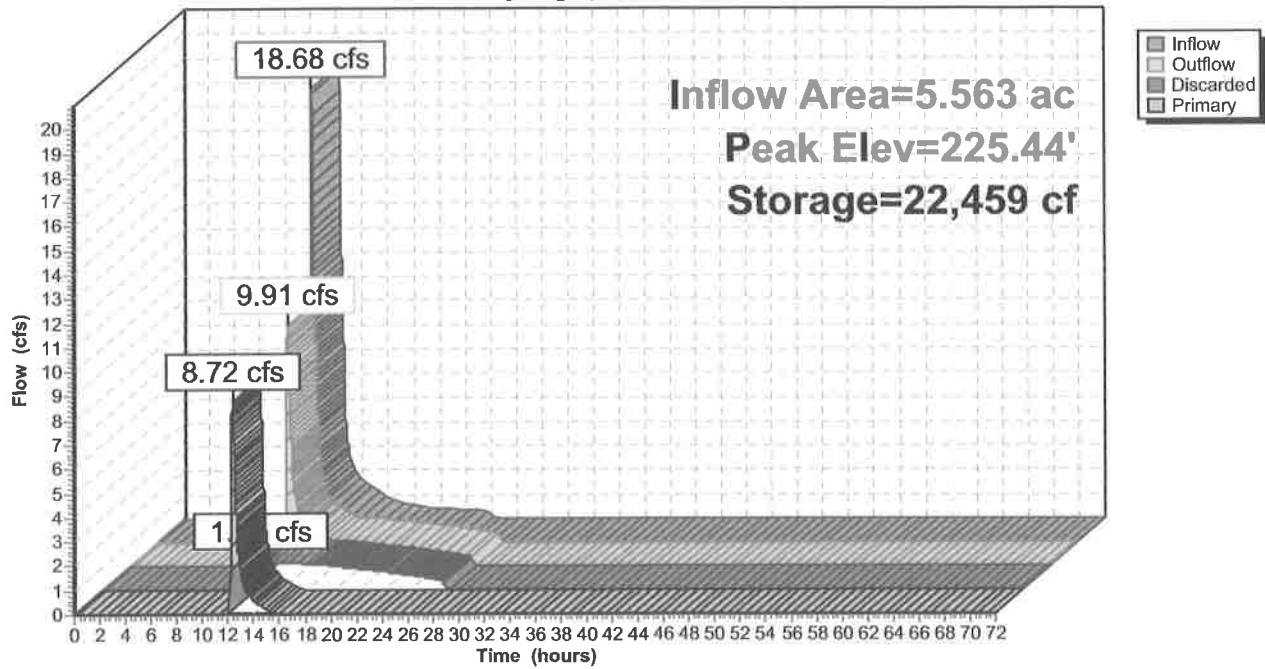

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 100

Summary for Pond 14P: Chamber System

Inflow Area = 2.604 ac, 54.48% Impervious, Inflow Depth = 4.31" for 50-yr event
 Inflow = 11.76 cfs @ 12.09 hrs, Volume= 0.935 af
 Outflow = 1.21 cfs @ 11.59 hrs, Volume= 0.935 af, Atten= 90%, Lag= 0.0 min
 Discarded = 1.21 cfs @ 11.59 hrs, Volume= 0.935 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Routed to Reach 7R : offsite south

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Peak Elev= 212.17' @ 12.94 hrs Surf.Area= 0.145 ac Storage= 0.312 af

Plug-Flow detention time= 81.8 min calculated for 0.935 af (100% of inflow)
 Center-of-Mass det. time= 81.8 min (867.4 - 785.6)

Volume	Invert	Avail.Storage	Storage Description
#1A	209.00'	0.146 af	19.60'W x 322.00'L x 5.50'H Field A 0.797 af Overall - 0.433 af Embedded = 0.364 af x 40.0% Voids
#2A	209.50'	0.326 af	Galley 4x4x4 x 320 Inside #1 Inside= 42.0"W x 43.0"H => 12.67 sf x 3.50'L = 44.3 cf Outside= 52.8"W x 48.0"H => 14.72 sf x 4.00'L = 58.9 cf 320 Chambers in 4 Rows
		0.472 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	209.00'	8.270 in/hr Exfiltration over Surface area
#2	Primary	214.00'	15.0" Round Culvert L= 157.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 214.00' / 206.60' S= 0.0471 ' / ' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 1.23 sf

Discarded OutFlow Max=1.21 cfs @ 11.59 hrs HW=209.06' (Free Discharge)

↑**1=Exfiltration** (Exfiltration Controls 1.21 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=209.00' (Free Discharge)

↑**2=Culvert** (Controls 0.00 cfs)

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 101

Pond 14P: Chamber System - Chamber Wizard Field A

Chamber Model = Galley 4x4x4 (Concrete Galley, UCPI 4x4x4 Galley or equivalent)

Inside= 42.0"W x 43.0"H => 12.67 sf x 3.50'L = 44.3 cf

Outside= 52.8"W x 48.0"H => 14.72 sf x 4.00'L = 58.9 cf

80 Chambers/Row x 4.00' Long = 320.00' Row Length +12.0" End Stone x 2 = 322.00' Base Length

4 Rows x 52.8" Wide + 12.0" Side Stone x 2 = 19.60' Base Width

6.0" Stone Base + 48.0" Chamber Height + 12.0" Stone Cover = 5.50' Field Height

320 Chambers x 44.3 cf = 14,190.3 cf Chamber Storage

320 Chambers x 58.9 cf = 18,840.4 cf Displacement

34,711.6 cf Field - 18,840.4 cf Chambers = 15,871.2 cf Stone x 40.0% Voids = 6,348.5 cf Stone Storage

Chamber Storage + Stone Storage = 20,538.8 cf = 0.472 af

Overall Storage Efficiency = 59.2%

Overall System Size = 322.00' x 19.60' x 5.50'

320 Chambers

1,285.6 cy Field

587.8 cy Stone



proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 50-yr Rainfall=7.54"

Printed 12/13/2023

Page 102

Pond 14P: Chamber System

Hydrograph

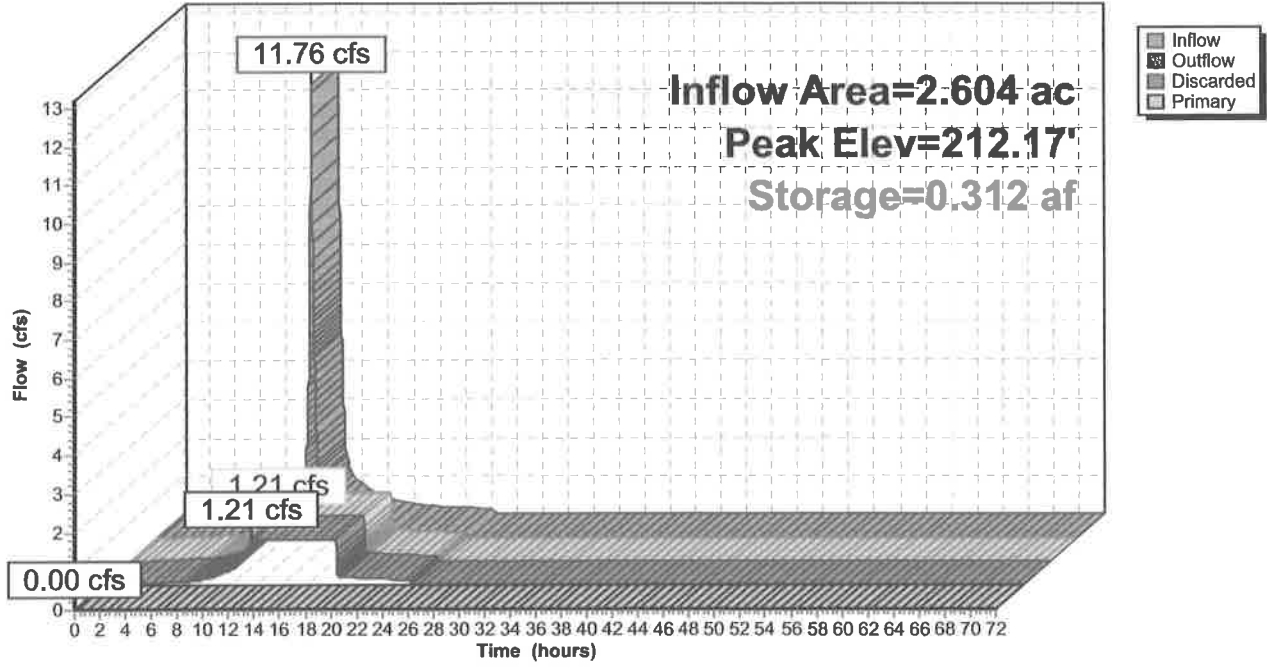

proposed 12-8-23

Type III 24-hr 50-yr Rainfall=7.54"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 103

Summary for Pond 16P: Infiltration Trench

Inflow Area = 0.632 ac, 25.27% Impervious, Inflow Depth = 2.35" for 50-yr event
 Inflow = 1.31 cfs @ 12.10 hrs, Volume= 0.124 af
 Outflow = 0.18 cfs @ 11.69 hrs, Volume= 0.124 af, Atten= 86%, Lag= 0.0 min
 Discarded = 0.18 cfs @ 11.69 hrs, Volume= 0.124 af

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Peak Elev= 197.52' @ 12.88 hrs Surf.Area= 952 sf Storage= 1,379 cf


Plug-Flow detention time= 50.5 min calculated for 0.124 af (100% of inflow)
 Center-of-Mass det. time= 50.5 min (849.9 - 799.4)

Volume	Invert	Avail.Storage	Storage Description
#1	195.00'	1,593 cf	8.50'W x 112.00'L x 5.00'H Prismaoid 4,760 cf Overall - 778 cf Embedded = 3,982 cf x 40.0% Voids
#2	196.25'	778 cf	18.0" Round CMP_Round 18" x 4 Inside #1 L= 110.0'
		2,371 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Discarded	195.00'	8.270 in/hr Exfiltration over Horizontal area

Discarded OutFlow Max=0.18 cfs @ 11.69 hrs HW=195.05' (Free Discharge)
 ↑=Exfiltration (Exfiltration Controls 0.18 cfs)

Pond 16P: Infiltration Trench

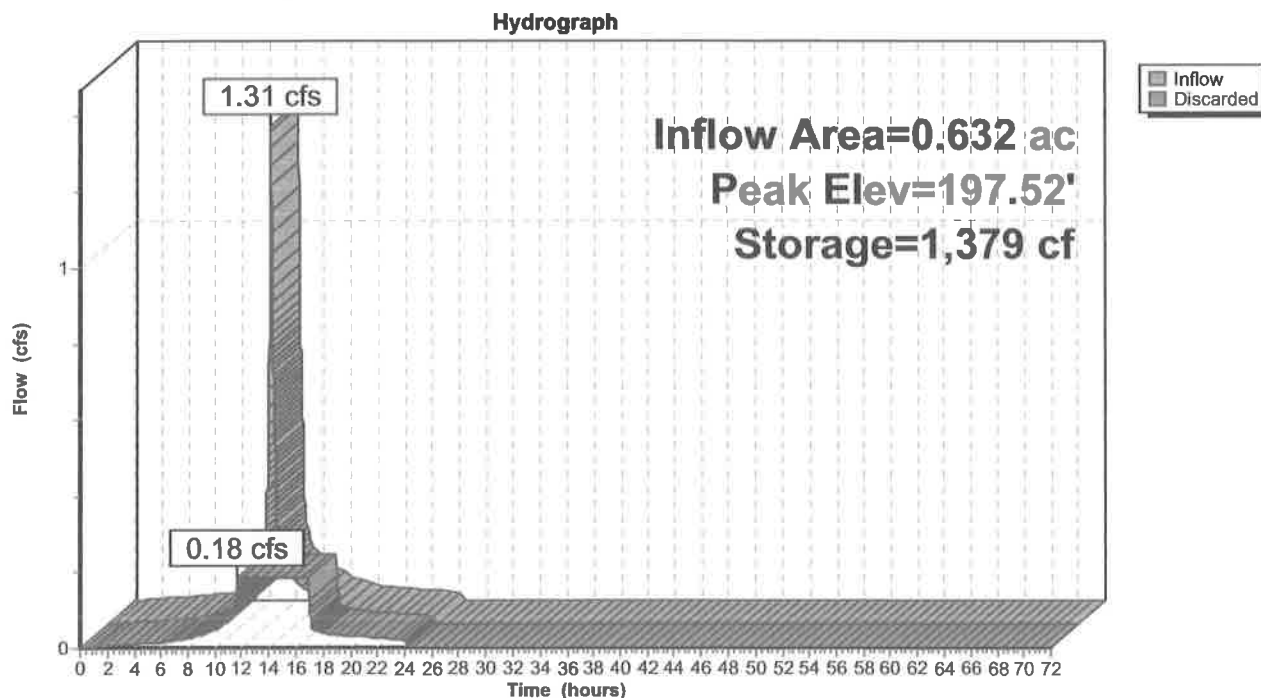

Time span=0.00-72.00 hrs, dt=0.01 hrs, 7201 points
 Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
 Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment 1S: P-1 (CB1)	Runoff Area=3,398 sf 66.27% Impervious Runoff Depth=6.38" Tc=6.0 min CN=78 Runoff=0.57 cfs 0.041 af
Subcatchment 2S: P-2 (CB2)	Runoff Area=1,896 sf 84.86% Impervious Runoff Depth=7.73" Tc=6.0 min CN=89 Runoff=0.37 cfs 0.028 af
Subcatchment 3S: P-3 (CB3)	Runoff Area=9,124 sf 89.35% Impervious Runoff Depth=8.09" Tc=6.0 min CN=92 Runoff=1.81 cfs 0.141 af
Subcatchment 4S: OS 1	Runoff Area=242,335 sf 40.85% Impervious Runoff Depth=4.52" Flow Length=855' Tc=9.9 min CN=63 Runoff=25.75 cfs 2.095 af
Subcatchment 7S: P-4 (CB4)	Runoff Area=17,772 sf 65.10% Impervious Runoff Depth=6.25" Tc=6.0 min CN=77 Runoff=2.95 cfs 0.213 af
Subcatchment 8S: P-5 (CB5)	Runoff Area=5,781 sf 64.57% Impervious Runoff Depth=6.25" Tc=6.0 min CN=77 Runoff=0.96 cfs 0.069 af
Subcatchment 9S: P-6 (CB6)	Runoff Area=11,883 sf 57.73% Impervious Runoff Depth=5.76" Tc=6.0 min CN=73 Runoff=1.83 cfs 0.131 af
Subcatchment 10S: P-7 (CB7)	Runoff Area=13,474 sf 0.00% Impervious Runoff Depth=1.30" Tc=6.0 min CN=36 Runoff=0.30 cfs 0.034 af
Subcatchment 11S: P-8 (CB8)	Runoff Area=22,491 sf 0.00% Impervious Runoff Depth=1.63" Tc=6.0 min CN=39 Runoff=0.75 cfs 0.070 af
Subcatchment 12S: P-9 (roof)	Runoff Area=27,632 sf 100.00% Impervious Runoff Depth=8.82" Tc=6.0 min CN=98 Runoff=5.65 cfs 0.466 af
Subcatchment 13S: P-10 (to south)	Runoff Area=15,401 sf 0.00% Impervious Runoff Depth=1.19" Flow Length=145' Tc=8.4 min CN=35 Runoff=0.27 cfs 0.035 af
Subcatchment 15S: P-10A (rear lawn)	Runoff Area=21,516 sf 4.43% Impervious Runoff Depth=1.63" Tc=6.0 min CN=39 Runoff=0.72 cfs 0.067 af
Subcatchment 17S: P-9A (roof)	Runoff Area=6,000 sf 100.00% Impervious Runoff Depth=8.82" Tc=6.0 min CN=98 Runoff=1.23 cfs 0.101 af
Subcatchment 18S: OS 2	Runoff Area=45,929 sf 0.00% Impervious Runoff Depth=0.70" Flow Length=333' Slope=0.0700 '/' Tc=11.1 min CN=30 Runoff=0.28 cfs 0.061 af
Reach 7R: offsite south	Inflow=19.54 cfs 0.928 af Outflow=19.54 cfs 0.928 af
Reach 20R: Headwall	Avg. Flow Depth=0.84' Max Vel=15.33 fps Inflow=19.33 cfs 0.893 af 24.0" Round Pipe n=0.012 L=311.0' S=0.0450 '/' Capacity=52.00 cfs Outflow=19.29 cfs 0.893 af

proposed 12-8-23

Type III 24-hr 100-yr Rainfall=9.06"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 105

Pond 6P: Existing Basin

Peak Elev=225.70' Storage=24,073 cf Inflow=25.75 cfs 2.095 af
Discarded=1.27 cfs 1.193 af Primary=19.15 cfs 0.832 af Outflow=20.42 cfs 2.024 af

Pond 14P: Chamber System

Peak Elev=213.98' Storage=0.442 af Inflow=15.14 cfs 1.193 af
Discarded=1.21 cfs 1.193 af Primary=0.00 cfs 0.000 af Outflow=1.21 cfs 1.193 af

Pond 16P: Infiltration Trench

Peak Elev=199.92' Storage=2,342 cf Inflow=1.92 cfs 0.168 af
Outflow=0.18 cfs 0.168 af

Total Runoff Area = 10.207 ac Runoff Volume = 3.553 af Average Runoff Depth = 4.18"
62.27% Pervious = 6.356 ac 37.73% Impervious = 3.851 ac

proposed 12-8-23

Type III 24-hr 100-yr Rainfall=9.06"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 106

Summary for Subcatchment 1S: P-1 (CB1)

Runoff = 0.57 cfs @ 12.09 hrs, Volume= 0.041 af, Depth= 6.38"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
2,252	98	Paved parking, HSG A
1,146	39	>75% Grass cover, Good, HSG A
3,398	78	Weighted Average
1,146		33.73% Pervious Area
2,252		66.27% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 1S: P-1 (CB1)

Hydrograph

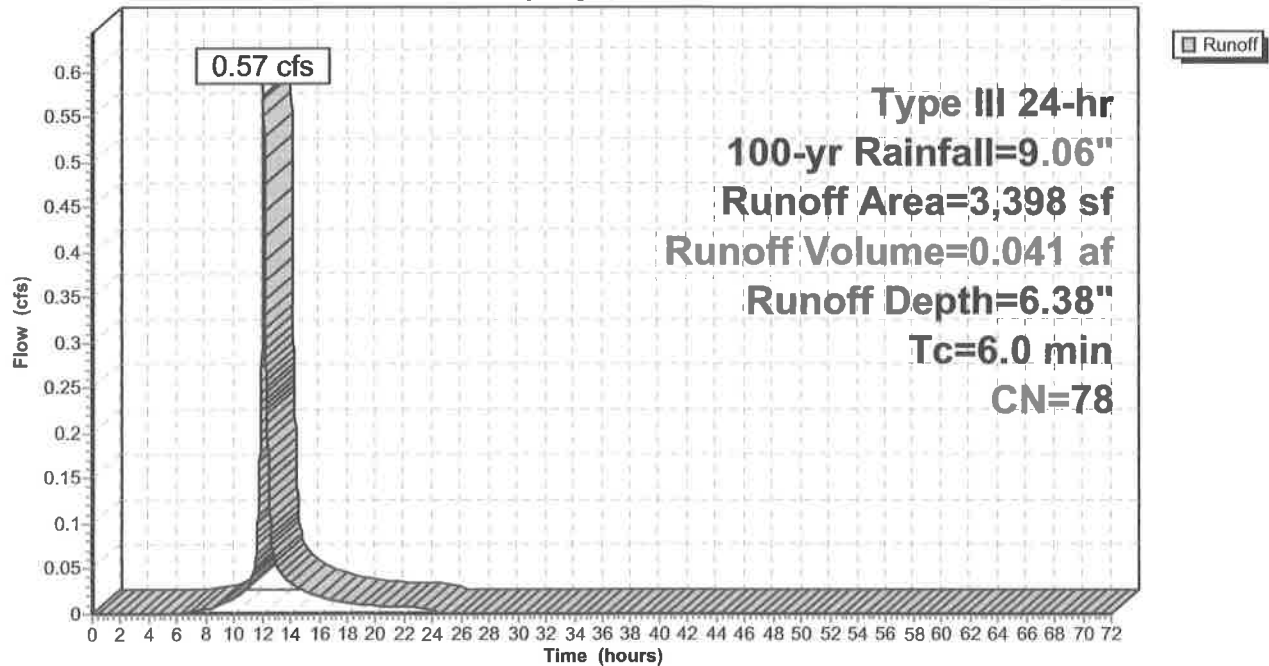

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 107

Summary for Subcatchment 2S: P-2 (CB2)

Runoff = 0.37 cfs @ 12.08 hrs, Volume= 0.028 af, Depth= 7.73"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
1,609	98	Paved parking, HSG A
287	39	>75% Grass cover, Good, HSG A
1,896	89	Weighted Average
287		15.14% Pervious Area
1,609		84.86% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 2S: P-2 (CB2)

Hydrograph

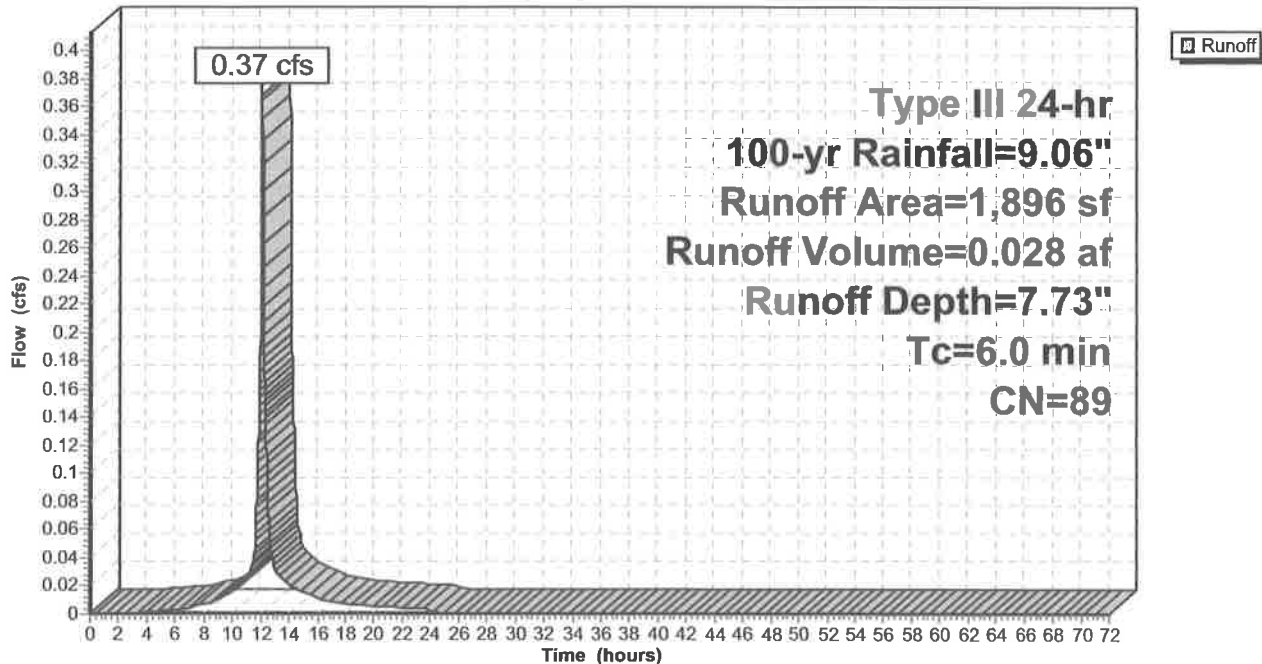

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 108

Summary for Subcatchment 3S: P-3 (CB3)

Runoff = 1.81 cfs @ 12.08 hrs, Volume= 0.141 af, Depth= 8.09"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
8,152	98	Paved parking, HSG A
972	39	>75% Grass cover, Good, HSG A
9,124	92	Weighted Average
972		10.65% Pervious Area
8,152		89.35% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 3S: P-3 (CB3)

Hydrograph

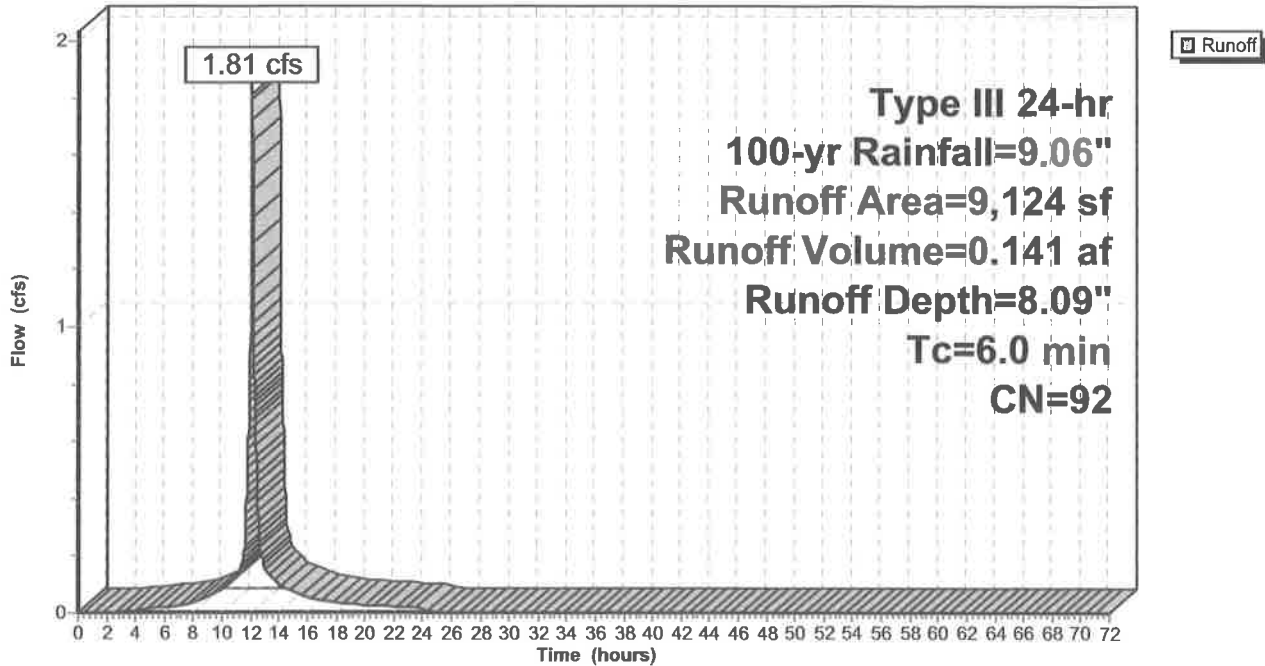

proposed 12-8-23

Type III 24-hr 100-yr Rainfall=9.06"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 109

Summary for Subcatchment 4S: OS 1

Runoff = 25.75 cfs @ 12.14 hrs, Volume= 2.095 af, Depth= 4.52"
Routed to Pond 6P : Existing Basin

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
21,486	98	Roofs, HSG A
15,524	30	Woods, Good, HSG A
127,810	39	>75% Grass cover, Good, HSG A
* 6,241	98	Water Surface, HSG A Basin
71,274	98	Paved parking, HSG A
242,335	63	Weighted Average
143,334		59.15% Pervious Area
99,001		40.85% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.0	50	0.0300	0.12		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
1.1	150	0.0120	2.22		Shallow Concentrated Flow, Paved Kv= 20.3 fps
1.5	475	0.0100	5.26	6.46	Pipe Channel, RCP_Round 15" 15.0" Round Area= 1.2 sf Perim= 3.9' r= 0.31' n= 0.013 Concrete pipe, bends & connections
0.3	180	0.0280	9.95	17.58	Pipe Channel, RCP_Round 18" 18.0" Round Area= 1.8 sf Perim= 4.7' r= 0.38' n= 0.013
9.9	855	Total			

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 110

Subcatchment 4S: OS 1

Hydrograph

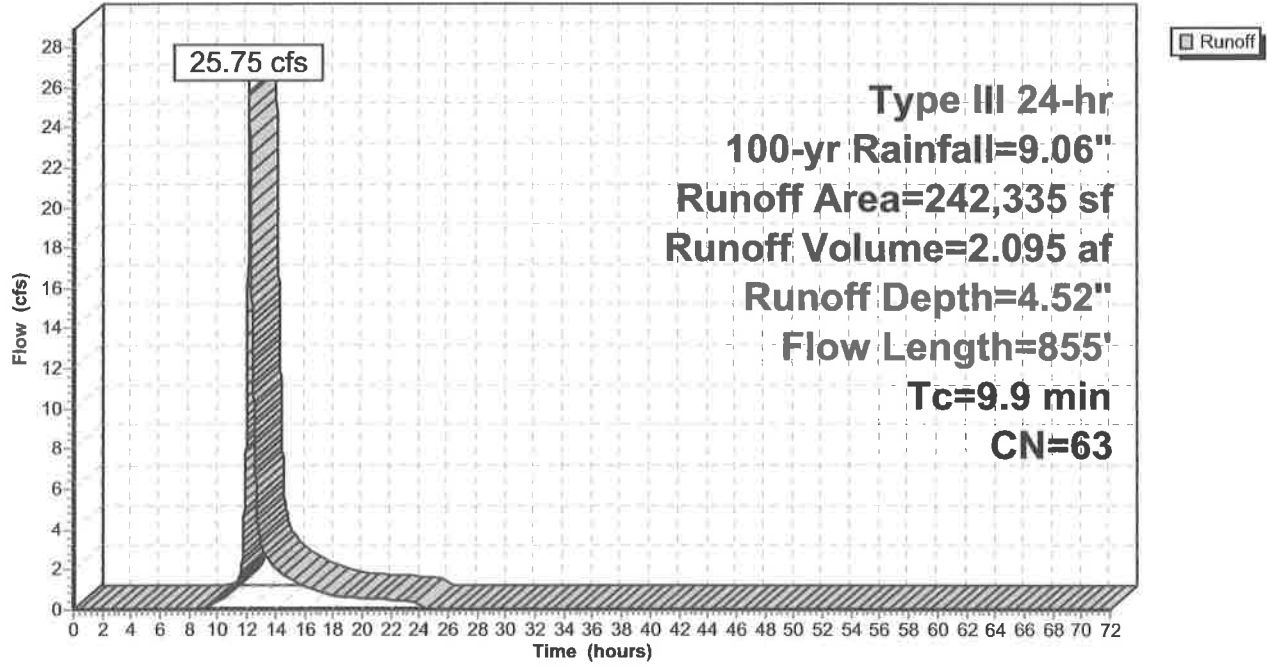

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 111

Summary for Subcatchment 7S: P-4 (CB4)

Runoff = 2.95 cfs @ 12.09 hrs, Volume= 0.213 af, Depth= 6.25"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
11,570	98	Paved parking, HSG A
6,202	39	>75% Grass cover, Good, HSG A
17,772	77	Weighted Average
6,202		34.90% Pervious Area
11,570		65.10% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 7S: P-4 (CB4)

Hydrograph

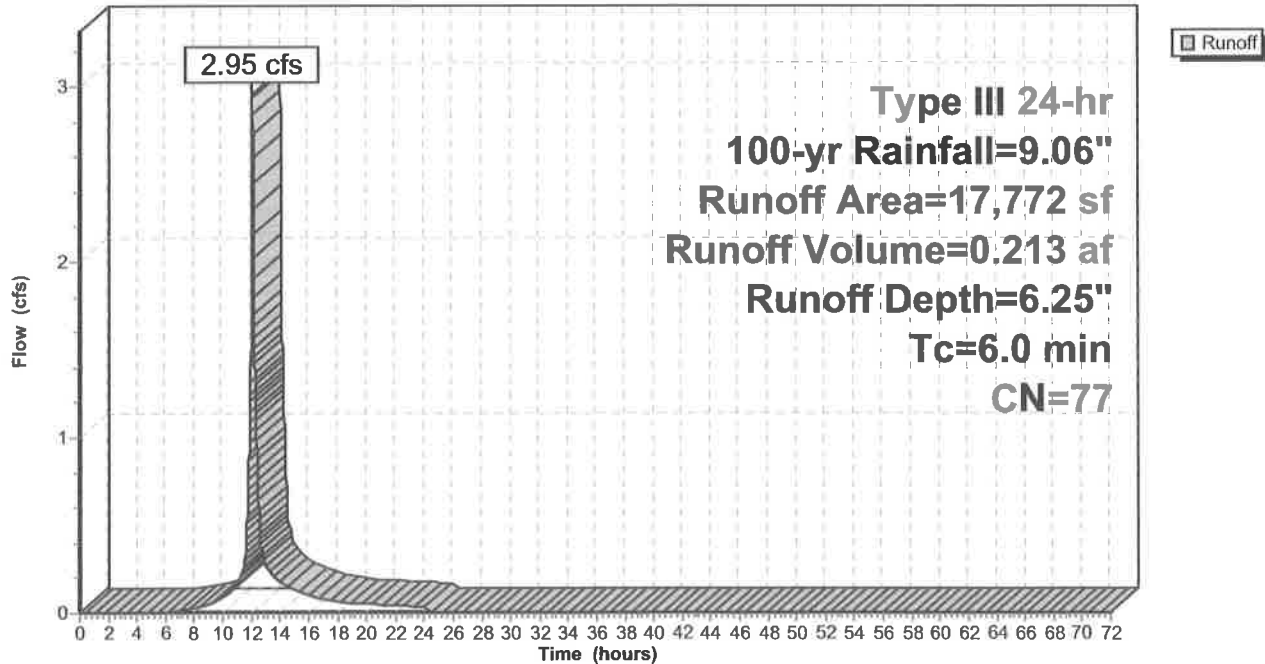

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 112

Summary for Subcatchment 8S: P-5 (CB5)

Runoff = 0.96 cfs @ 12.09 hrs, Volume= 0.069 af, Depth= 6.25"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
3,733	98	Paved parking, HSG A
2,048	39	>75% Grass cover, Good, HSG A
5,781	77	Weighted Average
2,048		35.43% Pervious Area
3,733		64.57% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 8S: P-5 (CB5)

Hydrograph

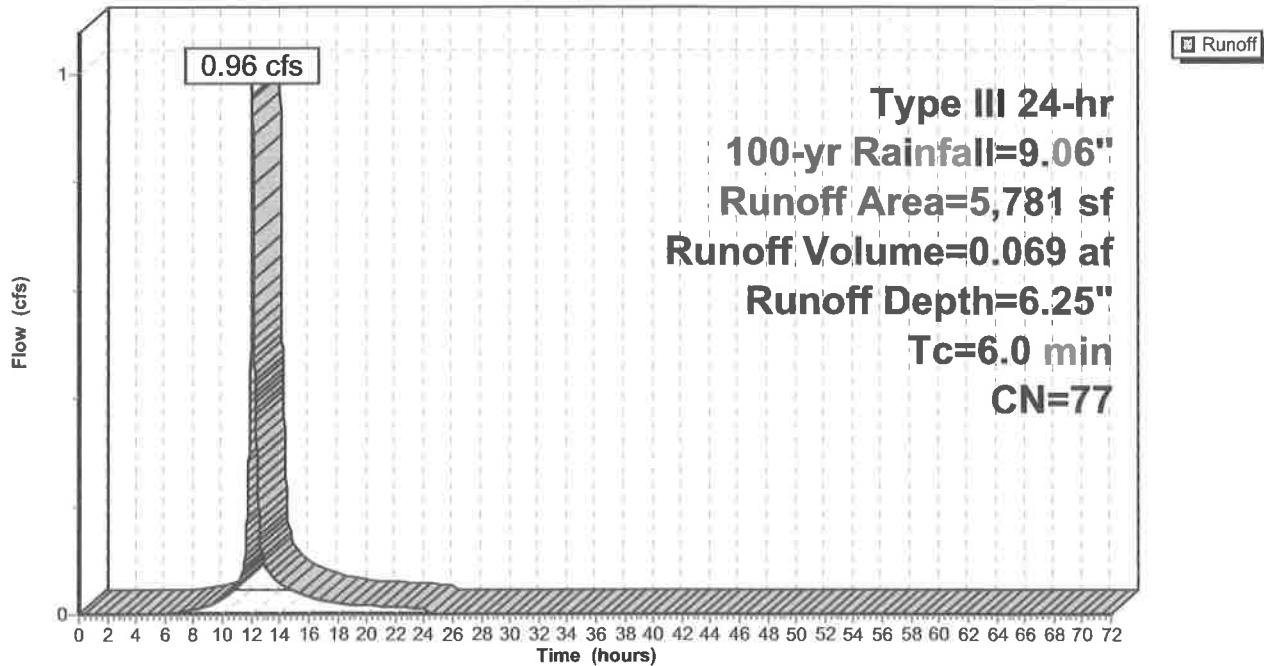

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 113

Summary for Subcatchment 9S: P-6 (CB6)

Runoff = 1.83 cfs @ 12.09 hrs, Volume= 0.131 af, Depth= 5.76"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
6,860	98	Paved parking, HSG A
5,023	39	>75% Grass cover, Good, HSG A
11,883	73	Weighted Average
5,023		42.27% Pervious Area
6,860		57.73% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 9S: P-6 (CB6)

Hydrograph

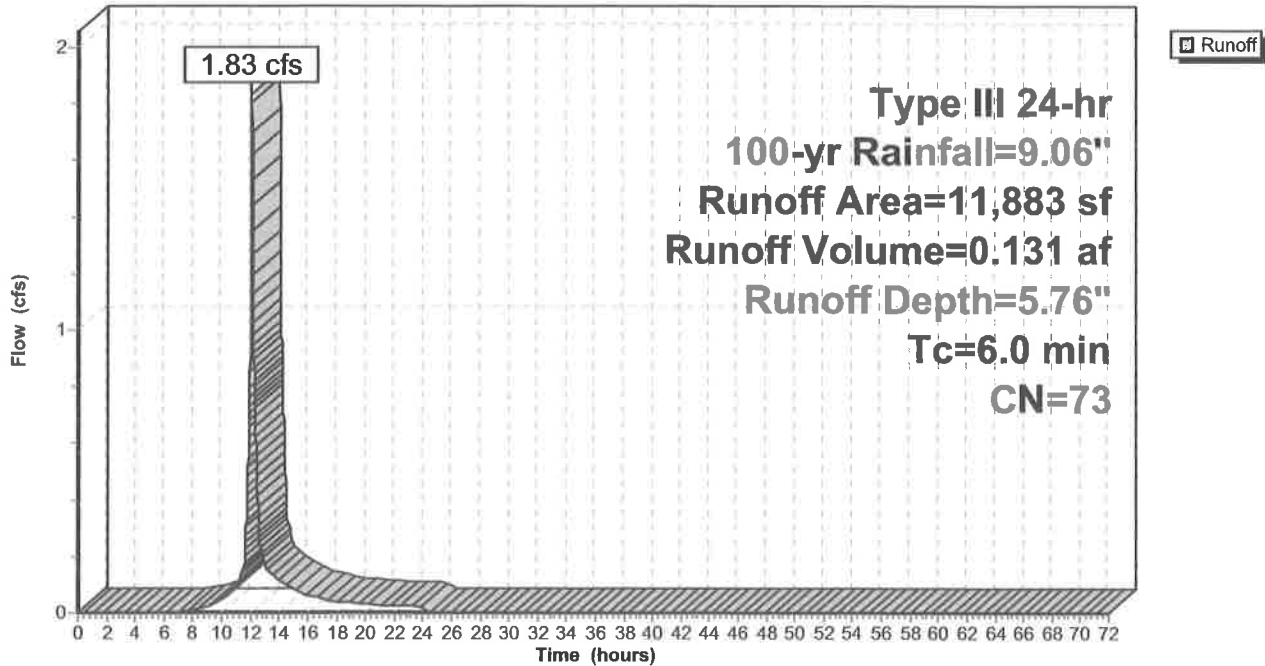

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 114

Summary for Subcatchment 10S: P-7 (CB7)

Runoff = 0.30 cfs @ 12.12 hrs, Volume= 0.034 af, Depth= 1.30"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
8,914	39	>75% Grass cover, Good, HSG A
4,560	30	Woods, Good, HSG A
13,474	36	Weighted Average
13,474		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 10S: P-7 (CB7)

Hydrograph

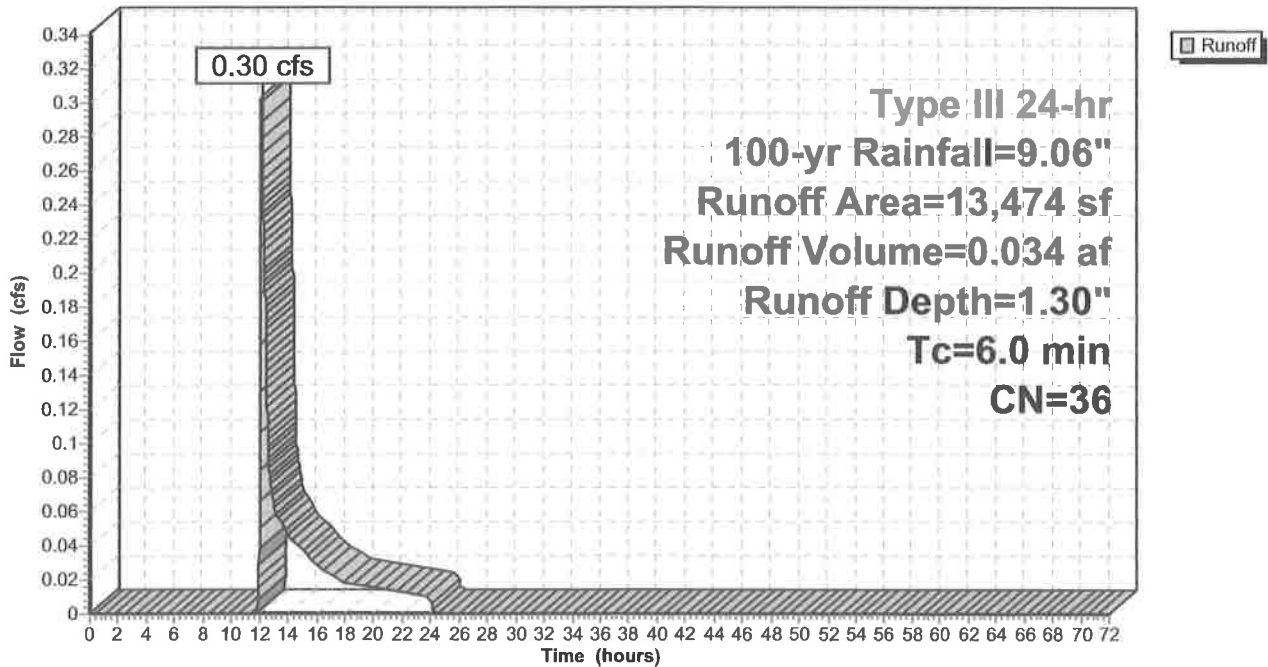

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 115

Summary for Subcatchment 11S: P-8 (CB8)

Runoff = 0.75 cfs @ 12.11 hrs, Volume= 0.070 af, Depth= 1.63"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
22,491	39	>75% Grass cover, Good, HSG A
22,491		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 11S: P-8 (CB8)

Hydrograph

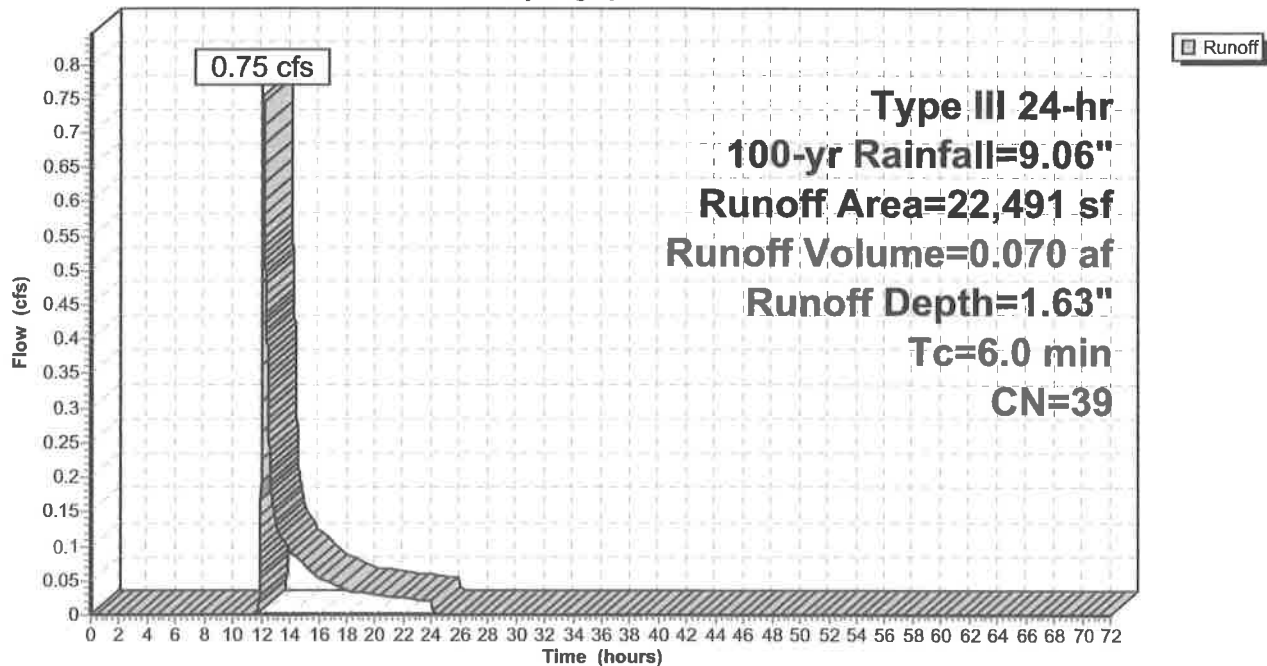

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 116

Summary for Subcatchment 12S: P-9 (roof)

Runoff = 5.65 cfs @ 12.08 hrs, Volume= 0.466 af, Depth= 8.82"
Routed to Pond 14P : Chamber System


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
27,632	98	Roofs, HSG A
27,632		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 12S: P-9 (roof)

Hydrograph

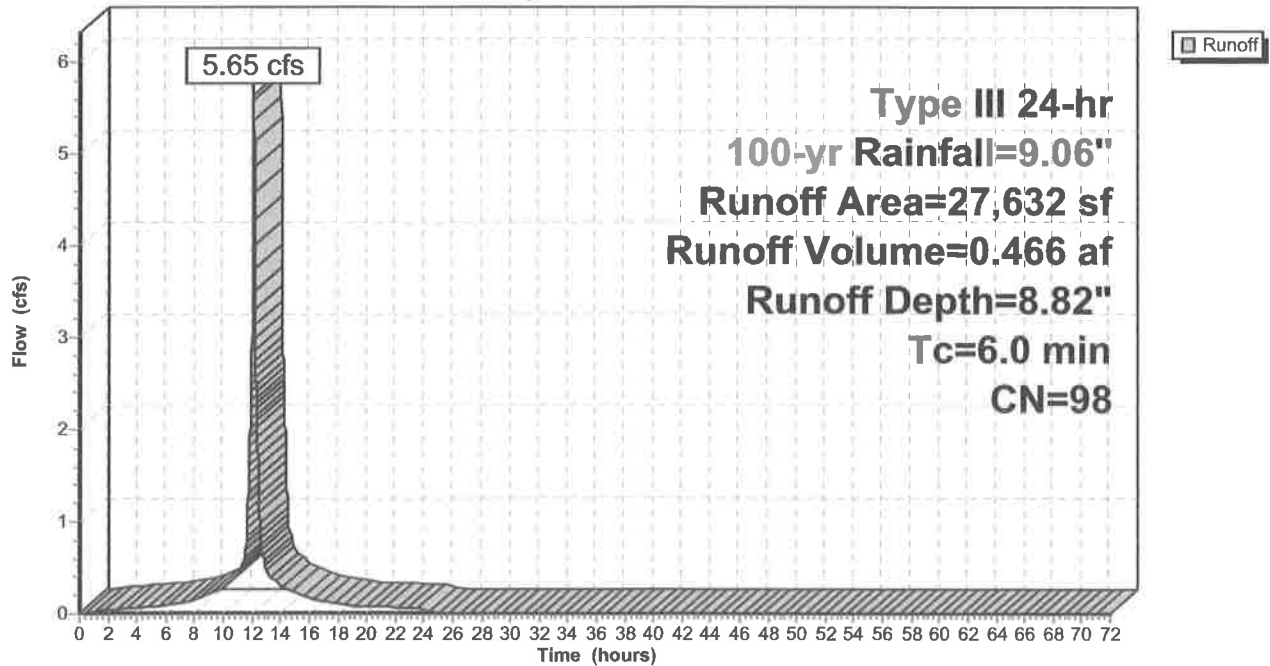

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 117

Summary for Subcatchment 13S: P-10 (to south)

Runoff = 0.27 cfs @ 12.16 hrs, Volume= 0.035 af, Depth= 1.19"
Routed to Reach 7R : offsite south


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
8,371	39	>75% Grass cover, Good, HSG A
7,030	30	Woods, Good, HSG A
15,401	35	Weighted Average
15,401		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
8.2	50	0.0200	0.10		Sheet Flow, Grass: Dense n= 0.240 P2= 3.20"
0.2	95	0.1900	6.54		Shallow Concentrated Flow, Grassed Waterway Kv= 15.0 fps
8.4	145	Total			

Subcatchment 13S: P-10 (to south)

Hydrograph

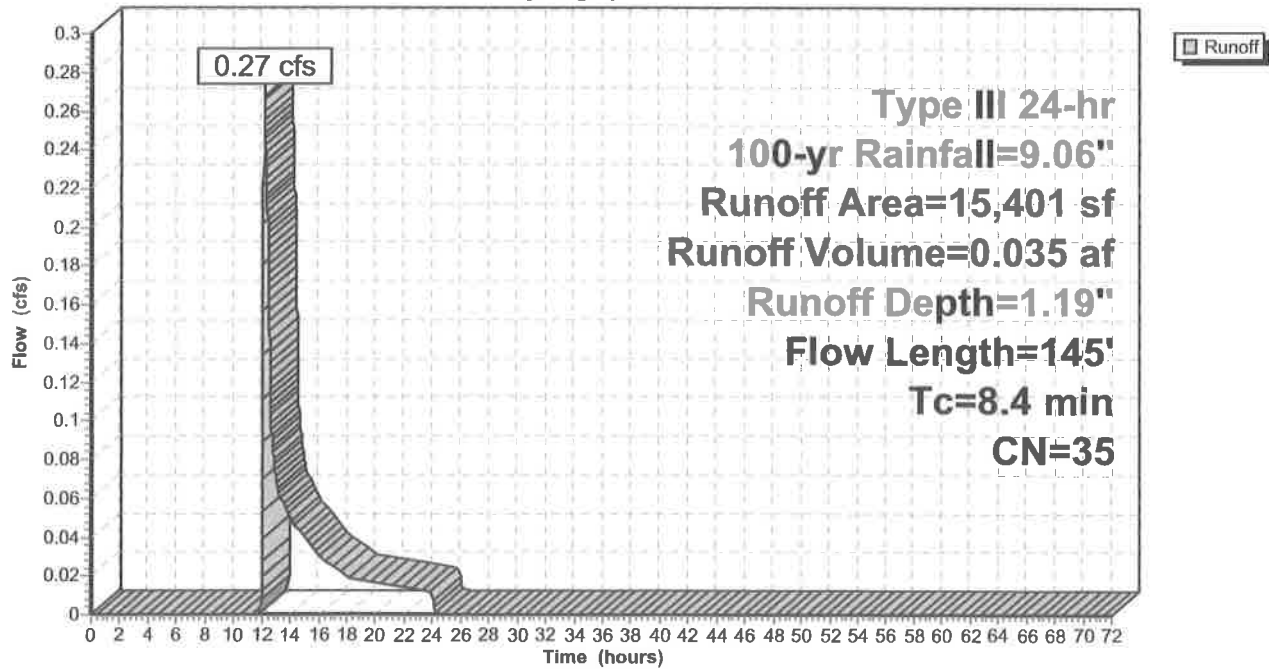

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 118

Summary for Subcatchment 15S: P-10A (rear lawn)

Runoff = 0.72 cfs @ 12.11 hrs, Volume= 0.067 af, Depth= 1.63"
Routed to Pond 16P : Infiltration Trench


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
13,389	39	>75% Grass cover, Good, HSG A
953	98	Water Surface, HSG A
7,174	30	Meadow, non-grazed, HSG A
21,516	39	Weighted Average
20,563		95.57% Pervious Area
953		4.43% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 15S: P-10A (rear lawn)

Hydrograph

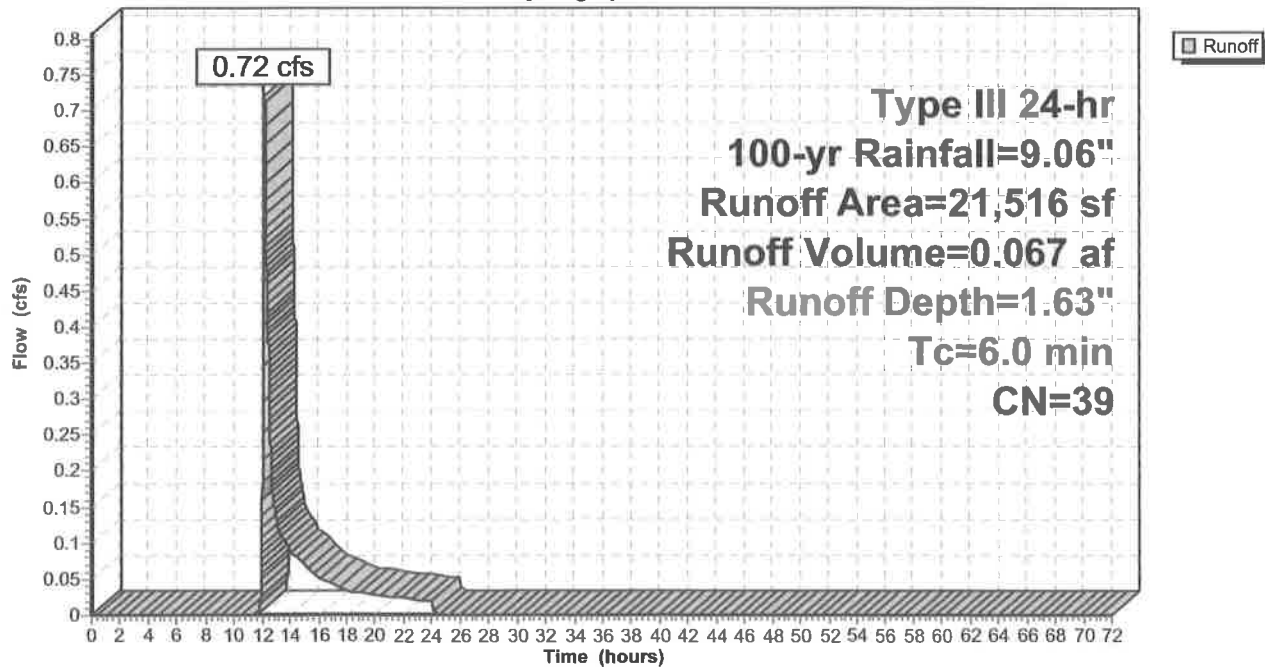

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 119

Summary for Subcatchment 17S: P-9A (roof)

Runoff = 1.23 cfs @ 12.08 hrs, Volume= 0.101 af, Depth= 8.82"
Routed to Pond 16P : Infiltration Trench


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
6,000	98	Roofs, HSG A
6,000		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
6.0					Direct Entry,

Subcatchment 17S: P-9A (roof)

Hydrograph

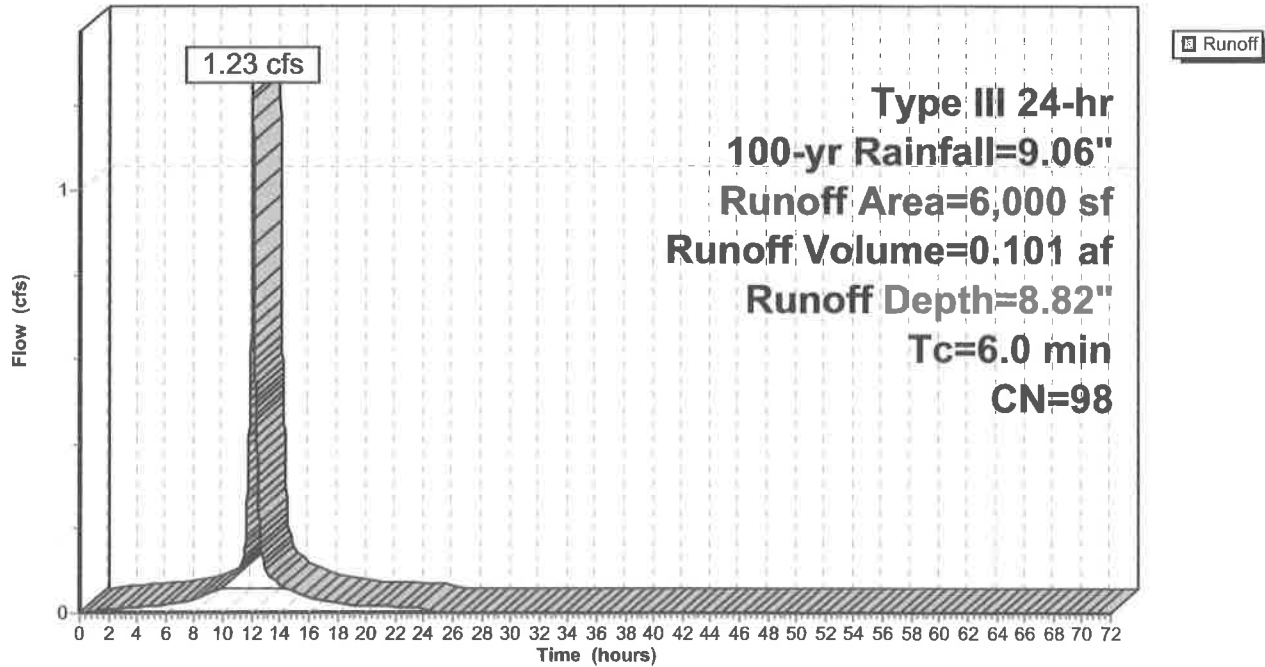

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 120

Summary for Subcatchment 18S: OS 2

Runoff = 0.28 cfs @ 12.42 hrs, Volume= 0.061 af, Depth= 0.70"
Routed to Reach 20R : Headwall


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Type III 24-hr 100-yr Rainfall=9.06"

Area (sf)	CN	Description
45,929	30	Woods, Good, HSG A
45,929		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
7.5	50	0.0700	0.11		Sheet Flow, Woods: Light underbrush n= 0.400 P2= 3.20"
3.6	283	0.0700	1.32		Shallow Concentrated Flow, Woodland Kv= 5.0 fps
11.1	333	Total			

Subcatchment 18S: OS 2

Hydrograph

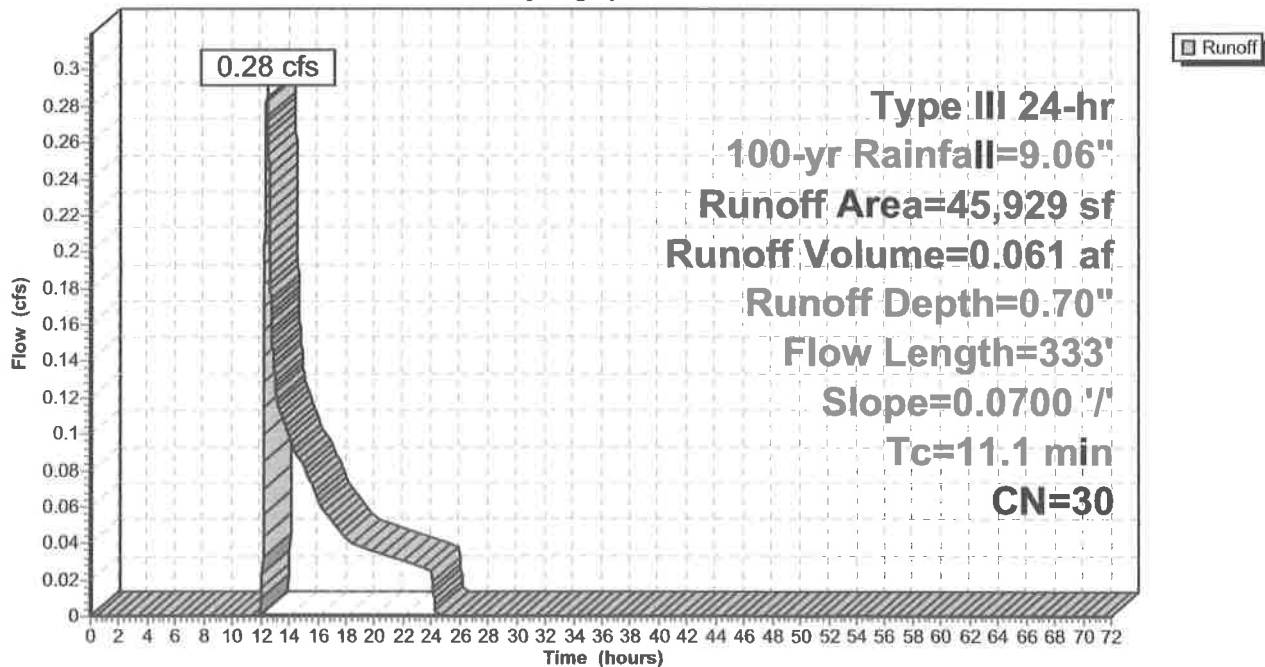

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 121


Summary for Reach 7R: offsite south

Inflow Area = 10.207 ac, 37.73% Impervious, Inflow Depth = 1.09" for 100-yr event
Inflow = 19.54 cfs @ 12.24 hrs, Volume= 0.928 af
Outflow = 19.54 cfs @ 12.24 hrs, Volume= 0.928 af, Atten= 0%, Lag= 0.0 min

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs

Reach 7R: offsite south

Hydrograph

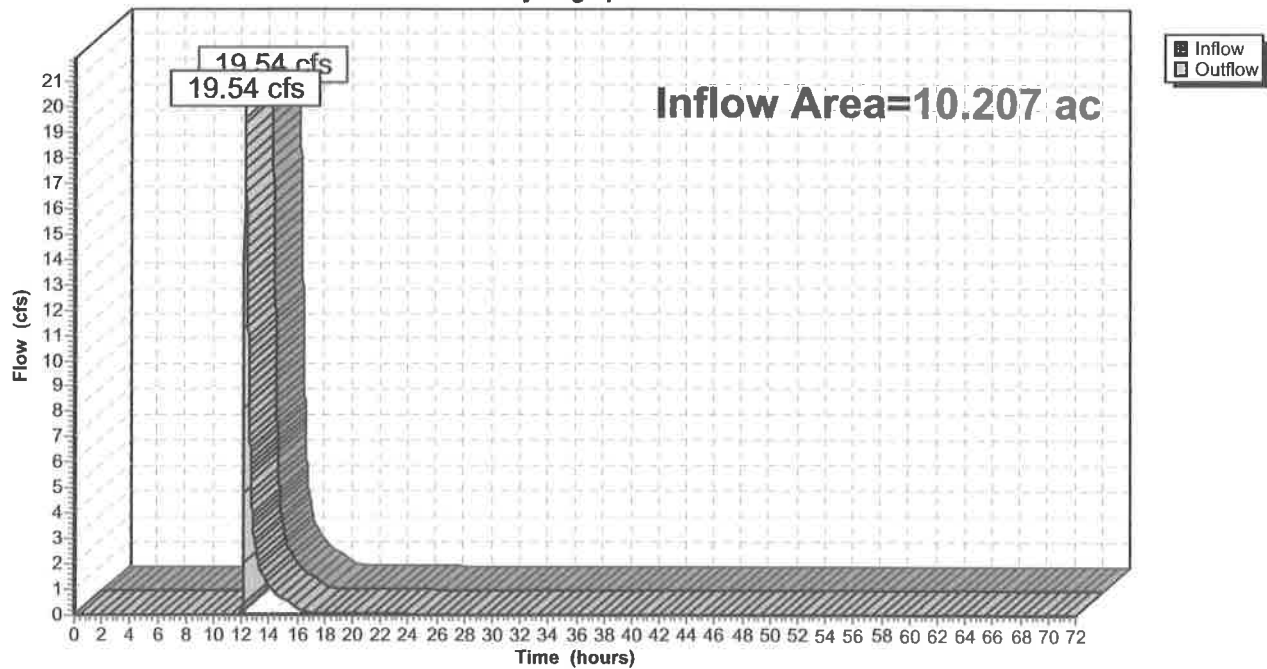

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 122


Summary for Reach 20R: Headwall

Inflow Area = 6.618 ac, 34.34% Impervious, Inflow Depth = 1.62" for 100-yr event
Inflow = 19.33 cfs @ 12.23 hrs, Volume= 0.893 af
Outflow = 19.29 cfs @ 12.24 hrs, Volume= 0.893 af, Atten= 0%, Lag= 0.6 min
Routed to Reach 7R : offsite south

Routing by Stor-Ind+Trans method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
Max. Velocity= 15.33 fps, Min. Travel Time= 0.3 min
Avg. Velocity = 3.93 fps, Avg. Travel Time= 1.3 min


Peak Storage= 392 cf @ 12.23 hrs
Average Depth at Peak Storage= 0.84' , Surface Width= 1.98'
Bank-Full Depth= 2.00' Flow Area= 3.1 sf, Capacity= 52.00 cfs

24.0" Round Pipe
n= 0.012
Length= 311.0' Slope= 0.0450 '/'
Inlet Invert= 214.00', Outlet Invert= 200.00'



Reach 20R: Headwall

Hydrograph

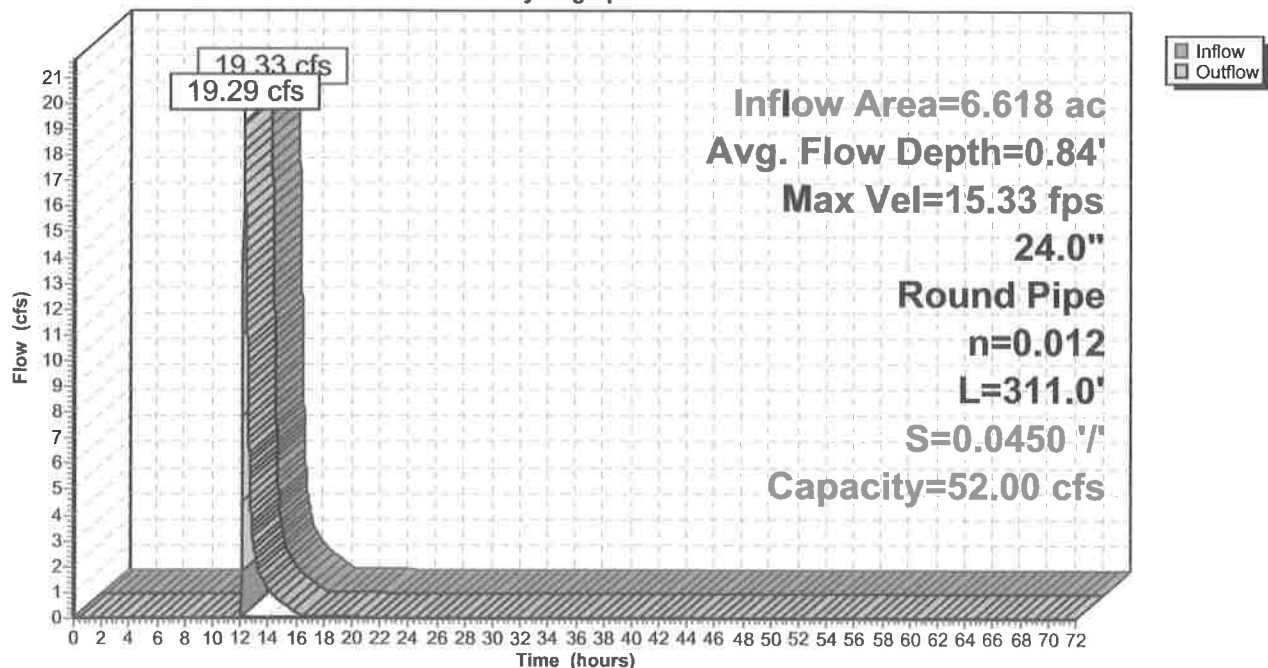

Summary for Pond 6P: Existing Basin

Inflow Area = 5.563 ac, 40.85% Impervious, Inflow Depth = 4.52" for 100-yr event
 Inflow = 25.75 cfs @ 12.14 hrs, Volume= 2.095 af
 Outflow = 20.42 cfs @ 12.23 hrs, Volume= 2.024 af, Atten= 21%, Lag= 5.2 min
 Discarded = 1.27 cfs @ 12.23 hrs, Volume= 1.193 af
 Primary = 19.15 cfs @ 12.23 hrs, Volume= 0.832 af
 Routed to Reach 20R : Headwall

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs / 3
 Peak Elev= 225.70' @ 12.23 hrs Surf.Area= 7,063 sf Storage= 24,073 cf

Plug-Flow detention time= 151.6 min calculated for 2.024 af (97% of inflow)
 Center-of-Mass det. time= 132.5 min (969.6 - 837.2)

Volume	Invert	Avail.Storage	Storage Description
#1	211.00'	111 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 467 cf Embedded = 279 cf x 40.0% Voids
#2	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder Inside #1
#3	211.00'	117 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 452 cf Embedded = 294 cf x 40.0% Voids
#4	211.50'	452 cf	8.00'D x 9.00'H Vertical Cone/Cylinder Inside #3
#5	210.50'	107 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall - 478 cf Embedded = 269 cf x 40.0% Voids
#6	210.50'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #5
#7	210.50'	123 cf	10.00'D x 10.00'H Vertical Cone/Cylinder 785 cf Overall - 478 cf Embedded = 308 cf x 40.0% Voids
#8	210.70'	478 cf	8.00'D x 9.50'H Vertical Cone/Cylinder Inside #7
#9	211.00'	298 cf	10.00'D x 9.50'H Vertical Cone/Cylinder 746 cf Overall x 40.0% Voids
#10	211.20'	467 cf	8.00'D x 9.30'H Vertical Cone/Cylinder
#11	220.50'	23,070 cf	Custom Stage Data (Prismatic) Listed below (Recalc)
		26,170 cf	Total Available Storage

Elevation (feet)	Surf.Area (sq-ft)	Inc.Store (cubic-feet)	Cum.Store (cubic-feet)
220.50	2,038	0	0
222.00	3,006	3,783	3,783
224.00	4,743	7,749	11,532
225.00	5,659	5,201	16,733
225.50	6,241	2,975	19,708
226.00	7,205	3,362	23,070

Device	Routing	Invert	Outlet Devices
#1	Discarded	220.49'	8.270 in/hr Exfiltration over Surface area above 220.49' Excluded Surface area = 443 sf
#2	Primary	225.00'	10.0' long + 4.0 'H SideZ x 5.0' breadth Broad-Crested Rectangular Weir Head (feet) 0.20 0.40 0.60 0.80 1.00 1.20 1.40 1.60 1.80 2.00 2.50 3.00 3.50 4.00 4.50 5.00 5.50 Coef. (English) 2.34 2.50 2.70 2.68 2.68 2.66 2.65 2.65 2.65 2.65 2.67 2.66 2.68 2.70 2.74 2.79 2.88

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 124

Discarded OutFlow Max=1.27 cfs @ 12.23 hrs HW=225.70' (Free Discharge)


↑1=Exfiltration (Exfiltration Controls 1.27 cfs)

Primary OutFlow Max=19.11 cfs @ 12.23 hrs HW=225.70' (Free Discharge)

↑2=Broad-Crested Rectangular Weir (Weir Controls 19.11 cfs @ 2.15 fps)

Pond 6P: Existing Basin

Hydrograph

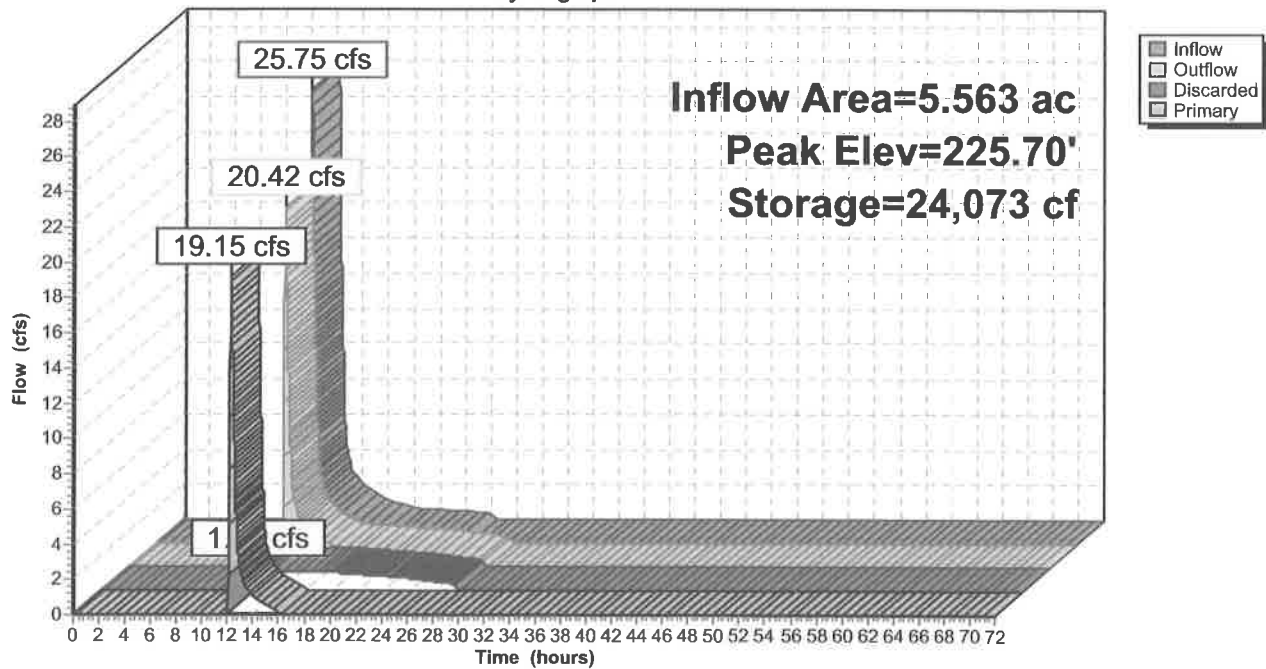

Summary for Pond 14P: Chamber System

Inflow Area = 2.604 ac, 54.48% Impervious, Inflow Depth = 5.50" for 100-yr event
 Inflow = 15.14 cfs @ 12.09 hrs, Volume= 1.193 af
 Outflow = 1.21 cfs @ 11.37 hrs, Volume= 1.193 af, Atten= 92%, Lag= 0.0 min
 Discarded = 1.21 cfs @ 11.37 hrs, Volume= 1.193 af
 Primary = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af
 Routed to Reach 7R : offsite south

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Peak Elev= 213.98' @ 13.30 hrs Surf.Area= 0.145 ac Storage= 0.442 af

Plug-Flow detention time= 125.8 min calculated for 1.193 af (100% of inflow)
 Center-of-Mass det. time= 125.8 min (909.2 - 783.5)

Volume	Invert	Avail.Storage	Storage Description
#1A	209.00'	0.146 af	19.60'W x 322.00'L x 5.50'H Field A 0.797 af Overall - 0.433 af Embedded = 0.364 af x 40.0% Voids
#2A	209.50'	0.326 af	Galley 4x4x4 x 320 Inside #1 Inside= 42.0"W x 43.0"H => 12.67 sf x 3.50'L = 44.3 cf Outside= 52.8"W x 48.0"H => 14.72 sf x 4.00'L = 58.9 cf 320 Chambers in 4 Rows
		0.472 af	Total Available Storage

Storage Group A created with Chamber Wizard

Device	Routing	Invert	Outlet Devices
#1	Discarded	209.00'	8.270 in/hr Exfiltration over Surface area
#2	Primary	214.00'	15.0" Round Culvert L= 157.0' CPP, square edge headwall, Ke= 0.500 Inlet / Outlet Invert= 214.00' / 206.60' S= 0.0471 '/' Cc= 0.900 n= 0.012 Corrugated PP, smooth interior, Flow Area= 1.23 sf

Discarded OutFlow Max=1.21 cfs @ 11.37 hrs HW=209.06' (Free Discharge)
 ↑1=Exfiltration (Exfiltration Controls 1.21 cfs)

Primary OutFlow Max=0.00 cfs @ 0.00 hrs HW=209.00' (Free Discharge)
 ↑2=Culvert (Controls 0.00 cfs)

proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 126

Pond 14P: Chamber System - Chamber Wizard Field A

Chamber Model = Galley 4x4x4 (Concrete Galley, UCPI 4x4x4 Galley or equivalent)

Inside= 42.0"W x 43.0"H => 12.67 sf x 3.50'L = 44.3 cf

Outside= 52.8"W x 48.0"H => 14.72 sf x 4.00'L = 58.9 cf

80 Chambers/Row x 4.00' Long = 320.00' Row Length +12.0" End Stone x 2 = 322.00' Base Length

4 Rows x 52.8" Wide + 12.0" Side Stone x 2 = 19.60' Base Width

6.0" Stone Base + 48.0" Chamber Height + 12.0" Stone Cover = 5.50' Field Height

320 Chambers x 44.3 cf = 14,190.3 cf Chamber Storage

320 Chambers x 58.9 cf = 18,840.4 cf Displacement

34,711.6 cf Field - 18,840.4 cf Chambers = 15,871.2 cf Stone x 40.0% Voids = 6,348.5 cf Stone Storage

Chamber Storage + Stone Storage = 20,538.8 cf = 0.472 af

Overall Storage Efficiency = 59.2%

Overall System Size = 322.00' x 19.60' x 5.50'

320 Chambers

1,285.6 cy Field

587.8 cy Stone



proposed 12-8-23

Prepared by Chessia Consulting Services LLC

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC


Type III 24-hr 100-yr Rainfall=9.06"

Printed 12/13/2023

Page 127

Pond 14P: Chamber System

Hydrograph

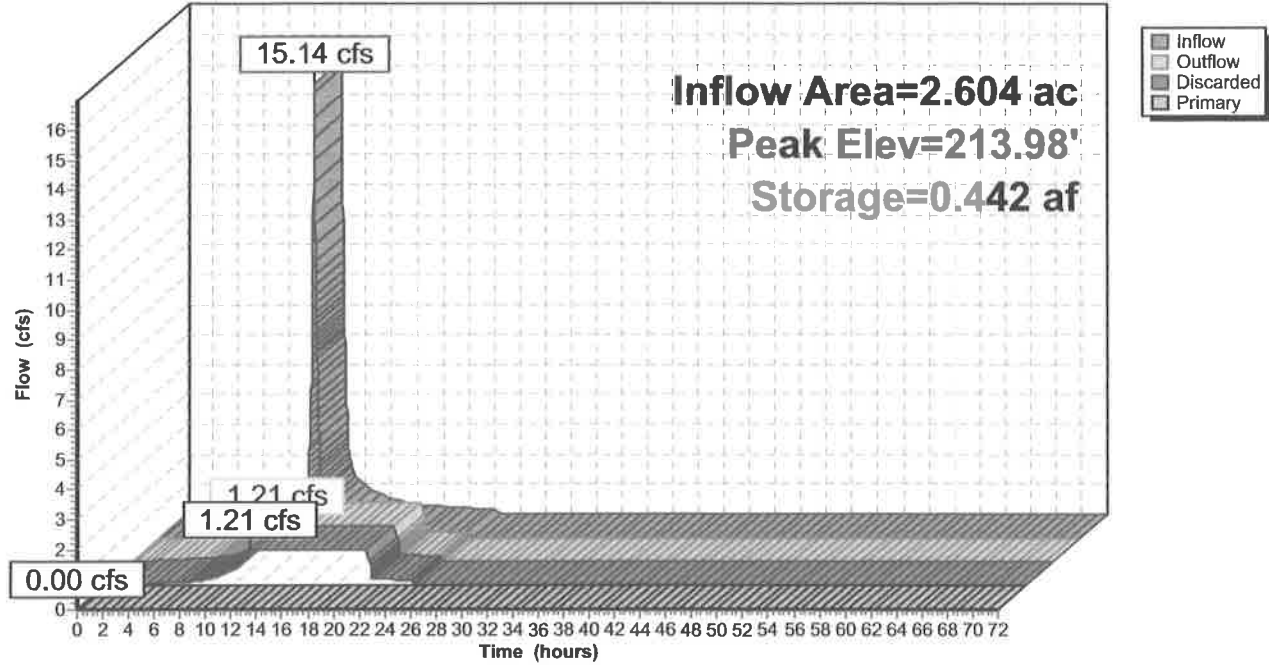

proposed 12-8-23

Type III 24-hr 100-yr Rainfall=9.06"

Prepared by Chessia Consulting Services LLC

Printed 12/13/2023

HydroCAD® 10.20-3g s/n 04201 © 2023 HydroCAD Software Solutions LLC

Page 128

Summary for Pond 16P: Infiltration Trench

Inflow Area = 0.632 ac, 25.27% Impervious, Inflow Depth = 3.20" for 100-yr event
 Inflow = 1.92 cfs @ 12.09 hrs, Volume= 0.168 af
 Outflow = 0.18 cfs @ 11.64 hrs, Volume= 0.168 af, Atten= 91%, Lag= 0.0 min
 Discarded = 0.18 cfs @ 11.64 hrs, Volume= 0.168 af

Routing by Stor-Ind method, Time Span= 0.00-72.00 hrs, dt= 0.01 hrs
 Peak Elev= 199.92' @ 13.50 hrs Surf.Area= 952 sf Storage= 2,342 cf

Plug-Flow detention time= 102.6 min calculated for 0.168 af (100% of inflow)
 Center-of-Mass det. time= 102.6 min (905.4 - 802.8)

Volume	Invert	Avail.Storage	Storage Description
#1	195.00'	1,593 cf	8.50'W x 112.00'L x 5.00'H Prismatic 4,760 cf Overall - 778 cf Embedded = 3,982 cf x 40.0% Voids
#2	196.25'	778 cf	18.0" Round CMP_Round 18" x 4 Inside #1 L= 110.0'
		2,371 cf	Total Available Storage

Device	Routing	Invert	Outlet Devices
#1	Discarded	195.00'	8.270 in/hr Exfiltration over Horizontal area

Discarded OutFlow Max=0.18 cfs @ 11.64 hrs HW=195.05' (Free Discharge)
 ↑-1=Exfiltration (Exfiltration Controls 0.18 cfs)

Pond 16P: Infiltration Trench

